


SECTION C-C

SLOPE PROTECTION AS SPECIFIED

SEE PLANS FOR SLOPE

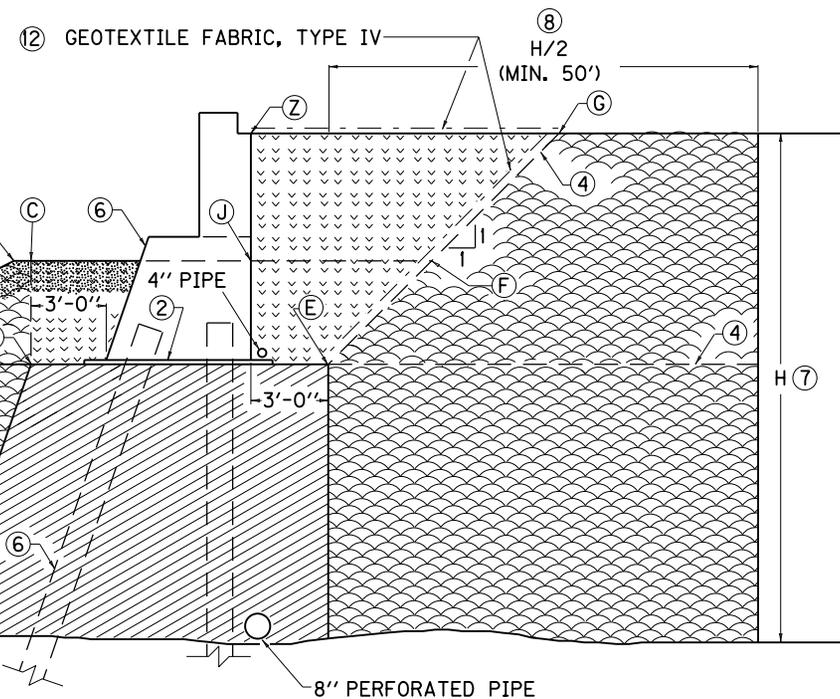

SECTION B-B

8" PERFORATED PIPE

BID ITEMS AND UNIT TO BID
 PERFORATED PIPE-4 IN LF
 PERFORATED PIPE-8 IN LF
 GRANULAR EMBANKMENT CUYD
 COHESIVE PILE CORE CUYD
 GRANULAR PILE CORE CUYD
 STRUCTURE GRANULAR BACKFILL CUYD
 FABRIC-GEOTEXTILE TYPE IV SQYD

LF
 LF
 CUYD
 CUYD
 CUYD
 CUYD
 SQYD

CONSTRUCTION SEQUENCE "A"

1. CONSTRUCT EMBANKMENT TO SLOPES A, B, F, AND G SUCH THAT NO UNCOMPACTED OR LOOSE MATERIAL SHALL REMAIN.
2. EXCAVATE FOR END-BENT TO C, D, E, AND F.
3. INSTALL PILES (OR OTHER FOUNDATION).
4. PLACE 2" MORTAR BED OR ANY CLASS CONCRETE.
5. CONSTRUCT CONCRETE END-BENT.
6. INSTALL 4" PERFORATED UNDERDRAIN PIPE AND BACKFILL.
7. BACKFILL TO C, D, E, F, G, Z, AND J.

① CONSTRUCTION SEQUENCE "B"

1. CONSTRUCT EMBANKMENT TO TEMPORARY SLOPE (4).
2. INSTALL PILES (OR OTHER FOUNDATION).
3. PLACE 2" MORTAR BED OR ANY CLASS CONCRETE.
4. CONSTRUCT CONCRETE END-BENT.
5. INSTALL 4" PERFORATED UNDERDRAIN PIPE AND BACKFILL.
6. BACKFILL TO FINISHED GRADE.

~ NOTES ~

- ① CONSTRUCTION SEQUENCE "B" IS A PERMITTED ALTERNATE ONLY WHEN GRANULAR OR ROCK EMBANKMENT IS REQUIRED.
- ② 2" MORTAR BED OR ANY CLASS CONCRETE.
- ③ 4" PERFORATED UNDERDRAIN PIPE WRAPPED WITH GEOTEXTILE FABRIC FOR DRAINING THE EXCAVATED TRENCH AND STRUCTURE GRANULAR BACKFILL.
- ④ ACCEPTABLE ALTERNATE FOR TEMPORARY SLOPE (CONSTRUCTION SEQUENCE "B").
5. SHADED PORTIONS AND REPRESENT LIMITS OF NON-ERODIBLE GRANULAR EMBANKMENT.
- ⑥ SLOPES ARE EQUAL.
- ⑦ "H" = EMBANKMENT HEIGHT MEASURED FROM SUBGRADE ELEVATION AT POINT Z TO THE LOWEST ELEVATION AT THE TOE OF THE SLOPE.
- ⑧ LIMITS OF EMBANKMENT CONSTRUCTION (H/2 OR 50' MIN.) REQUIRING 2' MAX LIFT THICKNESS.
9. SEE CURRENT SPECIAL PROVISION NO. 69 FOR CONSTRUCTION AND MATERIAL REQUIREMENTS, METHOD OF MEASUREMENT AND BASIS OF PAYMENT.
10. STRUCTURE GRANULAR BACKFILL PLACED AS A COMPLETE SEPARATE OPERATION AFTER CONSTRUCTION OF ALL OTHER EMBANKMENT.
11. *NO INDIVIDUAL FRAGMENTS LARGER THAN 4 INCHES IN ANY DIMENSION PERMITTED WITHIN 3'-0" OF THE STRUCTURE.*
- ⑫ PLACE GEOTEXTILE FABRIC, TYPE IV PRIOR TO PLACING STRUCTURE GRANULAR BACKFILL (WITH SOIL EMBANKMENT ONLY) AND AGGREGATE BASE COURSE (WITH ALL EMBANKMENT MATERIALS).

LEGEND

- SLOPE PROTECTION (SEE BRIDGE PLANS)
- GRANULAR PILE CORE OR COHESIVE PILE CORE
- STRUCTURE GRANULAR BACKFILL
- EMBANKMENT (GRANULAR, ROCK OR SOIL PER PLANS)

USE WITH CUR. STD. DWG. RGX-100

KENTUCKY	
DEPARTMENT OF HIGHWAYS	
TREATMENT OF EMBANKMENTS AT END-BENTS - DETAILS	
STANDARD DRAWING NO. RGX-105-08	
SUBMITTED	DATE 12-01-15
<small>DIRECTOR, DIVISION OF DESIGN</small>	<small>DATE</small>
APPROVED	DATE 12-01-15
<small>STATE HIGHWAY ENGINEER</small>	<small>DATE</small>