



CALL NO. 202

CONTRACT ID. 211307

LEE - OWSLEY COUNTIES

FED/STATE PROJECT NUMBER 121GR21D007 - STP

DESCRIPTION BOONEVILLE-BEATTYVILLE ROAD (KY11)

WORK TYPE GRADE & DRAIN WITH ASPHALT SURFACE

PRIMARY COMPLETION DATE 320 WORKING DAYS

LETTING DATE: February 19,2021

Sealed Bids will be received electronically through the Bid Express bidding service until 10:00 am EASTERN STANDARD TIME February 19,2021. Bids will be publicly announced at 10:00 am EASTERN STANDARD TIME.

PLANS AVAILABLE FOR THIS PROJECT.

DBE CERTIFICATION REQUIRED - 8.50%

REQUIRED BID PROPOSAL GUARANTY: Not less than 5% of the total bid.

TABLE OF CONTENTS

PART I	SCOPE OF WORK
	<ul style="list-style-type: none">• PROJECT(S), COMPLETION DATE(S), & LIQUIDATED DAMAGES• CONTRACT NOTES• FEDERAL CONTRACT NOTES• ASPHALT MIXTURE• INCIDENTAL SURFACING• FUEL AND ASPHALT PAY ADJUSTMENT• ASPHALT PAVEMENT RIDE QUALITY CAT A• COMPACTION OPTION A• MATERIAL TRANSFER VEHICLE (MTV)• SPECIAL NOTE(S) APPLICABLE TO PROJECT• TREE REMOVAL• RIGHT OF WAY CERTIFICATION• UTILITY IMPACT & RAIL CERTIFICATION NOTES• WATERLINE SPECIFICATIONS• KPDES STORM WATER PERMIT, BMP AND ENOI• COMMUNICATING ALL PROMISES• MATERIAL SUMMARY
PART II	SPECIFICATIONS AND STANDARD DRAWINGS
	<ul style="list-style-type: none">• SPECIFICATIONS REFERENCE• SUPPLEMENTAL SPECIFICATION• [SN-1I] PORTABLE CHANGEABLE SIGNS• [SN-11D] ROCK BLASTING• [SN-11E] BORING AND JACKING STEEL PIPE WITHOUT CARRIER PIPE• [SN-11M] BARCODE LABEL ON PERMANENT SIGNS• [SN-11N] LONGITUDINAL PAVEMENT JOINT ADHESIVE
PART III	EMPLOYMENT, WAGE AND RECORD REQUIREMENTS
	<ul style="list-style-type: none">• FEDERAL-AID CONSTRUCTION CONTRACTS - FHWA 1273• NONDISCRIMINATION OF EMPLOYEES• EXECUTIVE BRANCH CODE OF ETHICS• PROJECT WAGE RATES LOCALITY 2 / FEDERAL• NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION TO ENSURE EEO LEE• NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION TO ENSURE EEO OWSLEY
PART IV	INSURANCE
PART V	BID ITEMS

PART I
SCOPE OF WORK

ADMINISTRATIVE DISTRICT - 10

CONTRACT ID - 211307

121GR21D007 - STP

COUNTY - LEE

PCN - DE06500112107

STP 0302 (026)

BOONEVILLE-BEATTYVILLE ROAD (KY11) RELOCATE KY11 FROM OWSLEY-LEE COUNTY LINE EXTENDING NORTH TO KY587, A DISTANCE OF 02.09 MILES.GRADE & DRAIN WITH ASPHALT SURFACE SYP NO. 10-00292.10.

GEOGRAPHIC COORDINATES LATITUDE 37:31:12.00 LONGITUDE 83:44:05.00

COUNTY - OWSLEY

PCN - DE09500112107

STP 0302 (026)

BOONEVILLE-BEATTYVILLE ROAD (KY11) RELOCATE KY11 FROM KY30 AT LEVI EXTENDING NORTH TO THE OWSLEY-LEE COUNTY LINE, A DISTANCE OF 02.46 MILES.GRADE & DRAIN WITH ASPHALT SURFACE SYP NO. 10-00292.10.

GEOGRAPHIC COORDINATES LATITUDE 37:31:12.00 LONGITUDE 83:44:05.00

COMPLETION DATE(S):

320 WORKING

APPLIES TO ENTIRE CONTRACT

CONTRACT NOTES

PROPOSAL ADDENDA

All addenda to this proposal must be applied when calculating bid and certified in the bid packet submitted to the Kentucky Department of Highways. Failure to use the correct and most recent addenda may result in the bid being rejected.

BID SUBMITTAL

Bidder must use the Department's electronic bidding software. The Bidder must download the bid file located on the Bid Express website (www.bidx.com) to prepare a bid packet for submission to the Department. The bidder must submit electronically using Bid Express.

JOINT VENTURE BIDDING

Joint venture bidding is permissible. All companies in the joint venture must be prequalified in one of the work types in the Qualifications for Bidders for the project. The bidders must get a vendor ID for the joint venture from the Division of Construction Procurement and register the joint venture as a bidder on the project. Also, the joint venture must obtain a digital ID from Bid Express to submit a bid. A joint bid bond of 5% may be submitted for both companies or each company may submit a separate bond of 5%.

UNDERGROUND FACILITY DAMAGE PROTECTION

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. When prescribed in said directives, the contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom shall be contacted through their individual Protection Notification Center. Non-compliance with these directives can result in the enforcement of penalties.

REGISTRATION WITH THE SECRETARY OF STATE BY A FOREIGN ENTITY

Pursuant to KRS 176.085(1)(b), an agency, department, office, or political subdivision of the Commonwealth of Kentucky shall not award a state contract to a person that is a foreign entity required by [KRS 14A.9-010](#) to obtain a certificate of authority to transact business in the Commonwealth ("certificate") from the Secretary of State under [KRS 14A.9-030](#) unless the person produces the certificate within fourteen (14) days of the bid or proposal opening. If the foreign entity is not required to obtain a certificate as provided in [KRS 14A.9-010](#), the foreign entity should identify the applicable exception. Foreign entity is defined within [KRS 14A.1-070](#).

For all foreign entities required to obtain a certificate of authority to transact business in the Commonwealth, if a copy of the certificate is not received by the contracting agency within the time frame identified above, the foreign entity's solicitation response shall be deemed non-responsive or the awarded contract shall be cancelled.

Businesses can register with the Secretary of State at <https://secure.kentucky.gov/sos/ftbr/welcome.aspx>.

SPECIAL NOTE FOR PROJECT QUESTIONS DURING ADVERTISEMENT

Questions about projects during the advertisement should be submitted in writing to the Division of Construction Procurement. This may be done by fax (502) 564-7299 or email to kytc.projectquestions@ky.gov. The Department will attempt to answer all submitted questions. The Department reserves the right not to answer if the question is not pertinent or does not aid in clarifying the project intent.

The deadline for posting answers will be 3:00 pm Eastern Daylight Time, the day preceding the Letting. Questions may be submitted until this deadline with the understanding that the later a question is submitted, the less likely an answer will be able to be provided.

The questions and answers will be posted for each Letting under the heading "Questions & Answers" on the Construction Procurement website (www.transportation.ky.gov/contract). The answers provided shall be considered part of this Special Note and, in case of a discrepancy, will govern over all other bidding documents.

HARDWOOD REMOVAL RESTRICTIONS

The US Department of Agriculture has imposed a quarantine in Kentucky and several surrounding states, to prevent the spread of an invasive insect, the emerald ash borer. Hardwood cut in conjunction with the project may not be removed from the state. Chipping or burning on site is the preferred method of disposal.

INSTRUCTIONS FOR EXCESS MATERIAL SITES AND BORROW SITES

Identification of excess material sites and borrow sites shall be the responsibility of the Contractor. The Contractor shall be responsible for compliance with all applicable state and federal laws and may wish to consult with the US Fish and Wildlife Service to seek protection under Section 10 of the Endangered Species Act for these activities.

ACCESS TO RECORDS

The contractor, as defined in KRS 45A.030 (9) agrees that the contracting agency, the Finance and Administration Cabinet, the Auditor of Public Accounts, and the Legislative Research Commission, or their duly authorized representatives, shall have access to any books, documents, papers, records, or other evidence, which are directly pertinent to this contract for the purpose of financial audit or program review. Records and other prequalification information confidentially

disclosed as part of the bid process shall not be deemed as directly pertinent to the contract and shall be exempt from disclosure as provided in KRS 61.878(1)(c). The contractor also recognizes that any books, documents, papers, records, or other evidence, received during a financial audit or program review shall be subject to the Kentucky Open Records Act, KRS 61.870 to 61.884.

In the event of a dispute between the contractor and the contracting agency, Attorney General, or the Auditor of Public Accounts over documents that are eligible for production and review, the Finance and Administration Cabinet shall review the dispute and issue a determination, in accordance with Secretary's Order 11-004.

April 30, 2018

FEDERAL CONTRACT NOTES

The Kentucky Department of Highways, in accordance with the Regulations of the United States Department of Transportation 23 CFR 635.112 (h), hereby notifies all bidders that failure by a bidder to comply with all applicable sections of the current Kentucky Standard Specifications, including, but not limited to the following, may result in a bid not being considered responsive and thus not eligible to be considered for award:

- | | |
|--------------------------------|--|
| 102.02 Current Rating | 102.08 Preparation and Delivery of Proposals |
| 102.13 Irregular Bid Proposals | 102.14 Disqualification of Bidders |
| 102.09 Proposal Guaranty | |

CIVIL RIGHTS ACT OF 1964

The Kentucky Department of Highways, in accordance with the provisions of Title VI of the Civil Rights Act of 1964 (78 Stat. 252) and the Regulations of the Federal Department of Transportation (49 C.F.R., Part 21), issued pursuant to such Act, hereby notifies all bidders that it will affirmatively insure that the contract entered into pursuant to this advertisement will be awarded to the lowest responsible bidder without discrimination on the ground of race, color, or national origin.

NOTICE TO ALL BIDDERS

To report bid rigging activities call: 1-800-424-9071.

The U.S. Department of Transportation (DOT) operates the above toll-free "hotline" Monday through Friday, 8:00 a.m. to 5:00 p.m. eastern time. Anyone with knowledge of possible bid rigging, bidder collusion, or other fraudulent activities should use the "hotline" to report such activities.

The "hotline" is part of the DOT's continuing effort to identify and investigate highway construction contract fraud and abuse and is operated under the direction of the DOT Inspector General. All information will be treated confidentially and caller anonymity will be respected.

SECOND TIER SUBCONTRACTS

Second Tier subcontracts on federally assisted projects shall be permitted. However, in the case of DBE's, second tier subcontracts will only be permitted where the other subcontractor is also a DBE. All second tier subcontracts shall have the consent of both the Contractor and the Engineer.

DISADVANTAGED BUSINESS ENTERPRISE PROGRAM

It is the policy of the Kentucky Transportation Cabinet (“the Cabinet”) that Disadvantaged Business Enterprises (“DBE”) shall have the opportunity to participate in the performance of highway construction projects financed in whole or in part by Federal Funds in order to create a level playing field for all businesses who wish to contract with the Cabinet. To that end, the Cabinet will comply with the regulations found in 49 CFR Part 26, and the definitions and requirements contained therein shall be adopted as if set out verbatim herein.

The Cabinet, contractors, subcontractors, and sub-recipients shall not discriminate on the basis of race, color, national origin, or sex in the performance of work performed pursuant to Cabinet contracts. The contractor shall carry out applicable requirements of 49 CFR 26 in the award and administration of federally assisted highway construction projects. The contractor will include this provision in all its subcontracts and supply agreements pertaining to contracts with the Cabinet.

Failure by the contractor to carry out these requirements is a material breach of its contract with the Cabinet, which may result in the termination of the contract or such other remedy as the Cabinet deems necessary.

DBE GOAL

The Disadvantaged Business Enterprise (DBE) goal established for this contract, as listed on the front page of the proposal, is the percentage of the total value of the contract.

The contractor shall exercise all necessary and reasonable steps to ensure that Disadvantaged Business Enterprises participate in a least the percent of the contract as set forth above as goals for this contract.

OBLIGATION OF CONTRACTORS

Each contractor prequalified to perform work on Cabinet projects shall designate and make known to the Cabinet a liaison officer who is assigned the responsibility of effectively administering and promoting an active program for utilization of DBEs.

If a formal goal has not been designated for the contract, all contractors are encouraged to consider DBEs for subcontract work as well as for the supply of material and services needed to perform this work.

Contractors are encouraged to use the services of banks owned and controlled by minorities and women.

CERTIFICATION OF CONTRACT GOAL

Contractors shall include the following certification in bids for projects for which a DBE goal has been established. BIDS SUBMITTED WHICH DO NOT INCLUDE CERTIFICATION OF DBE PARTICIPATION WILL NOT BE ACCEPTED. These bids will not be considered for award by the Cabinet and they will be returned to the bidder.

“The bidder certifies that it has secured participation by Disadvantaged Business Enterprises (“DBE”) in the amount of _____ percent of the total value of this contract and that the DBE participation is in compliance with the requirements of 49 CFR 26 and the policies of the Kentucky Transportation Cabinet pertaining to the DBE Program.”

The certification statement is located in the electronic bid file. All contractors must certify their DBE participation on that page. DBEs utilized in achieving the DBE goal must be certified and prequalified for the work items at the time the bid is submitted.

DBE PARTICIPATION PLAN

Lowest responsive bidders must submit the *DBE Plan/ Subcontractor Request*, form TC 14-35 DBE, within **5** days of the letting. This is necessary before the Awards Committee will review and make a recommendation. **The project will not be considered for award prior to submission and approval of the apparent low bidder’s DBE Plan/Subcontractor Request.**

The DBE Participation Plan shall include the following:

1. Name and address of DBE Subcontractor(s) and/or supplier(s) intended to be used in the proposed project;
2. Description of the work each is to perform including the work item, unit, quantity, unit price and total amount of the work to be performed by the individual DBE. The Proposal Line Number, Category Number, and the Project Line Number can be found in the “material listing” on the Construction Procurement website under the specific letting;
3. The dollar value of each proposed DBE subcontract and the percentage of total project contract value this represents. DBE participation may be counted as follows:
 - a. If DBE suppliers and manufactures assume actual and contractual responsibility, the dollar value of materials to be furnished will be counted toward the goal as follows:
 - The entire expenditure paid to a DBE manufacturer;
 - 60 percent of expenditures to DBE suppliers that are not manufacturers provided the supplier is a regular dealer in the product involved. A regular dealer must be engaged in, as its principal business and in its own name, the sale of products to the public, maintain an inventory and own and operate distribution equipment; and
 - The amount of fees or commissions charged by the DBE firms for a bona fide service, such as professional, technical, consultant, or managerial services and assistance in the procurement of essential personnel, facilities, equipment, materials, supplies, delivery of materials and supplies or for furnishing bonds, or insurance, providing such fees or commissions are determined to be reasonable and customary.

- b) The dollar value of services provided by DBEs such as quality control testing, equipment repair and maintenance, engineering, staking, etc.;
 - c) The dollar value of joint ventures. DBE credit for joint ventures will be limited to the dollar amount of the work actually performed by the DBE in the joint venture;
4. Written and signed documentation of the bidder's commitment to use a DBE contractor whose participation is being utilized to meet the DBE goal; and
 5. Written and signed confirmation from the DBE that it is participating in the contract as provided in the prime contractor's commitment.

UPON AWARD AND BEFORE A WORK ORDER WILL BE ISSUED

Contractors must submit the signed subcontract between the contractor and the DBE contractor, along with the DBE's certificate of insurance. If the DBE is a supplier of materials for the project, a signed purchase order must be submitted to the Division of Construction Procurement.

Changes to DBE Participation Plans must be approved by the Cabinet. The Cabinet may consider extenuating circumstances including, but not limited to, changes in the nature or scope of the project, the inability or unwillingness of a DBE to perform the work in accordance with the bid, and/or other circumstances beyond the control of the prime contractor.

CONSIDERATION OF GOOD FAITH EFFORTS REQUESTS

If the DBE participation submitted in the bid by the apparent lowest responsive bidder does not meet or exceed the DBE contract goal, the apparent lowest responsive bidder must submit a Good Faith Effort Package to satisfy the Cabinet that sufficient good faith efforts were made to meet the contract goals prior to submission of the bid. Efforts to increase the goal after bid submission will not be considered in justifying the good faith effort, unless the contractor can show that the proposed DBE was solicited prior to the letting date. DBEs utilized in achieving the DBE goal must be certified and prequalified for the work items at the time the bid is submitted. One complete set (hard copy along with an electronic copy) of this information must be received in the Division of Contract Procurement no later than 12:00 noon of the tenth calendar day after receipt of notification that they are the apparent low bidder.

Where the information submitted includes repetitious solicitation letters it will be acceptable to submit a sample representative letter along with a distribution list of the firms solicited. Documentation of DBE quotations shall be a part of the good faith effort submittal as necessary to demonstrate compliance with the factors listed below which the Cabinet considers in judging good faith efforts. This documentation may include written subcontractors' quotations, telephone log notations of verbal quotations, or other types of quotation documentation.

The Good Faith Effort Package shall include, but may not be limited to information showing evidence of the following:

1. Whether the bidder attended any pre-bid meetings that were scheduled by the Cabinet to inform DBEs of subcontracting opportunities;
2. Whether the bidder provided solicitations through all reasonable and available means;
3. Whether the bidder provided written notice to all DBEs listed in the DBE directory at the time of the letting who are prequalified in the areas of work that the bidder will be subcontracting;
4. Whether the bidder followed up initial solicitations of interest by contacting DBEs to determine with certainty whether they were interested. If a reasonable amount of DBEs within the targeted districts do not provide an intent to quote or no DBEs are prequalified in the subcontracted areas, the bidder must notify the Disadvantaged Enterprise Business Liaison Officer (DEBLO) in the Office of Civil Rights and Small Business Development to give notification of the bidder's inability to get DBE quotes;
5. Whether the bidder selected portions of the work to be performed by DBEs in order to increase the likelihood of meeting the contract goals. This includes, where appropriate, breaking out contract work items into economically feasible units to facilitate DBE participation, even when the prime contractor might otherwise perform these work items with its own forces;
6. Whether the bidder provided interested DBEs with adequate and timely information about the plans, specifications, and requirements of the contract;
7. Whether the bidder negotiated in good faith with interested DBEs not rejecting them as unqualified without sound reasons based on a thorough investigation of their capabilities. Any rejection should be so noted in writing with a description as to why an agreement could not be reached;
8. Whether quotations were received from interested DBE firms but were rejected as unacceptable without sound reasons why the quotations were considered unacceptable. The fact that the DBE firm's quotation for the work is not the lowest quotation received will not in itself be considered as a sound reason for rejecting the quotation as unacceptable. The fact that the bidder has the ability and/or desire to perform the contract work with its own forces will not be considered a sound reason for rejecting a DBE quote. Nothing in this provision shall be construed to require the bidder to accept unreasonable quotes in order to satisfy DBE goals;
9. Whether the bidder specifically negotiated with subcontractors to assume part of the responsibility to meet the contract DBE goal when the work to be subcontracted includes potential DBE participation;
10. Whether the bidder made any efforts and/or offered assistance to interested DBEs in obtaining the necessary equipment, supplies, materials, insurance and/or bonding to satisfy the work requirements of the bid proposal; and
11. Any other evidence that the bidder submits which may show that the bidder has made reasonable good faith efforts to include DBE participation.

FAILURE TO MEET GOOD FAITH REQUIREMENT

Where the apparent lowest responsive bidder fails to submit sufficient participation by DBE firms to meet the contract goal and upon a determination by the Good Faith Committee based upon the information submitted that the apparent lowest responsive bidder failed to make sufficient reasonable efforts to meet the contract goal, the bidder will be offered the opportunity to meet in person for administrative reconsideration. The bidder will be notified of the Committee's decision within 24 hours of its decision. The bidder will have 24 hours to request reconsideration of the Committee's decision. The reconsideration meeting will be held within two days of the receipt of a request by the bidder for reconsideration.

The request for reconsideration will be heard by the Office of the Secretary. The bidder will have the opportunity to present written documentation or argument concerning the issue of whether it met the goal or made an adequate good faith effort. The bidder will receive a written decision on the reconsideration explaining the basis for the finding that the bidder did or did not meet the goal or made adequate Good Faith efforts to do so.

The result of the reconsideration process is not administratively appealable to the Cabinet or to the United States Department of Transportation.

The Cabinet reserves the right to award the contract to the next lowest responsive bidder or to rebid the contract in the event that the contract is not awarded to the low bidder as the result of a failure to meet the good faith requirement.

SANCTIONS FOR FAILURE TO MEET DBE REQUIREMENTS OF THE PROJECT

Failure by the prime contractor to fulfill the DBE requirements of a project under contract or to demonstrate good faith efforts to meet the goal constitutes a breach of contract. When this occurs, the Cabinet will hold the prime contractor accountable, as would be the case with all other contract provisions. Therefore, the contractor's failure to carry out the DBE contract requirements shall constitute a breach of contract and as such the Cabinet reserves the right to exercise all administrative remedies at its disposal including, but not limited to the following:

- Disallow credit toward the DBE goal;
- Withholding progress payments;
- Withholding payment to the prime in an amount equal to the unmet portion of the contract goal; and/or
- Termination of the contract.

PROMPT PAYMENT

The prime contractor will be required to pay the DBE within seven (7) working days after he or she has received payment from the Kentucky Transportation Cabinet for work performed or materials furnished.

CONTRACTOR REPORTING

All contractors must keep detailed records and provide reports to the Cabinet on their progress in meeting the DBE requirement on any highway contract. These records may include, but shall not be limited to payroll, lease agreements, cancelled payroll checks, executed subcontracting agreements, etc. Prime contractors will be required to complete and submit a **signed and notarized** Affidavit of Subcontractor Payment (TC 18-7) and copies of checks for any monies paid to each DBE subcontractor or supplier utilized to meet a DBE goal. These documents must be completed and signed within 7 days of being paid by the Cabinet.

Payment information that needs to be reported includes date the payment is sent to the DBE, check number, Contract ID, amount of payment and the check date. Before Final Payment is made on this contract, the Prime Contractor will certify that all payments were made to the DBE subcontractor and/or DBE suppliers.

******* IMPORTANT *******

Please mail the original, signed and completed TC (18-7) Affidavit of Subcontractor Payment form and all copies of checks for payments listed above to the following address:

Office of Civil Rights and Small Business Development
6th Floor West 200 Mero Street
Frankfort, KY 40622

The prime contractor should notify the KYTC Office of Civil Rights and Small Business Development seven (7) days prior to DBE contractors commencing work on the project. The contact in this office is Mr. Melvin Bynes. Mr. Bynes' current contact information is email address – melvin.bynes2@ky.gov and the telephone number is (502) 564-3601.

DEFAULT OR DECERTIFICATION OF THE DBE

If the DBE subcontractor or supplier is decertified or defaults in the performance of its work, and the overall goal cannot be credited for the uncompleted work, the prime contractor may utilize a substitute DBE or elect to fulfill the DBE goal with another DBE on a different work item. If after exerting good faith effort in accordance with the Cabinet's Good Faith Effort policies and procedures, the prime contractor is unable to replace the DBE, then the unmet portion of the goal may be waived at the discretion of the Cabinet.

PROHIBITION ON TELECOMMUNICATIONS EQUIPMENT OR SERVICES

In accordance with the FY 2019 National Defense Authorization Act (NDAA), 2 CFR 200.216, and 2 CFR 200.471, Federal agencies are prohibited, after August 13, 2020, from obligating or expending financial assistance to obtain certain telecommunications and video surveillance services and equipment from specific producers. As a result of these regulations, contractors and subcontractors are prohibited, on projects with federal funding participation, from providing telecommunication or video surveillance equipment, services, or systems produced by:

- Huawei Technologies Company or ZTE Corporation (or any subsidiary or affiliate of such entities)
- Hytera Communications Corporation, Hangzhou Hikvision Digital Technology Company, or Dahua Technology Company (or any subsidiary or affiliate of such entities)

LEGAL REQUIREMENTS AND RESPONSIBILITY TO THE PUBLIC – CARGO PREFERENCE ACT (CPA).

(REV 12-17-15) (1-16)

SECTION 7 is expanded by the following new Article:

102.10 **Cargo Preference Act – Use of United States-flag vessels.**

Pursuant to Title 46CFR Part 381, the Contractor agrees

- To utilize privately owned United States-flag commercial vessels to ship at least 50 percent of the gross tonnage (computed separately for dry bulk carriers, dry cargo liners, and tankers) involved, whenever shipping any equipment, material, or commodities pursuant to this contract, to the extent such vessels are available at fair and reasonable rates for United States-flag commercial vessels.

- To furnish within 20 days following the date of loading for shipments originating within the United States or within 30 working days following the date of loading for shipments originating outside the United States, a legible copy of a rated, 'on-board' commercial ocean bill-of-lading in English for each shipment of cargo described in paragraph 1 of this section to both the Contracting Officer (through the prime contractor in the case of subcontractor bills-of-lading) and to the Division of National Cargo, Office of Market Development, Maritime Administration, Washington, DC 20590.

- To insert the substance of the provisions of this clause in all subcontracts issued pursuant to this contract.

ASPHALT MIXTURE

Unless otherwise noted, the Department estimates the rate of application for all asphalt mixtures to be 110 lbs/sy per inch of depth.

INCIDENTAL SURFACING

The Department has included in the quantities of asphalt mixtures established in the proposal estimated quantities required for resurfacing or surfacing mailbox turnouts, farm field entrances, residential and commercial entrances, curve widening, ramp gores and tapers, and road and street approaches, as applicable. Pave these areas to the limits as shown on Standard Drawing RPM-110-06 or as directed by the Engineer. In the event signal detectors are present in the intersecting streets or roads, pave the crossroads to the right of way limit or back of the signal detector, whichever is the farthest back of the mainline. Surface or resurface these areas as directed by the Engineer. The Department will not measure placing and compacting for separate payment but shall be incidental to the Contract unit price for the asphalt mixtures.

FUEL AND ASPHALT PAY ADJUSTMENT

The Department has included the Contract items Asphalt Adjustment and Fuel Adjustment for possible future payments at an established Contract unit price of \$1.00. The Department will calculate actual adjustment quantities after work is completed. If existing Contract amount is insufficient to pay all items on the contract with the adjustments, the Department will establish additional monies with a change order.

ASPHALT PAVEMENT RIDE QUALITY CATEGORY A

The Department will apply Pavement Rideability Requirements on this project in accordance with Section 410, Category A.

OPTION A

Be advised that the Department will accept compaction of asphalt mixtures furnished for driving lanes and ramps, at 1 inch (25mm) or greater, on this project according to OPTION A in accordance with Section 402 and Section 403 of the current Standard Specifications. The Department will require joint cores as described in Section 402.03.02 for surface mixtures only. The Department will accept compaction of all other asphalt mixtures according to OPTION B.

MATERIAL TRANSFER VEHICLE (MTV)

Provide and use a MTV in accordance with Sections 403.02.10 and 403.03.05.

SPECIAL NOTE FOR EXCESS MATERIAL SITES

OWSLEY/LEE COUNTY RECONSTRUCT KY 11 ITEM 10-292.10

The construction activities of this project may result in a considerable amount of excess material. It is the contractor's responsibility to dispose of any material in compliance with the United States Army Corps of Engineers (USACE) and Kentucky Division of Water (DOW) rules and regulations pertaining to discharges into Waters of the U.S. The contractor is also responsible to ensure material disposal actions are also in compliance with the US Fish and Wildlife Service (USFWS) rules and regulations pertaining to the Endangered Species Act, Section 106 of the National Historic Preservation Act, Floodplains, as well as any other pertinent regulations.

The Kentucky Transportation Cabinet (KYTC) has acquired Section 404 (USACE) & 401 (DOW) permits for two (2) excess material sites (1 and 2) that the contractor may use for this KYTC project. It is the contractor's responsibility to review the Clean Water Act 404 & 401 permits and maintain compliance with the 401 & 404 permits throughout the duration of the project.

Mitigation requirements resulting from the use of these identified excess material sites will be in the form of in-lieu fees and will be paid by the KYTC prior to stream/wetland impacts occurring in the excess material sites.

The KYTC has purchased temporary easements for Excess Material Sites 1 & 2.

The only access rights that KYTC has secured is within the temporary easement boundaries. See Roadway Plan Sheets R51 and R52 for easement boundaries and conceptual grading plan. The contractor must secure any haul roads or accesses through other properties by agreements with property owners or other governmental agencies (i.e. County roads, private roads, etc.).

The Kentucky Transportation Cabinet (KYTC) has not identified any other excess material sites, acquired property/easements or Section 404 (USACE) & 401 (DOW) permits for any other excess material sites on this project.

If the contractor chooses to use other excess material site(s) (rather than or in addition to) the KYTC's identified excess material sites, or modify the identified excess material sites, it will be the responsibility of the contractor to:

- Identify excess material sites
 - A list of potential sites shall presented at the Pre-Construction Meeting
 - Sites that minimize environmental impacts will be preferred
 - Sites that impact Outstanding State Resource Waters (<http://eppcapp.ky.gov/spwaters/>, <https://apps.legislature.ky.gov/Law/KAR/401/010/026.pdf>) will not be permitted

- Secure property rights and access to the excess material site(s)
- Obtain environmental clearances through a KYTC pre-qualified firm for Section 7, Section 106, and Wetlands. Any cost associated with these studies will be the responsibility of the contractor.
- Coordinate with the KYTC Central Office Division of Environmental Analysis (DEA) (Contact: David Harmon 502.782.5016) and provide all the information necessary to modify the existing permits (Section 404, Section 401, and Section 7 including a Biological Opinion from U.S. Fish & Wildlife Service) for this project.

No additional contract time will be allowed for this process

The contractor will be allowed only two (2) permit modifications of the existing 404 permit.

The contractor will be responsible for any environmental fees that are additional to what KYTC has already agreed to pay that are associated with additional or modified sites including but not limited to: USFWS fees for tree cutting, in-lieu fees for stream mitigation, etc. The method of payment will be discussed during coordination with KYTC DEA.

The contractor is responsible for obtaining, maintaining, and repairing accesses to ALL sites through public or private property.

All work associated with KYTC identified excess material sites or additional contractor identified excess material sites will be incidental to the excavation cost including but not limited to the following items: Environmental Studies and Fees, Access Road Acquisition/Maintenance/Repair, Erosion Control Devices, Clearing and Grubbing, Seeding and Protection, Utility Relocation, Temporary and Permanent Drainage Ditches, and Structures (including pipes, culverts, etc.)


Questions concerning any potential impacts to "Waters of the United States" should be brought to the attention of the appropriate District Office for the Corps of Engineers for determination, prior to disturbance. Any fees associated with obtaining new or modified permit approvals for the disposal of excess material from the USFWS, USACE or other appropriate regulatory agencies are the responsibility of the contractor.

All new or modified permit approvals (401/404, Section 7, Section 106, etc.) must be completed prior to disturbance of excess material site(s).

Any communications made by the contractor with regulatory agencies must copy:
KYTC DEA (dave.harmon@ky.gov)

< OR >

Attn: Dave Harmon
KYTC Division Environmental Analysis
200 Mero Street, Frankfort KY 40622).

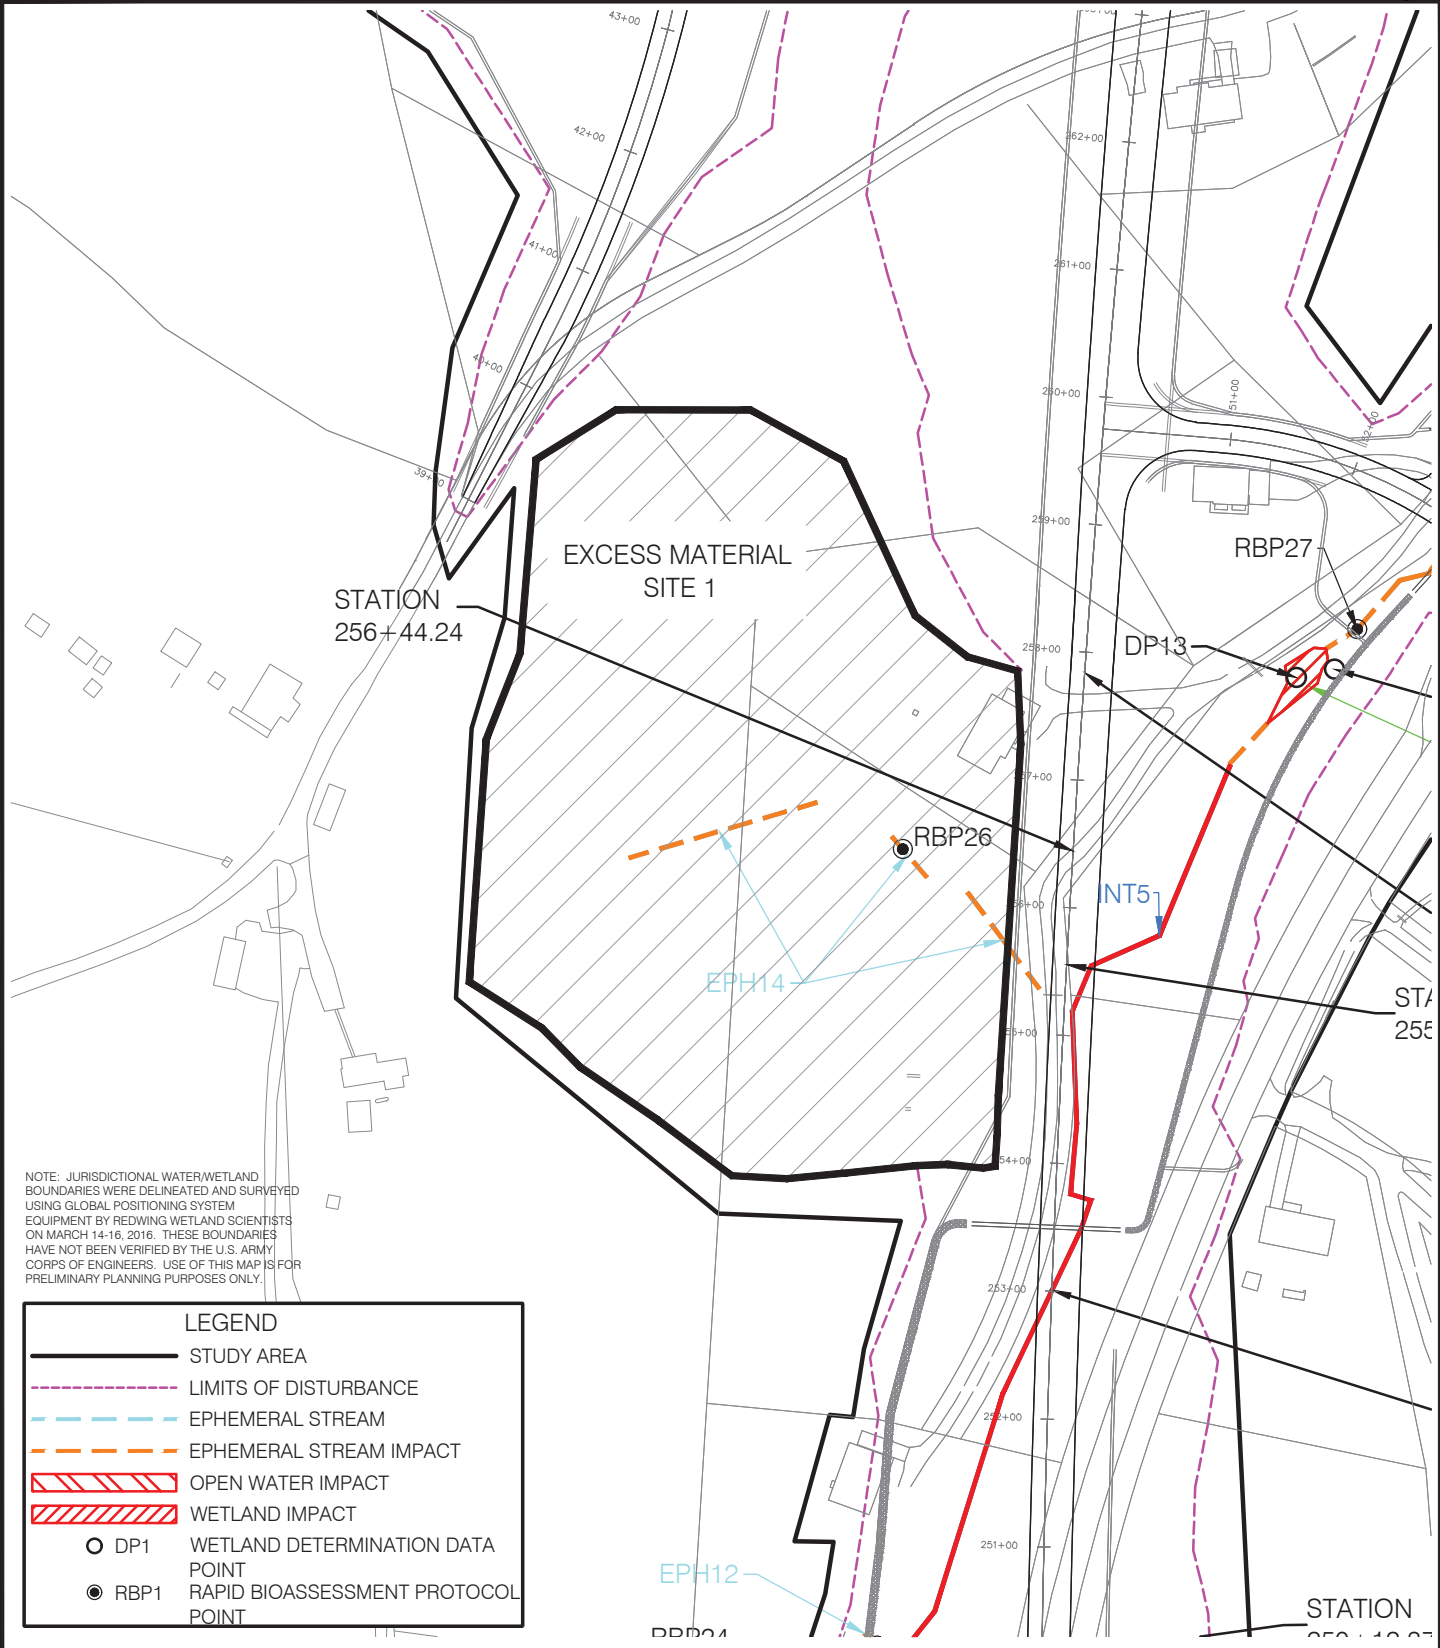

NOTE: JURISDICTIONAL WATER/WETLAND BOUNDARIES WERE DELINEATED AND SURVEYED USING GLOBAL POSITIONING SYSTEM EQUIPMENT BY REDWING WETLAND SCIENTISTS ON MARCH 14-16, 2016. THESE BOUNDARIES HAVE NOT BEEN VERIFIED BY THE U.S. ARMY CORPS OF ENGINEERS. USE OF THIS MAP IS FOR PRELIMINARY PLANNING PURPOSES ONLY.

LEGEND	
	STUDY AREA
	LIMITS OF DISTURBANCE
	EPHEMERAL STREAM
	EPHEMERAL STREAM IMPACT
	OPEN WATER IMPACT
	WETLAND IMPACT
	DP1 WETLAND DETERMINATION DATA POINT
	RBP1 RAPID BIOASSESSMENT PROTOCOL POINT



SOURCE: BASE MAP PROVIDED BY KYTC AND GRW

KENTUCKY HIGHWAY 11
RELOCATION
OWSLEY AND LEE
COUNTIES, KENTUCKY
KYTC ITEM NO. 10-292.10




DETAIL STATION
EXCESS MATERIAL SITE 1

FIGURE 4
SHEET 17 OF 18

REVISED DATE: 05-03-16 DRAWN BY: BJD

P:\2015 Projects\15-200-KY 11\Figures\RW-Details_PROJECT 17, Eric Bowman, 12/29/2016 11:08 AM

NOTE: JURISDICTIONAL WATER/WETLAND BOUNDARIES WERE DELINEATED AND SURVEYED USING GLOBAL POSITIONING SYSTEM EQUIPMENT BY REDWING WETLAND SCIENTISTS ON MARCH 14-16, 2016. THESE BOUNDARIES HAVE NOT BEEN VERIFIED BY THE U.S. ARMY CORPS OF ENGINEERS. USE OF THIS MAP IS FOR PRELIMINARY PLANNING PURPOSES ONLY.

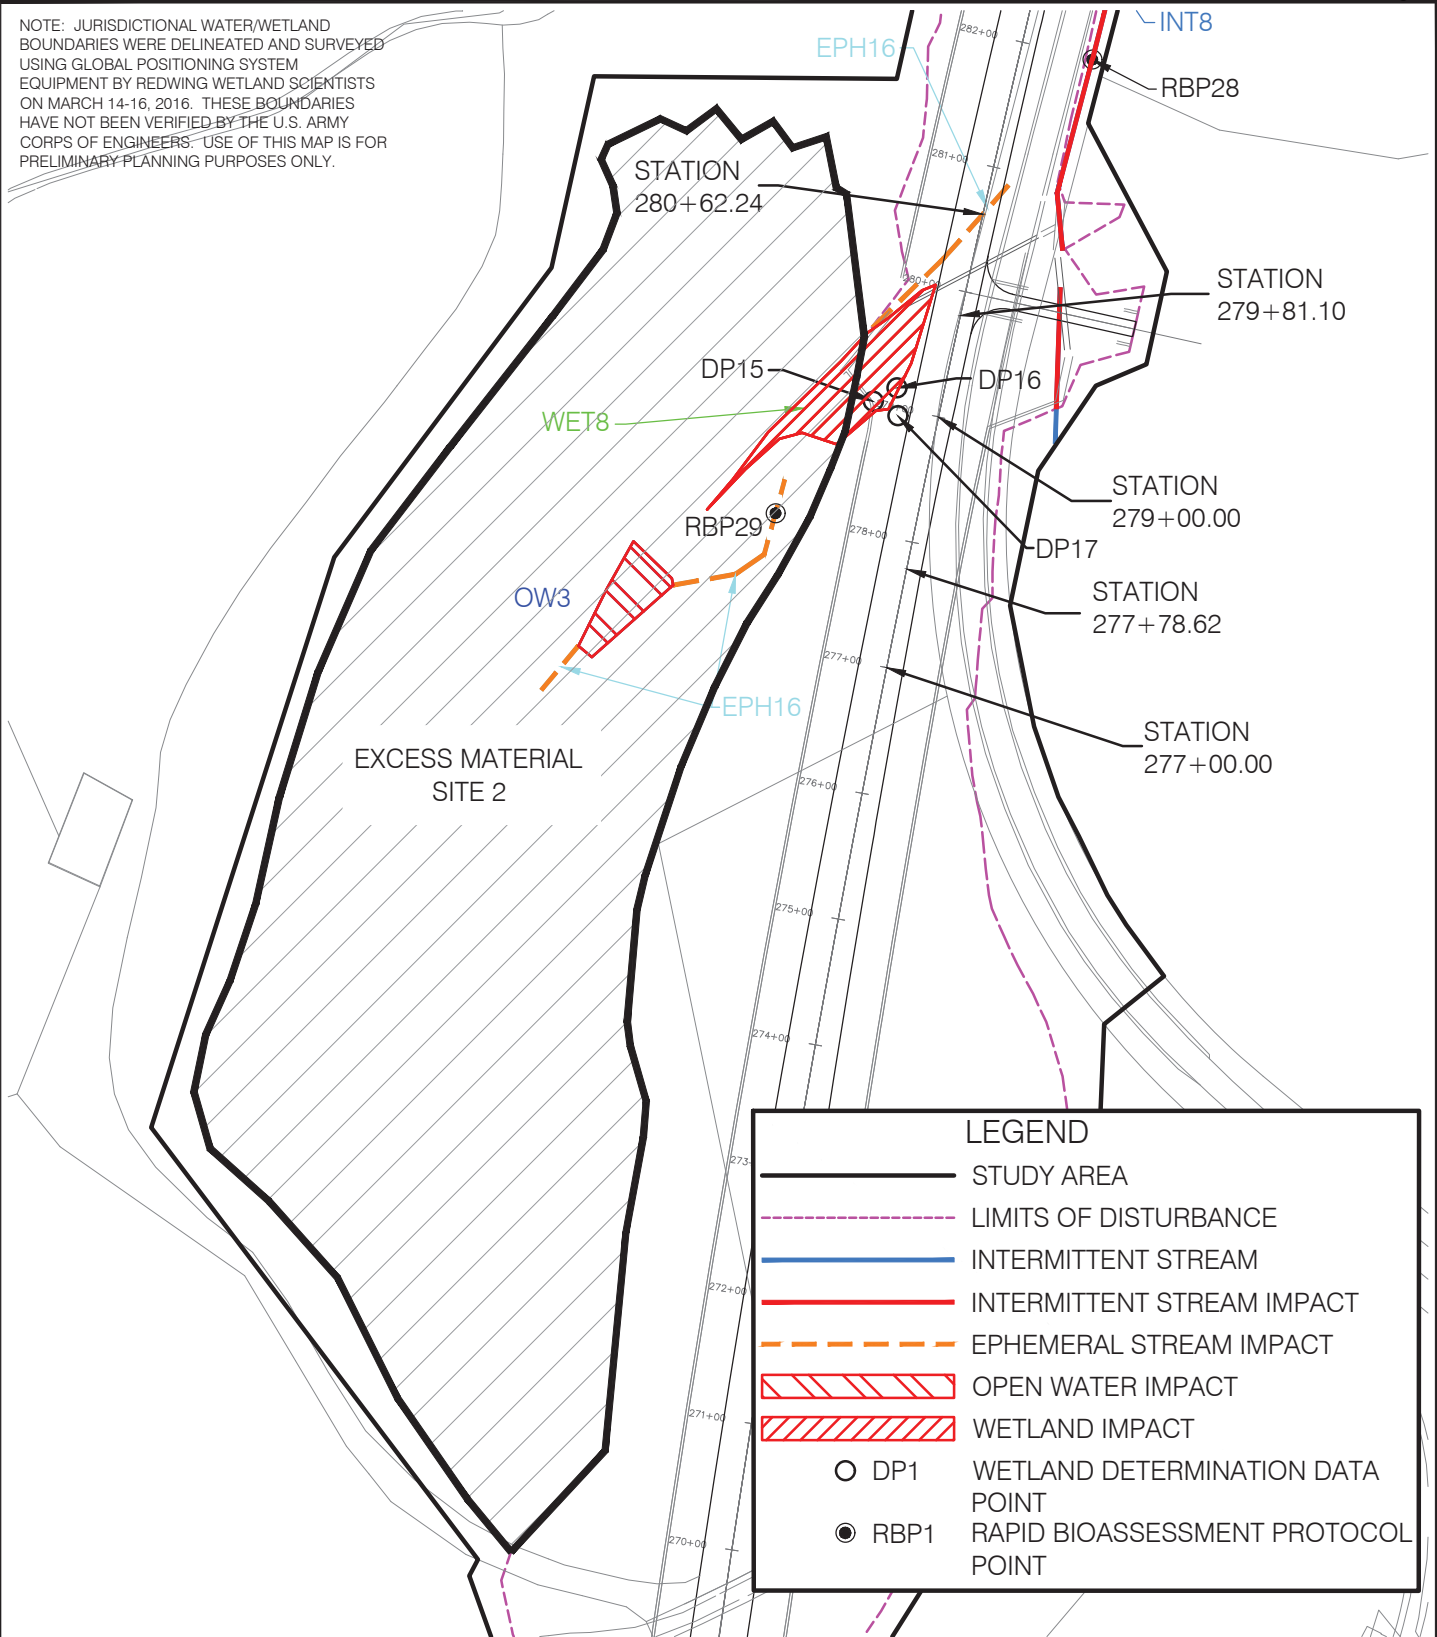

LEGEND	
	STUDY AREA
	LIMITS OF DISTURBANCE
	INTERMITTENT STREAM
	INTERMITTENT STREAM IMPACT
	EPHEMERAL STREAM IMPACT
	OPEN WATER IMPACT
	WETLAND IMPACT
	DP1 WETLAND DETERMINATION DATA POINT
	RBP1 RAPID BIOASSESSMENT PROTOCOL POINT



SOURCE: BASE MAP PROVIDED BY KYTC AND GRW

KENTUCKY HIGHWAY 11
RELOCATION
OWSLEY AND LEE
COUNTIES, KENTUCKY
KYTC ITEM NO. 10-292.10



DETAIL STATION
EXCESS MATERIAL SITE 2

FIGURE 4
SHEET 18 OF 18

P:\2015 Projects\15-200-KY 11\Figures\RW-Details_PROJECT 18, Eric Bowman, 12/29/2016 11:08 AM

SPECIAL NOTE

General Utility Coordination

The Contractor shall communicate, cooperate, and coordinate with the Department, the utility owners, and potentially affected third parties, as necessary for the utility relocation work. The Contractor shall be responsible for all coordination needed to ensure that the road construction and utility relocation work may concurrently and effectively take place.

This item shall include assignment of a Utility Coordinator for the project to coordinate plans, work and schedules directly with the utility companies and KYTC personnel. The Utility Coordinator shall be a licensed professional engineer with project management experience. This item includes responsibility to ensure the project progresses efficiently and in accordance with the proposed contract documents. The Department may consult the Utility Coordinator on matters of utility work design, construction, cost, and/or schedule. Any changes in the proposed scope, design, construction, cost, and/or schedule for the utility work shall be approved by the Department. This item includes conducting monthly coordination meetings with involved utility companies and as needed on project site visits to manage utility relocation activity, resolve conflicts with the road activity, and minimize impact to the project. The department shall be invited to Utility Coordination meetings.

The Department will consider payment as full compensation for all work required under this note.

Code	Item Description	Unit
24845EC	Utility Coordination	Lump Sum

SPECIAL NOTE FOR INLAID PAVEMENT MARKERS

I. DESCRIPTION

Except as provided herein, perform all work in accordance with the Department's Standard and Supplemental Specifications and applicable Standard and Sepia Drawings, current editions. Article references are to the Standard Specifications. This work shall consist of:

- (1) Maintain and Control Traffic; and (2) furnish and install Inlaid Pavement Markers (IPMs) in recessed grooves; and (3) any other work as specified by these notes and the Contract.

II. MATERIALS

The Department will sample all materials in accordance with the Department's Sampling Manual. Make the materials available for sampling a sufficient time in advance of the use of the materials to allow for the necessary time for testing unless otherwise specified in these Notes.

A. Maintain and Control Traffic. See Traffic Control Plan.

B. Markers. Provide reflective lenses with depth control breakaway positioning tabs. Before furnishing the markers, provide to the Engineer the manufacturer's current recommendations for adhesives and installation procedures. Use one brand and design throughout the project. Use markers meeting the specifications in the table below.

SPECIFICATIONS FOR HOUSING AND REFLECTOR	
Material:	Polycarbonate Plastic
Weight:	Housing 2.00 oz.
	Reflector 2.00oz.
Housing Size:	5.00" x 3.00" x 0.70" high
Specific Intensity of Reflectivity at 0.2° Observation Angle	
White:	3.0 at 0°entrance angle
	1.2 at 20°entrance angle
Yellow:	60% of white values
Red:	25% of white values


C. Adhesives. Use adhesives that conform to the manufacturer's recommendations.

III. CONSTRUCTION

A. Maintain and Control Traffic. See Traffic Control Plan.


B. Installation. Install IPMs in recessed grooves cut into the final course of pavement according to the manufacturer's recommendations. Do not cut the grooves until the pavement has cured sufficiently to prevent damaging the pavement. Cut installation grooves using diamond blades on saws that accurately control groove dimensions. Remove all dirt, grease, oil, loose or unsound layers, and any other material from the marker area which would reduce the bond of the adhesive. Maintain pavement surfaces in a clean condition until placing markers.

Prepare the pavement surfaces, and install the markers in the recessed groove according to the drawing below. Use an approved snowplowable epoxy adhesive. Ensure that the adhesive bed area is equal to the bottom area of the marker, and apply adhesive in sufficient quantity to force excess out around the entire perimeter of the marker. Use materials, equipment, and construction procedures that ensure proper adhesion of the markers to the pavement surface according to the manufacturer's recommendations. Remove all excess adhesive from in front of the reflective faces. If any adhesive or foreign matter cannot be removed from the reflective faces, or if any marker fails to properly adhere to the pavement surface, remove and replace the marker at no additional cost to the Department.

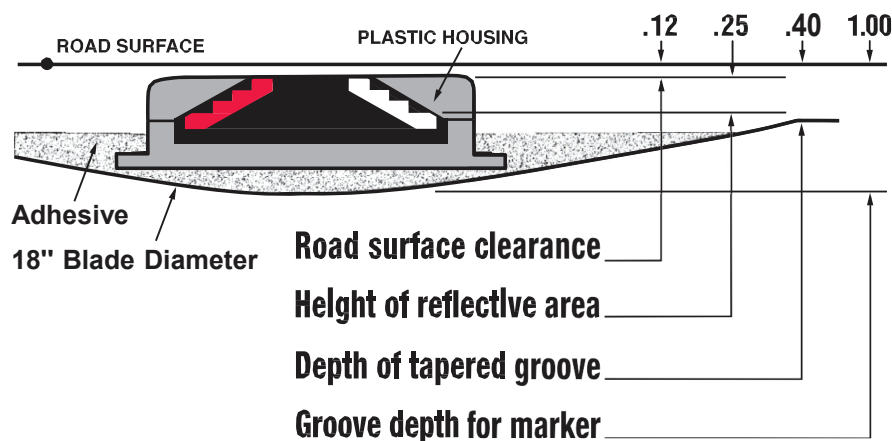

Inlaid Pavement Markers
Page 3 of 4

C. Location and Spacing. Install the markers in the pattern for high reflectivity with two (2) IPMs per groove. Locate and space markers as shown in the current standard drawings or sepias (note: use Inlaid Pavement Markers wherever Type V Pavement Markers are called for). Do not install markers on bridge decks. Do not install a marker on top of a pavement joint or crack. Offset the recessed groove a minimum of 3 inches from any longitudinal pavement joint or crack and at least one inch from the painted stripe, ensuring that the finished line of markers is straight with minimal lateral deviation. Give preference to maintaining the 3-inch offset between recessed groove and joint as opposed to keeping the line of markers straight.

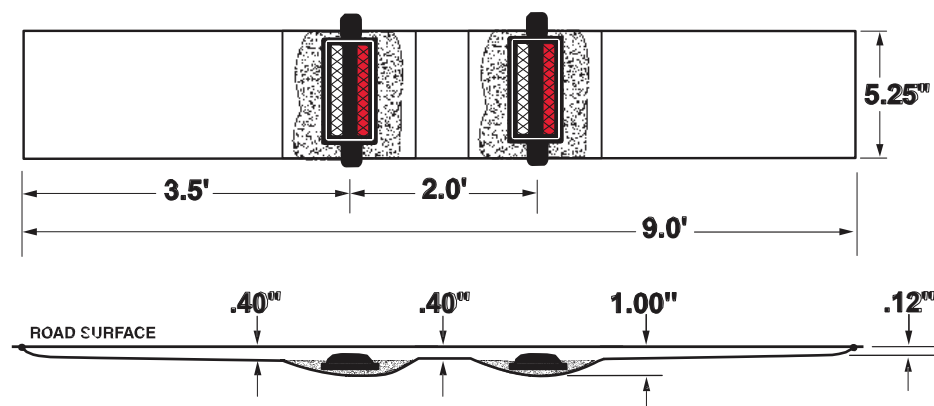

Place inlaid markers as much in line with existing pavement striping as possible. Place markers installed along an edge line or channelizing line so that the near edge of the plastic housing is no more than one inch from the near edge of the line. Place markers installed along a lane line between and in line with the dashes. Do not place markers over the lines except where the lines deviate visibly from their correct alignment, and then only after obtaining the Engineer's prior approval of the location.

If conflicts between recessed groove placement in relation to pavement joint and striping cannot be resolved, obtain the Engineer's approval to eliminate the marker or revise the alignment.

D. Disposal of Waste. Dispose of all removed pavement, debris, and other waste at sites off the right of way obtained by the Contractor at no additional cost to the Department. See Special Note for waste and Borrow.

E. Restoration. Be responsible for all damage to public and/or private property resulting from the work. Restore all damaged features in like kind materials and design at no additional cost to the Department.

Inlaid Pavement Markers

Page 4 of 4

F. On-Site Inspection. Make a thorough inspection of the site prior to submitting a bid and be thoroughly familiar with existing conditions so that the work can be expeditiously performed after a contract is awarded. The Department will consider submission of a bid as evidence of this inspection having been made and will not honor any claims for money or grant Contract time extensions resulting from site conditions.

G. Caution. Do not take information shown on the drawings and in this proposal and the types and quantities of work listed as an accurate or complete evaluation of the material and conditions to be encountered during construction, but consider the types and quantities of work listed as approximate only. The bidder must draw his own conclusion as to the conditions encountered. The Department does not give any guarantee as to the accuracy of the data and no claim will be considered for additional compensation or extension of Contract time if the conditions encountered are not in accordance with the information shown.

IV. MEASUREMENT

A. Maintain and Control Traffic. See Traffic Control Plan.

B. "INLAID PAYMENT MARKER" shall be measured as each. One (1) installation of "INLAID PAVEMENT MARKER" will consist of grooving the pavement, removing cuttings and debris, preheating pavement to remove moisture, adhesives, and installation of two (2) markers with all lenses in accordance with this note.

Note: Each pay item of Inlaid Pavement Marker will require two markers.

V. PAYMENT

A. Maintain and Control Traffic. See Traffic Control Plan.

B. Inlaid Pavement Markers. The Department will make payment for the completed and accepted quantity of completely installed "INLAID PAVEMENT MARKERS" at the Contract unit price, each. Accept payment as full compensation for all labor, equipment, materials, and incidentals to accomplish this work to the satisfaction of the Engineer. A system of one (1) groove and two (2) markers shall be paid as one "INLAID PAVEMENT MARKER". The bid item "INLAID PAVEMENT MARKER" shall be used regardless of the color and type of lenses required.

December 5, 2018

10W

SPECIAL NOTE FOR WATERBLASTING STRIPING REMOVAL

This Special Note will apply where indicated on the plans or in the proposal. Section references herein are to the Department’s Standard Specifications for Road and Bridge Construction, current edition.

1.0 DESCRIPTION. Remove pavement striping, temporary or permanent, from asphalt or concrete pavement using ultra-high pressure water.

2.0 MATERIALS AND EQUIPMENT.

2.1 Truck Mounted Ultra-high Pressure Pump and Water Tank. Use a truck having a separate hydrostatic transmission capable of speed increments of ±1 foot per minute at operator’s discretion. Use a pump capable of delivering a minimum of 30,000 psi to a bumper mounted deck containing an operator controlled rotating manifold that is speed variable up to at least 3,000 rpm and accepts interchangeable waterjet nozzles. Provide all necessary waterjet nozzle setups and patterns to ensure clean sufficient removal. Ensure the deck’s discharge directs the water and removal material in a manner that is not hazardous to vehicles or pedestrians.

2.2 Water. Conform to Section 803.

3.0 CONSTRUCTION. Before starting work, provide the Engineer with a contractor work history of 2 projects where striping removal was completed acceptably for a similar type of pavement. If no history is available, complete 1,000 linear feet of striping removal and obtain the Engineer’s approval before continuing.

Conduct striping removal under lane closures meeting the conditions of the MUTCD and Kentucky Standard Drawings and Specifications. Waterblast to remove temporary or permanent striping completely as the Engineer directs. Do not damage the pavement in any way and protect all joint seals. If damage is observed, stop the removal process until the operator can make changes and demonstrate acceptable striping removal. Repair any damage to the pavement. Vacuum all marking material and removal debris concurrently with the blasting operation.

4.0 MEASUREMENT. The Department will measure the quantity in linear feet. When the removal area’s width exceeds 8 inches and a second pass is required, the Department will measure the length of the additional pass for Payment. The Department will not measure for payment additional passes for widths of 8 inches or less or passes to further eradicate markings. The Department will not measure repair of damaged pavement for payment and will consider it incidental to this item of work.

5.0 PAYMENT. The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
---	Waterblast Stripe Removal	Linear Foot

The Department will consider payment as full compensation for all work required under this note.

January 1, 2008

**SPECIAL NOTE FOR
HISTORIC PROPERTY**

**OWSLEY/LEE COUNTY
RECONSTRUCT KY 11
ITEM 10-292.10**

Environmental studies have shown historic resources to be present on Parcel 48. The contractor shall not deviate from the work shown in the plans on acquired fee simple or easements from this parcel. If deviations from the plans are needed, the contractor shall contact the KYTC District 10 Environmental Coordinator at 606-666-8841 for approval and consultation with other agencies prior to work beginning.

SPECIAL NOTE FOR SPRAY APPLIED THERMOPLASTIC PAVEMENT MARKING MATERIALS

I. DESCRIPTION

Except as provided herein, all work shall be performed in accordance with the Department’s Standard Specifications, Interim Supplemental Specifications, applicable Standard and Sepia Drawings, applicable Special Provisions and Special Notes, current editions. Article references are to the Standard Specifications. This project shall consist of furnishing all labor, equipment, materials and incidentals for the following:

- (1) Spray applied thermoplastic pavement marking materials with reflectorized glass beads for permanent applications

II. MATERIALS

- A. **DROP ON BEADS.** Use beads that will ensure the pavement marking material will meet retroreflectivity requirements. The Department will evaluate the beads as part of the marking system through retroreflectivity readings.
- B. **APPROVAL.** Select materials that conform to the composition and physical characteristic requirements below when evaluated in accordance with AASHTO T-250 or other test methods as cited. The Department will sample and evaluate for approval each lot of thermoplastic material delivered for use per contract prior to installation of the thermoplastic material. Do not allow the installation of thermoplastic material until it has been approved by the Division of Materials. Allow the Department a minimum of 10 working days to evaluate and approve thermoplastic material from the date sampled.
- C. **Composition.** Use a maleic-modified glycerol ester resin (alkyd binder) to formulate the thermoplastic material. Ensure the pigment, pre-mix beads, and filler are uniformly dispersed in the resin. Use material that is free from all dirt and foreign material. Provide independent analysis data and certification for each formulation stating the total concentration of each heavy metal present, the test method used for each determination, and compliance to 40 CFR 261 for leachable heavy metals content.

COMPOSITION (Percentage by Weight)		
Component	White	Yellow
Binder, ⁽¹⁾	26.0 min.	26.0 min.
Glass Beads (Premixed)	30 - 40	30 - 40
Titanium Dioxide (Rutile, Type II)	10.0 min.	—
Calcium Carbonate & Inert Fillers ⁽²⁾	42.0 max.	50.0 max.
Heavy Metals Content	Comply with 40 CFR 261	Comply with 40 CFR 261

⁽¹⁾Use a binder that consists of a mixture of synthetic resins, at least one being solid at room temperature, and high boiling point plasticizers. Ensure that at least one-third of the binder composition is solid maleic-modified glycerol ester resin and is not less than 8 percent by weight of the entire material formulation. Do not use alkyd binder that contains petroleum based hydrocarbon resins.

⁽²⁾The manufacturer may choose the amount of calcium carbonate and inert fillers, providing all other requirements of this section are met.

Spray Applied Thermoplastic
 Page 2 of 3

D. Physical Characteristics. For thermoplastic material heated for 4 hours at 425°F under agitation, conform to the following requirements.

a) **Color.** As determined with a spectrophotometer using D65 illuminant with a 45 degree entrance angle and 0 degree observation angle geometry.

CIELAB Color Coordinates		
	Yellow	White
Daytime Color (CIELAB) Spectrophotometer using illuminant D65 at 45° illumination and 0° viewing with a 2° observer	L* 81.76 a* 19.79 b* 89.89 Maximum allowable variation 6.0ΔE*	L* 93.51 a* -1.01 b* 0.70 Maximum allowable variation 6.0ΔE*
Nighttime Color (CIELAB) Spectrophotometer using illuminant A at 45° illumination and 0° viewing with a 2° observer	L* 86.90 a* 24.80 b* 95.45 Maximum allowable variation 6.0ΔE*	L* 93.45 a* -0.79 b* 0.43 Maximum allowable variation 6.0ΔE*

b) **Set Time.** Use material that, when applied at a temperature range of 375 ± 25 °F and thickness of 60 ± 10 mils, sets to bear traffic in not more than 2 minutes when the air and road surface temperature is approximately ≥ 50 ± 3 °F, and not more than 10 minutes when the air and road surface temperature is approximately < 50 ± 3 °F.

c) **Softening Point.** Ensure that the thermoplastic material has a softening point of 180 ± 15 °F.

d) **Bond Strength.** Ensure that the bond strength of the thermoplastic material to concrete exceeds 180 psi.

e) **Cracking Resistance at Low Temperature.** Ensure that the thermoplastic material shows no cracks when observed from a distance exceeding one foot.

f) **Impact Resistance.** Ensure the impact resistance of the thermoplastic material is a minimum of 50 inch-pounds.

g) **Flash Point.** Use thermoplastic material that has a flash point not less than 475 °F.

E. PACKAGING. Package thermoplastic material in suitable 50 pound containers to which the material shall not adhere during shipment or storage. Include a label stating that the thermoplastic material is to be maintained with a temperature range of 350 – 400°F during application. Provide the thermoplastic material in granular form.

F. SHELF LIFE. Ensure that the thermoplastic material conforms to this section for a period of one year. Replace any thermoplastic material not conforming to the above requirements.

G. MANUFACTURER’S TESTING. Perform testing in accordance with AASHTO T-250 on a minimum of one composite sample per 10,000 pounds, or portion thereof, per lot of thermoplastic produced.

H. CERTIFICATION. Submit manufacturer’s certification stating conformance to the requirements of this section for each lot of extruded thermoplastic delivered for use on projects. Clearly state the manufacture, formulation identification, product name, color, date of manufacturer, total quantity of lot produced, actual quantity of thermoplastic material represented, sampling method utilized to obtain the samples, and required manufacturer’s testing data for each composite sample tested to represent each lot produced.

III. CONSTRUCTION METHODS

- A. **SURFACE PREPARATION.** The contractor will be required to sweep all pavement surfaces prior to striping and maintain the cleaning operation far enough in advance of the striping operation to prevent any dust from the cleaning operation from mixing with the paint. The sweeper must maintain contact with the roadway. When the Engineer determines abnormal amounts of debris or other material have accumulated beyond the capability of the required sweeping unit which will require shoveling or other means to remove, the Engineer will make arrangements, prior to painting, to have the material removed by the Department.
- B. **INSTALLATION.** Install thermoplastic materials in accordance with Section 714, Durable Pavement Striping, and the following exceptions:
 - Install the thermoplastic materials at a minimum thickness of 60 mils.
 - Ensure the material temperature is maintained between 350 and 400°F.
 - Do not allow the material temperature to exceed 400°F.
 - Removal of existing stripe on asphalt surfaces is not required.
- C. **RETROREFLECTIVITY.** The Department will evaluate installed markings in accordance with Section 714.03.06, Proving Period for Durable Markings.

IV. METHOD OF MEASUREMENT

- A. **ACCEPTANCE AND PAYMENT.** The Department will accept spray applied thermoplastic materials based on compliance of the manufacturer’s certification and conformance of test results obtained by the Department to the requirements of this special note.

Contrary to Section 714.03.08, Acceptance of Non-Specification Thermoplastic Markings, the Department will not accept non-specification compliant markings. Remove non-specification compliant markings by water blasting. The Department will perform random thickness tests on applied markings to determine compliance to thickness requirements

IV. BASIS OF PAYMENT

The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
24995EC	PAVE STRIPING-SPRAY THERMO-6 IN W	LF
24996EC	PAVE STRIPING-SPRAY THERMO-6 IN Y	LF

The Department will consider payment as full compensation for furnishing all labor, materials, equipment, and incidentals required to construct spray applied thermoplastic pavement markings.

SPECIAL NOTE

For Tree Removal

**Lee and Owsley County
I-75 TO MOUNTAIN PARKWAY; RECONSTRUCT KY-11
FROM KY-30 AT LEVI IN OWSLEY COUNTY TO 0.5
MILE SOUTH OF KY-587 IN LEE COUNTY. START AT
KY-30 AT LEVI IN OWSLEY MOVING NORTH.**

Item No. 10-292.10

**NO CLEARING OF TREES 5 INCHES OR GREATER (DIAMETER BREST
HEIGHT) FROM JUNE 1 THROUGH JULY 31.**

**If there are any questions regarding this note, please contact Danny Peake, Director,
Division of Environmental Analysis, 200 Mero Street, Frankfort, KY 40601, Phone:
(502) 564-7250.**



KENTUCKY TRANSPORTATION CABINET
Department of Highways
DIVISION OF RIGHT OF WAY & UTILITIES

TC 62-226
Rev. 01/2016
Page 1 of 1

RIGHT OF WAY CERTIFICATION

<input checked="" type="checkbox"/> Original	<input type="checkbox"/> Re-Certification	RIGHT OF WAY CERTIFICATION	
--	---	-----------------------------------	--

ITEM #	COUNTY	PROJECT # (STATE)	PROJECT # (FEDERAL)
10-292.10	Owsley/Lee	1100 FD04 095 6981101R	

PROJECT DESCRIPTION

RECONSTRUCT KY-11 FROM KY-30 AT LEVI IN OWSLEY COUNTY TO KY-587 INTERSECTION IN LEE COUNT

No Additional Right of Way Required

Construction will be within the limits of the existing right of way. The right of way was acquired in accordance to FHWA regulations under the Uniform Relocation Assistance and Real Property Acquisitions Policy Act of 1970, as amended. No additional right of way or relocation assistance were required for this project.

Condition # 1 (Additional Right of Way Required and Cleared)

All necessary right of way, including control of access rights when applicable, have been acquired including legal and physical possession. Trial or appeal of cases may be pending in court but legal possession has been obtained. There may be some improvements remaining on the right-of-way, but all occupants have vacated the lands and improvements, and KYTC has physical possession and the rights to remove, salvage, or demolish all improvements and enter on all land. Just Compensation has been paid or deposited with the court. All relocations have been relocated to decent, safe, and sanitary housing or that KYTC has made available to displaced persons adequate replacement housing in accordance with the provisions of the current FHWA directive.

Condition # 2 (Additional Right of Way Required with Exception)

The right of way has not been fully acquired, the right to occupy and to use all rights-of-way required for the proper execution of the project has been acquired. Some parcels may be pending in court and on other parcels full legal possession has not been obtained, but right of entry has been obtained, the occupants of all lands and improvements have vacated, and KYTC has physical possession and right to remove, salvage, or demolish all improvements. Just Compensation has been paid or deposited with the court for most parcels. Just Compensation for all pending parcels will be paid or deposited with the court prior to AWARD of construction contract

Condition # 3 (Additional Right of Way Required with Exception)

The acquisition or right of occupancy and use of a few remaining parcels are not complete and/or some parcels still have occupants. All remaining occupants have had replacement housing made available to them in accordance with 49 CFR 24.204. KYTC is hereby requesting authorization to advertise this project for bids and to proceed with bid letting even though the necessary right of way will not be fully acquired, and/or some occupants will not be relocated, and/or the just compensation will not be paid or deposited with the court for some parcels until after bid letting. KYTC will fully meet all the requirements outlined in 23 CFR 635.309(c)(3) and 49 CFR 24.102(j) and will expedite completion of all acquisitions, relocations, and full payments after bid letting and prior to AWARD of the construction contract or force account construction.

Total Number of Parcels on Project	EXCEPTION (S) Parcel #	ANTICIPATED DATE OF POSSESSION WITH EXPLANATION
132		
Number of Parcels That Have Been Acquired		
Signed Deed	116	
Condemnation	16	
Signed ROE	16	

Notes/ Comments (Text is limited. Use additional sheet if necessary.)

LPA RW Project Manager		Right of Way Supervisor	
Printed Name		Printed Name	Edgar Raleigh II
Signature		Signature	<i>Edgar Raleigh II</i> 2021.01.14 15:50:32 -05'00'
Date		Date	January 14, 2021
Right of Way Director		FHWA	
Printed Name		Printed Name	
Signature	<i>Charles Hale</i> 2021.01.19	Signature	
Date	11:02:10 -05'00'	Date	

UTILITIES AND RAIL CERTIFICATION NOTE

Lee / Owsley County
FD04 095 / 065 69811 01U
Mile point: 0.000 TO 1.082
I-75 TO MOUNTAIN PARKWAY; RECONSTRUCT KY-11 FROM KY-30 AT LEVI IN OWSLEY COUNTY TO KY-587 INTERSECTION IN LEE COUNTY. START AT KY-30 AT LEVI IN OWSLEY MOVING NORTH.
(06CCR)(10CCR)(14CCR)(18CCN) (2020CCR)
ITEM NUMBER: 10-292.10

PROJECT NOTES ON UTILITIES

For all projects under 2000 Linear feet which require a normal excavation locate request pursuant to KRS 367.4901-4917, the awarded contractor shall field mark the proposed excavation or construction boundaries of the project (also called white lining) using the procedure set forth in KRS 367.4909(9)(k). For all projects over 2000 linear feet, which are defined as a "Large Project" in KRS 367.4903(18), the awarded contractor shall initially mark the first 2000 linear feet minimally of proposed excavation or construction boundaries of the project to be worked using the procedure set forth in KRS 367.4909(9)(k). This temporary field locating of the project excavation boundary shall take place prior to submitting an excavation location request to the underground utility protection Kentucky Contact Center. For large projects, the awarded contractor shall work with the impacted utilities to determine when additional white lining of the remainder of the project site will take place. This provision shall not alter or relieve the awarded contractor from complying with requirements of KRS 367.4905 to 367.4917 in their entirety.

Please Note: The information presented in this Utility Note is informational in nature and the information contained herein is not guaranteed.

The contractor will be responsible for contacting all utility facility owners on the subject project to coordinate his activities. The contractor will coordinate his activities to minimize and, where possible, avoid conflicts with utility facilities. Due to the nature of the work proposed, it is unlikely to conflict with the existing utilities beyond minor facility adjustments. Where conflicts with utility facilities are unavoidable, the contractor will coordinate any necessary relocation work with the facility owner and Resident Engineer. The Kentucky Transportation Cabinet maintains the right to remove or alter portions of this contract if a utility conflict occurs. The utility facilities as noted in the previous section(s) have been determined using data garnered by varied means and with varying degrees of accuracy: from the facility owners, a result of S.U.E., field inspections, and/or reviews of record drawings. The facilities defined may not be inclusive of all utilities in the project scope and are not Level A quality, unless specified as such. It is the contractor's responsibility to verify all utilities and their respective locations before excavating.

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. The contractor is instructed to contact KY 811 for

UTILITIES AND RAIL CERTIFICATION NOTE

Lee / Owsley County
FD04 095 / 065 69811 01U
Mile point: 0.000 TO 1.082
I-75 TO MOUNTAIN PARKWAY; RECONSTRUCT KY-11 FROM KY-30 AT LEVI IN OWSLEY COUNTY TO KY-587 INTERSECTION IN LEE COUNTY. START AT KY-30 AT LEVI IN OWSLEY MOVING NORTH.
(06CCR)(10CCR)(14CCR)(18CCN) (2020CCR)
ITEM NUMBER: 10-292.10

the location of existing underground utilities. Contact shall be made a minimum of two (2) and no more than ten (10) business days prior to excavation. The contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY 811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom are to be contacted through their individual Protection Notification Center. It may be necessary for the contractor to contact the County Court Clerk to determine what utility companies have facilities in the area. Non-compliance with these directives can result in the enforcement of penalties.

NOTE: DO NOT DISTURB THE FOLLOWING FACILITIES LOCATED WITHIN THE PROJECT DISTURB LIMITS

Crystal Broadband Networks - CATV

AT&T - KY - Communication

Delta Natural Gas Company, Inc. - Natural Gas

People's Rural Telephone/TV - CATV, Completion date: 12/28/2020

Jackson Energy Cooperative Corporation - Electric, Completion date: 7/1/2021

City of Booneville - Water

City of Beattyville – Water

The Contractor is fully responsible for protection of all utilities listed above

THE FOLLOWING FACILITY OWNERS ARE RELOCATING/ADJUSTING THEIR FACILITIES WITHIN THE PROJECT LIMITS AND WILL BE COMPLETE PRIOR TO CONSTRUCTION

Not Applicable.

UTILITIES AND RAIL CERTIFICATION NOTE

Lee / Owsley County
FD04 095 / 065 69811 01U
Mile point: 0.000 TO 1.082
I-75 TO MOUNTAIN PARKWAY; RECONSTRUCT KY-11 FROM KY-30 AT LEVI IN OWSLEY COUNTY TO KY-587 INTERSECTION IN LEE COUNTY. START AT KY-30 AT LEVI IN OWSLEY MOVING NORTH.
(06CCR)(10CCR)(14CCR)(18CCN) (2020CCR)
ITEM NUMBER: 10-292.10

THE FOLLOWING FACILITY OWNERS HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE OWNER OR THEIR SUBCONTRACTOR AND IS TO BE COORDINATED WITH THE ROAD CONTRACT

Crystal Broadband Networks – CATV. Crystal Broadband Network will be attaching facilities to poles already installed by Jackson Energy and may use poles to be installed by PRTC and/or AT&T.

CBN Estimated Completion Date: 1/31/2022

AT&T - KY – Communication. AT&T – KY will be attaching facilities to poles already installed by Jackson Energy and may use poles to be installed by PRTC and/or AT&T and will be installing a portion of their facilities underground.

AT&T Estimated Completion Date: 12/31/2021

Delta Natural Gas Company, Inc. - Natural Gas

Delta Gas Estimated Completion Date: 1/31/2022

People's Rural Telephone/TV – CATV. PRTC will primarily be attaching facilities to poles already installed by Jackson Energy and will be installing a limited number of new poles.

PRTC Estimated Completion Date: 7/31/2021

Jackson Energy Cooperative Corporation – Electric. Jackson Energy has installed new facilities and has removed all retired facilities from the project except existing old poles that are currently still occupied by other utility companies. Jackson Energy’s relocation is substantially complete except for the removal of their old existing poles that are still occupied by other utility companies. Removal of old existing Jackson Energy poles will be performed after the relocation of other facilities occupying these poles is complete.,

Jackson Energy Estimated Completion date: 2/28/2022

Provided the contractor meets all obligations for obtaining field locations of existing utilities and makes all effort to avoid and protect all existing utilities, the contractor may access and perform work on the project not in conflict with the existing utilities. The contractor is advised that significant portions of the project will not be available for highway construction activities until such time that existing utilities that are currently in conflict are relocated. The contractor will be required to coordinate his work with ongoing utility relocation activities and schedule his work around the existing utilities until such time

UTILITIES AND RAIL CERTIFICATION NOTE

Lee / Owsley County
FD04 095 / 065 69811 01U
Mile point: 0.000 TO 1.082
I-75 TO MOUNTAIN PARKWAY; RECONSTRUCT KY-11 FROM KY-30 AT LEVI IN OWSLEY COUNTY TO KY-587 INTERSECTION IN LEE COUNTY. START AT KY-30 AT LEVI IN OWSLEY MOVING NORTH.
(06CCR)(10CCR)(14CCR)(18CCN) (2020CCR)
ITEM NUMBER: 10-292.10

they are relocated. No additional compensation will be made for the contractor's inability to access the portions of the project requiring utility relocations nor will additional contract time be awarded. No claims for loss of production due to the ongoing utility relocation work will be entertained.

THE FOLLOWING FACILITY OWNERS HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE ROAD CONTRACTOR AS INCLUDED IN THIS CONTRACT

City of Booneville - Water

City of Beattyville – Water

RAIL COMPANIES HAVE FACILITIES IN CONJUNCTION WITH THIS PROJECT AS NOTED

No Rail Involvement Rail Involved Rail Adjacent

UTILITIES AND RAIL CERTIFICATION NOTE

Lee / Owsley County
FD04 095 / 065 69811 01U
Mile point: 0.000 TO 1.082
I-75 TO MOUNTAIN PARKWAY; RECONSTRUCT KY-11 FROM KY-30 AT LEVI IN OWSLEY COUNTY TO KY-587 INTERSECTION IN LEE COUNTY. START AT KY-30 AT LEVI IN OWSLEY MOVING NORTH.
(06CCR)(10CCR)(14CCR)(18CCN) (2020CCR)
ITEM NUMBER: 10-292.10

AREA FACILITY OWNER CONTACT LIST

Facility Owner	Address	Contact Name	Phone	Email
AT&T - KY - Communication	29 Willis Branch Prestonsburg KY 41653	Jack Salyer	6064249328	js2299@att.com
City of Beattyville - Water	PO Box 307 Beattyville KY 41311	Scott Jackson	6064645207	mayor@beattyville.org
City of Booneville - Water	PO Box 1 Booneville Ky 41314	Charles Long	6065936800	cityboon@prtcnet.org
Crystal Broadband Networks - CATV	PO Box 180336 Chicago IL 60618	Jonathan Kurien	6066633439	jonathank@crystalbn.com
		Kevin Gibson	8773190328	KGibson@crystalbn.com
Delta Natural Gas Company, Inc. - Natural Gas	3617 Lexington Road Winchester KY 40391	Robert Nellipowitz	8597446171	rnellipowitz@deltagas.com
Jackson Energy Cooperative Corporation - Electric	115 Jackson Energy Lane McKee KY 40447	Joe Garland	6063649205	joegarland@jacksonenergy.com
		Rick Caudill	6063649217	RickCaudill@Jacksonenergy.com
People's Rural Telephone/TV - CATV	P.O. Box 159 McKee KY 40447	John Renner	6062877101	John.Renner@prtc.org



nesbitt engineering, inc.
providing proven solutions since 1976

227 North Upper Street
Lexington, KY 40507-1016

Technical Specifications

**KY 11 Waterline Relocation
City of Beattyville Waterworks
Lee County, Kentucky
City of Booneville Waterworks
Owsley County, Kentucky
10-292.10**

July 2020

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

TECHNICAL SPECIFICATIONS TABLE OF CONTENTS

Incorporate By Reference All Applicable Kentucky Transportation Cabinet Standard Specifications for Road and Bridge Construction, Latest Revision

DIVISION 1 - GENERAL REQUIREMENTS

<u>Section No.</u>	<u>Title</u>	<u>Page No.</u>
01025	Measurement and Payment	01025-1 thru 01025-28
01300	Submittals	01300-1 thru 01300-8
01310	Progress Schedules	01310-1 thru 01310-3
01788	Project Record Documents	01788-1 thru 01788-2

DIVISION 2 - SITE WORK

<u>Section No.</u>	<u>Title</u>	<u>Page No.</u>
02320	Horizontal Directional Drilling	02320-1 thru 02320-6
02326	Steel Casing Pipe	02326-1 thru 02326-4
02600	Water Distribution Pipe	02600-1 thru 02600-21
02640	Meters, Individual Pressure Reducing Valves, and Service Lines	02640-1 thru 02640-3

DIVISION 5 - METALS

<u>Section No.</u>	<u>Title</u>	<u>Page No.</u>
05540	Castings	05540-1 thru 05540-3

DIVISION 15 - MECHANICAL

<u>Section No.</u>	<u>Title</u>	<u>Page No.</u>
15100	Valves and Plumbing Specialties	15100-1 thru 15100-10
15101	Large Valves and Appurtenances	15101-1 thru 15101-15
15123	Couplings, Flanged Coupling Adapters, and Service Saddles	15123-1 thru 15123-4

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

SECTION 01025

MEASUREMENT AND PAYMENT

PART 1 - GENERAL

1.01 WORK INCLUDED

The Contractor shall furnish all necessary labor, machinery, tools, apparatus, equipment, materials, service, other necessary supplies and perform all work including all excavation and backfilling (without additional compensation, except where specifically set out in these specifications) at the unit or lump sum bid price for the items or work described under PART 2 of this section.

1.02 PROGRESS AND PAYMENTS SCHEDULES

- A. Within fifteen (15) days after the date of formal execution of the AGREEMENT, the Contractor shall prepare and submit to the Engineer, for approval, a construction schedule which depicts the Contractor's plan for completing the contract requirements and show work placement in dollars versus contract time. The Contractor's construction schedule must be approved by the Engineer before any payments will be made on this contract.
- B. Within fifteen (15) days after the date of formal execution of the CONTRACT AGREEMENT, the Contractor shall prepare and submit to the Engineer, for approval, a periodic estimate which depicts the Contractor's cost for completing the contract requirements and show by major unit of the project work, the Contractor's dollar value for the material and the labor (two separate amounts) to be used as a basis for the periodic payments. The Contractor's periodic estimate must be approved by the Engineer before any payments will be made on this contract.
- C. The Engineer's decision as to sufficiency and completeness of the Contractor's construction schedule and periodic estimate will be final.
- D. The Contractor must make current, to the satisfaction of the Engineer, the construction schedule and periodic estimate each time he requests a payment on this contract.
- E. The Contractor's construction schedule and periodic estimate must be maintained at the construction site available for inspection and shall be revised to incorporate approved change orders as they occur.
- F. When the Contractor requests a payment on this contract, it must be on the approved periodic estimate and be current. Further, the current periodic estimate and construction schedule (both updated and revised) shall be submitted for review and approval by the Engineer before monthly payments will be made by the Owner. The Contractor shall submit six (6) current copies of each (periodic estimate and construction schedule) when requesting payment.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1.03 CONDITIONS FOR PAYMENT

- A. The Owner will make payments for acceptable work in place and materials properly stored on-site. The value of payment shall be as established on the approved construction schedule and periodic estimate, EXCEPT the Owner will retain ten percent (10%) of the work in place and a percentage as hereinafter listed for items properly stored or untested.
- B. No payment will be made for stored materials unless a proper invoice from the supplier is attached to the pay request. Further, no item whose value is less than \$1,000.00 will be considered as stored materials for pay purposes.
- C. Payment for pipeline items shall be limited to eighty percent (80%) of the bid price until the pipeline items have been tested and accepted by the Engineer.
- D. Payment for equipment items shall be limited to eighty-five percent (85%) of their scheduled value (materials portion only) until they are set in place. Eighty-five percent (85%) payment for stored materials and equipment shall be contingent on proper on-site storage as recommended by the manufacturer or required by the Engineer.
- E. Payment for equipment items set in-place shall be limited to ninety percent (90%) of their scheduled value until they are ready for operation and have been certified by the manufacturer. Ninety percent (90%) payment for installed equipment shall be contingent on proper routine maintenance of the equipment in accordance with the manufacturer's recommendations.
- F. Payment for equipment items set in place and ready for operation shall be limited to ninety-five percent (95%) of their scheduled value until all acceptance tests have been completed and the required manufacturer's pre-startup operator's training has been completed.
- G. Payment for the labor portion of equipment items will be subject only to the degree of completeness and the appropriate retainage.
- H. The Owner may reduce the percent of retainage once the project has achieved satisfactory progress and is at the fifty percent (50%) mark. If the percent of retainage is reduced, the dollar amount of retainage for work-in-place will not be reduced but will remain constant following the fifty percent (50%) constructed status. The retainage on the equipment items shall be determined as defined hereinbefore.
- I. Additionally, the Owner may reinstate the retainage to a full ten percent (10%) of the scheduled value of work-in-place and material items should the Owner, at its discretion, determine that the Contractor is not making satisfactory progress or there is other specific cause for such withholding.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1.04 CLAIMS FOR EXTRA WORK

- A. If the Contractor claims that any instructions by Drawings or otherwise involve extra cost, he shall give the Engineer written notice of said claim within ten (10) days after the receipt of such instructions, and in any event before proceeding to execute the work, stating clearly and in detail the basis of his claim or claims. No such claim shall be valid unless so made.
- B. Claims for additional compensation for extra work, due to alleged errors in spot elevations, contour lines, or bench marks, will not be recognized unless accompanied by certified survey data, made prior to the time the original ground was disturbed, clearly showing that errors exist which resulted, or would result, in handling more material, or performing more work than would reasonably be estimated from the Drawings and/or topographical maps issued.
- C. Any discrepancies which may be discovered between actual conditions and those represented by the topographical maps and/or Drawings shall at once be reported to the Engineer, and work shall not proceed, except at the Contractor's risk, until written instructions have been received by him from the Engineer.
- D. If, on the basis of the available evidence, the Engineer determines that an adjustment of the Contract Price or time is justifiable, the procedure shall then be as provided herein for "Changes in the Work".
- E. By execution of this Contract, the Contractor warrants that he has visited the site of the proposed work and fully acquainted himself with the existing site conditions relating to construction and labor, and that he fully understands the facilities, difficulties, and restrictions attending the execution of the work under this Contract. The Contractor further warrants that he has thoroughly examined and is familiar with the Drawings, Specifications and all other documents comprising the Contract. The Contractor further warrants that by execution of this Contract his failure when he was bidding on this Contract to receive or examine any form, instrument or document, or to visit the site and acquaint himself with conditions there existing, in no way relieves him from any obligation under the Contract, and the Contractor agrees that the Owner shall be justified in rejecting any claim based on facts regarding which he should have been on notice as a result thereof.

1.05 DETERMINATION OF THE VALUE OF EXTRA (ADDITIONAL) OR OMITTED WORK

- A. The value of extra (additional) or omitted work shall be determined in one or more of the following ways:
 - 1. On the basis of the actual cost of all the items of labor (including on-the-job supervision), materials, and use of equipment, plus a maximum 15 percent for added work or a minimum 15 percent for deleted work which shall cover the Contractor's general supervision,

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

overhead and profit. In case of subcontracts, the 15 percent (maximum for added work and minimum for deleted work) is interpreted to mean the subcontractor's supervision, overhead and profit, and an additional 5 percent (maximum for added work and minimum for deleted work) may then be added to such costs to cover the General Contractor's supervision, overhead and profit. The cost of labor shall include required insurance, taxes and fringe benefits. Equipment costs shall be based on current rental rates in the areas where the work is being performed but, in no case shall such costs be greater than the current rates published by the Associated Equipment Distributors, Chicago, Illinois.

2. By estimate and acceptance in a lump sum.
 3. By unit prices named in the Contract or subsequently agreed upon.
- B. Provided, however, that the cost or estimated cost of all extra (additional) work shall be determined in advance of authorization by the Engineer and approved by the Owner.
- C. All extra (additional) work shall be executed under the conditions of the original Contract. Any claim for extension of time shall be adjusted according to the proportionate increase or decrease in the final total cost of the work unless negotiated on another basis.
- D. Except for over-runs in contract unit price items, no extra (additional) work shall be done except upon a written Field Order Directive, or Change Order from the Engineer, and no claim on the part of the Contractor for pay for extra (additional) work shall be recognized unless so ordered in writing by the Engineer.

PART 2 – PRODUCTS

2.01 W AIR RELEASE VALVE This bid item description shall apply to all air release valve installations of every size except those defined as "Special". This item shall include the air release valve, main to valve connecting line or piping, manhole, vault, structure, access casting or doors, tapping the main, labor, equipment, excavation, proper backfill and restoration required to install the air release valve at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. All air release/vacuum valves on a project shall be paid under one bid item regardless of size. No separate pay items will be established for size variations. Only in the case of the uniqueness of a particular air release valve would a separate bid item be established. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

BOLLARDS This item is for payment for furnishing and installing protective guard posts at above ground utility installations. A bollard may consist of, but not limited to, a steel post set in concrete or any other substantial post material. This item shall include all labor, equipment, and materials needed for complete installation of the bollard as specified by the utility owner specifications and plans. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete. *NOTE: A bid code for this item has been established in standard roadway bid items and shall be used for payment of this item. The bid code is 21341ND*

- 2.02 W CAP EXISTING MAIN** This item shall include the specified cap, concrete blocking and/or mechanical anchoring, labor, equipment, excavation, backfill, and restoration required to install the cap at the location shown on the plans or as directed in accordance with the specifications. This item is not to be paid on new main installations. This pay item is only to be paid to cap existing mains. Caps on new mains are incidental to the new main. Any and all caps on existing mains shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.03 W DIRECTIONAL BORE** Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of water main under streets, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.
- 2.04 W ENCASEMENT CONCRETE** Includes all labor, equipment, excavation, concrete, reinforcing steel, backfill, restoration, and etc., to construct the concrete encasement of the water main as shown on the plans, and in accordance with the specifications and standard drawings. Payment under this item shall be in addition to the carrier pipe as paid under separate bid items. Carrier pipe is not included in this bid item. Any and all concrete encasement shall be paid under one bid item included in the contract regardless of the size of the carrier pipe or the volume of concrete or steel reinforcement as specified in the plans and specifications. No separate bid items will be established for size variations. Measurement of pay quantity shall be from end of concrete to end of concrete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

2.05 W ENCASUREMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

2.06 W ENCASUREMENT STEEL OPEN CUT This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to open cut and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The size encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

2.07 W FIRE HYDRANT ADJUST Includes all labor, equipment, excavation, materials, and backfill to adjust the existing fire hydrant using the fire hydrant manufacturer's extension kit for adjustments of 18" or less. Adjustments greater than 18" require anchoring couplings and vertical bends to adjust to grade. The Contractor will supply and install all anchor couplings, bends, fire hydrant extension, concrete blocking, restoration, granular drainage material, etc, needed to adjust the fire hydrant complete and ready for use as shown on the plans, and in accordance with the specifications and standard drawings. This also includes allowing for the utility

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

owner inspector to inspect the existing fire hydrant prior to adjusting, contractor returning unusable fire hydrants to the utility owner warehouse and picking up a replacement hydrant. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete and ready for use.

- 2.08 W FIRE HYDRANT ASSEMBLY** Includes all labor, equipment, new fire hydrant, isolating valve and valve box, concrete pad around valve box (when specified in specifications or plans), piping, anchoring tee, anchoring couplings, fire hydrant extension, excavation, concrete blocking, granular drainage material, backfill, and restoration, to install a new fire hydrant assembly as indicated on plans and on standard drawings complete and ready for use. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.09 W FIRE HYDRANT RELOCATE** This item includes all labor and equipment to remove the existing fire hydrant from its existing location and reinstalling at a new location. This item shall include a new isolating valve and valve box, concrete pad around valve box (when required in specifications or plans), new piping, new anchoring tee, anchoring couplings, fire hydrant extensions, concrete blocking, restoration, granular drainage material, excavation, and backfill as indicated on plans, specifications, and on standard drawings complete and ready for use. This item shall also include allowing for utility owner inspector to inspect the existing fire hydrant prior to reuse, contractor returning unusable fire hydrants to the utility owner warehouse and picking up a replacement hydrant for use, if the existing fire hydrant is determined unfit for reuse. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.10 W FIRE HYDRANT REMOVE** This bid item includes removal of an abandoned fire hydrant, isolating valve, and valve box to the satisfaction of the engineer. The removed fire hydrant, isolating valve and valve box shall become the property of the contractor for his disposal as salvage or scrap. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.11 W FLUSH HYDRANT ASSEMBLY** This item shall include the flushing hydrant assembly, service line, tapping the main, labor, equipment, excavation, backfill, and restoration required to install the flush hydrant at the location shown on the plans and in accordance with the specifications and standard drawings, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.12 W FLUSHING ASSEMBLY** This item shall include the flushing device assembly, service line, meter box and lid, tapping the main, labor, equipment, excavation, backfill, and restoration required to install the flushing device at the location shown

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

on the plans and in accordance with the specifications and standard drawings, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.13 W LEAK DETECTION METER** This item is for payment for installation of a water meter at main valve locations where shown on the plans for detection of water main leaks. The meter shall be of the size and type specified in the plans or specifications. This item shall include all labor, equipment, meter, meter box or vault, connecting pipes between main and meter, main taps, tapping saddles, casting, yoke, and any other associated material needed for installation of a functioning water meter in accordance with the plans and specifications, complete and ready for use. No separate payment will be made under any other contract item for connecting pipe or main taps. Any and all leak detection meters shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete and ready for use.
- 2.14 W LINE MARKER** This item is for payment for furnishing and installing a water utility line marker as specified by the utility owner specifications and plans. A line marker may consist of a post or monument of whatever materials specified and shall include markings and/or signage on same as specified by plans or specifications. This item shall include all labor, equipment, and materials needed for complete installation of the marker. This item shall be paid EACH (EA) when complete.
- 2.15 W MAIN POINT RELOCATE** This item is intended for payment for horizontal and/or vertical relocation of a short length of an existing main at the locations shown on the plans. This bid item is to be used to relocate an existing water main at point locations such as to clear a conflict at a proposed drainage structure, pipe or any other similar short relocation situation, and where the existing pipe material is to be reused. The contractor shall provide any additional pipe or fitting material needed to complete the work as shown on the plans and specifications. The materials provided shall be of the same type and specification as those that exist. Substitution of alternative materials shall be approved by the engineer in advance on a case by case basis. New polyethylene wrap is to be provided (if wrap exists or is specified in the specifications to be used). If it is necessary that the pipe be disassembled for relay, payment under this item shall also include replacement of joint gaskets as needed. Bedding and backfill shall be provided and performed the same as with any other pipe installation as detailed in the plans and specifications. Payment under this item shall be for each location requiring an existing main to be relocated horizontally or vertically regardless of pipe size or relocation length. No separate pay items will be established for pipe size variations or relocation segment length variations. Water Main Relocate shall not be paid on a linear feet basis; but, shall be Paid EACH (EA) at each location when complete and placed in service. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.
- 2.16 W METER** This item is for payment for installation of all standard water meters of all sizes 2 inches ID or less as specified on the plans. This item shall include all

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

labor, equipment, meter, meter box, casting, yoke, and any other associated material needed for installation of a functioning water meter in accordance with the plans and specifications, complete and ready for use. This item shall include connections to the new or existing water service line. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

2.17 W METER ADJUST This item includes all labor, equipment, excavation, materials, backfill, restoration, and etc., to adjust the meter casting to finished grade (whatever size exists) at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

2.18 W METER RELOCATE This item includes all labor, equipment, excavation, additional fittings, disinfection, testing, restoration, and etc., to relocate the existing water meter (whatever size exists), meter yoke, meter box, casting, and etc., from its old location to the location shown on the plans or as directed, in accordance with the specifications and standard drawings complete and ready for use. The new service pipe (if required) will be paid under short side or long side service bid items. Any and all meter relocations of 2 inches or less shall be paid under one bid item included in the contract regardless of size. Each individual relocation shall be paid individually under this item; however, no separate bid items will be established for meter size variations of 2 inches ID or less. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

2.19 W METER VAULT SIZE RANGE 1 OR 2 This item is for payment for installation of an underground structure for housing of a larger water meter, fittings, and valves as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or access doors, the specified meter(s) valve(s), all piping, and fitting materials associated with installing a functioning meter and vault in accordance with the plans, standard drawings, and specifications, complete and ready for use. The size shall be the measured internal diameter of the meter and piping to be installed. The size meter vault to be paid under size 1 or 2 shall be as follows:

Size Range 1 = All meter and piping sizes greater than 2 inches up to and including 6 inches

Size Range 2 = All meter and piping sizes greater than 6 inches

This item shall be paid EACH (EA) when complete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

2.20 W METER/FIRE SERVICE COMBO VAULT This item is for payment for installation of an underground structure for housing of a water meter and fire

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

service piping, fittings, and valves as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or access doors, the specified meter(s), valve(s), all piping, and fitting materials associated with installing a functioning meter and fire service vault in accordance with the plans and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.21 W METER WITH PRESSURE REDUCING VALVE (PRV)** This item is for payment for installation of all standard water meters with pressure reducing valves (PRV) of all sizes 2 inches ID or less as specified on the plans. This item shall include all labor, equipment, meter, PRV, meter box, casting, yoke, and any other associated material needed for installation of a functioning water meter with PRV in accordance with the plans and specifications, complete and ready for use. This item shall include connections to the new or existing water service line. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.22 W PIPE** This description shall apply to all PVC, ductile iron, and polyethylene/plastic pipe bid items of every size and type to be used as water main, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, sanitizing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall include all temporary and permanent materials and equipment required to pressure test and sanitize mains including, but not limited to, pressurization pumps, hoses, tubing, gauges, main taps, saddles, temporary main end caps or plugs and blocking, main end taps for flushing, chlorine liquids or tablets for sanitizing, water for testing/sanitizing and flushing (when not supplied by the utility), chlorine neutralization equipment and materials, and any other items needed to accomplish pressure testing and sanitizing the main installation. This item shall also include pipe anchors, at each end of polyethylene pipe runs when specified to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- 2.23 W PLUG EXISTING MAIN** This item shall include the specified plug, concrete blocking and/or anchoring, labor, equipment, excavation, backfill, and restoration required to install the plug in an existing in-service main that is to remain at the location shown on the plans or as directed in accordance with the specifications. Any and all plugs on all existing in-service mains shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

NOTE: This utility bid item is not to be paid on new main installations or abandoned mains. This pay item is to plug existing in-service mains only. Plugs on new mains are incidental to the new main just like all other fittings.

NOTE: Plugging of existing abandon mains shall be performed and paid in accordance with Section 708.03.05 of KYTC Standard Specifications For Road And Bridge Construction and paid using Bid Code 01314 Plug Pipe.

- 2.24 W PRESSURE REDUCING VALVE** This description shall apply to all pressure reducing valves (PRV) of every size required in the plans and specifications except those bid items defined as "Special". Payment under this description is to be for PRVs being installed with new main. This item includes the PRV as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), pit or vault, backfill, restoration, testing, disinfection, and etc., required to install the specified PRV at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, PRVs shall be restrained. PRV restraint shall be considered incidental to the PRV and adjoining pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.25 W PUMP STATION** This item is for payment for installation of pumps and an above or below ground structure for housing of the pumps. This item shall include all pumps, piping, fittings, valves, electrical components, building materials, concrete, any other appurtenances, labor, equipment, excavation, and backfill, to complete the pump station installation as required by the plans, standard drawings, and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LUMP SUM (LS) when complete.

- 2.26 W REMOVE TRANSITE (AC) PIPE** This item shall include all labor, equipment, and materials needed for removal and disposal of the pipe as hazardous material. All work shall be performed by trained and certified personnel in accordance with all environmental laws and regulations. Any and all transite AC pipe removed shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- 2.27 W SERVICE LONG SIDE** This bid item description shall apply to all service line installations of every size bid up to and including 2 inch inside diameter, except those service bid items defined as "Special". This item includes the specified piping material, main tap, tapping saddle (if required), and corporation stop materials, coupling for connecting the new piping to the surviving existing piping, encasement of 2 inches or less internal diameter (if required by plan or specification), labor, equipment, excavation, backfill, testing, disinfection, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service installations where the ends of the service connection are on opposite sides of the public roadway and the service line crosses the centerline of the public roadway as shown on the plans. The length of the service line is not to be specified. Payment under this item shall not be restricted by a minimum or maximum length. The contractor shall draw his own conclusions as to the length of piping that may be needed. Payment under this item shall include boring, jacking, or excavating across the public roadway for placement. Placement of a service across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for special bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.28 W SERVICE SHORT SIDE** This bid item description shall apply to all service line installations of every size up to and including 2 inch internal diameter, except those service bid items defined as "Special". This item includes installation of the specified piping material of the size specified on plans, encasement of 2 inches or less internal diameter (if required by plan or specification), main tap, tapping saddle (if required), corporation stop, coupling for connecting the new piping to the surviving existing piping, labor, equipment, excavation, backfill, testing, disinfection, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service installations where both ends of the service connection are on the same side of the public roadway, or when an existing service crossing a public roadway will remain and is being extended, reconnected, or relocated with all work on one side of the public roadway centerline as shown on the plans. The length of the service line is not to be specified and shall not be restricted to any minimum or maximum length. Payment shall be made under this item even if the service crosses a private residential or commercial entrance; but, not a public roadway. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. The contractor shall draw his own conclusions as to the length of piping that may be needed. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- 2.29 W SERVICE RELOCATE** This item is for the relocation of an existing water service line where a meter is not involved, and where an existing service line can easily be adjusted by excavating alongside and moving the line horizontally and/or vertically a short distance without cutting the service line to avoid conflicts with road construction. This item shall include excavation, labor, equipment, bedding, and backfill to relocate the line in accordance with the plans and specifications complete and ready for use. Payment under this item shall be for each location requiring relocation. Payment shall be made under this item regardless of service size or relocation length. No separate pay items will be established for size or length variation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.30 W STRUCTURE ABANDONMENT** This item is to be used to pay for abandonment of larger above or below ground water structures such as meter vaults, fire pits, pump stations, tanks, and etc. Payment under this time shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to water construction, (i.e., abandonment of standard water meters up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted fill or flowable fill for abandonment of the structure in place and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.31 W STRUCTURE REMOVAL** This item is to be used to pay for removal of larger above or below ground water structures such as meter vaults, fire pits, pump stations, tanks, and etc. Payment under this time shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to water construction, (i.e., removal of standard water meters up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted backfill for removal of the structure and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.32 W TAPPING SLEVE AND VALVE SIZE 1 OR 2** This item shall include the specified tapping sleeve, valve, valve box, concrete pad around valve box (when required in specifications or plans), labor, and equipment to install the specified tapping sleeve and valve, complete and ready for use in accordance with the plans and specifications. The size shall be the measured internal diameter of the live pipe to be tapped. The size tapping sleeve and valve to be paid under sizes 1 or 2 shall be as follows:

Size 1 = All live tapped main sizes up to and including 8 inches
Size 2 = All live tapped main sizes greater than 8 inches

Please refer to the Utility Company's Specifications. If the Company does not have

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.33 W TIE-IN** This bid description shall be used for all main tie-in bid items of every size except those defined as "Special". This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, disinfection, testing and backfill required to make the water main tie-in as shown on the plans, and in accordance with the specifications complete and ready for use. Pipe for tie-ins shall be paid under separate bid items. This item shall be paid EACH (EA) when complete.
- 2.34 W VALVE** This description shall apply to all valves of every size required in the plans and specifications except those bid items defined as "Special". Payment under this description is to be for gate or butterfly valves being installed with new main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by specification), restoration, testing, disinfection, and etc., required to install the specified valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, valves shall be restrained. Valve restraint shall be considered incidental to the valve and adjoining pipe. This description does not apply to cut-in valves. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.35 W VALVE ANCHOR EXISTING** This bid item is intended to pay for installation of restraint hardware on an existing valve where no restraint exists to hold the valve in place to facilitate tie-ins and other procedures where restraint is prudent. This work shall be performed in accordance with water specifications and plans. This bid item shall include all labor equipment, excavation, materials and backfill to complete restraint of the designated valve, regardless of size, at the location shown on the plans, complete and ready for use. Materials to be provided may include, but is not limited to, retainer glands, lugs, threaded rod, concrete, reinforcing steel or any other material needed to complete the restraint. Should the associated valve box require removal to complete the restraint, the contractor shall reinstall the existing valve box, the cost of which shall be considered incidental to this bid item. No separate bid items are being provided for size variations. All sizes shall be paid under one bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.36 W VALVE BOX ADJUST** Includes all labor, equipment, valve box and valve stem extensions (if required), excavation, backfill, concrete pad around valve box (when specified in specifications or plans), restoration, and etc., to adjust the top of the box to finished grade complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- 2.37 W VALVE CUT-IN** This bid description is for new cut-in valve installations of all sizes where installation is accomplished by cutting out a section of existing main. This item shall include cutting the existing pipe, supplying the specified valve, couplings or sleeves, valve box, concrete pad around valve box (when required in specifications or plans), labor, equipment, and materials to install the valve at the locations shown on the plans, or as directed by the engineer, complete and ready for use. Any pipe required for installation shall be cut from that pipe removed or supplied new by the contractor. No separate payment will be made for pipe required for cut-in valve installation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.38 W VALVE VAULT** This item is for payment for installation of an underground structure for housing of specific valve(s) as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or doors, the specified valve(s), all piping, and fitting materials associated with installing a functioning valve vault in accordance with the plans, standard drawing, and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.39 S BYPASS PUMPING** This item shall include all labor, equipment, and materials needed to complete a bypass pumping and/or hauling operation for diversion of sewage during sanitary sewer construction. Examples of such operations when bypass pumping and/or hauling may be necessary is during force main tie-ins, manhole invert reconstruction, insertion of new manholes into existing mains, or other similar construction. There may be more than one bypass pumping/hauling operation on a project. This item shall be paid for each separate bypass pumping/hauling operation occurrence as called out on the plans or directed by the engineer and actually performed. There will be no separate bid items defined for length, duration, or volume of sewage pumped or hauled in each occurrence. If a bypass pumping/hauling operation is called out on the plans; but, conditions are such that the bypass pumping/hauling operation is not needed or utilized, no payment will be made under this item. The contractor shall draw his own conclusions as to what labor, equipment, and materials may be needed for each bypass pumping/hauling occurrence. The contractor should be prepared to handle the maximum volume of the sewer being bypassed, even during a storm event. This item shall not be paid separately, but shall be considered incidental, when bypass pumping and/or hauling is needed during cast-in-place-pipe (CIPP) and/or point repair operations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA).
- 2.40 S CIPP LATERAL SERVICE INVESTIGATION** This item shall include all equipment, materials, labor and incidentals necessary to enter the sewer in compliance with all safety/confided space requirements and perform the identification, assessment and pre-measurement of all existing and abandoned

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

laterals for the placement of Cured-In-Place-Pipe lining. This item shall be in payment for all lateral service investigation for all sewer segments to be lined as a part of this contract. This bid item shall include bypass pumping when required. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be LUMP SUM (LS).

- 2.41 S CIPP LATERAL REINSTATEMENT** This item is to pay for installing a Cured-In-Place-Pipe liner in service laterals and service/mainline connections to stabilize structural defects and construction inadequacies. This bid item shall include all labor, equipment, materials and incidentals necessary to perform the service lateral reinstatement in accordance with the plans and specifications. Work under this item shall include bypass pumping, sewer flow control, pre-installation cleaning, sealing connections to existing sewer main, pre- and post- construction CCTV inspection and final testing of the CIPP system. This item shall also include the "top hat" required by the specifications. All CIPP lateral reinstatements shall be paid under this item regardless of the size or length of reinstatement. No separate bid items of varying sizes or length of CIPP lateral reinstatement will be provided in the contract. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be EACH (EA) for each CIPP lateral reinstatement complete and ready for use.
- 2.42 S CIPP LINER** This bid Item is to pay for rehabilitation of existing sanitary sewers using the Cured-In-Place-Pipe method. This bid item description applies to all CIPP sizes included in the contract. All CIPP Liner items of all varying sizes shall include all labor, materials, customer notification, testing, necessary permits, ingress and egress procedures, bypass pumping, pre-construction video, sediment and root removal, dewatering, traffic control, erosion and sediment control, excavation pits, removal and replacement of manhole frames and covers as necessary to facilitate the lining work, sealing at manholes and service connections, clearing and grubbing, pipeline cleaning, re-cleaning and video inspection as many times as necessary, debris collection and disposal, root removal, pre- and post-construction video inspection, all digital inspection footage, final report preparation and approval, the cost of potable water from the Owner, required compliance tests, site restoration, site cleanup, sealing of liner at manholes, acceptance testing and all other rehabilitation work and incidentals not included under other pay items necessary to complete the rehabilitation per the plans and specifications. There will be no separate payment for acceptance testing of the lined pipe; but shall be considered incidental to this item. Pay under this item shall be by each size bid in the contract. Pay measurement shall be from center of manhole to center of manhole. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).
- 2.43 S CIPP PROTRUDING LATERAL REMOVAL** This item includes all equipment, materials, labor and incidentals necessary to enter the sewer in compliance with all safety/confined space requirements, remove a sufficient amount of the protruding tap to insure a proper and safe Cured-In-Place-Pipe lining insertion and perform pre-installation CCTV. This bid item shall include

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

bypass pumping when required. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be EACH (EA) for each protruding lateral removed.

- 2.44 S CONCRETE PIPE ANCHOR** This item shall be constructed on the sewer pipe at the locations shown on the plans in accordance with sanitary sewer specifications and standard drawings. Payment for concrete anchors will be made at the contract unit price each in place complete and ready for use. Each concrete anchor of sewer pipe or force main shall be paid under one bid item per contract regardless of the sizes of carrier pipe being anchored in the contract. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.45 S DIRECTIONAL BORE** Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of force main or gravity sewer under streets, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).
- 2.46 S ENCASEMENT CONCRETE** Includes all labor, equipment, excavation, concrete, reinforcing steel, backfill, restoration, and etc., to construct the concrete encasement of the sewer or force main as shown on the plans, and in accordance with the specifications and standard drawings. Payment under this item shall be in addition to the carrier pipe as paid under separate bid items. Carrier pipe is not included in this bid item. Any and all concrete encasement shall be paid under one bid item included in the contract regardless of the size of the carrier pipe or the volume of concrete or steel reinforcement as specified in the plans and specifications. No separate bid items will be established for size variations. Measurement of pay quantity shall be from end of concrete to end of concrete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.
- 2.47 S ENCASEMENT STEEL BORED** This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

- 2.48 S ENCASEMENT STEEL OPEN CUT** This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to open cut install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The size encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

- 2.49 S FORCE MAIN** This description shall apply to all PVC and ductile iron and polyethylene/plastic pipe bid items of every size and type, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

also include pipe anchors on polyethylene pipe runs as shown on the plans or required by the specifications to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

- 2.50 S FORCE MAIN AIR RLS/VAC VLV** This bid item description shall apply to all force main air release/vacuum valve installations of every size except those defined as "Special". This item shall include the air release/vacuum valve, main to valve connecting line or piping, manhole/vault/structure, access casting or doors, tapping the main, labor, equipment, excavation, proper backfill and restoration required to install the air release/vacuum valve at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. All air release/vacuum valves on a project shall be paid under one bid item regardless of size. No separate pay items will be established for size variations. Only in the case of the uniqueness of a particular air release/vacuum valve would a separate bid item be established. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.51 S FORCE MAIN DIRECTIONAL BORE** Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of sewer or force main under streets, buildings, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).
- 2.52 S FORCE MAIN POINT RELOCATE** This item is intended for payment for horizontal and/or vertical relocation of a short length of an existing main at the locations shown on the plans. This bid item is to be used to relocate an existing force main at point locations such as to clear a conflict at a proposed drainage structure, pipe or any other similar short relocation situation, and where the existing pipe material is to be reused. The contractor shall provide any additional

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

pipe or fitting material needed to complete the work as shown on the plans and specifications. The materials provided shall be of the same type and specification as those that exist. Substitution of alternative materials shall be approved by the engineer in advance on a case by case basis. New polyethylene wrap is to be provided (if wrap exists or is specified in the specifications to be used). If it is necessary that the pipe be disassembled for relay, payment under this item shall also include replacement of joint gaskets as needed. Bedding and backfill shall be provided and performed the same as with any other pipe installation as detailed in the plans and specifications. Payment under this item shall be for each location requiring an existing main to be relocated horizontally or vertically regardless of pipe size or relocation length. No separate pay items will be established for pipe size variations or relocation segment length variations. Force Main Relocate shall not be paid on a linear feet basis; but shall be shall be paid EACH (EA) at each location when complete and placed in service. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

- 2.53 S FORCE MAIN TAP SLEEVE/VALVE RANGE 1 OR 2** This item shall include the specified tapping sleeve, valve, valve box, concrete pad around valve box (when required in specifications or plans), labor, and equipment to install the specified tapping sleeve and valve, complete and ready for use in accordance with the plans and specifications. The size shall be the measured internal diameter of the live pipe to be tapped. The size tapping sleeve and valve to be paid under sizes 1 or 2 shall be as follows:

Range 1 = All live tapped main sizes up to and including 8 inches

Range 2 = All live tapped main sizes greater than 8 inches

Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.54 S FORCE MAIN TIE-IN** This bid description shall be used for all force main tie-in bid items of every size except those defined as "Special". This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, testing and backfill required to make the force main tie-in as shown on the plans and in accordance with the specifications complete and ready for use. This bid item shall include purge and sanitary disposal of any sewage from any abandoned segments of force main. Pipe for tie-ins shall be paid under separate bid items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.55 S FORCE MAIN VALVE** This description shall apply to all force main valves of every size required in the plans and specifications, except those bid items defined as "Special". Payment under this description is to be for gate or butterfly force main valves being installed with new force main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

specification), restoration, testing, and etc., required to install the specified valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, force main valves shall be restrained. Force main valve restraint shall be considered incidental to the force main valve and adjoining pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.56 S FORCE MAIN VALVE BOX ADJUST** Includes all labor, equipment, valve box and valve stem extensions (if required), excavation, backfill, concrete pad around valve box (when specified in specifications or plans), restoration, and etc., to adjust the top of the force main valve box to finished grade complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.57 S LATERAL CLEANOUT** This item shall be for payment for installation of a cleanout in a service lateral line. This item shall include furnishing and installation of a tee, vertical pipe of whatever length required, and threaded cap. The cleanout shall extend from the lateral to final grade elevation. The size of the cleanout shall be equivalent to the size of the lateral. The cleanout materials shall meet the same specification as those for the lateral. The cleanout shall be installed at the locations shown on the plans or as directed by the engineer. Only one pay item shall be established for cleanout installation. No separate pay items shall be established for size or height variances. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.58 S LATERAL LOCATE** This bid item is to pay for all labor, equipment, and materials needed in locating an existing sanitary sewer service lateral for tie-in of the lateral to new mainline sewers and/or for the relocation of a lateral. This bid item shall be inclusive of any and all methods and efforts required to locate the lateral for tie-in or relocation of the lateral. Locating methods to be included under this items shall include, but are not limited to, those efforts employing the use of video cameras from within an existing sanitary sewer main or lateral, electronic locating beacons and/or tracers inserted into the sanitary sewer main or lateral, careful excavation as a separate operation from mainline sewer or lateral excavation, the use of dyes to trace the flow of a lateral, or any combination of methods required to accurately locate the lateral. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA).
- 2.59 S LATERAL LONG SIDE** This bid item description shall apply to all service lateral installations of every size up to and including 6 inch internal diameter, except those lateral bid items defined as "Special". This item includes the specified piping material, main tap, bends, clean outs, labor, equipment,

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

excavation, backfill, testing, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service lateral installations where the ends of the lateral connection are on opposite sides of the public roadway. The new lateral must cross the centerline of the public roadway to qualify for payment as a long side lateral. The length of the service lateral is not to be specified. Payment under this item shall not be restricted by a minimum or maximum length. The contractor shall draw his own conclusions as to the length of piping that may be needed. Payment under this item shall include boring, jacking, or excavating across the public roadway for placement. Placement of a service lateral across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.60 S LATERAL SHORT SIDE** This bid item description shall apply to all service lateral installations of every size up to and including 6 inch, except those lateral bid items defined as "Special". This item includes the specified piping material, main tap tee, bends, clean outs, labor, equipment, excavation, backfill, testing, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for lateral installations where both ends of the lateral connection are on the same side of the public roadway, or when an existing lateral crossing a public roadway will remain and is being extended, reconnected, or relocated with all work on one side of the public roadway centerline as shown on the plans. The length of the service lateral is not to be specified and shall not be restricted to any minimum or maximum length. Payment shall be made under this item even if the lateral crosses a private residential or commercial entrance; but, not a public roadway. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. The contractor shall draw his own conclusions as to the length of piping that may be needed. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.61 S LINE MARKER** This item is for payment for furnishing and installing a sewer utility line marker as specified by the utility owner specifications and plans. A line marker may consist of a post or monument of whatever materials specified and shall include markings and/or signage on same as specified by plans or specifications. This item shall include all labor, equipment, and materials needed for complete installation of the marker. This item shall be paid EACH (EA) when complete.
- 2.62 S MANHOLE** Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole. Payment for manholes will be made at the

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Manholes shall include concrete base, barrel sections, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup in accordance with the specifications and standard drawings. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.63 S MANHOLE ABANDON/REMOVE** Payment under this item is for the partial removal and/or filling of any sanitary sewer manhole regardless of size or depth that no longer serves any purpose. Payment shall be made regardless of whether the manhole is or is not in conflict with other work. Any manhole requiring partial removal, but not total removal, in order to clear a conflict with other work shall be paid under this item. All manholes partially removed shall be removed to a point at least one foot below final grade, one foot below roadway subgrade, or one foot clear of any other underground infrastructure, whichever is lowest. If partial removal of an abandoned manhole is elected by the contractor, the remaining manhole structure shall be refilled with flowable fill. Payment for disposal of a sanitary sewer manhole will be made under this item only. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.64 S MANHOLE ADJUST TO GRADE** Payment under this item is for the adjustment of sanitary sewer casting elevation on all sizes of existing sanitary manholes. This work shall be performed in accordance with the sanitary sewer specifications. Payment shall be made under this bid item regardless of the amount of adjustment necessary to a sanitary sewer manhole casting or diameter of the manhole. Work under this pay item may be as simple as placing a bed of mortar under a casting; but, shall also be inclusive of installation of adjusting rings, and /or addition, removal, or replacement of barrel sections. The existing casting is to be reused unless a new casting is specified on the plans. New casting, when specified, shall be paid as a separate bid item. Anchoring of the casting shall be incidental to this item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.65 S MANHOLE CASTING STANDARD** Payment under this bid items is for furnishing of a new standard traffic baring casting for sanitary manholes meeting the requirements of the sanitary sewer specifications and standard drawings. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when installed.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- 2.66 S MANHOLE CASTING WATERTIGHT** Payment under this bid item is for furnishing of a new watertight traffic baring casting for sanitary manholes meeting the requirements of the sanitary sewer specifications and standard drawings. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when installed.
- 2.67 S MANHOLE RECONSTRUCT INVERT** This bid item is to pay for all labor, equipment, and material for rework of the manhole bench to redirect or eliminate flow, such as when the flow of a pipe or pipes are being removed or redirected. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in elimination or redirect of flow. This item shall also include providing and placement of a rubber seal or boot as required by utility specification, standard drawing or plan. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the specifications, standard drawings, and plans. No payment shall be made under this bid when MANHOLE TAP EXISTING, or MANHOLE TAP EXISTING ADD DROP are being paid at the same location, as this type of work is included in those items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.68 S MANHOLE TAP EXISTING** This bid item is to pay for all labor, equipment, and material for coring one opening in an existing manhole base, addition of a rubber seal as specified, and rework of the manhole bench to direct the additional pipe flow. The bid item shall be paid for each core opening added to a single manhole. This bid item shall also include any rework of the existing manhole bench due to the elimination of other existing pipes and flow. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in the addition, elimination, or redirect of flow. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the specifications, standard drawings, and plans. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.69 S MANHOLE TAP EXISTING ADD DROP** This bid item is to pay for all labor, equipment, and material for coring one opening in an existing manhole base, addition of a rubber seal as specified, addition of a vertical drop pipe to the outside of the manhole, placement of reinforcing steel and concrete to encase vertical pipe, and rework of the manhole bench to direct the additional pipe flow. The bid item shall be paid for each drop added to a single manhole. This bid item shall also include any rework of the existing manhole bench due to the elimination of other existing pipes and flow. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in the addition, elimination, or redirect of flow. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

specifications, standard drawings, and plans. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.70 S MANHOLE WITH DROP** Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole with drop. Payment for drop manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Drop manholes shall include concrete base, barrel sections, drop materials, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.71 S MANHOLE WITH LINING** Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole with corrosion resistant lining. Payment for manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Manholes shall include concrete base, barrel sections, cone section or slab top, steps, lining, excavation, backfilling, air testing, restoration, and cleanup in accordance with the standard drawings. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- 2.72 S MANHOLE WITH TRAP** Payment under this item is for the installation of a new manhole with trap. Payment for trap manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Trap manholes shall include concrete base, manhole structure and trap materials, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup. All materials, except casting, shall be new and unused. Payment shall be made under this item regardless of whether the base is to be precast or cast-

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

in-place (doghouse). An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- 2.73 S PIPE** This description shall apply to all PVC and ductile iron gravity sewer pipe bid items of every size and type 8 inches internal diameter and larger, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, tap tees and couplings for joining to existing similar or dissimilar pipes), polyethylene wrap (if required by specification), labor, equipment, excavation, bedding, restoration, pressure or vacuum testing, temporary testing materials, video inspection, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. This bid item shall include material and placement of flowable fill under existing and proposed pavement, and wherever specified on the plans or in the specifications. No additional payment will be made for rock excavation. Measurement of quantities under this item shall be through fittings and encasements to a point at the outside face of manhole barrels, or to the point of main termination at dead ends or lamp holes. Carrier pipe placed within an encasement shall be paid under this item and shall include casing spacers and end seals. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).
- 2.74 S PIPE POINT REPAIR** This item is to be used to pay for repair of short lengths of existing sanitary sewer pipe that, through prior video inspection or other means, are known to have pre-existing failure. Pipe Point Repair may be needed in preparation for installation of cured-in-place-pipe (CIPP) lining or other instances where failure is known and repair is prudent. The size of pipe shall not be defined in separate bid items. All diameter sizes of point repair shall be paid under this one item. The materials to be used to make the repair shall be as defined on the plans or in the specifications. This bid item shall include all excavation, pipe materials, joining materials to connect old and new pipe, bedding, and backfill to complete the repair at the locations shown on the plans or as directed by the engineer, complete and ready for use. This bid item shall include bypass pumping when required. Measurement shall be from contact point to contact point of old and new pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).
- 2.75 S PUMP STATION** This item is for payment for installation of sanitary pump stations including above or below ground structure for housing of the pumps. This item shall include all pumps, piping, fittings, valves, electrical components, building materials, concrete, any other appurtenances, labor, equipment,

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

excavation, and backfill, to complete the pump station installation as required by the plans, standard drawings, and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LUMP SUM (LS) for each when complete.

2.76 S STRUCTURE ABANDON This item is to be used to pay for abandonment of larger above or below ground sewer structures such as air release/vacuum valve vaults, pump stations, tanks, etc. Payment under this time shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to sewer construction, (i.e., abandonment of standard air release/vacuum valves up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted fill or flowable fill for abandonment of the structure in place and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

2.77 S STRUCTURE REMOVAL This item is to be used to pay for removal of larger above or below ground sewer structures such as air release/vacuum valve vaults, pump stations, tanks, and etc. Payment under this time shall not be limited to size or scope; however, structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to sewer construction, (i.e., removal of standard air release/vacuum valves and their structure up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted backfill for removal of the structure and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

PART 3 QUANTITIES OF ESTIMATE

- A. Wherever the estimated quantities of work to be done and materials to be furnished under this contract are shown in any of the documents, including the Bid Proposal, they are given for use in comparing bids and the right is especially reserved except as herein otherwise specifically limited, to increase or diminish them as may be deemed reasonably necessary or desirable by the Owner to complete the work contemplated by this contract, and such increase or diminution shall not give cause for claims or liability for damages. The Engineer will not be financially responsible for any omissions from the Contract Documents and therefore not included by the Contractor in his proposal.
- B. Aerial photographs utilized for plan sheets in the Contract Documents are indicated at an approximate scale and shall not be scaled for quantity take-offs. The quantities listed in the bid schedule are given for use in comparing bids and may not be the actual quantities to be installed. It is

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

the Contractor's responsibility to field verify the bid item quantities to be installed prior to the ordering of materials. Payment on unit price contracts are based on actual quantities installed. The Owner or Engineer will not be financially responsible for any shortage of the bid items or overrun of bid items ordered for the quantities.

- C. The actual quantities of all materials to be used for this project shall be field verified prior to the Contractor ordering the necessary materials. The quantity listed in the bid schedule is given for use in comparing bids and may increase or diminish as may be deemed necessary or as directed by the Owner. Any such increase or diminution shall not give cause for claims or liability for damages. The Engineer or Owner will not be financially responsible for any charges incurred for restocking of materials ordered.

Qualifications and Warranty

- A. The utility contractor shall be qualified to perform the utility work in accordance with the utility plans and specifications. The contractor shall have a history of utility work with at least five (5) years utility installation experience. The utility contractor shall be knowledgeable of utility installation methods and requirements. The utility contractor shall be able to supply three (3) references of prior utility construction projects if requested by the owner.
- B. The utility contractor shall provide a written warranty to the utility owner for a period of one (1) year from the date of the contractor's final payment.

- END OF SECTION -

SECTION 01300

SUBMITTALS

PART 1 GENERAL

1.01 DESCRIPTION OF REQUIREMENTS

A. This section specifies the general methods and requirements of submissions applicable to the following WORK-related submittals:

1. General Procedures for Submittals
2. Construction Schedule
3. Schedule of Values and Payments
4. Schedule of SHOP DRAWING Submittals
5. SHOP DRAWINGS, Product Data, Samples and O&M Instructions
6. Construction Photographs
7. Test Reports
8. Manufacturer's Certificates
9. Manufacturer's Instructions
10. Contractor's Responsibility
11. Submission Requirements
12. Resubmission Requirements

Additional general submissions requirements are contained in paragraphs 5.1 through 5.7 of the General Conditions. The CONTRACTOR is responsible for the submittal of all weekly payrolls, monthly utilization and other required forms and reports, including reports and forms from his SUBCONTRACTORS. The prompt submittal of all required reports and forms will help to insure the timely processing of pay request. Detailed submittal requirements will be specified in the technical SPECIFICATIONS sections.

1.02 GENERAL PROCEDURES FOR SUBMITTALS

A. Coordination of Submittal Times:

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

The CONTRACTOR shall prepare and transmit each submittal sufficiently in advance of performing the related WORK or other applicable activities, or within the time specified in the individual WORK section of the SPECIFICATIONS, so that the installation will not be delayed by processing times including disapproval and re-submittal (if required), coordination with other submittals, testing, purchasing, fabrication, delivery and similar sequenced activities. No extension of time will be authorized because of the WORK.

1.03 CONSTRUCTION SCHEDULE

- A. In addition to the progress schedule requirements specified in Article 3 of the General Conditions, the CONTRACTOR shall, within ten (10) days after the NOTICE TO PROCEED provide and submit to the ENGINEER for review the schedule he plans to maintain in order to successfully construct the WORK within the time allotted. The schedule shall account for all WORK of the CONTRACTOR and his SUBCONTRACTORS.
- B. The CONTRACTOR shall update the schedule information monthly and submit the update information to the ENGINEER at the same time the pay estimate is prepared. The schedule shall contain all of the items of the periodic estimate and pay schedule.
- C. The CONTRACTOR bears full responsibility for scheduling all phases and stages of the WORK including his SUBCONTRACTOR WORK to insure its successful prosecution and completion within the time specified in accordance with all provisions of these SPECIFICATIONS.
- D. Refer to Section 01310 for additional requirements.

1.04 SCHEDULE OF VALUES AND PAYMENTS

- A. Within the (10) days after award of the Contract the CONTRACTOR shall submit to the OWNER in triplicate, a breakdown of the pay items, including a schedule of values and a schedule of payments. This breakdown shall be subject to approval by the OWNER, and when so approved shall become the basis for determining progress payments and for negotiation of CHANGE ORDERS, if required.

1.05 SCHEDULE OF SHOP DRAWING SUBMITTALS

- A. The CONTRACTOR shall, within ten (10) days after the NOTICE TO PROCEED provide and submit to the ENGINEER for review a SCHEDULE OF SHOP DRAWING SUBMITTALS. The schedule shall account for all materials used by the CONTRACTOR and his SUBCONTRACTORS.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- B. The schedule shall be organized to reflect the respective specification division under which it applies.

1.06 SHOP DRAWINGS, PRODUCT DATA AND SAMPLES

A. Shop Drawings

1. SHOP DRAWINGS, as defined in the General Conditions, and as specified in the technical SPECIFICATIONS include, but are not necessarily limited to custom-prepared data such as fabrication and erection/installation DRAWINGS, scheduled information, setting diagrams, actual shop WORK manufacturing instructions, custom templates, special wiring diagrams, coordination DRAWINGS, individual system of equipment inspection and test reports including performance curves and certifications, as applicable to the WORK.
2. All details on SHOP DRAWINGS submitted for review shall show clearly the relation of the various parts to the main member and lines of the structure, and where correct fabrication of the WORK depends upon field measurements, such measurements shall be made and noted on the SHOP DRAWINGS before being submitted for review by the ENGINEER.
3. Unless otherwise specified, the CONTRACTOR is not required to resubmit SHOP DRAWINGS on existing equipment. The CONTRACTOR shall, however, be responsible for obtaining all SHOP DRAWINGS and/or other information from the manufacturer necessary to complete the installation and startup of existing equipment.

B. Product Data

1. Product data as specified in individual sections, include, but are not necessarily limited to, standard prepared data for manufactured products (sometimes referred to as catalog data), such as the manufacturer's product specification and installation instructions, availability of colors and patterns, manufacturer's printed statements of compliances and applicability, roughing-in diagrams and templates, catalog cuts, product photographs, standard wiring diagrams, printed performance curves and operational-range diagrams, production or quality control inspection and test reports and certifications, mill reports, product operating and maintenance instructions and recommended spare parts listing, and printed product warranties, as applicable to the WORK.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

C. Samples

1. Samples specified in individual sections, included, but are not necessarily limited to, physical examples of the WORK such as sections of manufactured or fabricated WORK, small cuts or containers of materials, complete units of repetitively-used products, color/texture/pattern swatches and range sets, specimens for coordination of visual effects, graphic symbols, and units of WORK to be used by the ENGINEER or OWNER for independent inspection and testing, as applicable to the WORK.

1.07 CONSTRUCTION PHOTOGRAPHS

A. Miscellaneous photographs as directed by the ENGINEER or OWNER.

1. Photographs are required on this PROJECT and are the responsibility of the CONTRACTOR. Photographs shall be 3" x 5" color snapshots taken with a standard 35mm camera, or a digital camera with 8 MP minimum. CONTRACTOR shall be responsible for the taking, development, labeling and organizing of the photographs. All photographs shall be identified as to location, date and subject matter. Photographs shall be arranged in a photo album(s) by location, subject matter and date taken. Upon completion of the project, the CONTRACTOR shall supply the OWNER with the negatives or digital photo files. The later, if provided, shall be supplied on CD media in .jpg format.
2. No pay item has been set up for the photographs. The CONTRACTOR shall allow for a minimum of 200 - 3" x 5" color photographs (taken and arranged as outlined above) in his BID.

1.08 TEST REPORTS

- A. Submit for the Architect/Engineer's knowledge as contract administrator or for the Owner.
- B. Submit test reports for information for the limited purpose of assessing conformance with information given and the design concept expressed in the contract documents.

1.09 MANUFACTURER'S CERTIFICATES

- A. When specified in individual specification sections, submit certification by the manufacturer, installation/application subcontractor, or the Contractor to Architect/Engineer, in quantities specified for Product Data.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- B. Indicate material or Product conforms to or exceeds specified requirements. Submit supporting reference data, affidavits, and certifications as appropriate.
- C. Certificates may be recent or previous test results on material or Product, but must be acceptable to Architect/Engineer.

1.10 MANUFACTURER'S INSTRUCTIONS

- A. When specified in individual specification sections, submit printed instructions for delivery, storage, assembly, installation, start-up, adjusting, and finishing, to Architect/Engineer for delivery to owner in quantities specified for Product Data.

1.11 CONTRACTOR'S RESPONSIBILITY

- A. The CONTRACTOR shall review SHOP DRAWINGS, product data and samples prior to submission to determine and verify the following:
 - 1. Field measurements
 - 2. Field construction criteria
 - 3. Catalog numbers and similar data
 - 4. Conformance with the SPECIFICATIONS
- B. All SHOP DRAWINGS submitted by SUBCONTRACTORS for review shall be sent directly to the CONTRACTOR for preliminary checking. The CONTRACTOR shall be responsible for their submission at the proper time so as to prevent delays in delivery of materials.
- C. The CONTRACTOR shall check all SUBCONTRACTOR'S SHOP DRAWINGS regarding measurements, size of members, materials, and details to satisfy himself that they conform to the intent of the DRAWINGS and SPECIFICATIONS. DRAWINGS found to be inaccurate or otherwise in error shall be returned to the SUBCONTRACTORS for correction before submission thereof.
- D. Each shop drawing, WORKING drawing, sample and catalog data submitted by the CONTRACTOR shall have affixed to it a certification statement, signed by the CONTRACTOR. The certification shall state that the CONTRACTOR represents that he has determined and verified all field measurements, field construction criteria, materials, dimensions, catalog numbers and similar data and has checked and coordinated each item with other applicable review SHOP DRAWINGS and all Contract requirements.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- E. The CONTRACTOR shall notify the OWNER in writing, at the time of submittal, of any deviations in the submittals from the requirements of the CONTRACT DOCUMENTS.
- F. The CONTRACTOR should include the notation "Critical Path" on critical path submittals.
- G. The review of SHOP DRAWINGS, samples or catalog data by the ENGINEER shall not relieve the CONTRACTOR from his responsibility with regard to the fulfillment of the terms of the Contract.
- H. No portion of the WORK requiring a shop drawing, WORKING drawing, sample or catalog data shall be started nor shall any materials be fabricated or installed prior to the review or qualified review SHOP DRAWINGS and data shall be at the CONTRACTOR'S risk. The OWNER will not be liable for any expense or delay due to corrections or remedies required to accomplish conformity.
- I. PROJECT WORK, materials, fabrication, and installation shall conform with reviewed SHOP DRAWINGS, WORKING DRAWINGS, applicable samples, and catalog data.

1.12 SUBMISSION REQUIREMENTS

- A. The CONTRACTOR shall make submittals promptly in accordance with the accepted schedule, and in such sequence as to cause no delay in the WORK or in the WORK of any other CONTRACTOR.
- B. Number of submittals required:
 - 1. SHOP DRAWINGS: Submit six (6) copies.
 - 2. Operation and Maintenance Instructions: Submit six (6) copies.
- C. Submittals shall contain:
 - 1. The date of submission and the dates of any previous submissions.
 - 2. The PROJECT title, contract number, and submittal number.
 - 3. CONTRACTOR identification.
 - 4. The names of:
 - a. CONTRACTOR

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- b. SUPPLIER
 - c. Manufacturer
 - 5. Identification of the product, with the specification section number.
 - 6. Field dimensions, clearly identified as such.
 - 7. Relation to adjacent or critical features of the WORK or materials.
 - 8. Applicable standards, such as ASTM or Federal Specification numbers.
 - 9. Identification of revisions on re-submittals.
 - 10. An 8-inch x 3-inch blank space for CONTRACTOR'S and ENGINEER'S stamps.
- D. Submittals shall be clear and legible. Submittals with facsimile copies will be automatically rejected.

1.13 RESUBMISSION REQUIREMENTS

- A. The CONTRACTOR shall make any corrections or changes in the submittals required by the ENGINEER and resubmit until accepted, in accordance with the following:
- 1. SHOP DRAWINGS and Product Data:
 - a. Revise initial DRAWINGS or data, and resubmit as specified for the initial submittal.
 - b. Indicate any changes which have been made other than those requested by the ENGINEER.
 - 2. Samples:
 - a. Submit new samples as required for initial submittal.

PART 2 PRODUCTS

Not Used.

PART 3 EXECUTION

Not Used.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

END OF SECTION

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

SECTION 01310

PROGRESS SCHEDULES

PART 1 GENERAL

1.01 GENERAL

A. Scheduling Responsibilities

1. In order to provide a definitive basis for determining job progress, a construction schedule of a type approved by the OWNER will be used to monitor the PROJECT.
2. The CONTRACTOR shall be responsible for preparing the schedule and updating on a monthly basis. It shall at all times remain the CONTRACTOR'S responsibility to schedule and direct his forces in a manner that will allow for the completion of the WORK within the contractual period.

B. Construction Hours

1. No WORK shall be done between 8:00 p.m. and 7:00 a.m. nor on Sundays or legal holiday without the written permission of the OWNER. However, emergency work may be done without prior written permission.
2. If the CONTRACTOR, for his convenience and at no additional cost to the OWNER, should desire to carry on his WORK at night or outside the regular hours, he shall submit a written request to the ENGINEER and shall allow nine (9) days for satisfactory arrangements to be made for inspecting the WORK in progress. If permission is granted, the CONTRACTOR shall light the different parts of the PROJECT as required to comply with all applicable Federal, State and local regulations. The CONTRACTOR shall also revise his schedule as appropriate at the next monthly schedule update meeting to reflect the changes in working hours.

C. Progress of the WORK

1. The WORK shall be started within ten (10) days following the NOTICE TO PROCEED and shall be executed with such progress as may be required to prevent delay to other CONTRACTORS or to the general completion of the PROJECT. The WORK shall be executed at such times and in or on such parts of the PROJECT, and with such forces, material and equipment, to assure completion of the WORK in the time established by the Contract.
2. The CONTRACTOR agrees that whenever it becomes apparent from the current monthly Schedule update that delays have resulted and, hence,

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

that the Contract completion date will not be met or when so directed by the OWNER, he will take some or all of the following actions at no additional cost to the OWNER.

- (a) Increase construction manpower in such quantities and crafts as will substantially eliminate the backlog of WORK.
- (b) Increase the number of working hours per shift, shifts per working day or days per week, the amount of construction equipment, or any combination of the foregoing to substantially eliminate the backlog of WORK.
- (c) Reschedule activities to achieve maximum practical concurrence of accomplishment of activities, and comply with the revised schedule.
- (d) The CONTRACTOR shall submit to the OWNER or the OWNER'S representative for review a written statement of the steps he intends to take to remove or arrest the delay to the critical path in the accepted schedule. If the CONTRACTOR should fail to submit a written statement of the steps he intends to take or should fail to take such steps as required by the Contract, the OWNER may direct the level of effort in manpower (trades), equipment, and work schedule (overtime, weekend and holiday work, etc.), to be employed by the CONTRACTOR in order to remove or arrest the delay to the critical path in the accepted schedule, and the CONTRACTOR shall promptly provide such level of effort at no additional cost to the OWNER.

1.02 CONSTRUCTION SCHEDULE

A. Schedule Submissions

1. With ten (10) calendar days of the NOTICE TO PROCEED, the CONTRACTOR shall submit to the ENGINEER five (5) copies of his proposed schedule. The schedule will be the subject of a schedule review meeting with the CONTRACTOR, the ENGINEER and the OWNER or the OWNER'S representative within one (1) week of its submission. The CONTRACTOR will revise and resubmit schedule until it is acceptable and accepted by the OWNER or the OWNER'S representative.

1.03 SCHEDULE UPDATES

A. Monthly Meetings

1. A monthly Schedule Update Meeting will be held in conjunction with the applicable progress meeting at the construction site to review and update the Schedule. The Schedule Update Meetings

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

will be chaired by the OWNER or the OWNER'S representative and attended by the CONTRACTOR and the ENGINEER. Actual progress of the previous month will be recorded and future activities will be reviewed. The duration of activities and their logical connections may be revised as needed. Decisions made at these meetings and agreed to by all parties are binding with the exception that no contractual completion dates will be modified without formal written requests and acceptance as specified herein.

B. Conditions Requiring Revisions are as follows:

1. When a delay in completion of any WORK item or sequence of WORK items results in an extension of the PROJECT completion.
2. When delays in submittals or deliveries or work stoppages are encountered which make re-planning or rescheduling of the WORK necessary.
3. When the schedule does not represent the actual prosecution and progress of the PROJECT.

1.04 CONTRACT COMPLETION TIME

A. Causes for Extensions

1. The Contract completion time will be adjusted only for cause specified in this Contract. In the event the CONTRACTOR requests an extension of any Contract completion date, he shall furnish such justification and supporting evidence as the OWNER or the OWNER'S representative may deem necessary for a determination as to whether the CONTRACTOR is entitled to an extension of time under the provision of this Contract. The OWNER, with the assistance of ENGINEER and OWNER'S representative, will, after receipt of such justification and supporting evidence, make findings of fact and will advise the CONTRACTOR in writing thereof.

B. Request for Time Extension

1. Each request for change in any Contract completion date shall be initially submitted to the OWNER within the time frame stated in the General Conditions. All information known to the CONTRACTOR at that time concerning the nature and extent of the delay shall be transmitted to the OWNER at that time. Within the time frame stated in the General Conditions but before the date of final payment under this Contract, all information as required above concerning the delay must be submitted to the

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

OWNER. No time extension will be granted for requests which are not submitted within the foregoing time limits.

END OF SECTION

SECTION 01788

PROJECT RECORD DOCUMENTS

PART 1 GENERAL

1.01 SUMMARY

- A. Maintain at site one record copy of:
 - 1. Drawings.
 - 2. Project Manual.
 - 3. Addenda.
 - 4. Change orders and other modifications to Contract.
 - 5. ENGINEER field orders, written instructions, or clarifications.
 - 6. Approved submittals.
 - 7. Field test records.
 - 8. Construction photographs.
 - 9. Associated permits.
 - 10. Certificates of inspection and approvals.

1.02 SUBMITTALS

- A. At Substantial Completion:
 - 1. Deliver one marked up set of Drawings to ENGINEER for use in preparation of record drawings.
- B. Accompany submittals with transmittal letter containing following.
 - 1. Date.
 - 2. Project title and number.
 - 3. CONTRACTOR'S name and address.
 - 4. Title of record document.
 - 5. Signature of CONTRACTOR or authorized representative.

PART 2 PRODUCTS

(Not Used)

PART 3 EXECUTION

3.01 MAINTENANCE OF DOCUMENTS AND SAMPLES

- A. Store documents and samples in CONTRACTOR'S field office on-site apart from documents used for construction.
 - 1. Provide files and racks for storage of documents.
 - 2. Provide secure storage space for storage of samples.
- B. Maintain documents in clean, dry, legible condition and in good order. Do not use record documents for construction purposes.
- C. Make documents and samples available for inspection by ENGINEER or OWNER.
- D. Failure to properly maintain record documents may be reason to delay a portion of progress payments until records comply with Contract Documents.

3.02 RECORD DOCUMENTS

- A. Label each document "PROJECT RECORD" in neat, large printed letters.
- B. Maintain record set of Drawings and Specifications legibly annotated to show all changes are made during construction.
 - 1. Graphically depict changes by modifying or adding to plans, details, sections, elevations, or schedules.
 - 2. Make changes on each sheet affected by changes.
- C. Record information concurrently with construction progress.
 - 1. Do not conceal Work until required information is recorded.
 - 2. Record changes made by Written Amendment, Field Order, Change Order or Work Directive Change.
 - 3. Give particular attention to concealed equipment and materials that would be difficult to measure and record at later date.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

D. Drawings:

1. Graphically depict changes by modifying or adding to plans, details, sections, elevations, or schedules.
2. Make changes on each sheet affected by changes.
3. Dimensions:
 - a. Depths of various elements of foundation in relation to finish first floor datum.
 - b. Horizontal and vertical locations of underground utilities and appurtenances, referenced to permanent surface improvements.
4. Location of internal utilities and appurtenances concealed in construction, referenced to visible and accessible features of structure.
5. Details not on original Drawings.
6. Location and identification of exposed interior piping, including those shown schematically on Drawings.
7. Size of equipment and location including connections.
8. Electrical and Instrumentation:
 - a. Horizontal and vertical locations and size of underground cable, conduit, and duct runs dimensioned from established building lines.
 - b. Plan location and size of interior concealed and exposed feeders.
 - c. Size and location of access panels.
 - d. Variations from original Drawings.

E. Specifications:

1. Mark Specification sections to show substantial variations in actual Work performed in comparison with text of Specifications and modifications.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

2. Include variations in products delivered to site and from manufacturer's installation instructions and recommendations.
3. Give particular attention to substitutions and selection of options and similar information.
4. Note related record drawing information and Product Data.

END OF SECTION

SECTION 02320

HORIZONTAL DIRECTIONAL DRILLING

PART 1 GENERAL

1.01 SECTION DESCRIPTION

The work specified in this section consists of furnishing and installing underground utilities using the horizontal directional drilling (HDD) method of installation, also commonly referred to as directional boring or guided horizontal boring. This work shall include all services, equipment, materials, and labor for the complete and proper installation, testing, restoration of underground utilities and environmental protection and restoration.

1.02 REFERENCES

Specification 02600 – High Density Polyethylene (HDPE) Pipe and Fittings shall be used as a reference.

1.03 QUALITY ASSURANCE

The requirements set forth in this document specify a wide range of procedural precautions necessary to insure that the very basic, essential aspects of a proper directional bore installation are adequately controlled. Strict adherence shall be required under specifically covered conditions outlined in this specification. Adherence to the specifications contained herein, or the Engineer's approval of any aspect of any directional bore operation covered by this specification, shall in no way relieve the Contractor of their ultimate responsibility for the satisfactory completion of the work authorized under the Contract.

1.04 SUBMITTALS

A. WORK PLAN

Prior to beginning work, the Contractor must submit to the Engineer a general work plan outlining the procedure and schedule to be used to execute the project. Plan should document the thoughtful planning required to successfully complete the project.

B. EQUIPMENT

Contractor will submit specifications on directional drilling equipment to be used to ensure that the equipment will be adequate to complete the project.

C. MATERIALS

Specifications on material to be used shall be submitted to Engineer. Material shall include the pipe, fittings and any other item which is to be an installed component of the project.

PART 2 EQUIPMENT REQUIREMENTS

2.01 EQUIPMENT

The directional drilling equipment shall consist of a directional drilling rig of sufficient capacity to perform the bore and pullback the pipe, a drilling fluid mixing & delivery system of sufficient capacity to successfully complete the crossing, a guidance system to accurately guide boring operations and trained and competent personnel to operate the system. All equipment shall be in good, safe operating condition with sufficient supplies, materials and spare parts on hand to maintain the system in good working order for the duration of this project.

2.02 DRILLING SYSTEM

A. DRILLING RIG

The directional drilling machine shall consist of a hydraulically powered system to rotate, push and pull hollow drill pipe into the ground at a variable angle while delivering a pressurized fluid mixture to a guidable drill (bore) head. The machine shall be anchored to the ground to withstand the pulling, pushing and rotating pressure required to complete the crossing. The hydraulic power system shall be self-contained with sufficient pressure and volume to power drilling operations. Hydraulic system shall be free of leaks. Rig shall have a system to monitor and record maximum pull-back pressure during pull-back operations.

B. DRILL HEAD

The drill head shall be steerable by changing its rotation and shall provide the necessary cutting surfaces and drilling fluid jets.

C. MUD MOTORS (if required)

Mud motors shall be of adequate power to turn the required drilling tools.

D. DRILL PIPE

Shall be constructed of high quality 4130 seamless tubing, grade D or better, with threaded box and pins. Tool joints should be hardened to 32-36 RC.

2.03 GUIDANCE SYSTEM

The Guidance System shall be of a proven type and shall be setup and operated by personnel trained and experienced with this system. The Operator shall be aware of any magnetic anomalies and shall consider such influences in the operation of the guidance system if using a magnetic system.

2.04 DRILLING FLUID (MUD) SYSTEM

A. MIXING SYSTEM

A self-contained, closed, drilling fluid mixing system shall be of sufficient size to mix and deliver drilling fluid composed of bentonite clay, potable water and appropriate additives. Mixing system shall be able to molecularly shear individual bentonite particles from the dry powder to avoid clumping and ensure thorough mixing. The drilling fluid reservoir tank shall be sized for adequate storage of the mud. Mixing system shall continually agitate the drilling fluid during drilling operations.

B. DRILLING FLUIDS

Drilling fluid shall be composed of clean water and an appropriate additive. Water shall be from a clean source with a pH of 8.5 – 10 and/or as per mixing requirements of the Manufacturer. Water of a lower pH or with excessive calcium shall be treated with the appropriate amount of sodium carbonate or equal. The water and additives shall be mixed thoroughly and be absent of any clumps or clods. No hazardous additives may be used. Drilling fluid shall be maintained at a viscosity sufficient to suspend cuttings and maintain the integrity of bore wall.

C. DELIVERY SYSTEM

The mud pumping system shall have a minimum capacity to supply mud in accordance with the drilling equipment pull-back rating at a constant required pressure. The delivery system shall have filters in-line to prevent solids from being pumped into the drill pipe. Connections between the pump and drill pipe shall be relatively leak-free. Used drilling fluid and drilling fluid spilled during drilling operations shall be contained and properly disposed of. A berm, minimum of 12" high, shall be maintained around drill rigs, drilling fluid mixing system, entry and exit pits and drilling fluid recycling system (if used) to prevent spills into the surrounding environment. Pumps and or vacuum truck(s) of sufficient size shall be in place to convey excess drilling fluid from containment areas to storage facilities.

2.05 OTHER EQUIPMENT

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

A. PIPE ROLLERS

Pipe rollers, if required, shall be of sufficient size to fully support the weight of the pipe while being hydro-tested and during pull-back operations. Sufficient number of rollers shall be used to prevent excess sagging of pipe.

B. PIPE RAMMERS

Hydraulic or pneumatic pipe rammers may only be used if necessary and with the authorization of Engineer.

C. RESTRICTIONS

Other devices or utility placement systems for providing horizontal thrust other than those previously defined in the preceding sections shall not be used unless approved by the Engineer prior to commencement of the work. Consideration for approval will be made on an individual basis for each specified location. The proposed device or system will be evaluated prior to approval or rejection on its potential ability to complete the utility placement satisfactorily without undue stoppage and to maintain line and grade within the tolerances prescribed by the particular conditions of the project.

PART 3 - EXECUTION

3.01 GENERAL

The Engineer must be notified 48 hours in advance of starting work. The Directional Bore shall not begin until the Engineer is present at the job site and agrees that proper preparations for the operation have been made. The Engineer approval for beginning the installation shall in no way relieve the Contractor of the ultimate responsibility for the satisfactory completion of the work as authorized under the Contract. It shall be the responsibility of Engineer to provide inspection personnel at such times as appropriate without causing undue hardship by reason of delay to the Contractor.

3.02 PERSONNEL REQUIREMENTS

All personnel shall be fully trained in their respective duties as part of the directional drilling crew and in safety.

3.03 DRILLING PROCEDURE

A. SITE PREPARATION

1. Prior to any alterations to work-site, contractor shall photograph or video tape entire work area, including entry and exit points. One copy

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

of which shall be given to Engineer and one copy to remain with contractor for a period of one year following the completion of the project.

2. Work site as indicated on drawings, within right-of-way, shall be graded or filled to provide a level working area. No alterations beyond what is required for operations are to be made. Contractor shall confine all activities to designated work areas.

B. DRILL PATH SURVEY

Entire drill path shall be accurately surveyed with entry and exit stakes placed in the appropriate locations within the areas indicated on drawings. If contractor is using a magnetic guidance system, drill path will be surveyed for any surface geo-magnetic variations or anomalies.

C. ENVIRONMENTAL PROTECTION

Contractor shall place silt fence between all drilling operations and any drainage, wetland, waterway or other area designated for such protection by contract documents, state, federal and local regulations. Additional environmental protection necessary to contain any hydraulic or drilling fluid spills shall be put in place, including berms, liners, turbidity curtains and other measures. Contractor shall adhere to all applicable environmental regulations. Fuel or oil may not be stored in bulk containers within 200' of any water-body or wetland.

D. SAFETY

Contractor shall adhere to all applicable state, federal and local safety regulations and all operations shall be conducted in a safe manner.

E. PIPE

Pipe shall be welded/fused together in one length, if space permits. Pipe will be placed on pipe rollers before pulling into bore hole with rollers spaced close enough to prevent excessive sagging of pipe.

F. PILOT HOLE

1. Pilot hole shall be drilled on bore path with no deviations greater than 5% of depth over a length of 100'. In the event that pilot does deviate from bore path more than 5% of depth in 100', Contractor will notify Engineer and Engineer may require Contractor to pull-back and re-drill from the location along bore path before the deviation.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

2. In the event that a drilling fluid fracture, inadvertent returns or returns loss occurs during pilot hole drilling operations, contractor shall cease drilling, wait at least 30 minutes, inject a quantity of drilling fluid with a viscosity exceeding 120 seconds as measured by a March funnel and then wait another 30 minutes. If mud fracture or returns loss continues, contractor will cease operations and notify Engineer. Engineer and contractor will discuss additional options and work will then proceed accordingly.

G. REAMING

Upon successful completion of pilot hole, contractor will ream bore hole to a minimum of 25% greater than outside diameter of pipe using the appropriate tools. Contractor will not attempt to ream at one time more than the drilling equipment and mud system are designed to safely handle.

H. PULL-BACK

1. After successfully reaming bore hole to the required diameter, contractor will pull the pipe through the bore hole. In front of the pipe will be a swivel. Once pull-back operations have commenced, operations must continue without interruption until pipe is completely pulled into borehole. During pull-back operations contractor will not apply more than the maximum safe pipe pull pressure at any time.
2. In the event that pipe becomes stuck, contractor will cease pulling operations to allow any potential hydro-lock to subside and will commence pulling operations. If pipe remains stuck, contractor will notify Engineer. Engineer and contractor will discuss options and then work will proceed accordingly.

3.04 PIPE TESTING

- A.** Pipe testing sections shall be followed in its entirety following pull-back of the pipe.
1. All mains shall be swabbed.
 2. All mains shall be chlorinated.

3.05 Basis For Payment

- A.** Piping shall be paid for at the unit price bid and shall include all work incidental to making a complete installation such as excavation, bedding, backfill, painting, testing, disinfection, cleanup, seeding, etc.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

END OF SECTION

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

SECTION 02326

STEEL CASING PIPE

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Steel casing pipe shall be furnished and installed as shown on the DRAWINGS and specified herein.

1.02 RELATED WORK

- A. Erosion and Water Pollution Control are address under KYTC Standard Specifications for Road and Bridge Construction, most current edition, Division 200
- B. Piping is included in this Division, Section 02600.

PART 2 PRODUCTS

2.01 STEEL CASING PIPE

- A. Steel casing or jack pipe shall be plain end steel pipe with a minimum yield strength of 35,000 psi and tensile strength of 60,000 psi per API-5L Grade B material. The steel pipe supplied shall be manufactured by the seamless, electric-weld, submerged arc weld or gas metal-arc weld process as specified in API-5L. Certifications of 35,000 psi minimum yield strength shall be furnished by the CONTRACTOR.
- B. The inside diameter shall be at least 2 inches greater than the largest outside diameter of the carrier pipe, joint or couplings for carrier pipe less than 6" in diameter. The inside diameter shall be at least 4" greater than the largest outside diameter of the carrier pipe, joint or couplings for carrier pipe 6" and over in diameter unless otherwise noted on the plan sheets. In all cases, the casing pipe shall be great enough to allow the carrier pipe to be removed subsequently without disturbing the casing pipe or roadbed.
- C. Casing pipe shall have minimum wall thickness as shown in the following table:

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

Nominal Diameter <u>(Inch)</u>	Nominal Thickness <u>(Inch)</u>	Nominal Diameter <u>(Inch)</u>	Nominal Thickness <u>(Inch)</u>
Under 10	0.188	24	0.438
10 - 12	0.250	26	0.438
14 - 16	0.281	28 - 30	0.500

PART 3 EXECUTION

3.01 TUNNELING, BORING OR JACKING

- A. Boring or jacking as specified herein shall be located as shown on DRAWINGS. All other casing pipe installations shall be open cut trench.
- B. Tunneling under paving, railroads, buildings and underground structures is included as an alternate to boring or repaving required by open cut trenching at no extra cost to the OWNER. Bore and casing pipe is also included as an alternate to tunneling. Backfilling of tunnels shall be mechanically tamped in not more than 3-inch layers and with material rendered suitable for tamping before being placed in tunnel unless otherwise shown on the DRAWINGS. No payment will be made for tunnels less than 3 feet long.
- C. In tunneling under buildings, the CONTRACTOR will held responsible for all damage by his operations and methods of excavation and backfilling.
- D. Should the CONTRACTOR elect and receive permission to tunnel and bore, other than locations designated on the DRAWINGS or required by the ENGINEER to be tunneled or bored, the entire compensation therefore shall be the same as the unit prices bid for installation in open trench, including paving replacement, but not including bore or unit prices.
- E. At locations where tunneling or boring or jacking is called for on the DRAWINGS, in addition to the unit prices for permanent tunnel, tunnel liner, temporary tunnel, boring or jacking and/or casing pipe, payment will be made for furnishing and laying carrier pipe inside the tunnel or casing pipe. No payment will be made for separate trench and backfill unit price items where permanent tunnel, tunnel liner, temporary tunnel, boring or jacking and/or casing pipe unit prices is paid.
- F. Boring or jacking under highways, railroads, sidewalks, pipelines, etc., shall be done at the locations shown on the DRAWINGS. It shall be performed by mechanical means and accurate vertical and horizontal alignment must be maintained. When shown on the DRAWINGS, casing pipe shall be used and shall be installed inside bored holes concurrently with boring, or jacking.

3.02 STEEL CASING PIPE INSTALLATION

- A. Steel casing pipe shall be of the size and wall thickness as shown on the DRAWINGS or specifications.
- B. When casing pipe is jacked, concurrent with boring, all joints shall be solidly welded. The weld shall be such that the joint shall be of such strength to withstand the forces exerted from the boring and jacking

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

operation as well as the vertical loading imposed on the pipe after installation. The weld shall also be such that it provides a smooth, non-obstructing joint in the interior of the pipe, which will allow easy installation of the carrier pipe without hanging or abrasion to the carrier pipe upon installation.

- C. When casing pipe is installed in open trench or permanent tunnel, it shall be bedded and backfilled as specified in Division 2. When casing pipe is installed in temporary tunnel, it shall be laid accurately to alignment of proposed pipeline and at an elevation below proposed pipeline necessary to support it at the planned elevation. Bedding and backfill for casing pipe in temporary tunnel shall be as specified in Division 2.
- D. Casing pipe in open trench, permanent tunnel and temporary tunnel shall be joined by welding such that it will not be moved out of alignment or grade and will prevent backfill material from entering joint. Where casing pipes are shown on the DRAWINGS to be equipped with vent pipes, vents shall be installed as shown on the DRAWINGS with cost of the same included in the price bid for the casing pipe unless otherwise specified.

3.03 CARRIER PIPE IN CASING PIPE INSTALLATION

A. Pipeline Spacers

Carrier pipes shall be centered inside casing pipe throughout the length of the casing pipe. Centering shall be accomplished by the installation of polyethylene pipeline spacers attached to the casing pipe in such a manner as to prevent the dislodgment of the spacers as the carrier pipe is pulled or pushed through the casing pipe. Spacers shall be of such dimensions to provide (1) full supportive load capacity of the carrier pipe and contents; (2) of such thickness to allow installation and/or removal of the pipe; and (3) to allow no greater than 1/2 inch movement of the carrier pipe within the casing pipe after the carrier pipe is installed. Installation shall be in accordance with manufacturer's recommendations. Spacers shall be model CI Polyethylene casing spacers as manufactured by Advance Products & Systems, Inc., or approved equal.

- B. Upon completion of installation of the carrier pipe, the annular space at the ends of the cover pipe shall be sealed to prevent the entrance of groundwater, silt, etc., into the casing pipe. The seal shall be a manufactured product specially made for this purpose. The seal shall be the best seal type constructed of synthetic rubber with stainless steel banding straps. Seals may be of the "pull-on" or "wrap around" type as manufactured by Advance Products and Systems, Inc. or approved equal.

3.04 BASIS FOR PAYMENT

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

Steel Casing Pipe shall be paid for at the unit price bid and shall include all work incidental to making a complete installation such as excavation, bedding, backfill, painting, testing, disinfection, cleanup, seeding, etc. Carrier pipe shall be paid under separate bid item.

END OF SECTION

SECTION 02600

WATER DISTRIBUTION PIPE

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, materials, equipment and incidentals necessary to install and test pipe and fittings as shown on the Drawings and required by the Specifications.
- B. Piping shall be located substantially as shown. The ENGINEER reserves the right to make such modifications in locations as may be found desirable to avoid interference between pipes or for other reasons. Pipe fitting notation is for the CONTRACTOR'S convenience and does not relieve him from laying and jointing different or additional items where required without additional compensation.
- C. Wherever the word pipe or piping is used it shall mean pipe and fittings unless otherwise noted.
- D. All references to Standards/Specifications shall mean the latest revision.

1.02 RELATED WORK

- A. Trenching, backfilling and compacting are included in KYTC Standard Specifications for Road and Bridge Construction, most current edition, Division 200 & 700.
- B. Concrete is included in KYTC Standard Specifications for Road and Bridge Construction, most current edition, Division 600.

1.03 DESCRIPTION OF SYSTEM

- A. Piping shall be installed substantially as shown on the DRAWINGS so as to form a complete smooth flow path and workable system.
- B. The piping and materials specified herein are intended to be standard types of pipe for use in transporting potable water as indicated on the DRAWINGS. The pipe and fittings shall be designed, constructed, and installed in accordance with the best practices and methods and the manufacturer's recommendations.

1.04 QUALIFICATIONS

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- A. All pipe and fittings under this section shall be furnished by manufacturers who are fully experienced, qualified, and regularly engaged in the manufacture of the materials to be furnished.

1.05 SUBMITTALS

- A. The CONTRACTOR shall submit to the ENGINEER for review in accordance with Division 1, Section 01300, complete sets of shop drawings showing layout and details of materials, joints and methods of construction and installation of the pipe, specials and fittings required.
- B. Before fabrication and/or shipping of the pipe is begun, the CONTRACTOR shall submit for approval a schedule of pipe lengths for the entire job. All pipe furnished under the Contract shall be fabricated in full accordance with the approved Drawings.

1.06 INSPECTION

- A. The manufacturer shall inspect all pipe joints for out-of-roundness and pipe ends for squareness. The manufacturer shall furnish to the ENGINEER a notarized affidavit stating all pipe meets the requirements of applicable ASTM Specifications, these Specifications, and the joint design with respect to square ends and out-of-round joint surfaces.

PART 2 PRODUCTS

2.01 DUCTILE IRON PIPE

- A. General
 - 1. Ductile iron pipe shall be centrifugally cast of ductile iron conforming to ASTM Specifications A 746 latest revision. The pipe design conditions shall be as follows:
 - a. Pressure: Minimum of 250 psi operating plus 100 psi surge allowance.
 - b. Trench Loading: Laying condition Type 4 unless otherwise specified on Drawings. Trench depth not less than 2' nor more than that shown on the Drawings.
 - c. Metal Design Strengths:

Bursting Tensile	40,000 psi
Modulus of Rupture	90,000 psi
 - 2. The manufacturing tolerances included in the nominal thickness shall not be less than specified by ANSI/AWWA C150/A21.50, latest revision.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

3. Minimum wall thickness shall be 0.33 inches (Class 52), or more if required for minimum operating pressure of 250 psi.
4. Pipe may be furnished in 18', or 20' nominal laying lengths; and the weight of any single pipe shall not be less than the tabulated weight by more than 5 percent for pipe 12" or smaller in diameter, nor by more than 4 percent for pipe larger than 12" in diameter.
5. The hydrostatic and acceptance tests for the physical characteristics of the pipe shall be as specified in ANSI/AWWA C151/A21.51, latest revision.
6. Any pipe not meeting the ANSI/AWWA specifications quotes above shall be rejected in accordance with the procedure outlined in the particular specification.
7. The ENGINEER shall be provided with 3 copies of a certification by the manufacturer that the pipe supplied for this Contract has been tested in accordance with the referenced specifications and is in compliance therewith.
8. The net weight, class or nominal thickness and sampling period shall be marked on each pipe. The pipe shall also be marked to show that it is ductile iron.
9. Unless otherwise noted, joints for ductile iron pipe will be "push-on" type consisting of a rubber gasket installed in a recess in the bell.
10. Ductile iron pipe must be used within 200 feet of underground petroleum storage tanks and shall have gaskets designed for this purpose such as Nitrile Butadiene (NBR), approved equal or better.

B. Lining and Coating Ductile Iron Pipe

1. All ductile iron pipe shall have a cement lining and bituminous seal coat on the inside. Cement mortar lining and bituminous seal coat inside shall conform to ANSI/AWWA C104/A21.4 latest revision.
2. All buried ductile iron pipe shall have manufacturer's outside coal tar or asphaltic base coating.
3. All above grade ductile iron pipe shall have the following coating system:
 - A. System Type: MCU/Epoxy.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- B. Surface Preparation: Surface Preparation: NAPF 500-03-03 Power Tool Cleaning.
 - C. Primer: Series 1 Purpleprime. DFT 2.5 to 3.5 mils.
 - D. Finish Coat: Series N69 Hi-Build Epoxoline II. DFT 4.0 to 6.0 mils. *[May require two coats if brush or roller applied].*
 - E. Total DFT: 6.5 to 9.5 mils.
 - F. Finish Color: As indicated on the drawings, or color schedule.
 - G. Coatings shall be Tnemec Company Incorporated, or approved equal.
4. All surface preparation and coating application shall be per the manufacturer's recommendations.
- C. Fittings for Ductile Iron Pipe-3" and larger
- 1. Ductile Iron fittings only shall be used with the ductile iron pipe.
 - 2. Mechanical joint fittings shall be used with underground pipe.
 - 3. Rubber-gasket joints shall conform to ANSI/AWWA C111/A21.11 latest revision for centrifugally cast ductile iron water pipe.
 - 4. All Working Pressures - Fittings shall conform to ANSI/AWWA Specifications C110/A21.10 latest revision for 250 psi water working pressure plus water hammer. Ductile iron fittings shall be ductile cast iron per ASTM Specifications A536, latest revision.
 - 5. All fittings shall be cement lined and bituminous coated per Federal Specifications WW-P-421b.
- D. Ductile Iron Pipe and Fittings - Smaller than 3"
- 1. Small size ductile iron pipe shall conform to ANSI Specifications A21.12 (AWWA C 112) latest revision. Fittings shall conform to ANSI Specifications A21.10 (AWWA C 110) latest revision.
 - 2. Pipe may be furnished with either mechanical joints or slip-on joints. Buried fittings shall be furnished with mechanical joints.
- E. Flanged Cast Iron Pipe and Flanged Coupling Adapters for Flexible Couplings

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1. Non-buried ductile iron pipe and fittings shall be flanged unless otherwise specified.
2. Flanged cast iron pipe and fittings shall have dimensions facing and drilling for ANSI Class 125 flanges (125 psi steam working pressure; 250 psi water working pressure).
3. Where flanges are pit cast integrally with pipe in vertical position in dry sand molds, flanged pipe shall be AWWA Class "B" or latest revision of ANSI Specifications A21.2, Class 50 pipe for sewage, sludge, gas and air service and Class 150 pipe for all types of water service.
4. Where flanged pipe is made up by threading plain end, centrifugally cast pipe, screwing on specially designed long hub flanges, and re-facing across both the face of the flange and the end of pipe, flange shall be per ANSI Specification B16.1 latest revision and pipe shall be Class 150 per ANSI Specification A21.6 latest revision.
5. Either of the foregoing methods of manufacture of flanged pipe will be acceptable, but when plain ends of flanged pipe are to fit into mechanical joint bells, then the outside diameter of the pipe shall be such that the joint can be made.
6. CBS (rubber and cloth both sides) gaskets 1/16" in thickness shall be used in connecting flanged piping. Nuts and bolts for use in making flanged connections shall have hexagonal heads, be of proper lengths and with U.S. standard threads. The tensile strength of steel used in the bolts shall be not less than 55,000 psi.
7. Flanged Coupling Adapters for flanged pipe shall be a mechanical joint cast to a special flanged joint using a neoprene "O-ring", in place of the usual 1/16" rubber ring gasket. The mechanical bell and special flanged joint piece shall be of high grade gray cast iron with bolt circle, bolt size and spacing conforming to ASA B16.1 Specifications latest revision. Mechanical joint follower flange shall be of ductile or malleable iron with high strength/weight ratio design. Bolts shall be fine grained, high tensile, malleable iron with malleable iron hexagon nuts.
8. Flanged Coupling Adapters for 12" and smaller cast iron pipe shall be Smith-Blair #912; Dresser style 127; or approved equal. For pipe larger than 12", flexible couplings shall be Smith-Blair #913; Dresser style 128; or approved equal. All flexible couplings shall be furnished with anchor studs.

F. Mechanical Joint Restraints

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1. Gland body, wedges and wedge actuating components shall be cast from grade 65-45-12 ductile iron material in accordance with ASTM A536.
2. Ductile iron gripping wedges shall be heat treated within a range of 370 to 470 BHN.
3. Three (3) test bars shall be incrementally poured per production shift as per Underwriter's Laboratory (U.L.) specifications and ASTM A536. Testing for tensile, yield and elongation shall be done in accordance with ASTM E8.
4. Chemical and nodularity tests shall be performed as recommended by the Ductile Iron Society, on a per ladle basis.

2.02 POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS

- A. PVC pipe shall comply with ASTM D01784 and shall be Type 1, Grade 1, with pressure and SDR rating as shown on the drawings or indicated in the proposal form. All PVC pipe shall conform to the latest revisions of the following specifications:

ASTM D2241 (PVC plastic pipe SDR-PR and Class T)
Commercial Standard CS 256 (pressure rated type)
National Sanitation Foundation Testing Laboratories (NSF)

- B. The name of the manufacturer of the plastic pipe to be used must be found on the current listing of Plastic Materials for Potable Water Application, published by the NSF (National Sanitation Foundation), Ann Arbor, Michigan, and must meet the requirements of the Standard Specifications for Polyvinyl Chloride (PVC) Plastic Pipe, D1785, published by ASTM (American Society for Testing and Materials).
- C. Pipe lengths shall not exceed 40 feet. Wall thickness shall be in accordance with CS-256 and ASTM D-2241. Pipe ends shall be beveled to accept the gasketed coupling. Rubber gasketing shall conform to ASTM 1869.
- D. Samples of pipe, physical and chemical data sheets shall be submitted to the ENGINEER for approval and his approval shall be obtained before pipe is purchased. The pipe shall be homogenous throughout and free from cracks, holes, foreign inclusions or other defects. The pipe shall be as uniform as commercially practical in color. Pipe shall have a ring painted around spigot ends in such a manner as to allow field checking of setting depth of pipe in the socket.
- E. Pipe must be delivered to the job site by means which will adequately support it, and not subject it to undue stresses. In particular, the load

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

shall be so supported that the bottom rows of pipe are not damaged by crushing. Pipe shall be unloaded carefully and strung or stored as close to the final point of placement as is practical.

F. The couplings and fittings shall be furnished by the pipe manufacturer and shall accommodate the pipe for which they are to be used. They shall have a minimum pressure rating of 200 psi. Insertion depth of the pipe in the coupling shall be controlled by an internal PVC mechanical stop in the coupling which will allow for a thermal expansion and contraction. Couplings method shall allow for half of each end of the pipe. Couplings shall permit 5 degree deflection (2-1/2 degrees each side) of the pipe without any evidence of infiltration, cracking or breaking. Couplings shall have rubber seals factory installed.

G. Pipe markings shall include the following, marked continuously down the length:

Manufacturer's Name
Nominal Size
Class Pressure Rating
PVC 1120
NSF Logo, and
Identification Code

H. Lubricant shall be water soluble, nontoxic, be non-objectionable in taste and odor imparted to the fluid, be non-supporting of bacteria growth and have no deteriorating effect on the PVC or rubber gaskets.

2.03 POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS (SCHEDULE 80)

A. General

Schedule 80 PVC pipe shall be as manufactured by the Celanese Piping Systems, Inc., or approved equal. To ensure installation uniformity, all piping system components shall be the products of one manufacturer.

B. Materials

1. Pipe and fittings shall be manufactured from a PVC compound which meets the requirements of Type 1, Grade 1 polyvinyl chloride as outlined in ASTM D-1784. A Type 1, Grade 1 compound is characterized as having the highest requirements for mechanical properties and chemical resistance. Fittings shall be socket type and shall conform to the requirements of ASTM D-2467.
2. Compound from which pipe is produced shall have a design stress rating of 200 psi at 73° F., listed by the Plastics Pipe Institute (PPI).

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

3. Materials from which pipe and fittings are manufactured shall have been tested and approved for conveying potable water by the National Sanitation Foundation (NSF).

C. Solvent Cement

All socket type connections shall be joined with PVC solvent cement complying to ASTM D-2564. Cement shall have a minimum viscosity of 2000 cps.

D. Installation

Installation shall be in strict accordance with the manufacturer's printed instructions. Printed installation instructions shall be submitted and approved by the ENGINEER prior to shipment of the pipe.

E. Testing

1. Pressure Pipe - Refer to Paragraph 3.02 of this Division.
2. Vacuum Pipe - All pipe intended for use under partial vacuum shall be tested by subjection to 24 inches of mercury vacuum; allowing 15 minutes to stabilize and thereafter lose not more than 1% vacuum pressure per hour over a minimum 4 hour test period. This test must be met or exceed prior to final acceptance.

2.04 COPPER PIPE AND FITTINGS

- A. Exterior copper pipe shall be Type K pipe (ASTM B88 latest revision), with compression fittings. Joints shall be drawn up firmly and shall be tested before backfilling and any leakage stopped.
- B. Wherever copper pipes pass through walls or floors, they shall have wrought or cast iron sleeves, for easy removal. Pipes passing through structural beams shall be placed as near as possible to the top of the beam under the floor slab.

2.05 HIGH DENSITY POLYETHYLENE PIPE

A. General

1. High density polyethylene pipe shall be Adyl "D" polyethylene pipe manufactured by E.I. DuPont DeNemours and Co., Inc., or "Driscopipe" as manufactured by Phillips Product Co., Inc., or approved equal.

B. Materials for Polyethylene Pipe

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1. The polyethylene pipe and fittings shall be made of polyethylene resins classified in ASTM D 1248 as Type III, Category 5, Grade P34 (pipe designation PE 3408 defined per ASTM D 3035 latest revision), having specific base resin densities of 0.942 g/cc minimum and 0.955 g/cc maximum, respectively; and having melt indexes of 0.4 g/10 min. maximum and 0.15 g/0.10 min. minimum, respectively.
2. Pipe made from these resins must have a long-term strength rating of 1,600 psi or more.
3. The polyethylene resin shall contain antioxidants and shall be stabilized with carbon black against ultra-violet degradation to provide protection during processing and subsequent weather exposure.
4. The polyethylene resin compound shall have a resistance to environmental stress cracking as determined by the procedure detailed in ASTM D 16930 latest revision, Condition B with sample preparation by procedure C of not less than 200 hours.

C. Polyethylene Pipe and Fittings

1. Polyethylene pipe furnished and installed under this Contract shall be of nominal outside diameter shown on the Drawings, and shall be designed for a normal internal working pressure and earth cover over top of the pipe to suit the conditions of proposed use.
2. Each length of pipe shall be marked, at no more than 10 foot intervals, with the following information:

Nominal pipe size
Type plastic material - PE3408
Pipe pressure rating
Manufacturer's name, trademark and code
3. All pipe shall be made from virgin material. No rework compound.
4. Pipe shall be homogenous throughout, and be free of visible cracks, holes, foreign material, blisters, or other deleterious faults.
5. Fittings for the polyethylene pipe line shall be molded for fabricated from the same material as specified hereinbefore for the high density polyethylene pipe.
6. Fittings for bends 22-1/2 degrees or greater shall be provided as shown on the Drawings. For alignment changes of less than 20 degrees deflection, the pipe may be laid in curves with a radius of 80 feet or greater.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

7. All run-of-the-pipe fittings shall be fusion welded into the pipe line. Tee branches shall be of the size shown on the Drawings and shall be furnished with flanged ends per ANSI B-16.1. All fittings shall be factory made.
8. Fittings shall be capable of withstanding the same pressure and loading conditions specified for the pipe.
9. Wye Branches shall be true wyes.

D. Pipe Jointing

1. Pipe to be joined by leak-proof, thermal, butt fusion joints. All fusion must be done by personnel trained by the pipe supplier using tools approved by the pipe supplier.
2. The fusion machine shall have hydraulic pressure control for fusing 2 pipe ends together; it shall include pressure fusion indicating gauges to correctly monitor fusion pressures. The machines shall be equipped with an electric or gasoline engine powered facing unit to trim irregularities from the pipe ends. The heating plate on the fusion machine shall be electrically heated and thermostatically controlled and shall contain a temperature gauge for monitoring temperature.
3. Joint strength must be equal to that of adjacent pipe as demonstrated by tensile test. In addition, results of tensile impact testing of joint should indicate a ductile rather than a brittle fracture. External appearance of fusion bead should be smooth without significant juncture groove.
4. Threaded or solvent cement joints and connections are not permitted.

E. Joining, Terminating or Adapting by Mechanical Means

1. The polyethylene pipe shall be connected to systems or fittings of other materials by means of an assembly consisting of a polyethylene flange adapter butt-fused to the pipe, a backup ring of either cast iron, steel, or high silica aluminum alloy made to ANSI B-16.1 dimensional standards (with modified pressure ratings), bolts of compatible material (insulated from the fittings where necessary) and a gasket of reinforced black rubber, asbestos-rubber compound or other material approved by the ENGINEER, cut to fit the joint. In all cases, the bolts shall be drawn up evenly and in line.
2. Termination of valves, or fittings such as tees, bonds, etc., made of other materials shall be by the flange assemblies specified

hereinbefore. The pipe adjacent to these joints and to joints themselves must be rigidly supported for a distance of one pipe diameter or 1 foot, whichever is greater, beyond the flange assembly.

F. Tools and Procedures

1. Fusion jointing and other procedures necessary for correct assembly of the polyethylene pipe and fittings will be done only by personnel trained in those skills by the pipe supplier.
2. Only those tools designed for aforementioned procedures and approved by the pipe supplier shall be used for assembly of pipe and fittings to ensure proper installation.

2.06 UNDERGROUND UTILITY WARNING TAPES

- A. Non-metallic underground utility warning tapes shall be installed directly above all buried pipe.
- B. The tape shall a pigmented polyolefin film with a printed message on one side that is impervious to all known alkalis, acids, chemical reagents and solvents found in the soil.
- C. The minimum overall thickness of the tape shall be 4.0 mils and the width shall not be less than 3" and a minimum unit length of 1000 ft/roll. The tape shall be color coded and imprinted with the message as follows:

Type of Utility	Color Code	Legends
Water	Safety Precaution Blue	Caution Buried Water Line Below
Sewer	Safety Green	Caution Buried Sewer Line Below

- D. Underground marking tape shall be "Terra Tape" as manufactured by Reef Industries, or approved equal.
- E. Installation of marking tapes shall be per manufacturer's recommendations and shall be as close to the grade as is practical for optimum protection and detectability. Allow a minimum of 18" between the tape and the line.
- F. Payment for detectable tapes shall be included in the linear foot price BID of the piping BID item(s).

2.07 DETECTABLE TRACER WIRE AND FLEXIBLE PIPELINE MARKERS

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- A. 10 gauge, single strand TRACER WIRE shall be placed directly on top of all PIPE and shall be attached to the pipe at 5 ft intervals maximum. Tracer wire segments shall be 800 feet maximum and shall terminate at each air release valve manhole, or a structure the same as a clean-out box. Contractor shall leave three feet of coiled slack at each termination point.
- A. A FLEXIBLE FIBER REINFORCED flat composite pipeline marker shall be installed above the force main approximately every 2000 feet at a location designated by the ENGINEER.
- B. The marker shall be manufactured of a fiber reinforced composite material. The reinforcement material shall be comprised of both lineal strands and horizontal mesh mats. The marker post must be flat in shape with rails on both sides. Marker shall be at least 3 3/4" wide. A 2 7/8" wide decal must fit on each side of the marker. The back side of the post shall have a rounded rib down the center and two small ribs on the sides to act as guides for the decals. Decals will be placed on both sides to ensure that a warning message can be seen from both directions.
- C. The marker shall be capable of withstanding a minimum of 10 vehicle impacts at 55 M.P.H. with a car bumper.
- D. The marker shall be coated with a coloring which matches the color of the post. The coating shall totally stop ultraviolet light from reaching the resin portion of the post. The coating shall not fade, peel, or blister after a minimum of 2,000 hours in a QUV Weatherometer.
- E. Red – Electric Orange - Communication
Yellow – Gas Blue – Potable Water
Green – Sewer Purple – Reclaimed water
- F. The marker post shall remain flexible from -40° F to +140° F.
- G. Decals shall be fade resistant and remain legible after a minimum of 2,000 hours in a QUV Weatherometer. Decal graphics shall include the international Do0Dig symbol. Decals shall be placed on both sides of the post.
- H. Marker shall be Rhino, or approved equal.

PART 3 EXECUTION

3.01 LAYING PIPE IN COMMON TRENCH

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- A. Pipelines, force mains and sewers laid in same trench shall, in all cases, be laid on original earth, regardless of divergence in their elevations. Pipe shall never be laid in backfill or one above the other. The CONTRACTOR shall include payment for all trenching and backfilling in his lump sum bid.

3.02 PRESSURE PIPE INSTALLATION - GENERAL

A. General

1. Pipe shall be handled with such care as necessary to prevent damage during installation. The interior of the pipe shall be kept clean and the pipe shall be installed to the lines and grades shown on the Drawings. Pipe shall be installed according to instructions and with tools recommended by the manufacturer. Whenever pipe laying is stopped, the end of the pipe shall be securely plugged or capped.
2. Ductile Iron fittings only shall be used with the PVC pipe.
3. Mechanical joint fittings shall be used with underground pipe.
4. Fittings less than 4-inches in diameter shall be of the mechanical joint type and be firmly blocked to original earth or rock to prevent water pressure from springing pipe sideward or upward. Concrete or other blocking material approved by the ENGINEER shall be placed such that it does not cover the pipe joints, nuts, and bolts.
5. Fittings 4-inches in diameter and greater shall be of the mechanical joint type and firmly restrained to prevent water pressure from springing pipe sideward or upward. The mechanical restraint shall be the Series 2000PV produced by EBAA Iron, Inc. or approved equal.
6. Pipes shall be free of all structures other than those planned. Openings and joints to concrete walls shall be constructed as shown on the Drawings.
7. Ductile iron or steel pressure pipe, 4 inch diameter or larger, entering a structure below original earth level, unsupported by original earth for a distance of more than 6 feet shall be supported by Class "2500" concrete, where depth of such support does not exceed 3 feet, and by Class "4000" concrete piers each 6 feet, where depth exceeds 3 feet. All other pressure pipe entering buildings or basins below original earth and having a cover of more than 24 inches of earth, or under roadway, shall be supported as shown in detail on the Drawings. All piers required will be paid for in accordance with the appropriate specification hereinbefore. Class "2500" concrete required will be included in the payment for furnishing and laying the particular pipe, in order to discourage excessive excavation outside the limits of structures. Pipes entering structures shall have flexible joint within 18

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

inches of exterior of structure, and also from point of leaving concrete support to original earth or crushed stone bedding.

B. Pressure Pipe Laying

1. Pressure pipe shall first be thoroughly cleaned at joints, then joined according to instructions and with tools recommended by the manufacturer. A copy of such instructions shall be available at all times at the site of the work.
2. All pipes must be forced and held together, or "homed" at the joints, before sealing ground level and unsupported by original earth for a distance of more than 6 feet shall be supported by concrete to original ground where depth of such support does not exceed 3 feet. When depth exceeds 3 feet, beams with piers shall be used for support.
3. Trench excavation for pipe laying must be of sufficient width to allow the proper jointing and alignment of the pipe. Trenches in earth or rock shall be dug deep enough to ensure 30" minimum cover over top of the pipe, unless otherwise indicated on the Drawings.
4. Trench line stations shall be set ahead of the trenching at least each 100 feet of pipeline. Trenches shall be dug true to alignment of stakes. Alignment of trenches or pipes in trench must not be changed to pass around obstacles such as poles, fences and other evident obstructions without the approval of the ENGINEER. Lines will be laid out to avoid obstacles as far as possible, consistent with maintenance of alignment necessary to finding the pipeline in the future and avoiding obstruction of future utilities and structures.
4. Cut pieces of pressure pipe 18" or more in length may be used in fitting to the specials and valves and fitting changes in grade and alignment. Cut ends shall be even enough to make first class joints.

C. Testing Pressure Pipe

1. Pressure and leakage tests shall be conducted in accordance with ANSI/AWWA C600.
2. The CONTRACTOR shall furnish all necessary equipment for pressure testing.
3. Inspection of pipe laying shall in no way relieve the CONTRACTOR of the responsibility for passing tests, stopping leakage, or correcting poor workmanship.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

4. Underground pipelines will not be finally accepted until leakage is less than allowable by ANSI/AWWA C600. In case leakage exceeds this amount, the CONTRACTOR shall locate and repair leaks until the entire pipeline will pass the required test. All leakage shall be stopped in exposed piping. The pumping equipment shall be disconnected during test.
5. The CONTRACTOR shall furnish meter or suction tank, pipe test plugs and bypassing piping and make all connections for conducting the above tests. The pumping equipment used shall be compressed air, centrifugal pump or other pumping equipment which will not place shock pressures on the pipeline. Power plunger pumps will not be permitted or us on closed pipe system for any purpose.

3.03 DUCTILE IRON PIPE INSTALLATION

- A. Pipe shall be handled with such care as necessary to prevent damage during installation. The interior of the pipe shall be kept clean and the pipe shall be laid to the lines and grades shown on the Drawings and/or as established by the ENGINEER.
- B. Whenever pipe laying is stopped, the end of the pipe shall be securely plugged or capped. Care should be taken to prevent flotation of pipe in the event the trench should flood.
- C. Fitting shall be firmly blocked to original earth or rock to prevent water pressure from springing pipe sideward or upward. Concrete or other blocking material shall be placed such that it does not cover the pipe joints, nuts and bolts.
- D. Pipes shall be free of all structures other than those planned. Openings and joints to concrete walls shall be constructed as shown on the Drawings. Any cast iron pipe entering a structure below original ground level and unsupported by original earth for a distance of more than 6 feet shall be supported by concrete to original ground where depth of such support does not exceed 3 feet. When depth exceeds 3 feet, beams with piers shall be used for support.
- E. All pipes entering buildings or basins below original earth level, which have less than 6 feet span between wall and original earth and having a cover of more than 24 inches of earth, or under roadway, must be adequately supported as approved by the ENGINEER or shown on the Drawings. All such supports are to be included in the contract price and no extra payment will be made for same.
- F. Pipes entering structures shall have a flexible joint within 18" of exterior of structure, or from point of leaving concrete support to original earth or rock bedding.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- G. Cast iron pipe shall be thoroughly cleaned at joints, then joined according to instructions and with tools recommended by the manufacturer.
- H. All pipes must be forced and held together, or "homed" at the joints, before sealing or bolting. Pipe must be aligned as each joint is placed, so as to obtain straight lines and grades. Curves and changes in grades shall be laid in such a manner that maximum allowable joint deflection is not exceeded.
- I. Cut pieces of cast iron pipe 18" or more in length, may be used in connecting valves and fittings and for changes in grade and alignment. Cut ends shall be even enough to make first class joints.
- J. Sufficient excavation for bell holes will be required for tightening of bolts. No pipe shall be laid resting on rock, blocking, or other unyielding objects except where laid above ground on piers or in permanent tunnels.

3.04 INSTALLING FLANGED OR THREADED PIPE AND FITTINGS

- A. The CONTRACTOR shall clean off all rust and dirt and paint all threads with red lead, before assembling, and the pipe shall be installed with flanges and pipes plumb and level, showing no leakage. Unions shall be included in threaded pipe runs to allow for easy removal of pipes. All valve operating devices shall be in locations and of types shown on the Drawings. They shall be accurately plumbed, leveled, supported and braced for smooth operation. Flanged joints shall be assembled with appropriate flanges, gaskets, and bolting. The clearance between flange faces shall be such that the connections can be gasketed and bolted tight without imposing undue strain on the piping system. Flange faces shall be parallel and the bores concentric; gaskets shall be centered on the flange faces so as not to project into the bore. Bolting shall be lubricated before assembly to ensure uniform bolt stressing. The flange bolts shall be drawn up and tightened in staggered sequence in order to prevent unequal gasket flange spacing. When a raised face is joined to a companion flange with a flat face, the raised face shall be machined down to a smooth matching surface and a full face gasket shall be used.

3.05 PVC PIPE INSTALLATION

PVC pipe shall be installed in accordance with the manufacturer's instructions and the "General" provisions under 3.01 and 3.02 in this Section.

3.06 HIGH DENSITY POLYETHYLENE PIPE INSTALLATION

- A. General

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1. High density polyethylene pipe shall be installed in strict accordance with the manufacturer's recommendations and these Specifications.
2. The CONTRACTOR shall have the manufacturer furnish all necessary technical assistance, installation instruction and jointing supervision required to ensure that the pipe is properly installed. The CONTRACTOR shall furnish the services of a technical representative of the manufacturer to supervise the joining, bedding, laying and backfilling of at least the first 200 feet of pipe.
3. Upon satisfactory completion of the initial jointing, bedding, laying and backfilling of the first 300 feet of pipe, the CONTRACTOR shall furnish the ENGINEER a written statement from the manufacturer's technical representative certifying that he has witnessed the work in progress and approves the techniques being used and the results obtained by the CONTRACTOR.
4. The manufacturer's technical representative shall have had previous experience with similar work, and be fully qualified to supervise and demonstrate proper procedures for jointing and laying the high density polyethylene pipe.

B. Bedding

1. The laying condition for the high density polyethylene pipe will be on a 6" pad of loose soil with mechanically compacted earth (to a 90 percent of maximum density as determined by Standard Proctor density test) to the centerline of the pipe.
2. At the CONTRACTOR'S option, he may substitute a 6" pad of No. 8 crushed stone below the bottom of the pipe and backfill to the centerline of the pie with No. 8 crushed stone.

C. Grade and Alignment

1. Polyethylene pipe shall be laid to predetermined grades and lines as indicated by the Contract Drawings. Grade lines shall be established either by means of offset grade stakes or by direct levels.

3.07 STERILIZATION OF POTABLE WATER PIPE

- A. Upon completion of the work and cleaning up, and prior to final acceptance, the CONTRACTOR shall sterilize all new distribution system improvements which will be in contact with drinking water; including potable water pipe and connections thereto (including pumps and pump piping).

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- B. Sterilization shall be accomplished by filling the facilities with water containing at least fifty (50) parts per million available chlorine utilizing a contact time of 24 hours. A residual of at least 25 parts per million, at the end of the 24 hour contact time, is required. No portion of the new work shall be placed in service prior to sterilization. At the end of the sterilization period, all sterilized surfaces and areas shall be thoroughly flushed with treated water and drained from the system, as directed by the OWNER.
- C. CONTRACTOR shall make an allowance in his bid to cover cost of filling the new water mains. The CONTRACTOR shall be billed for all water used for the construction and testing at a rate equal to the rate that the OWNER must pay the supplier.
- D. CONTRACTOR will be responsible for notifying the Health Department to observe sterilization test and shall be responsible for all sampling, including coordination, mailing and retesting, if required.

3.08 TESTING WATERLINE PIPE

- 1. Pressure and leakage tests shall be conducted in accordance with ANSI/AWWA C600.
- 2. The CONTRACTOR shall furnish all necessary equipment for pressure testing.
- 3. Inspection of pipe laying shall in no way relieve the CONTRACTOR of the responsibility for passing tests, stopping leakage, or correcting poor workmanship.
- 4. The piping shall be complete, and thrust blocks shall have been in place for no less than 10 days prior to be tested.
- 5. Piping shall be tested at a static pressure of 150 pounds per square inch over a period of not less than eight consecutive hours. The test will be considered successful when the pressure drop over the test period is 5 psi or less. If the pressure drop exceeds 5 psi, repair the leaks and repeat the test. After repairs have been made the test shall be conducted, again. Piping will be accepted once pressure loss does not exceed 5 psi.
- 6. Underground pipelines will not be finally accepted until leakage is less than allowable by ANSI/AWWA C600. In case leakage exceeds this amount, the CONTRACTOR shall locate and repair leaks until the entire pipeline will pass the required test. All leakage shall be stopped in exposed piping. The pumping equipment shall be disconnected during test. Allowable leakage is calculated by the following:

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- L: Allowable leakage, gallons per hour
- S: Length of pipe, feet
- D: Nominal diameter, inches
- P: Average test pressure, psi

$$L = \frac{(SD\sqrt{P})}{133,200}$$

7. The CONTRACTOR shall furnish meter or suction tank, pressure recorder, pressure gauges, pipe test plugs and bypassing piping and make all connections for conducting the above tests. The pumping equipment used shall be compressed air, centrifugal pump or other pumping equipment which will not place shock pressures on the pipeline. Power plunger pumps will not be permitted or us on closed pipe system for any purpose.

3.09 BASIS FOR PAYMENT

Piping shall be paid for at the unit price bid and shall include all work incidental to making a complete installation such as excavation, bedding, backfill, painting, testing, disinfection, cleanup, seeding, warning tape, tracer wire, warning signs, etc.

END OF SECTION

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

SECTION 02640

**METERS, INDIVIDUAL PRESSURE REDUCING VALVES,
AND SERVICE LINES**

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. This Section describes the service meters, individual pressure reducing valves, and service lines to be provided, their materials, construction, type, and installation.
- B. All meters shown on the plan sheets shall be 5/8 inch by 3/4 inch, unless otherwise noted.
- C. All meters and appurtenances shall be compatible with the OWNERS existing Radio Read System as shown in Section 11500 of these Specifications.

PART 2 PRODUCTS

In order to provide continuity in materials the City of Booneville requires the following materials to be used for their projects.

Saddles	Mueller H-16000
Corp Stop	Mueller H-15000
Setter (Yoke)	Mueller H-1400 w/ meter stop
Lid	Ford lockable lid
Meter	Master Meter BLMJ Meter with Allegro Radio Read
IPRV	Wilkins 600

In order to provide continuity in materials the City of Beattyville, require the following materials for their projects.

Saddles	Ford S 90 series
Corp Stop	Ford F 1000
Setter (Yoke)	Ford 70 series
Lid	Ford Flat Type
Meter	Badger Recordall Model 25 with Orion Radio Read
IPRV	Wilkins 600

2.01 INDIVIDUAL PRESSURE REDUCING VALVES

- A. Individual pressure reducing valves shall be installed with service meters where shown on the plan sheets.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- B. Individual pressure reducing valves shall include a bronze strainer. Every regulator shall have an adjustable pressure range of 50 to 125 pounds per square inch. Upon installation, the outlet pressure shall be set at 65 pounds per square inch.
- C. Individual pressure reducing valves shall be installed on the inlet/supply side of the service meter using a tandem copper setter. The CONTRACTOR shall ensure the meter boxes proposed for installation will accommodate the tandem copper setter, reducing valve and service meter.
- D. The reducing valve shall not be buried or otherwise housed outside the meter box.

2.02 METERS

A. SERVICE METER ASSEMBLY

- 1. Service meters to be furnished under this Contract shall be cold water rotating disc type with hermetically sealed and magnetically driven registers. Meters shall be first-line quality of the manufacturer and be in compliance with AWWA Standard C700, or latest revisions. Any type or make of meter supplied must have been manufactured and marketed in the U.S.A. for at least five (5) years. A bond may be submitted to waive this experience clause. The bond, if needed, shall be of an amount adequate for replacement of the meters and shall be held for five (5) years.
- 2. The main case shall be high grade waterworks bronze, with hinged, single lid cover and raised characters cast on them to indicate the direction of flow. Each meter must have the manufacturer's serial number stamped on the lid. Working pressure shall be not less than 150 pounds per square inch. Standard frost bottom meters with non-ferrous strainers snug against the main case shall be provided.
- 3. The measuring chamber shall be of corrosion-resistant thermoplastic material. The chamber shall be of the two-piece design, equipped with a disc made of hard rubber and as near to the specific gravity of water as possible. Discs shall be of the three-piece design of the thrust roller type.
- 4. The register shall be straight reading U.S. gallon type. The register unit shall be completely encased and hermetically sealed and driven by permanent magnets. There shall be a test index circle, divided into 100 equal parts, and shall have a red center sweep test hand. Registers shall be guaranteed by the manufacturer for a period of at least fifteen (15) years.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

5. New Service Meters shall include meter box and cover, meter, copper setter, four feet (4') of pipe and corporation stop, plus six feet (6') of pipe and adapter on the customer's side of meter. (This latter item is to prevent the customer or his plumber from disarranging or loosening the meter after the CONTRACTOR has already set the meter in its proper position.) Where the main line is in the highway right-of-way, meter shall be set as close to the right-of-way fence as practicable, but no meter on the same side of the road as the main line shall be set with more than ten feet (10') of service line unless prior approval has been obtained from the ENGINEER or his representative.
6. Meters shall be installed at each service connection unless directed otherwise by the ENGINEER. Meter boxes shall be concrete or PVC pipe twenty-four inches (24") deep. The box shall be twenty inches (20") in diameter. Meter box cover shall be eleven and one-half inches (11 1/2") diameter by four inches (4") deep. Meters shall be five-eighths inch by three-fourths inch (5/8" x 3/4"), unless shown otherwise on the plans. Meter connections shall be made by means of copper setters having a cutoff and three-fourths inch (3/4") spud. When shown on the plans (Standard Details) an angle check valve shall be furnished on the meter outlet side of the copper setter. (The size of meter box stated is for five-eighths inch by three-fourths inch (5/8" x 3/4") meter. For larger meters, meter box size shall be in accordance with standard practice). Alternative boxes may be considered upon submittal of shop drawings and performance data.
7. Meters shall be set in a workmanlike manner with backfill neatly compacted in place. In yards, pastures and other grassed areas, top of meter box will be one-half inch (1/2") above grade, otherwise two inches (2") above grade.

2.03 SERVICE LINES

- A. Unless indicated otherwise on the plans, all service lines shall be three quarter inch (3/4-inch) 250 psi Polyethylene tubing. A generous loop of Polyethylene tubing shall be included with the length required for the meter setting. A corporation stop shall be used on each service line at the main line connection.
- B. Service lines crossing a county road or city street will be jacked beneath paved or black topped city streets or county roads, unless rock prevents using this method. Open cut shall be used on all unpaved city streets, county roads and private driveways. Black topped private driveways shall also be jacked under. In all cases where lines are under traffic, a minimum cover of thirty inches (30") shall be provided. All backfill shall be puddled or compacted by air tampers in layers no greater than six inches (6") in depth.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- C. Existing service meters shall be disconnected from existing water mains where indicated and shall be reconnected to the new line. This work shall include up to thirty (30) lineal feet of matching type/diameter service line in the unit price bid for meter reconnection. Compression couplings with inserts shall be used to reconnect flexible (plastic) service line and sweat joints used for copper service line.

END OF SECTION

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

SECTION 05540

CASTINGS

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, materials, and equipment required to install castings as shown on the Drawings and specified herein. Included in this section are manhole covers, steps, valve boxes, and hatch covers.

1.02 RELATED WORK NOT INCLUDED

- A. Concrete is included in KYTC Standard Specifications for Road and Bridge Construction, most current edition, Division 600.

1.03 SUBMITTALS

The CONTRACTOR shall submit to the ENGINEER, in accordance with Division 1, Section 01300, copies of construction details of castings proposed for use.

PART 2 MATERIALS

2.01 GENERAL

- A. All castings shall be gray iron, conforming to the requirements of the ASTM Standards, Designation A48 - latest revision, Class 35B.

2.02 MANHOLE CASTINGS

- A. Frames and Covers
 - 1. Sanitary sewer manhole castings shall consist of cast iron frames and 22-3/4 inch diameter covers, having a combined weight of not less than 350 pounds for out of traffic locations and 460 pounds for traffic locations. The frame shall be at least 7 inches high overall. Manhole covers must set neatly in the frame, with contact surfaces machined smooth for even bearing. The top of the cover shall be flush with the frame edge. The top of the cover shall sufficient corrugations to prevent slipperiness and be marked in large letters "SANITARY SEWER." Covers shall have one pick hole only, about 1-1/2 inches wide and 3/4 inch deep with 3/8 inch square undercut at rear and 3/4 inch square undercut on sides. Covers on sanitary sewer manholes must not be perforated and shall be as manufactured by J.R. Hoe & Sons, Inc. or approved equal.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

2. Storm sewer manhole castings shall consist of cast iron frames and 22-3/4 inch diameter grate type covers, having a combined weight of not less than 460 pounds. The frames shall be at least 7 inches high overall. Manhole covers must set neatly in the frame with contact surfaces machined smooth for even bearing. The top of the cover shall be flush with the frame edge. The castings shall be Neenah Foundry Company with type "D" grate, or approved equal.

B. Steps

1. Cast iron or polypropylene plastic encapsulated steel manhole steps shall be patterns shown on the detail Drawings, and have corrugated treads. In case of need for non-protruding steps, shop drawings of special inset cast iron steps shall be reviewed by and be acceptable to the ENGINEER.
2. If a step constructed of another material is going to be considered, shop drawings will need to be submitted far enough in advance to allow consideration.
3. It is intended that the cast iron step be Neenah Foundry Company's R-1980-E, or equal, and the polypropylene plastic encapsulated steel step be M.A. Industries PS-1, or equal.

2.03 VALVE BOXES

A. Slip Type for Iron Body Gate Valves

1. Valve boxes for 2 inch through 10 inch valves shall be the 2 piece slip type, screw type, of sufficient length to allow for 36 inches of cover over the top of the pipe. The inner section shall have a minimum inside diameter of 5-1/4 inches with a hood type base that will cover the packing gland on a 2 inch through 10 inch valve (minimum of 8 inches inside diameter). The base of the top section shall be flanged at least 1-1/4 inches. A concrete collar shall be poured with typical dimensions of 24" x 24" x 6" deep as shown in the detail drawing. The caps shall be circular with a corrugated surface and have pick holes in the periphery and be marked "Water", "Gas", "Sewer", or "Air" according to use. For 12 inch through 16 inch valves, the valve boxes shall be Opelika Foundry Company No. 4907 for cast iron or approved equal.
2. Valve boxes for valves in the horizontal position shall be Opelika Foundry Company No. 4907 for cast iron or approved equal, with a base that is sized to allow covering of the bevel gear case and centering of the operating nut in the valve box.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

PART 3 EXECUTION

3.01 INSTALLATION

- A. The installation of castings is generally covered under specifications for pipe work and manholes. Castings shall be leveled, plumbed, secured, and installed in accordance with the Drawings.

END OF SECTION

SECTION 15100

VALVES AND PLUMBING SPECIALTIES

PART 1 GENERAL

1.01 WORK INCLUDED

- A. Furnish all labor, materials, equipment, and incidentals required, and install complete and ready for operation, all valves and appurtenances as show on the Drawings and as specified herein.

1.02 RELATED WORK

- A. Excavation is included in KYTC Standard Specifications for Road and Bridge Construction, most current edition, Division 200.

1.03 SYSTEM DESCRIPTION

- A. All of the equipment and materials specified herein is intended to be standard for use in controlling the flow of potable water or drainage as shown on the drawings.

1.04 QUALITY ASSURANCE

- A. All of the types of valves and appurtenances shall be products of well established firms who are fully experienced, reputable and qualified in the manufacture of the particular equipment to be furnished. All materials of construction shall be of an acceptable type and shall be designated for the pressure and temperature at which they are to be operated, for the materials they are to handle and for the use for which they are intended. The materials shall meet established technical standards of quality and strength necessary to assure safe installations and conform to applicable standards. The equipment shall be designed, constructed and installed in accordance with the best practices and methods and shall comply with these Specifications as applicable.

1.05 REFERENCES

- A. Kentucky Basic Building Code.
- B. Kentucky State Plumbing Law, Regulations and Code

1.06 SUBMITTALS

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- A. Copies of all materials required to establish compliance with these Specifications shall be submitted in accordance with the provisions of Division 1, Section 01300. Submittals shall include at least the following:
1. Certified drawings showing all important details of construction and dimensions.
 2. Descriptive literature, bulletins, and/or catalogs of the equipment.
 3. The total weight of each item.
 4. A complete total bill of materials.
 5. A list of the manufacturer's recommended spare parts.

1.07 OPERATING INSTRUCTIONS

- A. Operating and maintenance instructions shall be furnished to the ENGINEER as provided in Division 1. The instructions shall be prepared specifically for this installation and shall include all required cuts, drawings, equipment lists, descriptions, etc., that are required to instruct operating and maintenance personnel unfamiliar with such equipment.

PART 2 PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. General
1. All valves and appurtenances shall be of the size shown on the Drawings and as far as possible all equipment of the same type shall be from one manufacturer.
 2. All valves and appurtenances shall have the name of the maker, flow directional arrows, and the working pressure for which they are designed cast in raised letters on some appropriate part of the body.
 3. All buried valves shall open left (counterclockwise). Insofar as possible, all valves shall open counterclockwise.

2.02 VALVES

- A. Gate Valves

Gate valves shall be used in shut-off applications and where the valves are scheduled for infrequent use.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1. Gate Valves – 2-1/2 Inches and Smaller
 - a. Gate valves shall be for 125-pound water working pressure, 2-1/2 inches and 3 inches for air release. Valves 3 inches and smaller shall be standard brass construction, rising stem, double disc, parallel seat, with handwheel where exposed or key operated when in the ground. The valves shall be Crane No. 440, Jenkins 62U or approved equal.
 - b. In copper-solder-joint piping, Chase Style 1334 or approved equal, gate valves are preferred with solder joint connections.

2. Gate Valves and Appurtenances for Yard Piping – 3 to 14 inches
 - a. Gate valves for water shall meet the requirements of AWWA C509 covering resilient seated gate valves. Valves shall be rated for 200-psi working pressure and a minimum of 400-psi test pressure. The wedge shall be of cast iron completely encapsulated with rubber. The sealing rubber shall be permanently bonded to the cast iron wedge to meet ASTM tests for rubber metal bond ASTM D429. They shall have non-rising cast bronze stems (unless otherwise shown on the PLANS) and be fitted with “O-ring” seals. The operating nuts shall be 2-inch square. All valves shall open left, or counterclockwise. Stuffing boxes shall be the “O-ring” type with two rings located above thrust collar; the two rings shall be replaceable with valve fully open and subjected to full rated working pressure. Gate valves shall be mechanical joint, ANSI Standard 21.11 except where shown otherwise. The body and bonnet shall be coated with a fusion coating both interior and exterior to meet C50. Each valve shall have maker’s name, pressure rating and year in which manufactured cast on the body. Gate valves shall be as manufactured by Mueller Co., or approved equal.
 - b. Tapping sleeves shall be as manufactured by the Ford Meter Box Company, Inc., with cadmium-plated cast iron nuts and bolts. Sleeves shall be of cast iron, designated for working pressures not less than 200 psi. Lead gaskets shall be provided for the full area of the sleeve flanges.
 - b. Tapping valves shall conform to the requirements specified above for gate valves except that one end shall be flanged and one mechanical. Tapping valves shall be provided

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

with an over-sized opening to permit the use of full sized cutters.

- c. Four tee-handled gate wrenches of suitable length shall be furnished to operate all valves with valve boxes.

3. Gate Valves for Inside Service – 3 to 14 inches

Gate valves 3” and larger in size, unless otherwise specified shall be iron body, bronze mounted, solid wedge gate valves with flanged ends and conforming to the AWWA Standard Specification for Gate Valve for Water and Sewage Systems, Designation C509-latest revision, insofar as applicable and in addition to the following requirements:

- a. Valve shall be outside screw and yoke type with rising stem (unless otherwise shown on the PLANS).
- b. Flanges shall be faced and drilled to ANSI B16.1 125 pound template, unless otherwise shown on the PLANS.
- c. Bronze gate rings shall be fitted into grooves of dovetail or similar shape in the gates. For grooves or other shapes, the rings shall be firmly attached to the gates with bronze rivets.
- d. Handwheels shall turn counterclockwise to open the valves. Handwheels shall be of ample size and shall have an arrow and the word “OPEN” cast thereon to indicate the direction of opening.
- e. Stuffing box follower bolts shall be of steel and the nuts shall be of bronze.
- f. The design of the valves shall permit packing the valves without undue leakage while they are wide open and in service.
- g. O-ring stuffing boxes may be used.
- h. Gate valves for pipeline installation shall be housed in an adjustable two-piece cast iron valve box and have a cover with the word “Water” or “Sewer” stamped or cast.
- i. Gate valves with spur gears shall be housed to accommodate the offset of the operating nut.

B. Ball Valves

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

Ball valves shall normally be used in quick shut-off and frequent use applications. Specified valves shall be as indicated on the drawings.

1. Ball Valves - bronze

- a. Ball valves shall be for 125-pound water working pressure, 2 inches and smaller, standard bronze construction, with precision machined bronze ball, twin Buna-N seats, and handle operator with integral stop where exposed. Buried ball valves shall be as above with key or nut operators. Valves shall be Lunkenheimer No. 700-SB, Ford, or approved equal.

2. Ball Valves - PVC

- a. Ball valves shall be for 150 pound water working pressure, 140 degree Fahrenheit maximum temperature, 3 inches and smaller, standard PVC "True Union" construction, with PVC ball, Viton seats, and handle operator where exposed. Buried ball valves shall be as above with key, nut, pneumatic, or electric operators as shown on the DRAWINGS. Valves shall be Utilities Supply Corp., Plastic Piping Systems, or approved equal.

C. Individual Pressure Reducing Valves

1. Individual pressure reducing valves shall be installed where shown on the plan sheets.
2. Individual pressure reducing valves shall be Wilkens, Model No. 600LU, or approved equal, and shall include a bronze strainer. Every regulator shall have an adjustable pressure range of 50 to 125 pounds per square inch. Upon installation, the outlet pressure shall be set at 65 pounds per square inch.
3. Individual pressure reducing valves shall be installed on the inlet/supply side of the service meter using a tandem coppersetter. The CONTRACTOR shall ensure the meter boxes proposed for installation will accommodate the tandem coppersetter, reducing valve and service meter.
4. The reducing valve shall not be buried or otherwise housed outside the meter box.

D. Large Pressure Reducing Valves

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1. Pressure reducing valves shall be of the single seated balanced design type globe body with threaded inlet and outlet ports. It shall be diaphragm operated, spring loaded permitted adjustment over a range of no less than 30 psi.
2. The body shall be bronze construction with bronze or stainless steel stem and furnished with a replacement rubber seat.
3. The pressure reducing valves shall be Mermad, G-A Industries, APCO, or approved equal.

E. Pressure Relief Valves

The pressure relief valve shall relieve excessive system pressure when this pressure rises above pre-set value. It shall immediately, accurately, and with high repeatability respond to system pressure rise by fully opening as well as provide smooth drip-tight closing.

1. Main Valve: The main valve shall be a center guided, diaphragm actuated globe valve of angle pattern design. The body shall have a replaceable, raised, stainless steel seat ring. The valve shall have an unobstructed flow path, with no stem guides, bearings, or supporting ribs. The body and cover shall be ductile iron. All external bolts, nuts, and studs shall be Duplex® coated. All valve components shall be accessible and serviceable without removing the valve from the pipeline. End connections shall be ANSI-300 flange fittings. Valves shall receive a factory-applied epoxy coating.
2. Actuator: The actuator assembly shall be double chambered with an inherent separating partition between the lower surface of the diaphragm and the main valve. The entire actuator assembly (seal disk to top cover) shall be removable from the valve as an integral unit. The stainless steel valve shaft shall be center guided by a bearing in the separating partition. The replaceable radial seal disk shall include a resilient seal and shall be capable of accepting a V-Port Throttling Plug by bolting.
3. Control System: The control system shall consist of a 2-Way adjustable, direct acting, quick pressure relief pilot valve, a testing cock valve, and a filter. All fittings shall be forged brass or stainless steel. The assembled valve shall be hydraulically tested and factory adjusted to customer requirements.
4. Quality Assurance: The valve manufacturer shall be certified according to the ISO 9001 Quality Assurance Standard. The main valve shall be certified as a complete drinking water valve according to NSF, WRAS, and other recognized standards.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

5. Valves shall be Bermad 73Q Quick Pressure Relief Valve or approved equal.

F. Check Valves - Drainage

Check valves for backflow prevention in drainage (non-pressure) pipes shall be EPDM "duckbill" style construction utilizing 316 SS mounting bands for piping connection. Valves shall be designed for a maximum cracking pressure of 2" water column. Valves shall be Tideflex TF-2 or approved equal.

2.03 SPECIALTIES AND ACCESSORIES

A. Strainers, Filters, and Dryers

1. Strainers for Water Service

- a. Strainers shall be "Y" type with a cast iron body manufactured in accordance with ASTM A126-latest revision Class B steel, sizes 3/4 inch thru 12 inches. Strainer shall be rated at 200 psi pressure @ -20 to 150 deg F, and 125 @ 450 deg F., with a 304 stainless steel 0.125" perforated screen.
- b. Cover shall be carbon steel manufactured in accordance with ASTM A126-B latest revision. Cover shall contain a blow off outlet with an NPT outlet for connection of a drain valve.
- c. Contractor shall furnish and install on the blow off outlet, a stainless steel ball valve and cast iron piping directed to the floor drain.
- d. Strainers shall be Mueller, Model 758, Bermad or approved equal.

B. Dielectric Pipe Couplings

1. Dielectric pipe couplings shall be used wherever copper pipe connects to steel or cast iron pipe and appurtenances. Couplings shall have steel bodies with non-conducting bushings on both ends. Ends shall have standard pipe threads. Couplings shall be rated for at least 200 psi at 225°F. Couplings shall be as manufactured by Thermodynamics Corporation, Needham, MA; Water Vallett Company, Detroit, MI; or approved equal.

C. Valve Boxes

1. Slip Type for Iron Body Gate Valves

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- a. Valve boxes for 2 inch through 10 inch valves shall be the 2 piece slip type, without screw, of sufficient length to allow for 36 inches of cover over the top of the pipe, Tyler 6855 series, model #562-A, or approved equal. The inner section shall have a minimum inside diameter of 5-1/4 inches with a hood type base that will cover the packing gland on a 2 inch through 10 inch valve (minimum of 8 inches inside diameter). The base of the top section shall be flanged at least 1-1/4 inches. The caps shall be circular with a corrugated surface and have pick holes in the periphery and be marked "Water", "Gas", "Sewer", or "Air" according to use. For 12 inch through 16 inch valves, the valve boxes shall be Opelika Foundry Company No. 4907 for cast iron or approved equal.
- b. Valve boxes for valves in the horizontal position shall be Opelika Foundry Company No. 4907 for cast iron or approved equal, with a base that is sized to allow covering of the bevel gear case and centering of the operating nut in the valve box.

PART 3 EXECUTION

3.01 INSTALLATION

- A. All valves and appurtenances shall be installed in the locations shown, true to alignment and rigidly supported. Any damage to the above items shall be repaired to the satisfaction of the ENGINEER before they are installed.
- B. Control valves in all locations shall be so grouped and located that they may be easily operated, through access panels, doors, or adjacent to equipment.
- C. After installation, all valves and appurtenances shall be tested at least one hour at the working pressure corresponding to the class of pipe, unless a different test pressure is specified. If any joint proves to be defective, it shall be repaired to the satisfaction of the ENGINEER.
- D. Install all brackets, extension rods, guides, the various types of operators and appurtenances as shown on the DRAWINGS in masonry floors or walls, and install concrete inserts for hangers and supports as soon as forms are erected and before concrete is poured. Before setting these items, the CONTRACTOR shall check all DRAWINGS and figures which have a direct bearing on their location and he shall be responsible for the proper location of these valves and appurtenances during the construction of the structures.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- E. All materials shall be carefully inspected for defects in workmanship and materials; all debris and foreign material cleaned out of valve openings, etc.; all operating mechanisms operated to check their proper functioning, and all nuts and bolts checked for tightness. Valves and other equipment which do not operate easily, or are otherwise defective, shall be repaired or replaced at no additional cost to the OWNER.
- F. Fire hydrants, flushing hydrants and yard hydrants shall be set at the locations as shown on the DRAWINGS and bedded on a firm foundation. A drainage pit as detailed on the DRAWINGS shall be filled with screened gravel and satisfactorily compacted.
- G. During backfilling, additional screened gravel shall be brought up around, and 6-inches over, the drain port. Each hydrant shall be set in true vertical alignment and properly braced. Concrete thrust blocks shall be placed between the back of the hydrant inlet and undisturbed soil at the end of the trench. Minimum bearing area shall be as shown on the DRAWINGS. Felt roofing paper shall be placed around hydrant elbow before placing concrete. CARE SHALL BE TAKEN TO INSURE THAT CONCRETE DOES NOT PLUG THE DRAIN PORTS.
- H. If directed, the hydrant shall be tied to the pipe with suitable rods or clamps, galvanized, painted, or otherwise rustproof treated. Concrete used for backing shall be no leaner than 1 part cement, 2-1/2 parts sand, and 5-1/2 parts stone. Hydrant paint shall be touched up as required after installation.
- I. Buried flanged or mechanical joints shall be made with cadmium-plated bolts. All exposed bolts and nuts shall be cadmium-plated. All exposed bolts and nuts shall be heavily coated with two coats of bituminous paint.
- J. Yard hydrants shall be installed in accordance with manufacturer's recommendation and applicable requirements of the fire hydrants above.
- K. Buried valves and valve boxes shall be set with the valve stem vertically aligned in the center of the box. Valves shall be set on firm foundation and supported by tamping selected excavated material under the sides of the valve. The valve box shall be supported during backfilling and maintained in vertical alignment with the top flush with finish grade.

3.02 SHOP PAINTING

- A. Interior surfaces of all valves, the exterior surfaces of buried valves, and miscellaneous piping appurtenances shall be given a shop finish of an asphalt varnish conforming to Federal Specification TT-V51e for Varnish Asphalt.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- B. The exterior surface of various parts of the valves, operators, floor stands and miscellaneous piping shall be thoroughly cleaned of all scale, dirt, grease or other foreign matter and thereafter one shop coat of an approved rust-inhibitive primer, such as Inertol Primer No. 621, shall be applied in accordance with the instructions of the paint manufacturer.
- C. Ferrous surfaces obviously not to be painted shall be given a shop coat of grease or other suitable rust-resistant coating.
- D. Field painting is specified under Division 9, Section 09900.

3.03 INSPECTION AND TESTING

- A. The various pipelines in which the valves and appurtenances are to be installed are specified to be field-tested. During these tests any defective valve or appurtenance shall be adjusted, removed and replaced, or otherwise made acceptable to the ENGINEER.
- B. Various regulating valves, strainer, or other appurtenances shall be tested to demonstrate their conformance with the specified operational capabilities and any deficiencies shall be corrected or the device replaced or otherwise made acceptable to the ENGINEER.

END OF SECTION

SECTION 15101

LARGE VALVES AND APPURTENANCES

PART 1 GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, materials, equipment, and incidentals required and install complete and ready for operation all valves and appurtenances where shown on the Drawings as specified herein.
- B. The equipment specified herein includes the following:
 - 1. Gate valves with boxes for yard piping
 - 2. Gate valves for inside service
 - 3. Butterfly valves for yard piping
 - 4. Butterfly valves for inside service
 - 5. Plug valves for yard piping
 - 6. Plug valves for interior or above ground service
 - 7. Ball valves
 - 8. Check valves
 - 9. Air and vacuum relief valves (piping application)
 - 10. Automatic air release valves
 - 11. Shock absorbers
 - 12. Service clamps
 - 13. Expansion joints
 - 14. Pressure-reducing valves
 - 15. Back Pressure Sustaining Valves
- C. The work of this Section shall include the installation of valve tags furnished by the CONTRACTOR. All exposed valves provided under this Section shall be tagged.

1.02 RELATED WORK NOT INCLUDED

- A. Excavation, backfill, fill and grading is included in KYTC Standard Specifications for Road and Bridge Construction, most current edition, Division 200.
- B. Piping is included in the respective sections of Division 2 and 15.
- C. Valves, hydrants, meters and service lines for distribution system application are included in Division 2.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- D. Valves and service accessories on all plumbing systems are included in this Division, Section 15100.

1.03 DESCRIPTION OF SYSTEMS

- A. All of the equipment and materials specified herein is intended to be standard for use in controlling the flow of wastewater, sludges, water, air or chemicals, depending on the applications.

1.04 QUALIFICATIONS

- A. All of the types of valves and appurtenances shall be products of well-established firms who are fully experienced, reputable and qualified in the manufacture of the particular equipment to be furnished. The equipment shall be designed, constructed and installed in accordance with the best practices and methods and shall comply with these SPECIFICATIONS as applicable.

1.05 SUBMITTALS

- A. Complete shop drawings of all valves and appurtenances shall be submitted to the ENGINEER in accordance with the requirements of Division 1.
- B. Furnish all information required in Division 1.

1.06 OPERATING INSTRUCTIONS

- A. Manufacturer's operating and maintenance instructions as set forth in Division 1 shall be furnished to the ENGINEER for equipment furnished under this Section.

1.07 TOOLS

- A. Special tools, if required for normal operation and maintenance, shall be supplied with the equipment.

PART 2 PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. General
 - 1. All valves and appurtenances shall be of the size shown on the PLANS and as far as possible all equipment of the same type shall be from one manufacturer.
 - 2. All valves and appurtenances shall have the name of the maker, flow-directional arrows, and the working pressure for which they

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

are designed cast in raised letters on some appropriate part of the body.

3. Handwheel operator shall be no less than 12-inch diameter.
4. Except as otherwise shown on the PLANS or specified herein, all valves with operators located 7 feet or more above the operating floor shall be provided with chain-wheel operators complete with chain guides and galvanized steel chain.
5. All buried valves shall open left (counterclockwise). Insofar as possible, all valves shall open counterclockwise.
6. All butterfly valves, gate valves and plug valves 8 inches or larger shall be furnished with gear operators and gear cases conforming to the requirements of AWWA C504 or as shown on the PLANS.

2.02 VALVES

A. Butterfly Valves for Buried Service

1. Butterfly valves and operators for buried service shall conform to AWWA C504, except as hereinafter provided. Butterfly valves shall be rated for Class 150B and both valve and operator shall be especially designed for service buried in the ground where the ground water may at times completely submerge the valve and operator, and shall be of the totally enclosed type.
2. The valve bodies shall be of cast iron conforming to ASTM A48-CL 40. Valve ends shall be mechanical joint meeting ANSI Specification A21.11.
3. Except as otherwise specified herein, valve shafts shall be of Type 304 stainless steel. Shaft seals shall be rubber O-ring seals. Shafts having a minimum torsional strength equivalent to shafts specified in Section 3.3 of AWWA C504 and completely isolated from the pipeline contents shall be furnished. Connections between shafts and discs shall be designed to transmit full shaft torque.
4. If the rubber seat is in the body, the disc shall be of an alloy cast iron conforming to ASTM A436 Type I with the periphery machined to a smooth spherical surface. If the rubber seat is mounted on the disc edge it shall be held in place by a one-piece Type 304 stainless steel retaining ring and stainless steel screws, the disc shall be of ASTM A48, Class 40 cast iron and a mating Type 304 stainless steel ring shall be installed in the valve body.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

5. The unit shall be permanently lubricated with grease or oil. A standard AWWA 2 inch square operating nut shall be provided on the input shaft and it shall have a cap to center the valve box. Valves shall open to the left (counterclockwise).
 6. Valve and operator assemblies shall be given two coats of asphalt varnish conforming to Section 4 of AWWA C504.
 7. An Affidavit of Compliance in accordance with Section 1.5 of AWWA C504 shall be furnished to the ENGINEER prior to shipment of valves to the job site.
 8. Valve boxes shall be provided for each buried valves. Valve boxes and appurtenances are specified in Division 5, Section 05540.
 9. Four tee-handled gate wrenches of suitable length shall be furnished to operate all valves with valve boxes.
- B. Butterfly Valves (for Interior Service)
1. Butterfly valves and operators shall conform to the AWWA Standard Specification for rubber seated butterfly valves Designation C504, except as hereinafter specified. Valves shall have a minimum 150-psi pressure rating and be equal to those manufactured by Allis-Chalmers, Henry Pratt Company, or equal.
 2. Butterfly valves shall be flanged end with face-to-face dimensions in accordance with Table 3 of the above mentioned AWWA Specification for short-body valve, or wafer type.
 3. Valve seats shall be full resilient seats retained in the body or the disc edge in accordance with Section 3.5 of the above mentioned AWWA Specification. If the resilient seat is in the body, the disc shall be of an alloy cast iron conforming to ASTM A436 Type 1 with the periphery machined to a smooth spherical surface. If the resilient seat is mounted on the disc edge, it shall be held in place by a one-piece Type 304 stainless steel retaining ring and stainless screws, the disc shall be of ASTM A48, Class 40 cast iron and a mating Type 304 stainless steel ring shall be installed in the valve body. Resilient seats shall be Hycar or equal for water service and Nordel or equal for air service.
 4. The valve body shall be constructed of close grain cast iron per ASTM A126, Class B with integrally cast hubs for shaft bearing housings of the through boss-type. Permanently self-lubricating body bushings shall be provided and shall be sized to withstand bearing loads. Stuffing box of liberal dimensions shall be provided at the operator end of the vane shaft, arranged so that

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

the packing can be replaced by removing the bronze follower without removing the operator. Packing shall be of the Chevron type as manufactured by Garlock Packing Company. A sealing element utilizing O-rings shall also be acceptable.

5. The valve shaft shall be of Type 304 stainless steel and designed for both torsional and shearing stresses when the valve is operated under its greater dynamic or seating torque.
6. In general, the butterfly valve operators shall conform to the requirements of Section 3.8 of the AWWA Standard Specifications for Rubber Seated Butterfly Valves, Designation C504, insofar as applicable and as herein specified.
7. Gearing for the operators where required shall be totally enclosed in a gear case in accordance with Section 3.8.3 of the above mentioned AWWA Standard Specification.
8. The manual operators shall conform to Section 3.8.2 of the above mentioned AWWA Standard Specifications, insofar as applicable. Valves shall have Handwheel or lever operators and open left, or counterclockwise. Operators shall have indicators to show position of the valve disc. Operators shall be rigidly attached to the valve body.

C. Gate Valves and Appurtenances for Yard Piping

1. Gate valves for water shall meet the requirements of AWWA C509 covering resilient seated gate valves. Valves shall be rated for 200-psi working pressure and a minimum of 400-psi test pressure. The wedge shall be of cast iron completely encapsulated with rubber. The sealing rubber shall be permanently bonded to the cast iron wedge to meet ASTM tests for rubber metal bond ASTM D429. They shall have non-rising cast bronze stems (unless otherwise shown on the PLANS) and be fitted with "O-ring" seals. The operating nuts shall be 2-inch square. All valves shall open left, or counterclockwise. Stuffing boxes shall be the "O-ring" type with two rings located above thrust collar; the two rings shall be replaceable with valve fully open and subjected to full rated working pressure. Gate valves shall be mechanical joint, ANSI Standard 21.11 except where shown otherwise. The body and bonnet shall be coated with a fusion coating both interior and exterior to meet C50. Each valve shall have maker's name, pressure rating and year in which manufactured cast on the body. Gate valves shall be as manufactured by Mueller Co., or approved equal.
2. Tapping sleeves shall be as manufactured by the Ford Meter Box Company, Inc., with cadmium-plated cast iron nuts and bolts.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

Sleeves shall be of cast iron, designated for working pressures not less than 200 psi. Lead gaskets shall be provided for the full area of the sleeve flanges.

3. Tapping valves shall conform to the requirements specified above for gate valves except that one end shall be flanged and one mechanical. Tapping valves shall be provided with an over-sized opening to permit the use of full sized cutters.
4. Four tee-handled gate wrenches of suitable length shall be furnished to operate all valves with valve boxes.

D. Gate Valves for Inside Service

1. See Section 15100 of these SPECIFICATIONS for gate valves 2-1/2" in diameter and smaller.
2. Gate valves 3" and larger in size, unless otherwise specified shall be iron body, bronze mounted, solid wedge gate valves with flanged ends and conforming to the AWWA Standard Specification for Gate Valve for Water and Sewage Systems, Designation C509-latest revision, insofar as applicable and in addition to the following requirements:
 - a. Valve shall be outside screw and yoke type with rising stem (unless otherwise shown on the PLANS).
 - b. Flanges shall be faced and drilled to ANSI B16.1 125 pound template, unless otherwise shown on the PLANS.
 - c. Bronze gate rings shall be fitted into grooves of dovetail or similar shape in the gates. For grooves or other shapes, the rings shall be firmly attached to the gates with bronze rivets.
 - d. Handwheels shall turn counterclockwise to open the valves. Handwheels shall be of ample size and shall have an arrow and the word "OPEN" cast thereon to indicate the direction of opening.
 - e. Stuffing box follower bolts shall be of steel and the nuts shall be of bronze.
 - f. The design of the valves shall permit packing the valves without undue leakage while they are wide open and in service.
 - g. O-ring stuffing boxes may be used.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- h. Gate valves for pipeline installation shall be housed in an adjustable two-piece cast iron valve box and have a cover with the word "Water" or "Sewer" stamped or cast.
- i. Gate valves with spur gears shall be housed to accommodate the offset of the operating nut.

E. Gate Valves For 16 and 24 Inch Distribution Mains

1. General

Valves to be installed on 16 and 24-inch high service and transmission lines shall conform to the latest revision of AWWA Standard C-509 covering resilient seated gate valves. These large diameter valves shall be as manufactured by Clow Valve Co., M & H Valve Co., or approved equal.

2. Design

The valves shall be either, **non-rising stem**, opening by turning stem left or right and provided with **2" square operating nut or handwheel** with the word Open and an Arrow cast in the metal to indicate direction to open.

The wedge shall be of cast iron completely encapsulated with rubber.

The sealing rubber shall be permanently bonded to the cast iron wedge to meet ASTM tests for rubber metal bond ASTM D429.

Stems for NRS assemblies shall be cast bronze with integral collars in full compliance with AWWA. OS & Y stems shall be on bronze bar stock. The NRS stem stuffing box shall be the o-ring seal type with two rings located above thrust collar; the two rings shall be replaceable with valve fully open and subjected to full rated working pressure.

There shall be two low torque thrust bearings located above and below the stem collar. The stem nut shall be independent of wedge and shall be made of solid bronze. There shall be a smooth unobstructed waterway free of all pockets, cavities and depressions in the seat area.

3. Materials

All cast iron shall conform to ASTM-A-126 Class C. Castings shall be clean and sound without defects that will impair their service. No plugging or welding of such defects will be allowed.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

Stems shall be manganese bronze having a minimum tensile strength of 60,000 psi, a minimum yield of 20,000 psi.

Bolts shall be electro-zinc plated steel with hex heads and hex nuts in accordance with ASTM A-307 and A-563, respectively.

4. Testing

Prior to shipment from factory, each valve shall be tested by hydrostatic pressure equal to twice the specified working pressure of 250 psi.

5. Coating AWWA

The body and bonnet shall be coated with a fusion coating both interior and exterior to meet C550.

6. Marking

Valves shall be marked with name of manufacturer, the year of manufacture, the maximum working pressure and size of valve.

F. Plug Valves for Interior or Above Ground Service

1. Plug valves shall be manufactured in accordance with AWWA C-504, shall be of the 1/4 turn, eccentric, non-lubricated type, serviceable under full line pressure, and capable of sealing in both directions at the rated pressure. Valves shall have a minimum port area of 80% of the nominal pipe size. The valve body shall be of cast iron, 30,000 psi tensile strength with added nickel and chromium, ASTM A-126, Class B, 175 psi rating. Valve ends shall be flanged. The valve plug shall be ductile iron conforming to ASTM A-536, Grade 65-45-12 with neoprene resilient facing. The valve seating design shall be resilient and of the continuous interface type having consistent opening/closing torques and shall be non-jamming in the closed position. Closure shall be accomplished by means of an off-set plug design with a resilient seating face that achieves full 360 degree seating contact. Valves shall be of the bolted bonnet design. The resilient faced plug shall be replaceable without removing the valve body from the line. The valve body seating area shall be corrosion resistant by a welded-in overlay of high nickel content. Sprayed or plated seating surfaces will not be acceptable. Valves shall have permanently lubricated Type 316 stainless steel bearings on the upper and lower plug stem journal. Bearings shall be replaceable. Packing shall be Buna N (Vee Type) rated for 150 psig working pressure. Packing shall be adjustable and valves shall be designed such that they can be repacked without removing the bonnet. All exposed nuts, bolts, springs, and washers shall be

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

zinc plated, except exposed hardware for submerged valves that shall be of stainless steel.

2. All valves shall be equipped with gear actuators and handwheel operators (unless otherwise shown on the PLANS). All gearing shall be enclosed suitable for running in oil with seals provided on all shafts to prevent entry of dirt and water into the actuator. All shaft bearings shall be furnished with permanently lubricated bronze bearing bushings. Actuator shall clearly indicate valve position and an adjustable stop shall be provided. Construction of actuator housing shall be semi-steel. Hardware on actuators shall be of the same materials as the valves.
3. All valves and actuators shall be as manufactured by DeZurik Corporation or equal.
4. All plug valves shall be installed so that the direction of flow through the valve is in accordance with the manufacturer's recommendations.

G. 3-Way Plug Valves

1. Valves shall be of the non-lubricated taper plug type and shall have resilient faced plugs for drip tight shutoff. End connections shall be flanged and shall be drilled to ANSI 125 pound standard. Valves shall be semi-steel and shall have stainless steel bearings in the upper and lower journal areas. The three-way valve shall be furnished as standard with a plug to shut off one port at a time.
2. The valve shall be furnished with a resilient facing bonded to the plug sealing surface and shall have double handwheel actuators. The actuator shall be of the worm and gear type and shall have one handwheel to lift and reseal the plug and one handwheel to rotate the plug. Handwheel actuators shall be totally enclosed and shall have seals and gaskets to prevent entry of dirt, water or corrosive atmosphere. Actuators shall have corrosion resistant bearings on the gear sector. Actuators shall provide plug rotation up to 360°.
3. The 3-way valves, actuators and accessories shall be as manufactured by DeZurik Corporation, or equal.

H. Plug Valves for Yard Piping

1. Plug valves for yard piping shall be as specified above for interior plug valves, except valves shall have mechanical joint ends and stainless steel hardware. Buried actuators shall be as specified above and shall be of buried, submerged service with seals on all covers and shafts and all exposed hardware of stainless steel.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

Provide valve box, stem extension, and operating nut as specified above for gate valves.

- I. Ball Valves
 - 1. See Section 15100 of these SPECIFICATIONS.
- J. Check Valves
 - 1. Check valves for cast iron and ductile iron pipelines shall be swing type and shall meet the material requirements of AWWA Specification C508-latest revision Swing-Check Valves for ordinary water-works service. The valves shall be iron body, bronze mounted, single disc, 150 psi working water pressure, non-shock, and hydrostatically tested at 300 psi. Ends shall be 125 lb. ANSI B16.1 flanges.
 - a. When there is no flow through the line the disc shall hang lightly against its seat in practically a vertical position. When open, the disc shall swing clear of the water-way.
 - b. Check valves shall have bronze seat and body rings, extended bronze hinge pins and bronze nuts on the bolts of bolted covers.
 - c. Valves shall be so constructed that disc and body seat may easily be removed and replaced without removing the valve from the line. Valves shall be fitted with an extended hinge arm with outside lever and spring. Springs with various tensions shall be provided and springs approved by the ENGINEER shall be installed.
- K. Automatic Air and Vacuum Relief Valves for Vertical Turbine Pumps
 - 1. Combination air and vacuum valves for vertical turbine pumps shall be equal to APCO Air Valves for Vertical Turbine Pumps, per APCO Bulletin 586, as manufactured by Valve and Primer Corp., Schaumburg, Illinois, or approved equal.
 - 2. Valves shall be the size shown on the drawings and shall be equipped with an automatic air release valve, such as APCO Valve No. 55, or approved equal.
 - 3. Air valves for vertical turbine pumps shall be designed to allow large quantities of air to escape out the orifice when the pump is started and close water tight when the liquid enters the valve. The air valve shall also permit large quantities of air to re-enter through the orifice when the pump is stopped to prevent a vacuum from forming in the pump column.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

4. The valve shall consist of a body, cover, baffle, float and seat. The valve shall be designed to prevent prematurely shut-off. The seat shall be fastened into the valve cover, without distortion, and shall be easily removed, if necessary.
5. The entire float and baffle assembly must be shrouded with a perforated water diffuser to prevent the water column entering the valve, from slamming the float shut and eliminate water hammer in the system.
6. The float shall be stainless steel, designed to withstand a minimum of 1,000 psi, or approved equal. The float shall be center guided and not free floating for positive seating.
7. The discharge orifice shall be fitted with an automatic air release valve in order to vent small pockets of air. This valve shall consist of a body, cover, float and seat, and shall be rated at a working pressure of 150 psi.
8. The body, cover, and baffle of this valve assembly shall be constructed of cast iron, conforming to ASTM A48 Class 30, or approved equal. The float shall be stainless steel, conforming to ASTM A240, or approved equal. The seats shall be BUNA-N and the water diffuser shall be brass, or approved equal. All flanges shall be 125# ANSI.

L. Air Release Valves

1. Combination Air Valve Assemblies
 - a. Sizes 1-inch through 6-inch. Valve shall be single body, double orifice, allowing air to exit when filling a pipeline, and air to enter when draining. Orifices shall operate independently; the smaller release orifice shall be capable of opening when the larger is in the closed position.
 - b. The valve shall be designed to prevent premature closing. The closing mechanism shall be either needle and seat and be Buna-N, or of the rolling seal type made of Rubber E.P.DM., and attached to the valve cover to ensure drop-tight shut-off. The float shall be stainless steel, hermetically sealed, and designed to withstand pressures up to 1000 pounds per square inch, or approved equal. The float shall be of corrosion resistant materials in accordance with ASTM A240, or approved equal. The plug shall be bronze and in accordance with ASTM B124, or approved equal. The body, cover, and leverage frame shall be cast iron/Delrin and shall be in accordance with

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

ASTM A126 GR, B and ASTM D2133, reinforced Nylon, or approved equal.

- c. Valve exterior shall be painted with Red Oxide Phenolic Primer, or approved equal as accepted by the FDA for use in contact with potable water.
- d. All Combination Air Release Valves to be Val-Matic model #201C, or approved equal.
- e. Air valves shall be installed as shown in the plans, housed in a valve box with cover. Valve boxes for air valves shall be carefully set to grade with covers at grade.

2. Air Release (Vent) Valve Assemblies

- a. Air Vent Valve No. 50, or approved equal. Valve shall operate under pressure, allowing entrapped air to escape from a pipeline. Orifices shall operate by means of a simple lever mechanism (stainless steel, ASTM A240), rolling seal mechanism, or approved equal to prevent water from escaping as or after air is expelled.
- b. The closing mechanism shall be either needle and seat and be Buna-N, or of the rolling seal type made of Rubber E.P.DM., and attached to the valve cover to ensure drop-tight shut-off. The float shall be stainless steel, hermetically sealed, and designed to withstand pressures up to 1000 pounds per square inch, or approved equal. The float shall be of corrosion resistant materials in accordance with ASTM A240, or approved equal. The seat shall be of stainless steel, or approved equal. The seat shall have an orifice of 3/32 inches, or approved equal to operate up to 175 pounds per square inch (psi), or a 1/16 inch orifice when operation at pressures higher than 175 psi, or approved equal. The body shall be cast iron, ASTM A48, Class 30, or approved equal, and shall have a 1/2 inch NPT female threaded inlet and outlet, and be rated for 350 psi test pressure.
- c. Valve exterior shall be painted with Red Oxide Phenolic Primer, or approved equal as accepted by the FDA for use in contact with potable water.
- d. Valve to be Val-Matic model #15A.2, or approved equal.

M. Shock Absorbers

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

1. Shock absorbers shall be supplied on the plant water distribution piping where shown on the PLANS. The shock absorbers shall be Model 1485-1 as manufactured by Josam Manufacturing Company, Michigan City, Indiana or approved equal.

N. Service Clamps

1. Service clamps shall have malleable or ductile iron bodies, which extend at least 160 degrees around the circumference of the pipe and shall have neoprene gaskets cemented to the saddle body. Bodies shall be tapped for either corporation stop threads of IPS as required. Clamps with tap sizes 1 inch and smaller shall be of the single strap design. Clamps with tap sizes larger than 1 inch shall be of the double strap design.
2. Service clamps shall be Style 91 or 291 as manufactured by Dresser Industries, Inc., Type 311 or 313 as manufactured by Smith-Blair, Inc. or equal.

O. Expansion Joints

1. Expansion joints shall be single arch type of butyl rubber construction with carcass of high grade woven cotton or suitable synthetic fiber and individual solid steel ring reinforcement. Soft rubber fillers shall be integrally cured into the arches to prevent settling of material into the arch. Joints shall be constructed to pipeline size and to meet working pressure and corrosive conditions similar to the line where installed. Joints shall have full faced fabric reinforced butyl flanges integral with body. Split type steel backup rings shall be provided to ensure a good joint. Rings shall be designed for mating the ANSI Standard 150 lb. flanges. Joints shall have a working pressure rating of 140 psig (minimum). All joints shall be finish coated with Hypalon paint.
2. Expansion joints shall be furnished with control units. Control units shall consist of two (2) drilled plates, stretcher bolts, and rubber washers backed by metal washers. The stretcher bolts shall prevent over-elongation of the joint. Extra nuts shall be provided on the stretcher bolts on the inside of the plate to prevent over-compression. All nuts, bolts and plates shall be galvanized.
3. Expansion joints shall be Style 500B as manufactured by Mercer Rubber Company, Style 4140 by Uniroyal Company, or equal.

P. Pressure Reducing Valves

1. Pressure reducing valves shall be of the single seated balanced design type globe body with threaded inlet and outlet ports. It

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

shall be diaphragm operated, spring loaded permitted adjustment over a range of no less than 30 psi.

2. The body shall be bronze construction with bronze or stainless steel stem and furnished with a replacement rubber seat.
3. The pressure reducing valves shall be G-A Industries, APCO, or equal.

Q. Mud Valves

1. Mud valves shall be flanged end, rising stem type.
2. Bodies shall be cast iron. The stem, stem nut, disk ring, and seat ring shall be bronze. Bolts and nuts shall be rustproof steel.
3. Handwheel operator and floorstand shall be furnished where shown on the PLANS.
4. Provide stem guides for maximum unsupported stem length of 5 feet.
5. The valves shall be Clow F-3085, or equal.

PART 3 EXECUTION

3.01 INSTALLATION

- A. All valves and appurtenances shall be installed in the locations shown on the PLANS, true to alignment and rigidly supported. Any damage to the above items shall be repaired to the satisfaction of the ENGINEER before they are installed.
- B. After installation, all valves and appurtenances shall be tested at least 1 hour at the working pressure corresponding to the class of pipe, unless a different test pressure is specified. If a joint proves to be defective, it shall be repaired to the satisfaction of the ENGINEER.
- C. Install all brackets, extension rods, guides, the various types of operators and appurtenances as shown on the PLANS that are in masonry floors or walls, and install concrete inserts for hangers and supports as soon as forms are erected and before concrete is poured. Before setting these items, the CONTRACTOR shall check all plans and figures, which have a direct bearing on their location and he shall be responsible for the proper location of these valves and appurtenances during the construction of the structures.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- D. All materials shall be carefully inspected for defects in workmanship and materials; all debris and foreign material cleaned out of valve openings, etc.; all operating mechanisms operated to check their proper functioning, and all nuts and bolts checked for tightness. Valves and other equipment, which do not operate easily or are otherwise defective, shall be repaired or replaced at no additional cost the OWNER.
- E. Buried flanged or mechanical joints shall be made with cadmium plated bolts. All exposed bolts and nuts shall be cadmium plated. All exposed bolts and nuts shall be heavily coated with two (2) coats of bituminous paint comparable to Inertol No. 66 Special Heavy.
- F. Buried valves and valve boxes shall be set with the stem vertically aligned in the center of the gate box. Valves shall be set on a firm foundation and supported by tamping selected excavated material under the sides of the valve. The valve box shall be supported during backfilling and maintained in vertical alignment with the top flush with finish grade.

3.02 SHOP PAINTING

- A. Interior surfaces of all valves, the exterior surfaces of buried valves and miscellaneous piping appurtenances shall be given a shop finish of an asphalt varnish conforming to Federal Specification TT-V51e for Varnish Asphalt.
- B. The exterior surface of various parts of valves, operators, floor stands and miscellaneous piping shall be thoroughly cleaned of all scale, dirt, grease or other foreign matter and thereafter on shop coat an approved rust-inhibitive primer shall be applied in accordance with the instructions of the paint manufacturer.
- C. Ferrous surfaces obviously not to be painted shall be given a shop coat of grease or other suitable rust-resistant coating.
- D. Field painting is included under Division 9.

3.03 INSPECTION AND TESTING

- A. The various pipe lines in which the valves and appurtenances are to be installed are specified to be field tested. During these tests any defective valve or appurtenance shall be adjusted, removed and replaced, or otherwise made acceptable or the ENGINEER.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- B. Various regulating valves, strainer, or other appurtenances shall be tested to demonstrate their conformance with the specified operational capabilities and any deficiencies shall be corrected or the device replaced or otherwise made acceptable to the ENGINEER.

END OF SECTION

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

SECTION 15123

COUPLINGS, FLANGED COUPLING ADAPTERS, AND SERVICE SADDLES

PART 1 GENERAL

1.01 SUMMARY

- A. Section Includes:
 - 1. Couplings, flanged coupling adapters, and service saddles required for piping connections. Some products specified in this Section may not be required for this Contract. Refer to piping system specification section(s) and Drawings to determine particular products to be provided under this Contract.

1.02 SUBMITTALS

- A. Not required for products identical to those specified by name of manufacturer and model type.
- B. For products other than those specified by name of manufacturer and model number, submit information in accordance with requests for substitutions or "Or Equal" items in Section 01300.
- C. Submit information for products that vary from specified requirements regardless of manufacturer name.

PART 2 PRODUCTS

2.01 COUPLINGS

- A. Couplings for connecting plain-end steel or ductile iron pipe of same outside diameter;
 - 1. Dresser Style 38.
 - 2. Smith-Blair Product No. 411.
 - 3. or approved equal
- B. Stainless steel couplings for stainless steel aeration piping:
 - 1. Brico Depend-0-Lok Air Master Couplings or approved equal
 - a. Housing and closure plates: ASTM A-240-T-304L stainless steel.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

- b. Sealing plates: T-304 stainless steel.
 - c. Gaskets: ASTM D2000-EPDM for -20 deg. to 300 deg. F.
 - d. Hardware: ASTM A-276 T-304 stainless steel.
- C. Transition couplings for connecting plain-end steel or ductile iron pipe of different outside diameter:
- 1. Dresser Style 162.
 - 2. Smith-Blair Product No. 413.
 - 3. or approved equal.
- D. Insulating couplings for connecting plain-end steel or ductile iron pipe and stopping flow of electrical current:
- 1. Dresser Style 39.
 - 2. Smith-Blair Product No. 416.
 - 3. or approved equal.
- E. Pressure rating shall be greater than test pressure of piping system.
- F. Materials:
- 1. Middle Ring and Gaskets: As selected by manufacturer. Suitable for fluid service and maximum operating temperature of piping system,
 - 2. Followers: Ductile iron or steel.
 - 3. Bolts and Nuts: Manufacturer's standard.

2.02 FLANGED COUPLING ADAPTERS

- A. Flanged coupling adapters for connecting plain-end steel or ductile iron pipe to flanged pipe, fitting, valve, instrument, or equipment item:
- 1. Dresser Style 128.
 - 2. Smith-Blair Product No. 913.
 - 3. or approved equal.
- B. Pressure rating shall be greater than test pressure of piping system.

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

C. Materials:

1. Flange: Steel, faced and drilled to 150 lb. class in conformance with ANSI B16.5.
2. Body: Steel.
3. Follower: Ductile iron or steel.
4. Gasket: As selected by manufacturer. Suitable for fluid service and maximum operating temperature of piping system.
5. Bolts and Nuts: Manufacturer's standard.

2.03 SERVICE SADDLES with CORPORATION STOP

A. Service saddles for tapping pipe sizes 18 in. and smaller shall be double strap design.

1. Ford Saddles.
2. Mueller Saddles.
3. or approved equal.

B. Service saddles for tapping pipe sizes larger than 18 in. shall be triple strap design.

1. Smith-Blair Product No. 366. or approved equal

C. Materials:

1. Body: Malleable iron or ductile iron.
2. Straps: Steel.
3. Nuts and Washers: Manufacturer's standard.
4. Gasket: As selected by manufacturer. Suitable for fluid service and maximum operating temperature of piping system.

D. A corporation stop, Mueller H-15000 or approved equal, shall be used on each service line at the main line connection.

2.04 ANCHORS

A. Provide anchors including, but not limited to, tie rods, lugs, harness assemblies, flanged spool pieces, friction collars and hardware for each

KY 11 Waterline Relocation
City of Beattyville
City of Booneville
Technical Specifications

coupling, and flanged coupling adapter. Anchors shall restrain pipe to prevent movement out of each coupling and flanged coupling adapter.

- B. Design each anchor to sustain force developed by test pressure of piping system.
- C. Anchor studs placed perpendicular to longitudinal axis of pipe is unacceptable.
- D. Anchorage with welded attachments to ductile iron piping is unacceptable.

2.05 COATINGS

- A. Coatings for couplings, flanged coupling adapters, and service saddles shall be same material as coatings for connected pipe.

PART 3 EXECUTION

3.01 INSTALLATION

- A. Install in accordance with manufacturer's written instructions.

END OF SECTION



227 North Upper Street
Lexington, Kentucky
40507-1016
Tel (859) 233-3111
Fax (859) 259-2717

KyTC BMP Plan for Project CID ## - #####



Kentucky Transportation Cabinet

Highway District 10

And

_____ **(2), Construction**

**Kentucky Pollutant Discharge Elimination System
Permit KYR10
Best Management Practices (BMP) plan**

Groundwater protection plan

For Highway Construction Activities

For

**I-75 to Mountain Parkway; Reconstruct KY 11
from KY 30 at Levi in Owsley Co. to KY 587
Intersection in Lee Co.**

Project: CID ## - #####

KPDES BMP Plan Page 1 of 14

Revised 3/4/2016

KyTC BMP Plan for Project CID ## -

Project information

Note – (1) = Design (2) = Construction (3) = Contractor

1. Owner – Kentucky Transportation Cabinet, District 10
2. Resident Engineer: (2)
3. Contractor name: (2)
Address: (2)

Phone number: (2)
Contact: (2)
Contractors agent responsible for compliance with the KPDES permit requirements (3):
4. Project Control Number (2)
5. Route (Address) KY 11
6. Latitude/Longitude (project mid-point) 37°31'12", -83°44'05"
7. County (project mid-point) Owsley
8. Project start date (date work will begin): (2)
9. Projected completion date: (2)

A. Site description:

1. Nature of Construction Activity (from letting project description)

I-75 to Mountain Parkway; Reconstruct KY 11 from KY 30 at Levi in Owsley Co. to KY 587 Intersection in Lee Co.

KyTC BMP Plan for Project CID ## -

2. Order of major soil disturbing activities (2) and (3)
3. Projected volume of material to be moved
1,200,526 CY of excavation and 692,650 CY of embankment
4. Estimate of total project area (acres) 185.1 acres
5. Estimate of area to be disturbed (acres) 185.1 acres
6. Post construction runoff coefficient will be included in the project drainage folder. Persons needing information pertaining to the runoff coefficient will contact the resident engineer to request this information.
7. Data describing existing soil condition (2)
8. Data describing existing discharge water quality (if any) (2)
9. Receiving water name
Elk Lick, Long Branch
10. TMDLs and Pollutants of Concern in Receiving Waters: (1 DEA)
11. Site map – Project layout sheet plus the erosion control sheets in the project plans that depict Disturbed Drainage Areas (DDAs) and related information. These sheets depict the existing project conditions with areas delineated by DDA (drainage area bounded by watershed breaks and right of way limits), the storm water discharge locations (either as a point discharge or as overland flow) and the areas that drain to each discharge point. These plans define the limits of areas to be disturbed and the location of control measures. Controls will be either site specific as designated by the designer or will be annotated by the contractor and resident engineer before disturbance commences. The project layout sheet shows the surface waters and wetlands.
12. Potential sources of pollutants:

The primary source of pollutants is solids that are mobilized during storm events. Other sources of pollutants include oil/fuel/grease from servicing and operating construction equipment, concrete washout water, sanitary wastes and trash/debris. (3)

B. Sediment and Erosion Control Measures:

KyTC BMP Plan for Project CID ## -

1. Plans for highway construction projects will include erosion control sheets that depict Disturbed Drainage Areas (DDAs) and related information. These plan sheets will show the existing project conditions with areas delineated by DDA within the right of way limits, the discharge points and the areas that drain to each discharge point. Project managers and designers will analyze the DDAs and identify Best Management Practices (BMPs) that are site specific. The balance of the BMPs for the project will be listed in the bid documents for selection and use by the contractor on the project with approval by the resident engineer.

Projects that do not have DDAs annotated on the erosion control sheets will employ the same concepts for development and managing BMP plans.

2. Following award of the contract, the contractor and resident engineer will annotate the erosion control sheets showing location and type of BMPs for each of the DDAs that will be disturbed at the outset of the project. This annotation will be accompanied by an order of work that reflects the order or sequence of major soil moving activities. The remaining DDAs are to be designated as "Do Not Disturb" until the contractor and resident engineer prepare the plan for BMPs to be employed. The initial BMP's shall be for the first phase (generally Clearing and Grubbing) and shall be modified as needed as the project changes phases. The BMP Plan will be modified to reflect disturbance in additional DDA's as the work progresses. All DDA's will have adequate BMP's in place before being disturbed.
3. As DDAs are prepared for construction, the following will be addressed for the project as a whole or for each DDA as appropriate:
 - Construction Access – This is the first land-disturbing activity. As soon as construction begins, bare areas will be stabilized with gravel and temporary mulch and/or vegetation.
 - At the beginning of the project, all DDAs for the project will be inspected for areas that are a source of storm water pollutants. Areas that are a source of pollutants will receive appropriate cover or BMPs to arrest the introduction of pollutants into storm water. Areas that have not been opened by the contractor will be inspected periodically (once per month) to determine if there is a need to employ BMPs to keep pollutants from entering storm water.
 - Clearing and Grubbing – The following BMP's will be considered and used where appropriate.
 - Leaving areas undisturbed when possible.
 - Silt basins to provide silt volume for large areas.

KyTC BMP Plan for Project CID ## -

- Silt Traps Type A for small areas.
- Silt Traps Type C in front of existing and drop inlets which are to be saved
- Diversion ditches to catch sheet runoff and carry it to basins or traps or to divert it around areas to be disturbed.
- Brush and/or other barriers to slow and/or divert runoff.
- Silt fences to catch sheet runoff on short slopes. For longer slopes, multiple rows of silt fence may be considered.
- Temporary Mulch for areas which are not feasible for the fore mentioned types of protections.
- Non-standard or innovative methods.
- Cut & Fill and placement of drainage structures - The BMP Plan will be modified to show additional BMP's such as:
 - Silt Traps Type B in ditches and/or drainways as they are completed
 - Silt Traps Type C in front of pipes after they are placed
 - Channel Lining
 - Erosion Control Blanket
 - Temporary mulch and/or seeding for areas where construction activities will be ceased for 21 days or more.
 - Non-standard or innovative methods
- Profile and X-Section in place – The BMP Plan will be modified to show elimination of BMP's which had to be removed and the addition of new BMP's as the roadway was shaped. Probably changes include:
 - Silt Trap Type A, Brush and/or other barriers, Temporary Mulch, and any other BMP which had to be removed for final grading to take place.
 - Additional Silt Traps Type B and Type C to be placed as final drainage patterns are put in place.
 - Additional Channel Lining and/or Erosion Control Blanket.
 - Temporary Mulch for areas where Permanent Seeding and Protection cannot be done within 21 days.
 - Special BMP's such as Karst Policy
- Finish Work (Paving, Seeding, Protect, etc.) – A final BMP Plan will result from modifications during this phase of construction. Probably changes include:
 - Removal of Silt Traps Type B from ditches and drainways if they are protected with other BMP's which are sufficient to control erosion, i.e. Erosion Control Blanket or Permanent Seeding and Protection on moderate grades.
 - Permanent Seeding and Protection
 - Placing Sod
 - Planting trees and/or shrubs where they are included in the project

KyTC BMP Plan for Project CID ## -

- BMP's including Storm Water Management Devices such as velocity dissipation devices and Karst policy BMP's to be installed during construction to control the pollutants in storm water discharges that will occur after construction has been completed are : (1)

C. Other Control Measures

1. No solid materials, including building materials, shall be discharged to waters of the commonwealth, except as authorized by a Section 404 permit.
2. Waste Materials

All waste materials that may leach pollutants (paint and paint containers, caulk tubes, oil/grease containers, liquids of any kind, soluble materials, etc.) will be collected and stored in appropriate covered waste containers. Waste containers shall be removed from the project site on a sufficiently frequent basis as to not allow wastes to become a source of pollution. All personnel will be instructed regarding the correct procedure for waste disposal. Wastes will be disposed in accordance with appropriate regulations. Notices stating these practices will be posted in the office.

3. Hazardous Waste

All hazardous waste materials will be managed and disposed of in the manner specified by local or state regulation. The contractor shall notify the Section Engineer if there any hazardous wastes being generated at the project site and how these wastes are being managed. Site personnel will be instructed with regard to proper storage and handling of hazardous wastes when required. The Transportation Cabinet will file for generator, registration when appropriate, with the Division of Waste Management and advise the contractor regarding waste management requirements.

4. Spill Prevention

The following material management practices will be used to reduce the risk of spills or other exposure of materials and substances to the weather and/or runoff.

- **Good Housekeeping:**

The following good housekeeping practices will be followed onsite during the construction project.

KyTC BMP Plan for Project CID ## -

- An effort will be made to store only enough product required to do the job
- All materials stored onsite will be stored in a neat, orderly manner in their appropriate containers and, if possible, under a roof or other enclosure
- Products will be kept in their original containers with the original manufacturer's label
- Substances will not be mixed with one another unless recommended by the manufacturer
- Whenever possible, all of the product will be used up before disposing of the container
- Manufacturers' recommendations for proper use and disposal will be followed
- The site contractor will inspect daily to ensure proper use and disposal of materials onsite

➤ **Hazardous Products:**

These practices will be used to reduce the risks associated with any and all hazardous materials.

- Products will be kept in original containers unless they are not resealable
- Original labels and material safety data sheets (MSDS) will be reviewed and retained
- Contractor will follow procedures recommended by the manufacturer when handling hazardous materials
- If surplus product must be disposed of, manufacturers' or state/local recommended methods for proper disposal will be followed

The following product-specific practices will be followed onsite:

➤ **Petroleum Products:**

Vehicles and equipment that are fueled and maintained on site will be monitored for leaks, and receive regular preventative maintenance to reduce the chance of leakage. Petroleum products onsite will be stored in tightly sealed containers, which are clearly labeled and will be protected from exposure to weather.

The contractor shall prepare an Oil Pollution Spill Prevention Control and Countermeasure plan when the project that involves the storage of petroleum products in 55 gallon or larger containers with a total combined storage capacity of 1,320 gallons. This is a requirement of 40 CFR 112.

KyTC BMP Plan for Project CID ## -

This project (will / will not) (3) have over 1,320 gallons of petroleum products with a total capacity, sum of all containers 55 gallon capacity and larger.

➤ **Fertilizers:**

Fertilizers will be applied at rates prescribed by the contract, standard specifications or as directed by the resident engineer. Once applied, fertilizer will be covered with mulch or blankets or worked into the soil to limit exposure to storm water. Storage will be in a covered shed. The contents of any partially used bags of fertilizer will be transferred to a sealable plastic bin to avoid spills.

➤ **Paints:**

All containers will be tightly sealed and stored indoors or under roof when not being used. Excess paint or paint wash water will not be discharged to the drainage or storm sewer system but will be properly disposed of according to manufacturers' instructions or state and local regulations.

➤ **Concrete Truck Washout:**

Concrete truck mixers and chutes will not be washed on pavement, near storm drain inlets, or within 75 feet of any ditch, stream, wetland, lake, or sinkhole. Where possible, excess concrete and wash water will be discharged to areas prepared for pouring new concrete, flat areas to be paved that are away from ditches or drainage system features, or other locations that will not drain off site. Where this approach is not possible, a shallow earthen wash basin will be excavated away from ditches to receive the wash water

➤ **Spill Control Practices**

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices will be followed for spill prevention and cleanup:

- Manufacturers' recommended methods for spill cleanup will be clearly posted. All personnel will be made aware of procedures and the location of the information and cleanup supplies.
- Materials and equipment necessary for spill cleanup will be kept in the material storage area. Equipment and materials will include as appropriate, brooms, dust pans, mops, rags, gloves, oil absorbents, sand, sawdust, and plastic and metal trash containers.
- All spills will be cleaned up immediately after discovery.
- The spill area will be kept well ventilated and personnel will wear appropriate protective clothing to prevent injury from contact with a hazardous substance.

KyTC BMP Plan for Project CID ## -

- Spills of toxic or hazardous material will be reported to the appropriate state/local agency as required by KRS 224 and applicable federal law.
- The spill prevention plan will be adjusted as needed to prevent spills from reoccurring and improve spill response and cleanup.
- Spills of products will be cleaned up promptly. Wastes from spill clean up will be disposed in accordance with appropriate regulations.

D. Other State and Local Plans

This BMP plan shall include any requirements specified in sediment and erosion control plans, storm water management plans or permits that have been approved by other state or local officials. Upon submittal of the NOI, other requirements for surface water protection are incorporated by reference into and are enforceable under this permit (even if they are not specifically included in this BMP plan). This provision does not apply to master or comprehensive plans, non-enforceable guidelines or technical guidance documents that are not identified in a specific plan or permit issued for the construction site by state or local officials. (1)

E. Maintenance

1. The BMP plan shall include a clear description of the maintenance procedures necessary to keep the control measures in good and effective operating condition.
- Maintenance of BMPs during construction shall be a result of weekly and post rain event inspections with action being taken by the contractor to correct deficiencies.
 - Post Construction maintenance will be a function of normal highway maintenance operations. Following final project acceptance by the cabinet, district highway crews will be responsible for identification and correction of deficiencies regarding ground cover and cleaning of storm water BMPs. The project manager shall identify any BMPs that will be for the purpose of post construction storm water management with specific guidance for any non-routine maintenance. (1)

F. Inspections

Inspection and maintenance practices that will be used to maintain erosion and sediment controls:

KyTC BMP Plan for Project CID ## -

- All erosion prevention and sediment control measures will be inspected at least once each week and following any rain of one-half inch or more.
- Inspections will be conducted by individuals that have successfully completed the KEPSC-RI course as required by Section 213.02.02 of the Standard Specifications for Road and Bridge Construction, current edition.
- Inspection reports will be written, signed, dated, and kept on file.
- Areas at final grade will be seeded and mulched within 14 days.
- Areas that are not at final grade where construction has ceased for a period of 21 days or longer and soil stock piles shall receive temporary mulch no later than 14 days from the last construction activity in that area.
- All measures will be maintained in good working order; if a repair is necessary, it will be initiated within 24 hours of being reported.
- Built-up sediment will be removed from behind the silt fence before it has reached halfway up the height of the fence.
- Silt fences will be inspected for bypassing, overtopping, undercutting, depth of sediment, tears, and to ensure attachment to secure posts.
- Sediment basins will be inspected for depth of sediment, and built-up sediment will be removed when it reaches 50 percent of the design capacity and at the end of the job.
- Diversion dikes and berms will be inspected and any breaches promptly repaired. Areas that are eroding or scouring will be repaired and re-seeded / mulched as needed.
- Temporary and permanent seeding and mulching will be inspected for bare spots, washouts, and healthy growth. Bare or eroded areas will be repaired as needed.
- All material storage and equipment servicing areas that involve the management of bulk liquids, fuels, and bulk solids will be inspected weekly for conditions that represent a release or possible release of pollutants to the environment.

G. Non – Storm Water discharges

It is expected that non-storm water discharges may occur from the site during the construction period. Examples of non-storm water discharges include:

- Water from water line flushings.
- Water from cleaning concrete trucks and equipment.

KyTC BMP Plan for Project CID ## -

- Pavement wash waters (where no spills or leaks of toxic or hazardous materials have occurred).
- Uncontaminated groundwater and rain water (from dewatering during excavation).

All non-storm water discharges will be directed to the sediment basin or to a filter fence enclosure in a flat vegetated infiltration area or be filtered via another approved commercial product.

H. Groundwater Protection Plan (3)

This plan serves as the groundwater protection plan as required by 401 KAR 5:037.

- Contractors statement: (3)

The following activities, as enumerated by 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan, will or may be may be conducted as part of this construction project:

_____ 2. (e) land treatment or land disposal of a pollutant;

_____ 2. (f) Storing, ..., or related handling of hazardous waste, solid waste or special waste, ..., in tanks, drums, or other containers, or in piles, (This does not include wastes managed in a container placed for collection and removal of municipal solid waste for disposal off site);

_____ 2. (g) Handling of materials in bulk quantities (equal or greater than 55 gallons or 100 pounds net dry weight transported held in an individual container) that, if released to the environment, would be a pollutant;

_____ 2. (j) Storing or related handling of road oils, dust suppressants,, at a central location;

_____ 2. (k) Application or related handling of road oils, dust suppressants or deicing materials, (does not include use of chloride-based deicing materials applied to roads or parking lots);

_____ 2. (m) Installation, construction, operation, or abandonment of wells, bore holes, or core holes, (this does not include bore holes for the purpose of explosive demolition);

Or, check the following only if there are no qualifying activities

KyTC BMP Plan for Project CID ## -

_____ There are no activities for this project as listed in 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan.

The contractor is responsible for the preparation of a plan that addresses the

401 KAR 5:037 Section 3. (3) Elements of site specific groundwater protection plan:

- (a) General information about this project is covered in the Project information;
- (b) Activities that require a groundwater protection plan have been identified above;
- (c) Practices that will protect groundwater from pollution are addressed in section C. Other control measures.
- (d) Implementation schedule – all practices required to prevent pollution of groundwater are to be in place prior to conducting the activity;
- (e) Training is required as a part of the ground water protection plan. All employees of the contractor, sub-contractor and resident engineer personnel will be trained to understand the nature and requirements of this plan as they pertain to their job function(s). Training will be accomplished within one week of employment and annually thereafter. A record of training will be maintained by the contractor with a copy provide to the resident engineer.
- (f) Areas of the project and groundwater plan activities will be inspected as part of the weekly sediment and erosion control inspections
- (g) Certification (see signature page.)

KyTC BMP Plan for Project CID ## - #####

Contractor and Resident Engineer Plan certification

The contractor that is responsible for implementing this BMP plan is identified in the Project Information section of this plan.

The following certification applies to all parties that are signatory to this BMP plan:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. Further, this plan complies with the requirements of 401 KAR 5:037. By this certification, the undersigned state that the individuals signing the plan have reviewed the terms of the plan and will implement its provisions as they pertain to ground water protection.

Resident Engineer and Contractor Certification:

(2) Resident Engineer signature

Signed _____ title _____, _____ signature
 Typed or printed name²

(3) Signed _____ title _____, _____ signature
 Typed or printed name¹

1. Contractors Note: to be signed by a person who is the owner, a responsible corporate officer, a general partner or the proprietor or a person designated to have the authority to sign reports by such a person in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601. Reference the Project Control Number (PCN) and KPDES number when one has been issued.

2. KyTC note: to be signed by the Chief District Engineer or a person designated to have the authority to sign reports by such a person (usually the resident engineer) in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601 Reference the Project Control Number (PCN) and KPDES number when one has been issued.

KyTC BMP Plan for Project CID ## - ####

Sub-Contractor Certification

The following sub-contractor shall be made aware of the BMP plan and responsible for implementation of BMPs identified in this plan as follows:

Subcontractor

Name:
Address:
Address:

Phone:

The part of BMP plan this subcontractor is responsible to implement is:

I certify under penalty of law that I understand the terms and conditions of the general Kentucky Pollutant Discharge Elimination System permit that authorizes the storm water discharges, the BMP plan that has been developed to manage the quality of water to be discharged as a result of storm events associated with the construction site activity and management of non-storm water pollutant sources identified as part of this certification.

Signed _____ title _____, _____
Typed or printed name¹ signature

1. Sub Contractor Note: to be signed by a person who is the owner, a responsible corporate officer, a general partner or the proprietor or a person designated to have the authority to sign reports by such a person in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601. Reference the Project Control Number (PCN) and KPDES number when one has been issued.

SPECIAL NOTE

Filing of eNOI for KPDES Construction Stormwater Permit

County: OWSLEY/LEE

Route: KY 11

Item No.: 10-292.10

KDOW Submittal ID: 217531

Project Description: I-75 TO MOUNTAIN PARKWAY; RECONSTRUCT KY 11 FROM KY 30 AT LEVI IN OWSLEY COUNTY TO KY 587 INTERSECTION IN LEE COUNTY.


A Notice of Intent for obtaining coverage under the Kentucky Pollutant Discharge Elimination System (KPDES) General Permit for Stormwater Discharges Associated with Construction Activities (KYR10) has been drafted, copy of which is attached. Upon award, the Contractor will be identified in Section III of the form as the “Building Contractor” and it will be submitted for approval to the Kentucky Division of Water. The Contractor shall be responsible for advancing the work in a manner that is compliant with all applicable and appropriate KYTC specifications for sediment and erosion control as well as meeting the requirements of the KYR10 permit and the KDOW.

Upon award of the project, the appropriate District Project Delivery & Preservation Branch is responsible for providing the Project Development Project Manager (Darren Back) with the Contractor’s name, address, start date, and the CID #. The Project Development Project Manager is responsible for completing and submitting the eNOI document.

The Project Development Project Manager will notify the appropriate Project Delivery & Preservation Branch when the NOI is approved. The approved NOI will be placed in Site Manager. This will need to be accomplished prior to any on-site work.

This note conforms with the Joint Design (05-2017)/Construction (02-2017) Memorandum issued on March 28, 2017.

If there are any questions regarding this note, please contact Danny Peake, Director, Division of Environmental Analysis, TCOB, 200 Mero Street, Frankfort, KY 40622, Phone: (502) 564-7250.

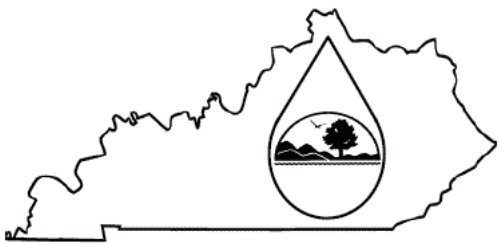	<h2 style="margin:0;">KENTUCKY POLLUTION DISCHARGE</h2> <h3 style="margin:0;">ELIMINATION SYSTEM (KPDES)</h3> <p style="margin:0;">Notice of Intent (NOI) for coverage of Storm Water Discharge Associated with Construction Activities Under the KPDES Storm Water General Permit KYR100000</p> <p style="margin:0;">Click here for Instructions (Controls/KPDES_FormKYR10_Instructions.htm)</p> <p style="margin:0;">Click here to obtain information and a copy of the KPDES General Permit. (http://dep.ky.gov/formslibrary/Documents/KYR10PermitPage.pdf)</p> <p style="margin:0;">(*) indicates a required field; (✓) indicates a field may be required based on user input or is an optionally required field</p>
---	---

Reason for Submittal:(*) <input type="text" value="Application for New Permit Coverage"/>	Agency Interest ID: <input type="text" value="Agency Interest ID"/>	Permit Number:(✓) <input type="text" value="KPDES Permit Number"/>
--	--	---

If change to existing permit coverage is requested, describe the changes for which modification of coverage is being sought:(✓)

ELIGIBILITY:
Stormwater discharges associated with construction activities disturbing individually one (1) acre or more, including, in the case of a common plan of development, contiguous construction activities that cumulatively equal one (1) acre or more of disturbance.

EXCLUSIONS:
The following are excluded from coverage under this general permit:
 1) Are conducted at or on properties that have obtained an individual KPDES permit for the discharge of other wastewaters which requires the development and implementation of a Best Management Practices (BMP) plan;
 2) Any operation that the DOW determines an individual permit would better address the discharges from that operation;
 3) Any project that discharges to an Impaired Water listed in the most recent Integrated Report, §305(b) as impaired for sediment and for which an approved TMDL has been developed.

SECTION I -- FACILITY OPERATOR INFORMATION (PERMITTEE)

Company Name:(✓) <input type="text" value="KYTC - District 10"/>	First Name:(✓) <input type="text" value="Corbett"/>	M.I.: <input type="text" value="R"/>	Last Name:(✓) <input type="text" value="Caudill"/>
Mailing Address:(*) <input type="text" value="PO Box 621"/>	City:(*) <input type="text" value="Jackson"/>	State:(*) <input type="text" value="Kentucky"/>	Zip:(*) <input type="text" value="41339"/>
eMail Address:(*) <input type="text" value="corbett.caudill@ky.gov"/>	Business Phone:(*) <input type="text" value="6066668841"/>	Alternate Phone: <input type="text" value="Phone"/>	

SECTION II -- GENERAL SITE LOCATION INFORMATION

Project Name:(*) <input type="text" value="Reconstruct KY 11"/>	Status of Owner/Operator(*) <input type="text" value="State Government"/>	SIC Code(*) <input type="text" value="1611 Highway and Street Const"/>
Company Name:(✓) <input type="text" value="KYTC - District 10"/>	First Name:(✓) <input type="text" value="Corbett"/>	M.I.: <input type="text" value="R"/>
Last Name:(✓) <input type="text" value="Caudill"/>		
Site Physical Address:(*) <input type="text" value="KY 11 Booneville - Beattyville Road"/>		
City:(*) <input type="text" value="Booneville"/>	State:(*) <input type="text" value="Kentucky"/>	Zip:(*) <input type="text" value="47601"/>
County:(*) <input type="text" value="Owsley"/>	Latitude(decimal degrees)(*)DMS to DD Converter (https://www.fcc.gov/media/radio/dms-decimal) <input type="text" value="37.520000"/>	Longitude(decimal degrees)(*) <input type="text" value="-83.734722"/>

SECTION III -- SPECIFIC SITE ACTIVITY INFORMATION

Project Description:(*)

a. For single projects provide the following information

Total Number of Acres in Project:(√) <input type="text" value="185.1"/>	Total Number of Acres Disturbed:(√) <input type="text" value="185.1"/>
Anticipated Start Date:(√) <input type="text"/>	Anticipated Completion Date:(√) <input type="text"/>

b. For common plans of development provide the following information

Total Number of Acres in Project:(√) <input type="text" value="# Acre(s)"/>	Total Number of Acres Disturbed:(√) <input type="text" value="# Acre(s)"/>
Number of individual lots in development, if applicable:(√) <input type="text" value="# lot(s)"/>	Number of lots in development:(√) <input type="text" value="# lot(s)"/>
Total acreage of lots intended to be developed:(√) <input type="text" value="Project Acres"/>	Number of acres intended to be disturbed at any one time:(√) <input type="text" value="Disturbed Acres"/>
Anticipated Start Date:(√) <input type="text" value="4/1/2021"/>	Anticipated Completion Date:(√) <input type="text" value="12/31/2024"/>

List Building Contractor(s) at the time of Application:(*)

+	Company Name		

SECTION IV -- IF THE PERMITTED SITE DISCHARGES TO A WATER BODY THE FOLLOWING INFORMATION IS REQUIRED ?

Discharge Point(s):

	Unnamed Tributary?	Latitude	Longitude	Receiving Water Name	
34	Yes	37.5403850	-83.727993	Long Branch	Delete
35	Yes	37.5424510	-83.727214	Long Branch	Delete
36	Yes	37.5447262	-83.727523	Long Branch	Delete
37	Yes	37.5447936	-83.727600	Long Branch	Delete
38	Yes	37.5450955	-83.726870	Long Branch	Delete
39	Yes	37.5452887	-83.726683	Long Branch	Delete
40	Yes	37.5466248	-83.726233	Long Branch	Delete
41	Yes	37.5466723	-83.725551	Long Branch	Delete
42	Yes	37.5469764	-83.725525	Long Branch	Delete
43	Yes	37.5403850	-83.727993	Long Branch	Delete

SECTION V -- IF THE PERMITTED SITE DISCHARGES TO A MS4 THE FOLLOWING INFORMATION IS REQUIRED ?


Name of MS4: <input type="text"/>									
Date of application/notification to the MS4 for construction site permit coverage: <input type="text" value="Date"/>	Discharge Point(s):(*) <table border="1" style="width:100%"> <thead> <tr> <th> </th> <th>Latitude</th> <th>Longitude</th> <th> </th> </tr> </thead> <tbody> <tr> <td>+</td> <td> </td> <td> </td> <td> </td> </tr> </tbody> </table>		Latitude	Longitude		+			
	Latitude	Longitude							
+									

SECTION VI -- WILL THE PROJECT REQUIRE CONSTRUCTION ACTIVITIES IN A WATER BODY OR THE RIPARIAN ZONE?

Will the project require construction activities in a water body or the riparian zone?: (*)	<input type="text" value="Yes"/>
If Yes, describe scope of activity: (√)	<input type="text" value="Culvert construction"/>
Is a Clean Water Act 404 permit required?:(*)	<input type="text" value="Yes"/>

Is a Clean Water Act 401 Water Quality Certification required?:(*)		Yes	
SECTION VII -- NOI PREPARER INFORMATION			
First Name:(*) Darren	M.I.: MI	Last Name:(*) Back	Company Name:(*) KYTC - District 10
Mailing Address:(*) PO Box 621	City:(*) Jackson	State:(*) Kentucky	Zip:(*) 41339
eMail Address:(*) darren.back@ky.gov	Business Phone:(*) 6066668841	Alternate Phone: Phone	
SECTION VIII -- ATTACHMENTS			
Facility Location Map:(*)	Upload file		
Supplemental Information:	Upload file		
SECTION IX -- CERTIFICATION			
I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.			
Signature:(*) Signature	Title:(*) Title		
First Name:(*) First Name	M.I.: MI	Last Name:(*) Last Name	
eMail Address:(*) eMail Address	Business Phone:(*) Phone	Alternate Phone: Phone	Signature Date:(*) Date
<div style="display: flex; justify-content: space-around; margin-top: 20px;"> Click to Save Values for Future Retrieval Click to Submit to EEC </div>			

COUNTY OF OWSLEY/LEE
 ITEM NO. 10-292.10
 SHEET NO. R133

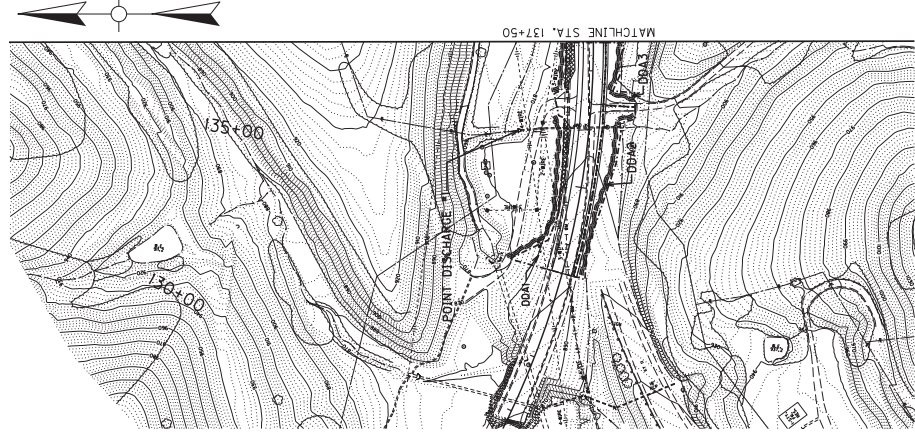

LEGEND
 --- DBA
 - - - - - DISTURBED DRAINAGE BOUNDARY
 - - - - - OVERLAND SHEET FLOW

KY II RELOCATION PLANS
 EROSION CONTROL PLANS
 GENERAL NOTES & SUBSUMMARY

PD#	LAT	LONG
1	37.4872314	-83.7230887
2	37.4878038	-83.7229972
3	37.4885651	-83.7229678
4	37.4916128	-83.7233700
5	37.4925699	-83.7240008
6	37.4988009	-83.7273093
7	37.4996263	-83.7282762
8	37.4993211	-83.7276751
9	37.5016200	-83.7300214
10	37.5023150	-83.7303074
11	37.5039452	-83.7311498
12	37.5049926	-83.7319126
13	37.5079878	-83.7336230
14	37.5084304	-83.7337148
15	37.5104064	-83.7332161
16	37.5117264	-83.7351286
17	37.5118427	-83.7351150
18	37.5138513	-83.7355813
19	37.5141912	-83.7354662
20	37.5146998	-83.7354024
21	37.5156238	-83.7355911
22	37.5204116	-83.7372081
23	37.5248122	-83.7333184
24	37.5258931	-83.7327209
25	37.5270749	-83.7324116
26	37.5296141	-83.7315299
27	37.5304697	-83.7306826
28	37.5323911	-83.7298921
29	37.5331790	-83.7297070
30	37.5349565	-83.7294506
31	37.5354975	-83.7289231
32	37.5366229	-83.7288148
33	37.5383716	-83.7280916
34	37.5403850	-83.7279936
35	37.5424510	-83.7272145
36	37.5447262	-83.7275234
37	37.5447936	-83.7276008
38	37.5450955	-83.7268705
39	37.5452887	-83.7266838
40	37.5466248	-83.7262336
41	37.5466723	-83.7255515
42	37.5469764	-83.7255252
43	37.5403850	-83.7279936

EROSION CONTROL NOTES

ALL SILT CONTROL DEVICES SHALL BE SIZED TO RETAIN A VOLUME OF 3,000 CUBIC FEET PER DISTURBED CONTRIBUTING ACRE.

THE CONTRACTOR SHALL CONDUCT HIS OPERATIONS TO MINIMIZE THE AMOUNT OF DISTURBED GROUND DURING EACH PHASE OF CONSTRUCTION. THE CONTRACTOR SHALL COMPUTE THE VOLUME NECESSARY TO CONTROL SEDIMENT DURING EACH PHASE OF CONSTRUCTION AS WORK PROCEEDS. SILT TRAPS MAY BE ADDED OR REMOVED IN ORDER TO ACHIEVE THE BEST MANAGEMENT PLAN. THE REQUIRED VOLUME AT EACH ADDED SILT TRAP SHALL BE COMPUTED AS UP GRADIENT CONTRIBUTING AREAS ARE DISTURBED OR ARE STABILIZED TO THE SATISFACTION OF THE ENGINEER. THE REQUIRED VOLUME CALCULATION FOR EACH SILT TRAP SHALL BE DETERMINED BY THE CONTRACTOR AND VERIFIED BY THE ENGINEER. THE REQUIRED VOLUME AT EACH SILT TRAP MAY BE REDUCED BY THE FOLLOWING AMOUNTS:

- UPGRADIENT AREAS NOT DISTURBED (ACRES).
- UPGRADIENT AREAS THAT HAVE BEEN RECLAIMED AND PROTECTED BY EROSION CONTROL BLANKET OR OTHER GROUND PROTECTION MATERIAL SUCH AS TEMPORARY MULCH (ACRES).
- THE USE OF TEMPORARY MULCH IS ENCOURAGED.
- UPGRADIENT AREAS THAT HAVE BEEN PROTECTED BY SILT FENCE (ACRES).
- AREAS PROTECTED BY SILT FENCE SHALL BE COMPUTED AT A MAXIMUM RATE OF 100 SQUARE FOOT PER LINEAR FOOT OF SILT FENCE.
- UPGRADIENT AREAS THAT HAVE BEEN PROTECTED BY SILT TRAPS (ACRES).

THE EROSION CONTROL PLAN SHALL BE ANNOTATED AS THE WORK PROCEEDS BY THE CONTRACTOR TO DETAIL THE SELECTION OF EACH EROSION CONTROL DEVICE USED AND THE VOLUME PROVIDED BY EACH SILT TRAP IN ACCORDANCE WITH THE DOCUMENTATION PROCEDURES ESTABLISHED BY THE DIVISION OF CONSTRUCTION.

IF A SILT BASIN IS NOT USED THEN ONE SILT TRAP TYPE A, ALTERNATE NUMBER 2 OR SILT TRAP TYPE B SHALL ALWAYS BE PLACED AT THE MOST REMOTE DOWNSTREAM COLLECTION POINT PRIOR TO DISCHARGING INTO A BLUE LINE STREAM OR ONTO AN ADJACENT PROPERTY OWNER, WHERE OVERLAND FLOW EXIST. A SILT FENCE OR OTHER FILTER DEVICES MAY BE USED OR THE OVERLAND FLOW MAY BE DIVERTED TO ONE OF THE FOREMENTED SILT BASIN OR TRAPS.

THE EROSION CONTROL PLANS DO NOT CONSTITUTE A BMP BY THEMSELVES. THEY PROVIDE A STARTING POINT FOR THE CONTRACTOR AND RESIDENT ENGINEER TO DEVELOP THE BMP ACCORDING TO SECTION 213.03.01 OF THE STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, AND THE SUPPLEMENTAL SPECS EFFECTIVE WITH THE OCTOBER, 2004 LETTING.

EROSION CONTROL MEASURES SHALL BE IN PLACE AND FUNCTIONING PRIOR TO ANY EXCAVATION OR DISTURBANCE WITHIN A DRAINAGE AREA.

THE CONTRACTOR SHALL BE REQUIRED TO CLEAN OUT (REMOVE SEDIMENT FROM) SILT TRAPS AND SILT FENCES WHENEVER THEY BECOME ONE-HALF FULL AND PROPERLY DISPOSE OF THE MATERIAL AT SITES APPROVED BY THE RESIDENT ENGINEER.

EROSION CONTROL MEASURES EMPLOYED BY THE CONTRACTOR WILL BE UNIQUE TO THE PROJECT AND WORK CONDITIONS AND SHALL BE APPROVED BY THE RESIDENT ENGINEER. THE DEVELOPMENT AND UTILIZATION OF THESE MEASURES WILL BE RECORDED AS PART OF THE BMP KEPT ON SITE, AND AVAILABLE FOR PUBLIC INSPECTION.

COUNTY OF	ITEM NO.	SHEET NO.
OWSLEY/LEE	10-292-10	R134




MICR05+0+01on v8.11.9.832
 C-SHEET NAME: R13400EC
 USER: goren,book
 DATE PLOTTED: January 13, 2021
 FILE NAME: C:\PWORK\BARREN, BARR\10864857\R13400EC.DGN

COUNTY OF	ITEM NO.	SHEET NO.
OWSLEY, LEE	10-292-10	R135



SCALE 1"=100'
 KY II RELOCATION
 EROSION CONTROL PLANS
 STA. 168+50 TO STA. 198+50

USER: goren,book	DATE PLOTTED: January 13, 2021	FILE NAME: C:\PWORK\BARREN,BAK\1864857\135050EC.DGN
C-SHEET NAME: R135050EC	USBR: goren,book	
E-SHEET NAME: R135050EC	DATE PLOTTED: January 13, 2021	
USBR: goren,book	DATE PLOTTED: January 13, 2021	

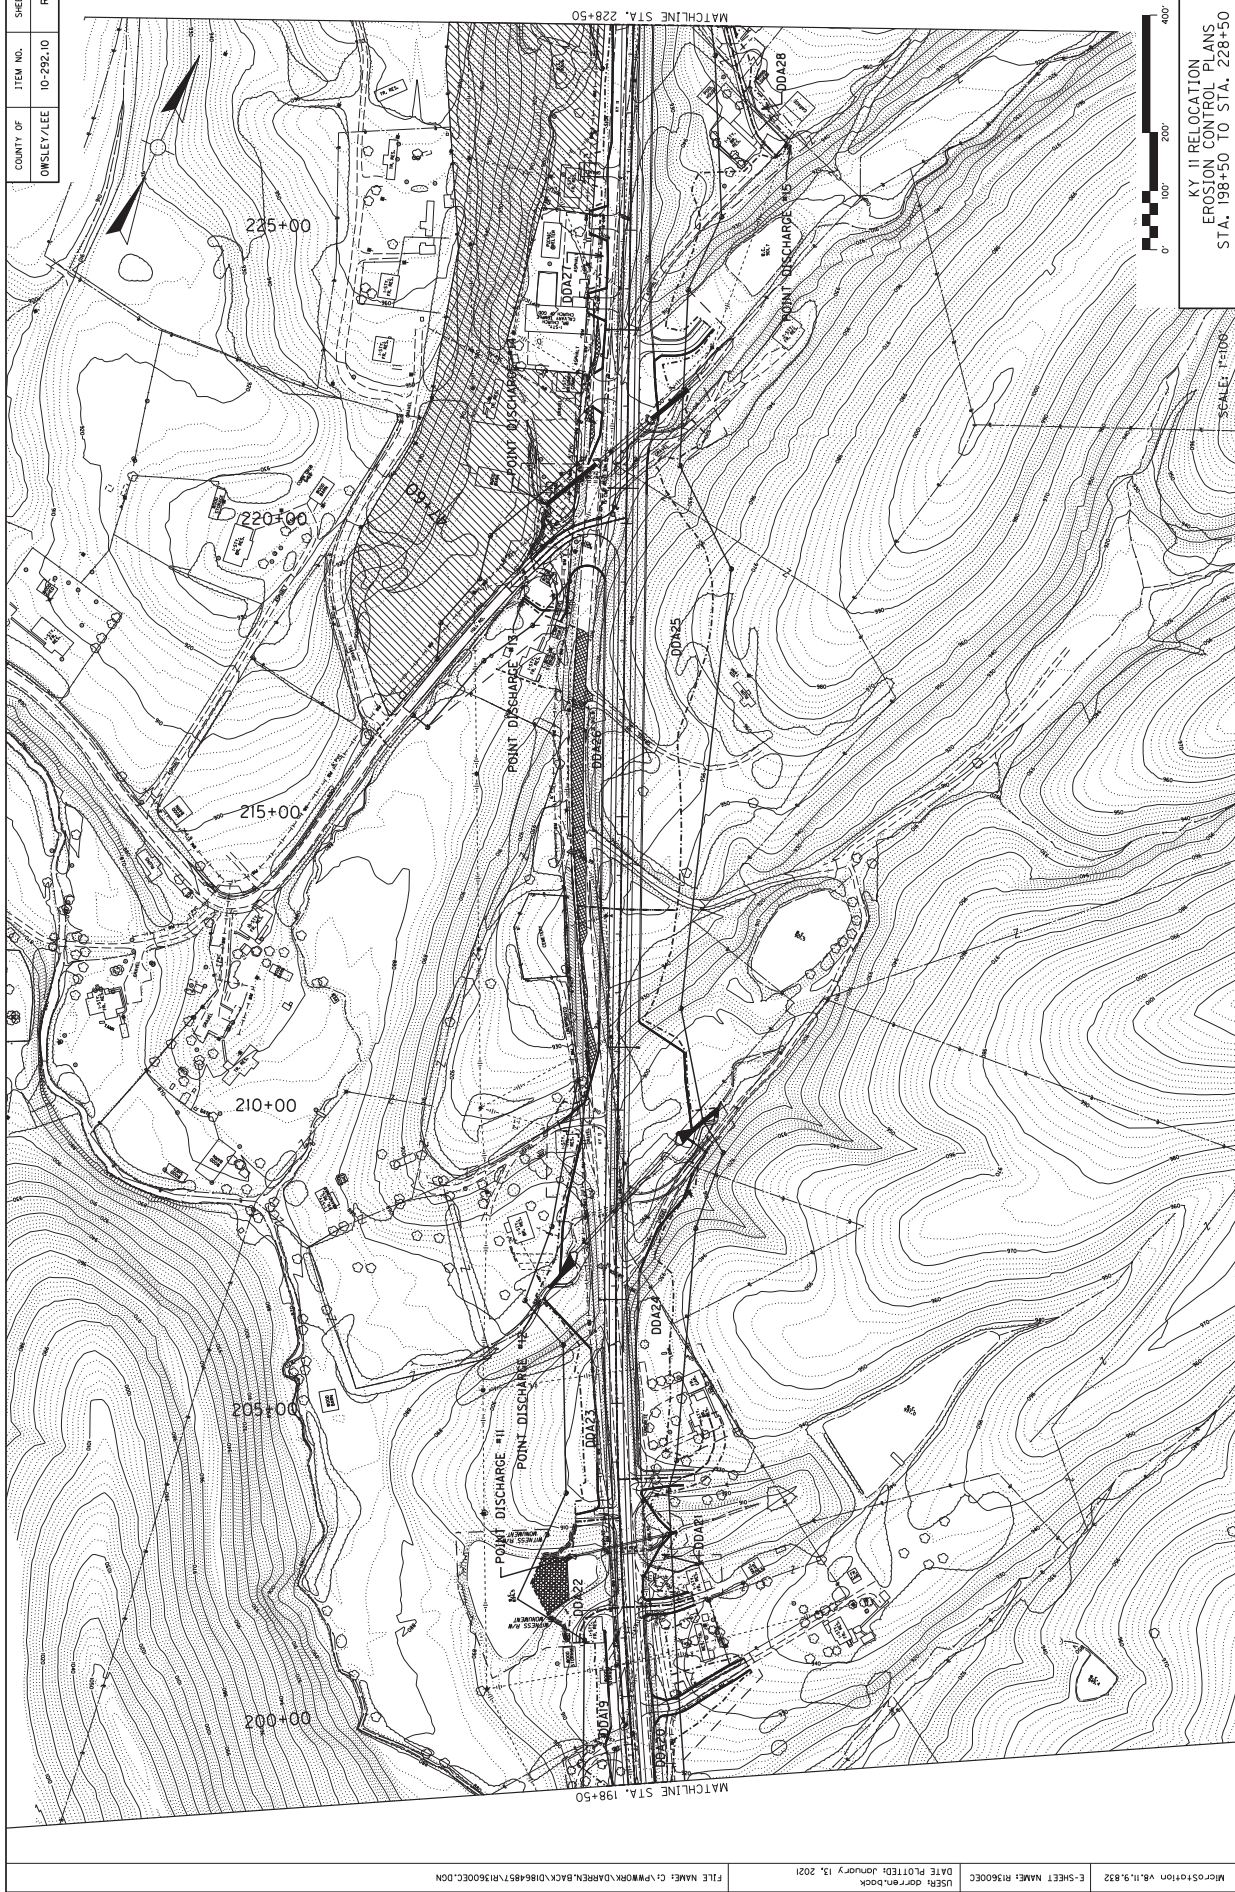


USF3: goren.book	DATE PLOTTED: January 13, 2021	FILE NAME: C:\PWORK\BAREN.BAK\084857\13600EC.DGN
C-SHEET NAME: R13600EC		
MicroStation v8.11.9.823		

COUNTY OF	ITEM NO.	SHEET NO.
OWSLEY/LEE	10-292-10	R137



MICROSURF V8.11.9.832 C-SHEET NAME: R13700C
 USER: gorenbook DATE PLOTTED: January 13, 2021
 FILE NAME: C:\PWORK\BARREN_BACK\0864857\R13700C.DGN

COUNTY OF	ITEM NO.	SHEET NO.
OWSLEY/LEE	10-292-10	R138

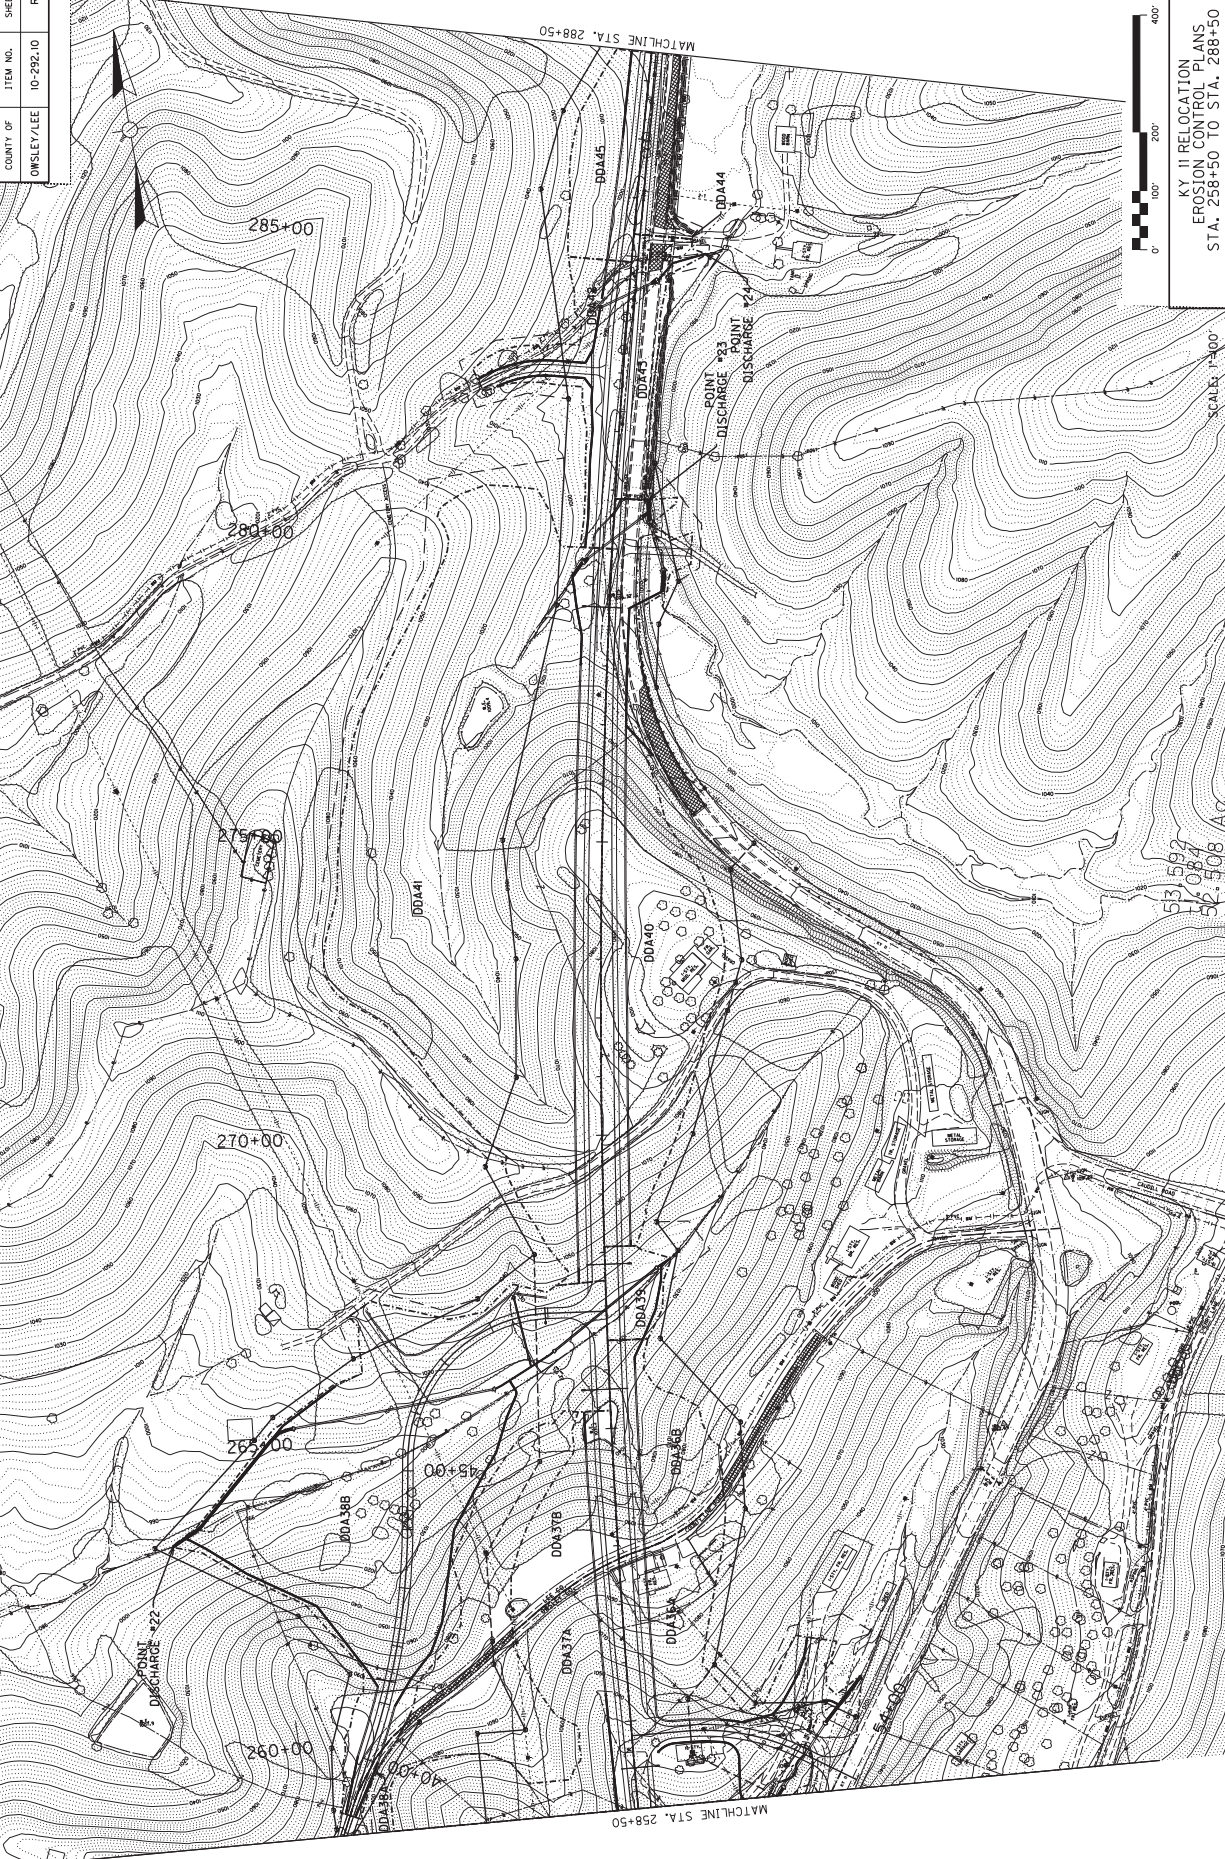

KY II RELOCATION
 EROSION CONTROL PLANS
 STA. 258+50 TO STA. 288+50

SCALE: 1"=100'




SCALE: 1" = 100'
 KY 11 RELOCATION
 EROSION CONTROL PLANS
 STA. 288+50 TO STA. 318+50

Mississippian 11.9.2022	E-SHEET NAME: R1390EC	USER: danner,back	DATE PLOTTED: January 13, 2021	FILE NAME: C:\P\WORK\DA\REN\BACK\121GR21D007\1390EC.DGN
-------------------------	-----------------------	-------------------	--------------------------------	---


SHEET NO.	ITEM NO.	COUNTY OF	SHEET NO.
R139	10-282-10	OWSLEY, LEE	R139

COUNTY OF	ITEM NO.	SHEET NO.
OWSLEY/LEE	10-282.10	R140

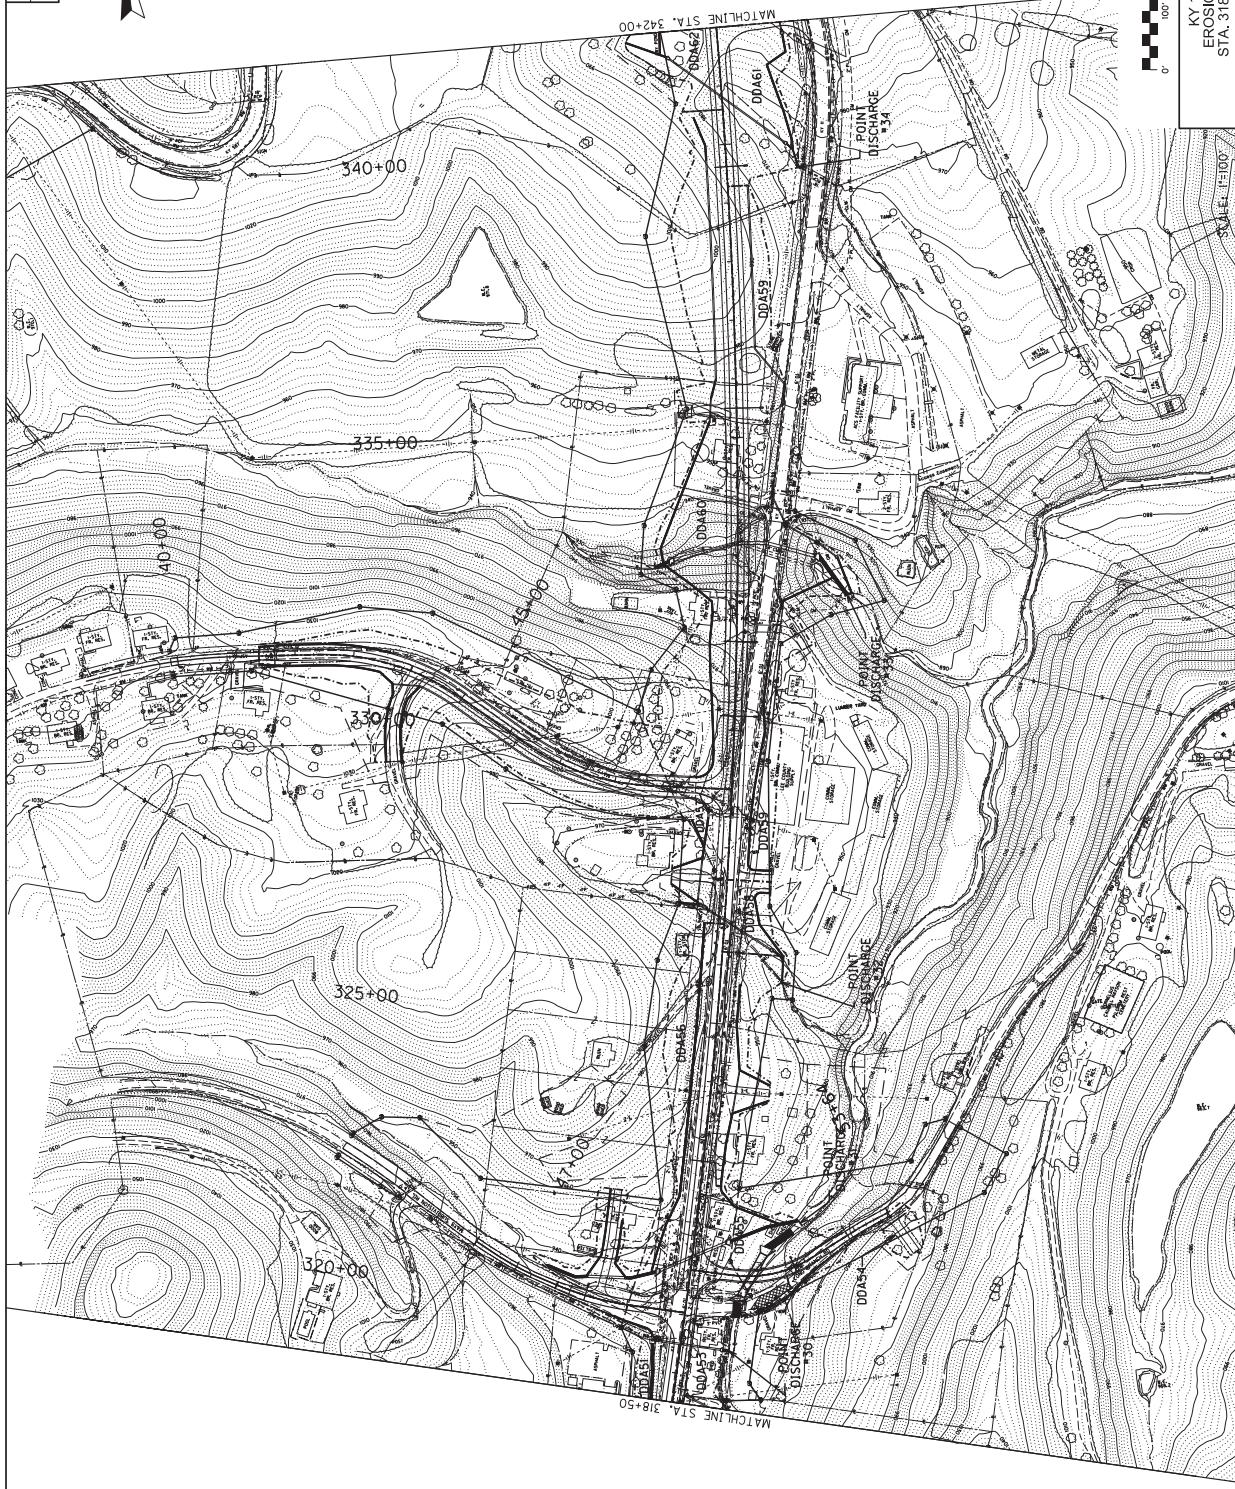

KY 11 RELOCATION
 EROSION CONTROL PLANS
 STA. 318+50 TO STA. 342+00

COUNTY OF	OWSLEY/LEE	SHEET NO.	R141
ITEM NO.	10-282.10		

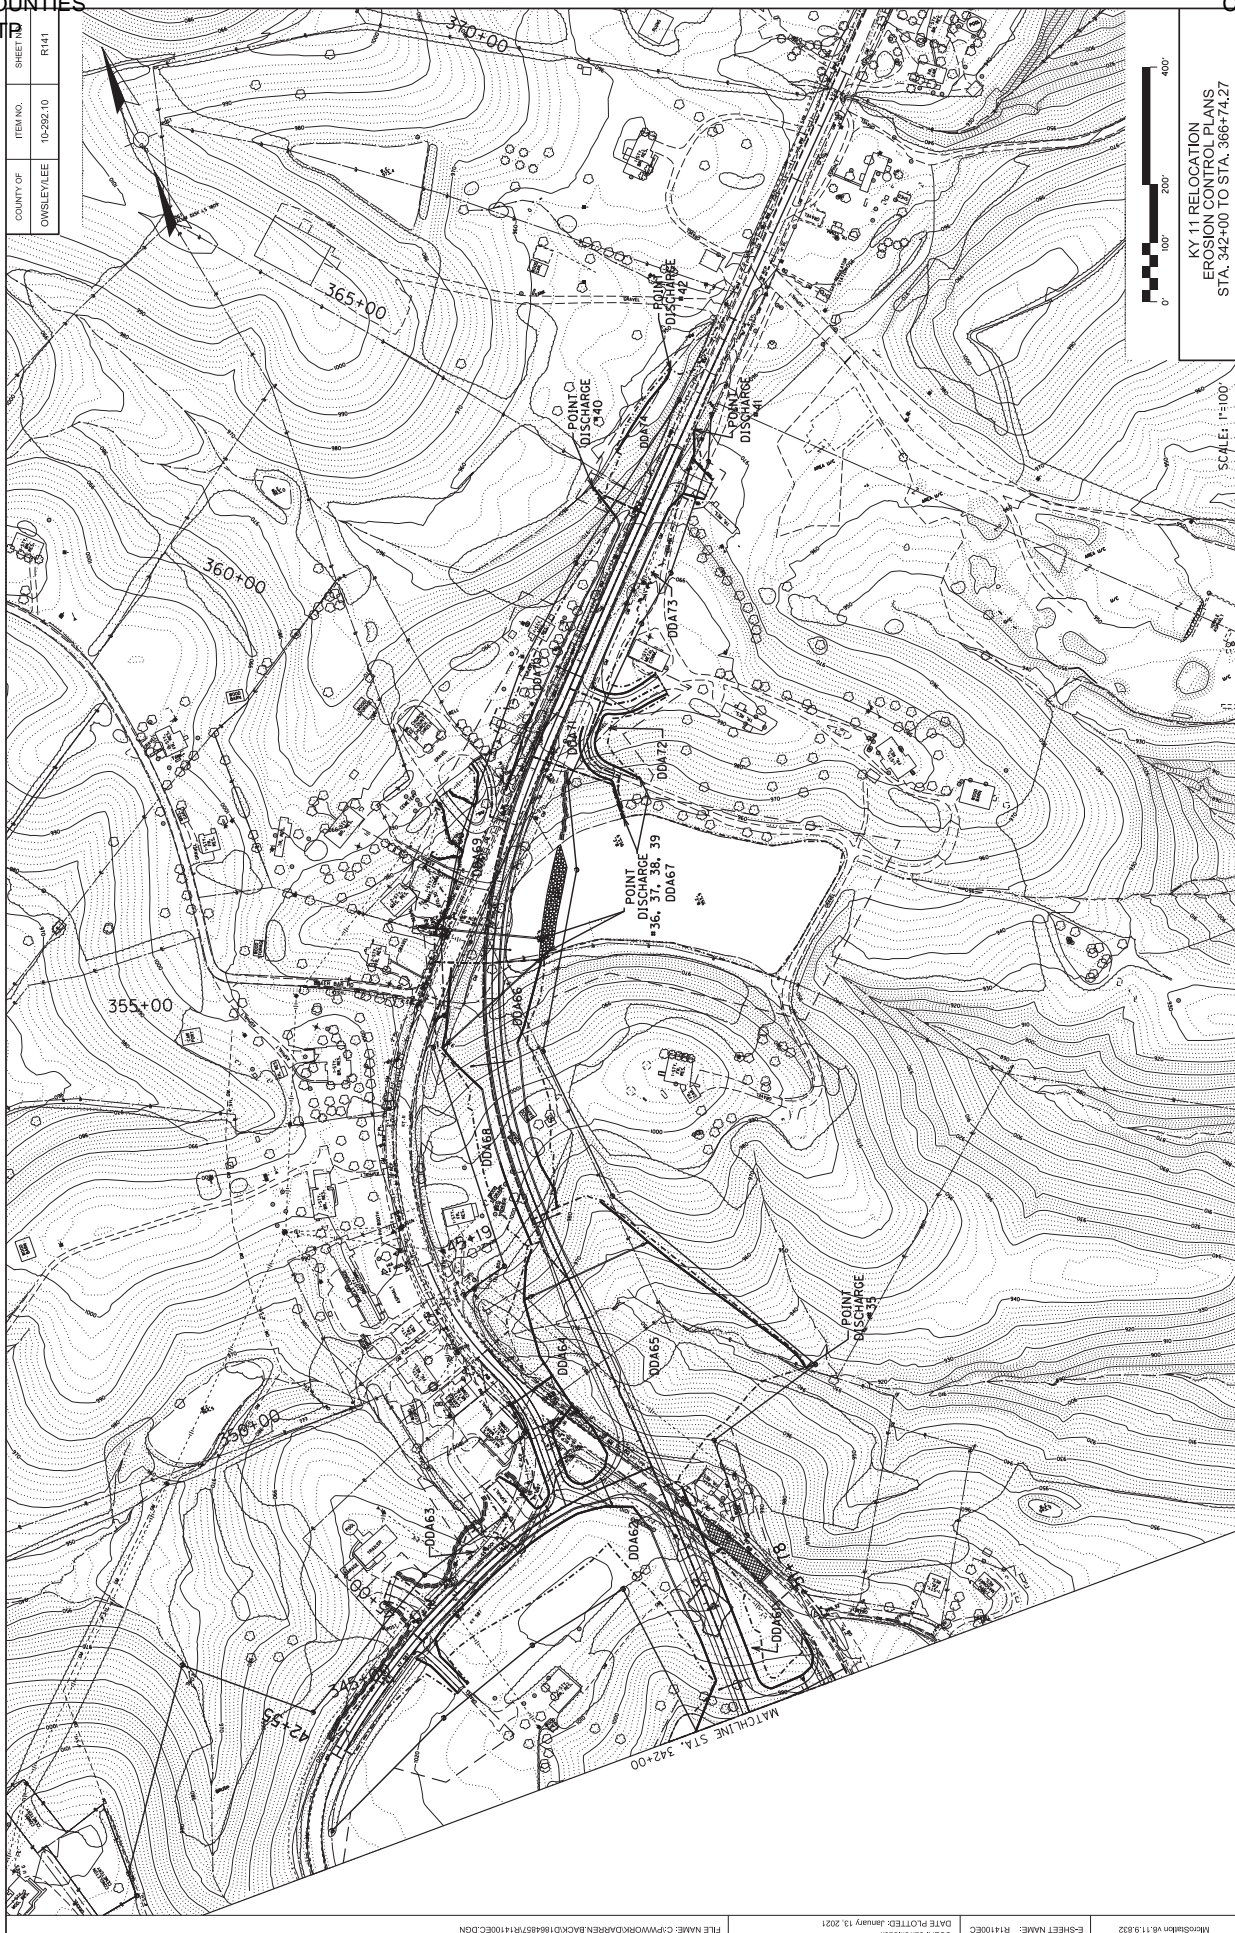

KY 11 RELOCATION
EROSION CONTROL PLANS
STA. 342+00 TO STA. 366+74.27

SCALE: 1"=100'

COUNTY OF	ITEM NO.	SHEET NO.
OWSLEY/LEE	10-292-10	R142



KY II RELOCATION
EROSION CONTROL PLANS
KY 587 STA. 42+55 TO 50+00

USER: goren,book
DATE PLOTTED: January 13, 2021
FILE NAME: C:\PWORK\BARREN,BAK\1864857\R14200C.DGN
C-SHEET NAME: R14200C
MFC:05+00\10\11.9.232

KENTUCKY TRANSPORTATION CABINET COMMUNICATING ALL PROMISES (CAP)

Item No. 10 - 292.1 County: Lee Route: 11 Project Manager: DARREN BACK

Item No. 10 - 292.1 County: Owsley Route: 11 Project Manager: DARREN BACK

1/11/21

CAP #	Date of Promise	Promise made to:	Location of Promise:	CAP Description
1	2/16/17	P103 - James P. & Letha J. Greene	~Sta. 328+00 LEFT	The existing carport on this parcel must be relocated during construction from the current entrance to the new entrance location. The property owner will be responsible for the relocation of the carport and must do so within 15 days of the new entrance & driveway being constructed. The property owner has already been compensated by KYTC for this relocation. Once the proposed entrance and driveway is constructed, the contractor will give the property owner notice and the 15 days will begin. If the carport is not moved within 15 days, the contractor should contact the District 10 Right of Way Section at 606-666-8841.
2	12/6/19	District 10 Environmental	~Sta. 185+90 LEFT	The historic marker at this location will be removed and stored by KYTC prior to construction beginning. The contractor shall call Environmental Coordinator Brandon Baker at the KYTC District 10 office at (606)666-8841 15 days prior to work beginning so the removal and storage can be scheduled.
3	12/20/19	District 10 Environmental	~Sta. 222+27 LEFT	Environmental studies have shown historic resources to be present on Parcel 48. The contractor shall not deviate from the work shown in the plans on acquired fee simple or easements from this parcel. If changes from the plans are needed, the contractor must contact the KYTC District 10 Environmental Coordinator at 606-666-8841 for consultation and approval with other agencies prior to work beginning.
4	4/8/16	P20 - Bobby L. & Joyce Carolyn Mayes	~Sta. 158+00 RIGHT - Sta. 161+60 RIGHT	The property owner reserves the right to remove some fill material from the easement and proposed right of way areas to construct a replacement septic structure if needed. The appraiser states that the septic system will not be affected by construction.
5	2/23/16	P27 - H & E Funeral Home, Inc. d/b/a Booneville Fu	Sta. 169+30.89 - Sta. 170+00 RIGHT 105'	Temporary easement areas are for entrance & side slope construction only. The owner requests that construction equipment not go beyond the acquisition areas unless an agreement is worked out between owner and contractor. The owner will be allowed to access the cemetery through the temporary easement along Ronnie Amis Rd. during construction to maintain and mow the property.
6	2/16/16	P30 - Ricky and Wilma Wilson	Sta. 189+00 RIGHT	An entrance shall be constructed to this property at Sta. 189+00 RIGHT. The plan sheets and quantities have been updated to account for this entrance. The property owner has agreed to grant access to their property to the contractor for purposes of constructing this entrance if it is needed.
7	9/11/15	P31 - Stephen Jackson and Carolyn Sue Jackson	Sta. 191+44 RIGHT	The contractor shall not disturb the retaining wall, located along the north edge of the central driveway (Sta. 191+44 RIGHT) near the proposed right of way limit.
8	1/7/15	P84 - Chasity and Shawn Charles	Entrance to P84 off Rocky Hill Rd. LEFT	The entrance shall be paved with asphalt. Any disturbed area on the parcel shall be re-seeded with grass.
9	3/10/15	P91 - Ashley and Derrick Smith	Entrance to P91 off Mays Subdivision Rd. No. 1 RIGHT	The entrance to this parcel shall be paved with asphalt.
10	2/3/15	P104 - Vickie Lynn Mays	Sta. 44+00 Mays Subdivision Rd. No. 2 RT	Any ground disturbed on the easement area will be reseeded with grass after grading operations are completed.

KENTUCKY TRANSPORTATION CABINET COMMUNICATING ALL PROMISES (CAP)

Item No. 10 - 292.1 County: Lee Route: 11 Project Manager: DARREN BACK

Item No. 10 - 292.1 County: Owsley Route: 11 Project Manager: DARREN BACK

1/11/21

CAP #	Date of Promise	Promise made to:	Location of Promise:	CAP Description
11	12/15/15	P123 - Judy Mullins	N/A	The property owner will not be held liable for any environmental damage that is caused by the contractor during the construction process.
12	10/28/15	P131 - Beattyville Congregation of Jehovah's Witne	P131 area adjacent to Mays Subdivision Rd. No. 1 RIGHT	An entrance to this parcel will be construed from Mays Subdivision Rd. No. 1 and approximate mainline Sta. 321+00 LEFT. The property owner agrees to allow the contractor access to perform work necessary on parcel to construct the entrance.
13	3/10/16	P518 - Gordon and Janet Treadway	All Acquired Area from P518	The property owner retains the right to remove any and all timber within the fee simple area. The property owner agrees to have said timber removed by 5/1/2016.
14	8/17/15	P41 - Blanche Evans	Sta. 203+70 RT	The property owner agrees to grant access to the contractor to enter the property for the only purpose of constructing a traffic bound base entrance to the remainder of the parcel. Any disturbed soil shall be reseeded with grass. The property owner agrees to allow KYTC to level and grade as necessary to remove the basement.
15	12/31/14	P105 - Helana Angel	Sta. 41+00 RT Mays Subdivision Rd. No. 2	The contractor shall pave the entrance to this parcel.
16	5/7/15	P120 - Anita Holland	KY 587	If fence on acquisition area is removed, property owner will retain it and posts. Contractor should notify owner 90 days prior to day removal will be needed.
17	7/14/15	P509 - Erika and Jamie Arnold	Sta. 356+88 LT	The existing entrances to this parcel will be tie back into the proposed KY 11 post construction.
18	2/12/15	P525 - Nicky and Mary Judd	Parcel 525	The property owner will have ingress and egress access to the parcel at all times during construction.

MATERIAL SUMMARY

CONTRACT ID: 211307

121GR21D007 - STP

DE06500112107

BOONEVILLE-BEATTYVILLE ROAD (KY11) RELOCATE KY11 FROM OWSLEY-LEE COUNTY LINE EXTENDING NORTH TO KY587 GRADE & DRAIN WITH ASPHALT SURFACE, A DISTANCE OF 2.09 MILES.

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
0835	00003	CRUSHED STONE BASE	29,713.00	TON
0840	00020	TRAFFIC BOUND BASE	1,028.00	TON
0845	00100	ASPHALT SEAL AGGREGATE	193.00	TON
0850	00103	ASPHALT SEAL COAT	23.00	TON
0855	00221	CL2 ASPH BASE 0.75D PG64-22	23,717.00	TON
0860	00301	CL2 ASPH SURF 0.38D PG64-22	5,777.00	TON
0865	00356	ASPHALT MATERIAL FOR TACK	40.30	TON
0870	02677	ASPHALT PAVE MILLING & TEXTURING	1,038.00	TON
0875	20071EC	JOINT ADHESIVE	16,035.00	LF
0880	00078	CRUSHED AGGREGATE SIZE NO 2 - FOR PERFORATED PIPE HEADWALLS	45.00	TON
0885	00078	CRUSHED AGGREGATE SIZE NO 2 - FOR SUBGRADE STABILIZATION	473.00	TON
0890	00440	ENTRANCE PIPE-15 IN	484.00	LF
0895	00441	ENTRANCE PIPE-18 IN	200.00	LF
0900	00443	ENTRANCE PIPE-24 IN	111.00	LF
0905	00452	ENTRANCE PIPE-24 IN EQUIV	47.00	LF
0910	00454	ENTRANCE PIPE-30 IN EQUIV	123.00	LF
0915	01000	PERFORATED PIPE-4 IN	2,697.00	LF
0920	01010	NON-PERFORATED PIPE-4 IN	971.00	LF
0925	01020	PERF PIPE HEADWALL TY 1-4 IN	5.00	EACH
0930	01028	PERF PIPE HEADWALL TY 3-4 IN	26.00	EACH
0935	01032	PERF PIPE HEADWALL TY 4-4 IN	3.00	EACH
0940	01987	DELINEATOR FOR GUARDRAIL BI DIRECTIONAL WHITE	123.00	EACH
0945	02014	BARRICADE-TYPE III	3.00	EACH
0950	02091	REMOVE PAVEMENT	758.00	SQYD
0955	02159	TEMP DITCH	5,225.00	LF
0960	02160	CLEAN TEMP DITCH	2,613.00	LF
0965	02200	ROADWAY EXCAVATION	713,594.00	CUYD
0970	02242	WATER	387.00	MGAL
0975	02360	GUARDRAIL TERMINAL SECTION NO 1	19.00	EACH
0980	02369	GUARDRAIL END TREATMENT TYPE 2A	5.00	EACH
0985	02371	GUARDRAIL END TREATMENT TYPE 7	17.00	EACH
0990	02381	REMOVE GUARDRAIL	2,223.00	LF
0995	02391	GUARDRAIL END TREATMENT TYPE 4A	4.00	EACH
1000	02397	TEMP GUARDRAIL	4,312.00	LF
1005	02429	RIGHT-OF-WAY MONUMENT TYPE 1	151.00	EACH
1010	02430	RIGHT-OF-WAY MONUMENT TYPE 1A	6.00	EACH
1015	02431	WITNESS R/W MONUMENT TYPE 2	1.00	EACH
1020	02432	WITNESS POST	3.00	EACH
1025	02475	PLUG WATER WELL	2.00	EACH
1030	02484	CHANNEL LINING CLASS III	23,096.00	TON
1035	02545	CLEARING AND GRUBBING - (APPROX. 98.562 ACRES IN LEE CO.)	1.00	LS

MATERIAL SUMMARY

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
1040	02555	CONCRETE-CLASS B - FOR PARTIALLY GROUTED RIPRAP	189.00	CUYD
1045	02562	TEMPORARY SIGNS	378.64	SQFT
1050	02585	EDGE KEY	157.50	LF
1055	02602	FABRIC-GEOTEXTILE CLASS 1	460.00	SQYD
1060	02603	FABRIC-GEOTEXTILE CLASS 2	1,238.00	SQYD
1065	02607	FABRIC-GEOTEXTILE CLASS 2 FOR PIPE	3,525.00	SQYD
1070	02650	MAINTAIN & CONTROL TRAFFIC - (LEE COUNTY)	1.00	LS
1075	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #5 - LEE CO)	1.00	LS
1080	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #6 - LEE CO)	1.00	LS
1085	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #7 - LEE CO)	1.00	LS
1090	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #8 - LEE CO)	1.00	LS
1095	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #9 - LEE CO)	1.00	LS
1100	02671	PORTABLE CHANGEABLE MESSAGE SIGN	2.00	EACH
1105	02676	MOBILIZATION FOR MILL & TEXT - (LEE COUNTY)	1.00	LS
1110	02690	SAFELOADING	84.29	CUYD
1115	02696	SHOULDER RUMBLE STRIPS	20,446.00	LF
1120	02701	TEMP SILT FENCE	5,225.00	LF
1125	02703	SILT TRAP TYPE A	64.00	EACH
1130	02704	SILT TRAP TYPE B	64.00	EACH
1135	02705	SILT TRAP TYPE C	64.00	EACH
1140	02706	CLEAN SILT TRAP TYPE A	64.00	EACH
1145	02707	CLEAN SILT TRAP TYPE B	64.00	EACH
1150	02708	CLEAN SILT TRAP TYPE C	64.00	EACH
1155	02726	STAKING - (LEE COUNTY)	1.00	LS
1160	02731	REMOVE STRUCTURE - (18'X8' BRIDGE STA. 51+00 LONGBRANCH)	1.00	LS
1165	02731	REMOVE STRUCTURE - (5'X5' SBC STA 51+27 PINE GROVE)	1.00	LS
1170	05952	TEMP MULCH	207,023.00	SQYD
1175	05953	TEMP SEEDING AND PROTECTION	155,267.00	SQYD
1180	05963	INITIAL FERTILIZER	26.00	TON
1185	05964	MAINTENANCE FERTILIZER	13.00	TON
1190	05985	SEEDING AND PROTECTION	254,005.00	SQYD
1195	05992	AGRICULTURAL LIMESTONE	157.00	TON
1200	06510	PAVE STRIPING-TEMP PAINT-4 IN	96,056.00	LF
1205	06514	PAVE STRIPING-PERM PAINT-4 IN	5,758.00	LF
1210	06530	PAVE STRIPING REMOVAL-4 IN	2,200.00	LF
1215	06573	PAVE MARKING-THERMO STR ARROW	2.00	EACH
1220	06574	PAVE MARKING-THERMO CURV ARROW	6.00	EACH
1225	06578	PAVE MARKING-THERMO MERGE ARROW	6.00	EACH
1230	10020NS	FUEL ADJUSTMENT	176,500.00	DOLL
1235	10030NS	ASPHALT ADJUSTMENT	108,644.00	DOLL
1240	21257ED	ENTRANCE PIPE-48 IN	63.00	LF
1245	21802EN	G/R STEEL W BEAM-S FACE (7 FT POST)	2,587.50	LF
1250	24489EC	INLAID PAVEMENT MARKER	150.00	EACH
1255	24540	R/W MONUMENT TYPE 3	47.00	EACH

MATERIAL SUMMARY

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
1260	24541	R/W MONUMENT TYPE 3A	2.00	EACH
1265	24814EC	PIPELINE INSPECTION	2,101.00	LF
1270	24845EC	UTILITY COORDINATION - (LEE COUNTY)	1.00	LS
1275	24995EC	PAVE STRIPING-SPRAY THERMO-6 IN W	20,782.00	LF
1280	24996EC	PAVE STRIPING-SPRAY THERMO-6 IN Y	22,332.00	LF
1285	00462	CULVERT PIPE-18 IN	543.00	LF
1290	00464	CULVERT PIPE-24 IN	749.00	LF
1295	00466	CULVERT PIPE-30 IN	505.00	LF
1300	00470	CULVERT PIPE-48 IN	406.00	LF
1305	00499	CULVERT PIPE-48 IN EQUIV	99.00	LF
1310	00522	STORM SEWER PIPE-18 IN	239.00	LF
1315	00526	STORM SEWER PIPE-30 IN	286.00	LF
1320	01204	PIPE CULVERT HEADWALL-18 IN	7.00	EACH
1325	01208	PIPE CULVERT HEADWALL-24 IN	8.00	EACH
1330	01210	PIPE CULVERT HEADWALL-30 IN	6.00	EACH
1335	01216	PIPE CULVERT HEADWALL-48 IN	6.00	EACH
1340	01217	PIPE CULVERT HEADWALL-48 IN EQUIV	2.00	EACH
1345	01450	S & F BOX INLET-OUTLET-18 IN	3.00	EACH
1350	01452	S & F BOX INLET-OUTLET-30 IN	3.00	EACH
1355	01490	DROP BOX INLET TYPE 1	1.00	EACH
1360	01493	DROP BOX INLET TYPE 2	2.00	EACH
1365	01544	DROP BOX INLET TYPE 11	3.00	EACH
1370	01650	JUNCTION BOX - (TYPE B1)	2.00	EACH
1375	08002	STRUCTURE EXCAV-SOLID ROCK	5.00	CUYD
1380	08003	FOUNDATION PREPARATION	1.00	LS
1385	08100	CONCRETE-CLASS A	132.10	CUYD
1390	08150	STEEL REINFORCEMENT	12,874.00	LB
1395	08002	STRUCTURE EXCAV-SOLID ROCK	18.00	CUYD
1400	08003	FOUNDATION PREPARATION	1.00	LS
1405	08100	CONCRETE-CLASS A	153.00	CUYD
1410	08150	STEEL REINFORCEMENT	14,507.00	LB
1415	08002	STRUCTURE EXCAV-SOLID ROCK	352.00	CUYD
1420	08003	FOUNDATION PREPARATION	1.00	LS
1425	08100	CONCRETE-CLASS A	255.30	CUYD
1430	08150	STEEL REINFORCEMENT	30,276.00	LB
1435	06401	FLEXIBLE DELINEATOR POST-M/W	9.00	EACH
1440	06406	SBM ALUM SHEET SIGNS .080 IN	517.00	SQFT
1445	06407	SBM ALUM SHEET SIGNS .125 IN	12.00	SQFT
1450	06410	STEEL POST TYPE 1	1,046.00	LF
1455	20458ES403	CENTERLINE RUMBLE STRIPS	10,223.00	LF
1460	24631EC	BARCODE SIGN INVENTORY	98.00	EACH
1465	02568	MOBILIZATION	1.00	LS
1470	02569	DEMOBILIZATION	1.00	LS
1475	14004	W DIRECTIONAL BORE - (2 INCH)	575.00	LF
1480	14004	W DIRECTIONAL BORE - (3 INCH)	340.00	LF
1485	14004	W DIRECTIONAL BORE - (4 INCH)	60.00	LF
1490	14004	W DIRECTIONAL BORE - (6 INCH)	215.00	LF
1495	14007	W ENCASEMENT STEEL BORED RANGE 2 - (W/4 INCH SDR17 WATERLINE)	50.00	LF
1500	14008	W ENCASEMENT STEEL BORED RANGE 3 - (W/6 INCH SDR17 WATERLINE)	30.00	LF

MATERIAL SUMMARY

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
1505	14013	W ENCASEMENT STEEL OPEN CUT RANGE 2 - (W/4 INCH SDR17 WATERLINE)	200.00	LF
1510	14022	W FLUSH HYDRANT ASSEMBLY - (TYPE 1)	2.00	EACH
1515	14022	W FLUSH HYDRANT ASSEMBLY - (TYPE 3)	4.00	EACH
1520	14056	W PIPE PVC 02 INCH	1,510.00	LF
1525	14057	W PIPE PVC 03 INCH	2,255.00	LF
1530	14058	W PIPE PVC 04 INCH	14,590.00	LF
1535	14059	W PIPE PVC 06 INCH	8,135.00	LF
1540	14080	W SERV PE/PLST LONG SIDE 3/4 IN	5.00	EACH
1545	14085	W SERV PE/PLST SHORT SIDE 3/4 IN	45.00	EACH
1550	14091	W TIE-IN 02 INCH	11.00	EACH
1555	14092	W TIE-IN 03 INCH	4.00	EACH
1560	14093	W TIE-IN 04 INCH	7.00	EACH
1565	14094	W TIE-IN 06 INCH	7.00	EACH
1570	14102	W VALVE 02 INCH	5.00	EACH
1575	14103	W VALVE 03 INCH	5.00	EACH
1580	14104	W VALVE 04 INCH	12.00	EACH
1585	14105	W VALVE 06 INCH	8.00	EACH
1590	14130	W METER WITH PRV 3/4 INCH	32.00	EACH

CONTRACT ID: 211307

121GR21D007 - STP

DE09500112107

BOONEVILLE-BEATTYVILLE ROAD (KY11) RELOCATE KY11 FROM KY30 AT LEVI EXTENDING NORTH TO THE OWSLEY-LEE COUNTY LINE GRADE & DRAIN WITH ASPHALT SURFACE, A DISTANCE OF 2.46 MILES.

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
0005	00003	CRUSHED STONE BASE	33,568.00	TON
0010	00020	TRAFFIC BOUND BASE	1,472.00	TON
0015	00100	ASPHALT SEAL AGGREGATE	231.00	TON
0020	00103	ASPHALT SEAL COAT	28.00	TON
0025	00221	CL2 ASPH BASE 0.75D PG64-22	24,560.00	TON
0030	00301	CL2 ASPH SURF 0.38D PG64-22	5,584.00	TON
0035	00356	ASPHALT MATERIAL FOR TACK	40.60	TON
0040	02099	CEM CONC ENT PAVEMENT-6 IN	63.00	SQYD
0045	02677	ASPHALT PAVE MILLING & TEXTURING	1,000.00	TON
0050	20071EC	JOINT ADHESIVE	17,462.00	LF
0055	00021	DRAINAGE BLANKET-EMBANKMENT - STA. 206+25 - 208+75	600.00	CUYD
0060	00078	CRUSHED AGGREGATE SIZE NO 2 - FOR PERFORATED PIPE HEADWALLS	16.00	TON
0065	00078	CRUSHED AGGREGATE SIZE NO 2 - FOR SUBGRADE STABILIZATION	474.00	TON
0070	00440	ENTRANCE PIPE-15 IN	623.00	LF
0075	00441	ENTRANCE PIPE-18 IN	253.00	LF
0080	00443	ENTRANCE PIPE-24 IN	276.00	LF
0085	01000	PERFORATED PIPE-4 IN	1,870.00	LF
0090	01010	NON-PERFORATED PIPE-4 IN	439.00	LF
0095	01020	PERF PIPE HEADWALL TY 1-4 IN	3.00	EACH

MATERIAL SUMMARY

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
0100	01028	PERF PIPE HEADWALL TY 3-4 IN	11.00	EACH
0105	01032	PERF PIPE HEADWALL TY 4-4 IN	2.00	EACH
0110	01314	PLUG PIPE	1.00	EACH
0115	01987	DELINEATOR FOR GUARDRAIL BI DIRECTIONAL WHITE	115.00	EACH
0120	02014	BARRICADE-TYPE III	3.00	EACH
0125	02091	REMOVE PAVEMENT	815.00	SQYD
0130	02159	TEMP DITCH	6,500.00	LF
0135	02160	CLEAN TEMP DITCH	3,250.00	LF
0140	02200	ROADWAY EXCAVATION	486,932.00	CUYD
0145	02203	STRUCTURE EXCAV-UNCLASSIFIED - FOR RETAINING WALL (STA. 230+50 TO STA. 232+50)	267.00	CUYD
0150	02242	WATER	460.00	MGAL
0155	02360	GUARDRAIL TERMINAL SECTION NO 1	28.00	EACH
0160	02371	GUARDRAIL END TREATMENT TYPE 7	11.00	EACH
0165	02381	REMOVE GUARDRAIL	62.50	LF
0170	02391	GUARDRAIL END TREATMENT TYPE 4A	6.00	EACH
0175	02397	TEMP GUARDRAIL	2,200.00	LF
0180	02404	SEPTIC TANK TREATMENT	1.00	EACH
0185	02429	RIGHT-OF-WAY MONUMENT TYPE 1	103.00	EACH
0190	02430	RIGHT-OF-WAY MONUMENT TYPE 1A	2.00	EACH
0195	02431	WITNESS R/W MONUMENT TYPE 2	2.00	EACH
0200	02432	WITNESS POST	3.00	EACH
0205	02475	PLUG WATER WELL	2.00	EACH
0210	02483	CHANNEL LINING CLASS II	302.00	TON
0215	02484	CHANNEL LINING CLASS III	20,571.00	TON
0220	02545	CLEARING AND GRUBBING - (APPROX. 86.536 ACRES IN OWSLEY CO.)	1.00	LS
0225	02555	CONCRETE-CLASS B - FOR PARTIALLY GROUTED RIPRAP	97.00	CUYD
0230	02555	CONCRETE-CLASS B - FOR RETAINING WALL (STA. 230+50 TO STA. 232+50)	148.00	CUYD
0235	02562	TEMPORARY SIGNS	995.86	SQFT
0240	02585	EDGE KEY	102.50	LF
0245	02602	FABRIC-GEOTEXTILE CLASS 1	483.00	SQYD
0250	02603	FABRIC-GEOTEXTILE CLASS 2	4,837.00	SQYD
0255	02607	FABRIC-GEOTEXTILE CLASS 2 FOR PIPE	3,743.00	SQYD
0260	02650	MAINTAIN & CONTROL TRAFFIC - (OWSLEY COUNTY)	1.00	LS
0265	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #1 - OWSLEY CO)	1.00	LS
0270	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #2 - OWSLEY CO)	1.00	LS
0275	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #3 - OWSLEY CO)	1.00	LS
0280	02651	DIVERSIONS (BY-PASS DETOURS) - (DIVERSION #4 - OWSLEY CO)	1.00	LS
0285	02671	PORTABLE CHANGEABLE MESSAGE SIGN	2.00	EACH
0290	02676	MOBILIZATION FOR MILL & TEXT - (OWSLEY COUNTY)	1.00	LS
0295	02690	SAFELOADING	69.38	CUYD
0300	02696	SHOULDER RUMBLE STRIPS	46,400.00	LF
0305	02701	TEMP SILT FENCE	6,500.00	LF
0310	02703	SILT TRAP TYPE A	57.00	EACH
0315	02704	SILT TRAP TYPE B	57.00	EACH

MATERIAL SUMMARY

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
0320	02705	SILT TRAP TYPE C	57.00	EACH
0325	02706	CLEAN SILT TRAP TYPE A	57.00	EACH
0330	02707	CLEAN SILT TRAP TYPE B	57.00	EACH
0335	02708	CLEAN SILT TRAP TYPE C	57.00	EACH
0340	02726	STAKING - (OWSLEY COUNTY)	1.00	LS
0345	02731	REMOVE STRUCTURE - (18'X8' BRIDGE STA. 51+00 LONGBRANCH)	1.00	LS
0350	02731	REMOVE STRUCTURE - (5'X5' SBC STA 51+27 PINE GROVE)	1.00	LS
0355	02731	REMOVE STRUCTURE - (6'X4' SBC ENT 179+85 RT.)	1.00	LS
0360	05950	EROSION CONTROL BLANKET	892.00	SQYD
0365	05952	TEMP MULCH	183,759.00	SQYD
0370	05953	TEMP SEEDING AND PROTECTION	137,819.00	SQYD
0375	05963	INITIAL FERTILIZER	23.00	TON
0380	05964	MAINTENANCE FERTILIZER	11.00	TON
0385	05985	SEEDING AND PROTECTION	216,985.00	SQYD
0390	05992	AGRICULTURAL LIMESTONE	135.00	TON
0395	06510	PAVE STRIPING-TEMP PAINT-4 IN	105,320.00	LF
0400	06514	PAVE STRIPING-PERM PAINT-4 IN	2,180.00	LF
0405	06530	PAVE STRIPING REMOVAL-4 IN	2,200.00	LF
0410	06569	PAVE MARKING-THERMO CROSS-HATCH	1,124.00	SQFT
0415	06574	PAVE MARKING-THERMO CURV ARROW	4.00	EACH
0420	10020NS	FUEL ADJUSTMENT	141,309.00	DOLL
0425	10030NS	ASPHALT ADJUSTMENT	113,507.00	DOLL
0430	21802EN	G/R STEEL W BEAM-S FACE (7 FT POST)	5,025.00	LF
0435	24489EC	INLAID PAVEMENT MARKER	198.00	EACH
0440	24540	R/W MONUMENT TYPE 3	17.00	EACH
0445	24541	R/W MONUMENT TYPE 3A	2.00	EACH
0450	24814EC	PIPELINE INSPECTION	1,848.00	LF
0455	24845EC	UTILITY COORDINATION - (OWSLEY COUNTY)	1.00	LS
0460	24995EC	PAVE STRIPING-SPRAY THERMO-6 IN W	27,030.00	LF
0465	24996EC	PAVE STRIPING-SPRAY THERMO-6 IN Y	16,035.00	LF
0470	00462	CULVERT PIPE-18 IN	140.00	LF
0475	00464	CULVERT PIPE-24 IN	56.00	LF
0480	00466	CULVERT PIPE-30 IN	222.00	LF
0485	00468	CULVERT PIPE-36 IN	241.00	LF
0490	00469	CULVERT PIPE-42 IN	214.00	LF
0495	00470	CULVERT PIPE-48 IN	272.00	LF
0500	00472	CULVERT PIPE-60 IN	99.00	LF
0505	00473	CULVERT PIPE-66 IN	148.00	LF
0510	00502	CULVERT PIPE-66 IN EQUIV	23.00	LF
0515	00521	STORM SEWER PIPE-15 IN	70.00	LF
0520	00522	STORM SEWER PIPE-18 IN	51.00	LF
0525	00524	STORM SEWER PIPE-24 IN	300.00	LF
0530	00526	STORM SEWER PIPE-30 IN	177.00	LF
0535	01202	PIPE CULVERT HEADWALL-15 IN	1.00	EACH
0540	01204	PIPE CULVERT HEADWALL-18 IN	1.00	EACH
0545	01208	PIPE CULVERT HEADWALL-24 IN	3.00	EACH
0550	01210	PIPE CULVERT HEADWALL-30 IN	5.00	EACH
0555	01212	PIPE CULVERT HEADWALL-36 IN	4.00	EACH
0560	01214	PIPE CULVERT HEADWALL-42 IN	4.00	EACH

MATERIAL SUMMARY

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
0565	01216	PIPE CULVERT HEADWALL-48 IN	4.00	EACH
0570	01220	PIPE CULVERT HEADWALL-60 IN	2.00	EACH
0575	01222	PIPE CULVERT HEADWALL-66 IN	4.00	EACH
0580	01222	PIPE CULVERT HEADWALL-66 IN - 66 IN EQUIVALENT	2.00	EACH
0585	01450	S & F BOX INLET-OUTLET-18 IN	2.00	EACH
0590	01451	S & F BOX INLET-OUTLET-24 IN	1.00	EACH
0595	01452	S & F BOX INLET-OUTLET-30 IN	2.00	EACH
0600	01490	DROP BOX INLET TYPE 1	5.00	EACH
0605	01496	DROP BOX INLET TYPE 3 - NO APRON	1.00	EACH
0610	01535	DROP BOX INLET TYPE 6F	1.00	EACH
0615	01538	DROP BOX INLET TYPE 7	1.00	EACH
0620	01577	DROP BOX INLET TYPE 14	1.00	EACH
0625	08100	CONCRETE-CLASS A - (INTERMEDIATE ANCHORS)	4.50	CUYD
0630	21800EN	BORE AND JACK PIPE-30 IN	75.00	LF
0635	08002	STRUCTURE EXCAV-SOLID ROCK	5.00	CUYD
0640	08003	FOUNDATION PREPARATION	1.00	LS
0645	08100	CONCRETE-CLASS A	113.80	CUYD
0650	08150	STEEL REINFORCEMENT	11,120.00	LB
0655	08002	STRUCTURE EXCAV-SOLID ROCK	5.00	CUYD
0660	08003	FOUNDATION PREPARATION	1.00	LS
0665	08100	CONCRETE-CLASS A	220.40	CUYD
0670	08150	STEEL REINFORCEMENT	20,834.00	LB
0675	06401	FLEXIBLE DELINEATOR POST-M/W	5.00	EACH
0680	06406	SBM ALUM SHEET SIGNS .080 IN	301.00	SQFT
0685	06407	SBM ALUM SHEET SIGNS .125 IN	12.00	SQFT
0690	06410	STEEL POST TYPE 1	488.00	LF
0695	20418ED	REMOVE & RELOCATE SIGNS	4.00	EACH
0700	20458ES403	CENTERLINE RUMBLE STRIPS	23,200.00	LF
0705	24631EC	BARCODE SIGN INVENTORY	45.00	EACH
0710	02568	MOBILIZATION	1.00	LS
0715	02569	DEMOBILIZATION	1.00	LS
0720	14004	W DIRECTIONAL BORE - (2 INCH)	910.00	LF
0725	14004	W DIRECTIONAL BORE - (4 INCH)	215.00	LF
0730	14004	W DIRECTIONAL BORE - (6 INCH)	210.00	LF
0735	14007	W ENCASMENT STEEL BORED RANGE 2 - (W/4 INCH SDR17 WATERLINE)	50.00	LF
0740	14008	W ENCASMENT STEEL BORED RANGE 3 - (W/6 INCH SDR17 WATERLINE)	55.00	LF
0745	14014	W ENCASMENT STEEL OPEN CUT RANGE 3 - (W/6 INCH SDR17 WATERLINE)	280.00	LF
0750	14022	W FLUSH HYDRANT ASSEMBLY - (TYPE 1)	6.00	EACH
0755	14056	W PIPE PVC 02 INCH	2,510.00	LF
0760	14057	W PIPE PVC 03 INCH	120.00	LF
0765	14058	W PIPE PVC 04 INCH	1,075.00	LF
0770	14059	W PIPE PVC 06 INCH	20,055.00	LF
0775	14080	W SERV PE/PLST LONG SIDE 3/4 IN	4.00	EACH
0780	14085	W SERV PE/PLST SHORT SIDE 3/4 IN	45.00	EACH
0785	14091	W TIE-IN 02 INCH	6.00	EACH
0790	14092	W TIE-IN 03 INCH	2.00	EACH
0795	14093	W TIE-IN 04 INCH	9.00	EACH
0800	14094	W TIE-IN 06 INCH	6.00	EACH

MATERIAL SUMMARY

Project Line No	Bid Code	DESCRIPTION	Quantity	Unit
0805	14102	W VALVE 02 INCH	7.00	EACH
0810	14103	W VALVE 03 INCH	2.00	EACH
0815	14104	W VALVE 04 INCH	9.00	EACH
0820	14105	W VALVE 06 INCH	10.00	EACH
0825	14124	W VALVE SPECIAL - (6 INCH PRV ASSEMBLY)	1.00	EACH
0830	14130	W METER WITH PRV 3/4 INCH	29.00	EACH

PART II
SPECIFICATIONS AND STANDARD DRAWINGS

SPECIFICATIONS REFERENCE

Any reference in the plans or proposal to previous editions of the *Standard Specifications for Road and Bridge Construction* and *Standard Drawings* are superseded by *Standard Specifications for Road and Bridge Construction, Edition of 2019* and *Standard Drawings, Edition of 2020*.

SUPPLEMENTAL SPECIFICATIONS

The contractor shall use the Supplemental Specifications that are effective at the time of letting.
The Supplemental Specifications can be found at the following link:

<http://transportation.ky.gov/Construction/Pages/Kentucky-Standard-Specifications.aspx>

SPECIAL NOTE FOR PORTABLE CHANGEABLE MESSAGE SIGNS

This Special Note will apply when indicated on the plans or in the proposal.

1.0 DESCRIPTION. Furnish, install, operate, and maintain variable message signs at the locations shown on the plans or designated by the Engineer. Remove and retain possession of variable message signs when they are no longer needed on the project.

2.0 MATERIALS.

2.1 General. Use LED Variable Message Signs Class I, II, or III, as appropriate, from the Department's List of Approved Materials.

Unclassified signs may be submitted for approval by the Engineer. The Engineer may require a daytime and nighttime demonstration. The Engineer will make a final decision within 30 days after all required information is received.

2.2 Sign and Controls. All signs must:

- 1) Provide 3-line messages with each line being 8 characters long and at least 18 inches tall. Each character comprises 35 pixels.
- 2) Provide at least 40 preprogrammed messages available for use at any time. Provide for quick and easy change of the displayed message; editing of the message; and additions of new messages.
- 3) Provide a controller consisting of:
 - a) Keyboard or keypad.
 - b) Readout that mimics the actual sign display. (When LCD or LCD type readout is used, include backlighting and heating or otherwise arrange for viewing in cold temperatures.)
 - c) Non-volatile memory or suitable memory with battery backup for storing pre-programmed messages.
 - d) Logic circuitry to control the sequence of messages and flash rate.
- 4) Provide a serial interface that is capable of supporting complete remote control ability through land line and cellular telephone operation. Include communication software capable of immediately updating the message, providing complete sign status, and allowing message library queries and updates.
- 5) Allow a single person easily to raise the sign to a satisfactory height above the pavement during use, and lower the sign during travel.
- 6) Be Highway Orange on all exterior surfaces of the trailer, supports, and controller cabinet.
- 7) Provide operation in ambient temperatures from -30 to + 120 degrees Fahrenheit during snow, rain and other inclement weather.
- 8) Provide the driver board as part of a module. All modules are interchangeable, and have plug and socket arrangements for disconnection and reconnection. Printed circuit boards associated with driver boards have a conformable coating to protect against moisture.
- 9) Provide a sign case sealed against rain, snow, dust, insects, etc. The lens is UV stabilized clear plastic (polycarbonate, acrylic, or other approved material) angled to prevent glare.
- 10) Provide a flat black UV protected coating on the sign hardware, character PCB, and appropriate lens areas.
- 11) Provide a photocell control to provide automatic dimming.

- 12) Allow an on-off flashing sequence at an adjustable rate.
- 13) Provide a sight to aim the message.
- 14) Provide a LED display color of approximately 590 nm amber.
- 15) Provide a controller that is password protected.
- 16) Provide a security device that prevents unauthorized individuals from accessing the controller.
- 17) Provide the following 3-line messages preprogrammed and available for use when the sign unit begins operation:

/KEEP/RIGHT/=>=>=>/	/MIN/SPEED/**MPH/
/KEEP/LEFT/<<<</	/ICY/BRIDGE/AHEAD/ /ONE
/LOOSE/GRAVEL/AHEAD/	LANE/BRIDGE/AHEAD/
/RD WORK/NEXT/**MILES/	/ROUGH/ROAD/AHEAD/
/TWO WAY/TRAFFIC/AHEAD/	/MERGING/TRAFFIC/AHEAD/
/PAINT/CREW/AHEAD/	/NEXT/***/MILES/
/REDUCE/SPEED/**MPH/	/HEAVY/TRAFFIC/AHEAD/
/BRIDGE/WORK/***0 FT/	/SPEED/LIMIT/**MPH/
/MAX/SPEED/**MPH/	/BUMP/AHEAD/
/SURVEY/PARTY/AHEAD/	/TWO/WAY/TRAFFIC/

*Insert numerals as directed by the Engineer.
Add other messages during the project when required by the Engineer.

2.3 Power.

- 1) Design solar panels to yield 10 percent or greater additional charge than sign consumption. Provide direct wiring for operation of the sign or arrow board from an external power source to provide energy backup for 21 days without sunlight and an on-board system charger with the ability to recharge completely discharged batteries in 24 hours.

3.0 CONSTRUCTION. Furnish and operate the variable message signs as designated on the plans or by the Engineer. Ensure the bottom of the message panel is a minimum of 7 feet above the roadway in urban areas and 5 feet above in rural areas when operating. Use Class I, II, or III signs on roads with a speed limit less than 55 mph. Use Class I or II signs on roads with speed limits 55 mph or greater.

Maintain the sign in proper working order, including repair of any damage done by others, until completion of the project. When the sign becomes inoperative, immediately repair or replace the sign. Repetitive problems with the same unit will be cause for rejection and replacement.

Use only project related messages and messages directed by the Engineer, unnecessary messages lessen the impact of the sign. Ensure the message is displayed in either one or 2 phases with each phase having no more than 3 lines of text. When no message is needed, but it is necessary to know if the sign is operable, flash only a pixel.

When the sign is not needed, move it outside the clear zone or where the Engineer directs. Variable Message Signs are the property of the Contractor and shall be removed from the project when no longer needed. The Department will not assume ownership of these signs.

4.0 MEASUREMENT. The final quantity of Variable Message Sign will be

11

the actual number of individual signs acceptably furnished and operated during the project. The Department will not measure signs replaced due to damage or rejection.

5.0 PAYMENT. The Department will pay for the Variable Message Signs at the unit price each. The Department will not pay for signs replaced due to damage or rejection. Payment is full compensation for furnishing all materials, labor, equipment, and service necessary to, operate, move, repair, and maintain or replace the variable message signs. The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
02671	Portable Changeable Message Sign	Each

Effective June 15, 2012

SPECIAL NOTE FOR ROCK BLASTING

This Special Note will apply when indicated on the plans or in the proposal. Section references herein are to the Department's Standard Specifications for Road and Bridge Construction, current edition.

1.0 DESCRIPTION. This work consists of fracturing rock and constructing stable final rock cut faces using presplit blasting and production blasting techniques.

2.0 MATERIALS. Deliver, store, and use explosives according to the manufacturer's recommendations and applicable laws. Do not use explosives outside their recommended use date. Verify date of manufacture and provide copies of the technical data sheets (TDS) and material safety data sheets (MSDS) to the Engineer. Explosives and initiating devices include, but are not necessarily limited to, dynamite and other high explosives, slurries, water gels, emulsions, blasting agents, initiating explosives, detonators, blasting caps, and detonating cord.

3.0 CONSTRUCTION. Furnish copies or other proof of all-applicable permits and licenses. Comply with Federal, State, and local regulations on the purchase, transportation, storage, and use of explosive material. Regulations include but are not limited to the following:

- 1) KRS 351.310 through 351.9901.
- 2) 805 KAR 4:005 through 4:165
- 3) Applicable rules and regulations issued by the Office of Mine Safety and Licensing.
- 4) Safety and health. OSHA, 29 CFR Part 1926, Subpart U.
- 5) Storage, security, and accountability. Bureau of Alcohol, Tobacco, and Firearms (BATF), 27 CFR Part 181.
- 6) Shipment. DOT, 49 CFR Parts 171-179, 390-397.

3.1 Blaster-in-Charge. Designate in writing a blaster-in-charge and any proposed alternates for the position. Submit documentation showing the blaster-in-charge, and alternates, have a valid Kentucky blaster's license. Ensure the blaster-in-charge or approved alternate is present at all times during blasting operations.

3.2 Blasting Plans. Blasting plans and reports are for quality control and record keeping purposes. Blasting reports are to be signed by the blaster-in-charge or the alternate blaster-in-charge. The general review and acceptance of blasting plans does not relieve the Contractor of the responsibility whatsoever for conformance to regulations or for obtaining the required results. All blasting plans shall be submitted to the Engineer. The Engineer will be responsible for submitting the plan to the Central Office Division of Construction and the Division of Mine Reclamation and Enforcement, Explosives and Blasting Branch at the following address: 2 Hudson Hollow, Frankfort, Kentucky, 40601.

A) General Blasting Plan. Submit a general blasting plan for acceptance at least 15 working days before drilling operations begin. Include, as a minimum, the following safety and procedural details:

- 1) Working procedures and safety precautions for storing, transporting, handling, detonating explosives. Include direction on pre and post blast audible procedures, methods of addressing misfires, and methods of addressing inclement weather, including lightning.
- 2) Proposed product selection for both dry and wet holes. Furnish Manufacturer's TDS and MSDS for all explosives, primers, initiators, and other blasting devices.
- 3) Proposed initiation and delay methods.
- 4) Proposed format for providing all the required information for the site specific blasting shot reports.

B) Preblast Meeting. Prior to drilling operations, conduct a preblast meeting to discuss safety and traffic control issues and any site specific conditions that will need to be addressed. Ensure, at a minimum, that the Engineer or lead inspector, Superintendent, blaster-in-charge, and all personnel involved in the blasting operation are present. Site specific conditions include blast techniques; communication procedures; contingency plans and equipment for dealing with errant blast material. The conditions of the General Blasting plan will be discussed at this meeting. Record all revisions and additions made to the blasting plan and obtain written concurrence by the blaster-in-charge. Provide a copy of the signed blast plan to the Engineer along with the sign in sheet from the preblast meeting.

3.3 Preblast Condition Survey and Vibration Monitoring and Control. Before blasting, arrange for a preblast condition survey of nearby buildings, structures, or utilities, within 500 feet of the blast or that could be at risk from blasting damage. Provide the Engineer a listing of all properties surveyed and any owners denying entry or failing to respond. Notify the Engineer and occupants of buildings at risk at least 24 hours before blasting.

Limit ground vibrations and airblast to levels that will not exceed limits of 805 KAR 4:005 through 4:165. More restrictive levels may be specified in the Contract.

Size all blast designs based on vibration, distance to nearest building or utility, blast site geometry, atmospheric conditions and other factors. Ground vibrations are to be controlled according to the blasting standards and scaled distance formulas in 805 KAR 4:020 or by the use of seismographs as allowed in 805 KAR 4:030. The Department will require seismographs at the nearest allowable location to the protected site when blasting occurs within 500 feet of buildings, structures, or utilities.

3.4 Blasting. Drill and blast at the designated slope lines according to the blasting plan. Perform presplitting to obtain smooth faces in the rock and shale formations. Perform the presplitting before blasting and excavating the interior portion of the specified cross section at any location. The Department may allow blasting for fall benches and haul roads prior to presplitting when blasting is a sufficient distance from the final slope and results are satisfactory to the Engineer. Use the types of explosives and blasting accessories necessary to obtain the required results.

Free blast holes of obstructions for their entire depth. Place charges without caving the blast hole walls. Stem the upper portion of all blast holes with dry sand or other granular material passing the 3/8-inch sieve. Dry drill cuttings are acceptable for stemming when blasts are more than 800 feet from the nearest dwelling.

11D

Stop traffic during blasting operations when blasting near any road and ensure traffic does not pass through the Danger Zone. The blaster-in-charge will define the Danger Zone prior to each blast. Ensure traffic is stopped outside the Danger Zone, and in no case within 800 feet of the blast location.

Following a blast, stop work in the entire blast area, and check for misfires before allowing worker to return to excavate the rock.

Remove or stabilize all cut face rock that is loose, hanging, or potentially dangerous. Leave minor irregularities or surface variations in place if they do not create a hazard. Drill the next lift only after the cleanup work and stabilization work is complete.

When blasting operations cause fracturing of the final rock face, repair or stabilize it in an approved manner at no cost to the Department.

Halt blasting operations in areas where any of the following occur:

- 1) Slopes are unstable;
- 2) Slopes exceed tolerances or overhangs are created;
- 3) Backslope damage occurs;
- 4) Safety of the public is jeopardized;
- 5) Property or natural features are endangered;
- 6) Fly rock is generated; or
- 7) Excessive ground or airblast vibrations occur in an area where damage to buildings, structures, or utilities is possible.
- 8) The Engineer determines that materials have become unsuitable for blasting

Blasting operations may continue at a reasonable distance from the problem area or in areas where the problems do not exist. Make the necessary modifications to the blasting operations and perform a test blast to demonstrate resolution of the problem.

A) Drill Logs. Maintain a layout drawing designating hole numbers with corresponding drill logs and provide a copy of this information to the blaster prior to loading the hole. Ensure the individual hole logs completed by the driller(s) show their name; date drilled; total depth drilled; and depths and descriptions of significant conditions encountered during drilling that may affect loading such as water, voids, changes in rock type.

B) Presplitting. Conduct presplitting operations in conformance with Subsection 204.03.04 of the Standard Specifications for Road and Bridge Construction.

3.5 Shot Report. Maintain all shot reports on site for review by the Department. Within one day after a blast, complete a shot report according to the record keeping requirements of 805 KAR 4:050. Include all results from airblast and seismograph monitoring.

3.6 Unacceptable Blasting. When unacceptable blasting occurs, the Department will halt all blasting operations. Blasting will not resume until the Department completes its investigation and all concerns are addressed. A blast is unacceptable when it results in fragmentation beyond the final rock face, fly rock, excessive vibration or airblast, overbreak, damage to the final rock face or overhang. Assume the cost for all resulting damages to private and public property and hold the Department harmless.

11D

When an errant blast or fly rock causes damage to or blocks a road or conveyance adjacent to the roadway, remove all debris from the roadway as quickly as practicable and perform any necessary repairs. Additionally, when specified in the Contract, the Department will apply a penalty.

Report all blasting accidents to the Division of Mine Reclamation and Enforcement, Explosives and Blasting Branch at 502-564-2340.

4.0 MEASUREMENT AND PAYMENT. The Department will not measure this work for payment and will consider all items contained in this note to be incidental to either Roadway Excavation or Embankment-in-Place, as applicable. However, if the Engineer directs in writing slope changes, then the Department will pay for the second presplitting operation as Extra Work.

The Department will measure for payment material lying outside the typical section due to seams, broken formations, or earth pockets, including any earth overburden removed with this material, only when the work is performed under authorized adjustments.

The Department will not measure for payment any extra material excavated because of the drill holes being offset outside the designated slope lines.

The Department will not measure for payment any material necessary to be removed due to the inefficient or faulty blasting practices.

June 15, 2012

11E

**SPECIAL NOTE FOR BORING AND JACKING STEEL PIPE
 WITHOUT CARRIER PIPE**

This Special Note will apply where indicated on the plans or in the proposal. Section references herein are to the Department’s Standard Specifications for Road and Bridge Construction, current edition.

1.0 DESCRIPTION. Bore and jack steel pipe. Use this note when no carrier pipe will be encased.

2.0 MATERIALS.

2.1 Pipe. Provide plain end steel pipe with a specific minimum yield strength, SMYS, of at least 35,000 psi and tensile strength of 60,000 psi per API-5L grade B material. The steel pipe supplied shall be manufactured by the seamless, electric-weld, submerged-arc weld or gas metal-arc well process as specified in API –5L. Certification of 35,000 psi SMYS shall be furnished by the supplier through the Contractor to the Engineer to retain 3 copies.

MINIMUM WALL THICKNESS FOR STEEL PIPE	
Nominal Diameter (Inches)	Wall Thickness (Inches)
18 or less	0.375
24	0.500
30	0.500
36	0.532
42	0.625

2.2 Grout. Conform to Subsection 601.03.03.

2.3 High Grade Bentonite. Conform to the following:

API 13A Section 4		
Requirement	Specification	Result
Viscometer Dial Reading at 600 rpm	30, minimum	40
Yield Point/Plastic Viscosity Ratio	3, maximum	3.00 maximum
Filtrate Volume	15 cm ³ , maximum	14.50 maximum
Residue greater than 75 micrometers	4.0 wt percent maximum	1.0-1.5 %
Moisture	10.0 wt percent maximum	9.0-9.5%

3.0 CONSTRUCTION. Perform the following:

1. Locate a suitable pit and obtain the Engineer’s approval.
2. Excavate the pit or trenches for the BORE AND JACK operation and for placing the end joints of pipe, when required. Securely sheet and brace the pits or trenches to prevent caving, where necessary.

11E

3. When installing pipe under railroads, highways, streets, or other facilities by Bore and Jack, perform construction without interfering with the facility operation or weakening the roadbed or structure.
4. Place excavated material near the top of the working pit and dispose of it as required. Use water or other fluids with the boring operation to lubricate the cuttings. Do not perform jetting.
5. In unconsolidated soil formations, use a gel-forming colloidal drilling fluid with at least 10 percent of high grade bentonite to consolidate excavated material, seal the walls of the hole, and lubricate subsequent removal of material and immediate pipe installation.
6. Ensure that the diameter of the excavation conforms to the outside diameter of the pipe as closely as possible.
7. Pressure grout voids that develop during the installation operation and that the Engineer determines are detrimental to the Work.
8. To force the pipe through the roadbed into the bored space, use a jack with a head constructed to apply uniform pressure around the ring of the pipe, which shall be square cut.
9. Set the pipe to be jacked on guides, braced together to properly support the pipe section and to direct it to the proper line and grade.
10. When the installation is made by concurrent boring and jacking, solidly weld all joints. Ensure the weld is strong enough to withstand the forces exerted from the boring and jacking operations as well as the vertical loading imposed on the pipe after installation and that it provides a smooth, non-obstructing joint in the interior of the pipe.
11. When the pipe is installed in open trench, bed and backfill according to Section 701.
12. The line and grade from the pipe's final position, as shown on plans, may vary no more than 2 percent in lateral alignment and one percent in vertical grade. Ensure that the final grade of the flow line is in the direction indicated on the Plans.
13. Use a cutting edge around the head end. Extend it a short distance beyond the pipe end with inside angles or lugs to keep the cutting edge from slipping back into the pipe.
14. Once the pipe installation begins, proceed with the operation without interruption to prevent the pipe from becoming firmly set in the embankment.
15. Remove and replace pipe damaged in jacking operations.
16. After completing the installation, backfill the excavated pits and trenches with flowable fill according to Section 601.03.03 B) 5 a) if the pit is in median area where it will have pavement over it.

4.0 MEASUREMENT. The Department will measure the completed length of Bore and Jacked pipe through the flowline from end to end in linear feet. The Department will not measure pressure grouting voids or removal and replacement of pipe damaged in jacking operations for payment and will consider it incidental to Bore and Jack. When abandoning a bore hole due to mechanical malfunction, improper alignment, or other problems due to construction operations, the Department will not measure the backfill and relocation for payment and will consider it incidental to this item of work. When abandoning a bore hole due to an unforeseen physical obstruction or situation, the Department will measure the work according to a negotiated supplemental agreement.

5.0 PAYMENT. The Department will make payment for the completed and accepted quantities under the following:

11E

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
----	Bore and Jack, Size Pipe	Linear Foot

The Department will consider payment as full compensation for all materials, earthwork, shoring, pipe and work required under this section.

June 15, 2012

SPECIAL NOTE FOR BARCODE LABEL ON PERMANENT SIGNS

1.0 DESCRIPTION. Install barcode label on sheeting signs. Section references herein are to the Department’s Standard Specifications for Road and Bridge Construction, current edition.

2.0 MATERIALS. The Department will provide the Contractor with a 2 inch x 1 inch foil barcode label for each permanent sheeting sign. A unique number will be assigned to each barcode label.

The Contractor shall contact the Operations and Pavement Management Branch in the Division of Maintenance at (502) 564-4556 to obtain the barcode labels.

3.0 CONSTRUCTION. Apply foil barcode label in the lower right quadrant of the sign back. Signs where the bottom edge is not parallel to the ground, the lowest corner of the sign shall serve as the location to place the barcode label. The barcode label shall be placed no less than one-inch and no more than three inches from any edge of the sign. The barcode must be placed so that the sign post does not cover the barcode label.

Barcodes shall be applied in an indoor setting with a minimum air temperature of 50°F or higher. Prior to application of the barcode label, the back of the sign must be clean and free of dust, oil, etc. If the sign is not clean, an alcohol swab shall be used to clean the area. The area must be allowed to dry prior to placement of the barcode label.

Data for each sign shall include the barcode number, MUTCD reference number, sheeting manufacturer, sheeting type, manufacture date, color of primary reflective surface, installation date, latitude and longitude using the North American Datum of 1983 (NAD83) or the State Plane Coordinates using an x and y ordinate of the installed location.

Data should be provided electronically on the TC 71-229 Sign Details Information and TC 71-230 Sign Assembly Information forms. The Contractor may choose to present the data in a different format provided that the information submitted to the Department is equivalent to the information required on the Department TC forms. The forms must be submitted in electronic format regardless of which type of form is used. The Department will not accept PDF or handwritten forms. These completed forms must be submitted to the Department prior to final inspection of the signs. The Department will not issue formal acceptance for the project until the TC 71-229 and TC-230 electronic forms are completed for all signs and sign assemblies on the project.

4.0 MEASUREMENT. The Department will measure all work required for the installation of the barcode label and all work associated with completion and submission of the sign inventory data (TC 71-229 and TC 71-230).

The installation of the permanent sign will be measured in accordance to Section 715.

5.0 PAYMENT. The Department will make payment for the completed and accepted quantities under the following:



<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
24631EC	Barcode Sign Inventory	Each

The Department will not make payment for this item until all barcodes are installed and sign inventory is complete on every permanent sign installed on the project. The Department will make payment for installation of the permanent sign in accordance to Section 715. The Department will consider payment as full compensation for all work required under this special note.





One Sign Post





↑
2" Wide Post

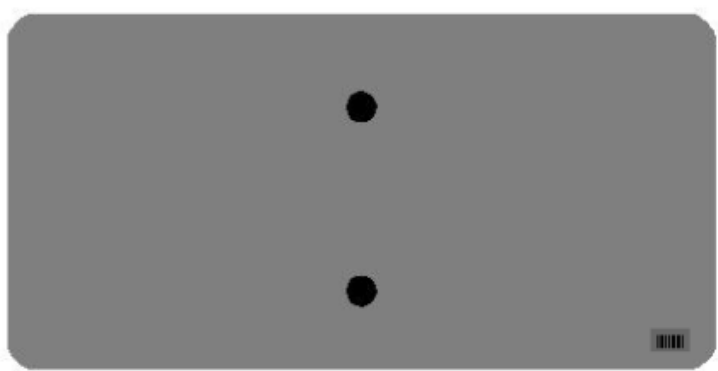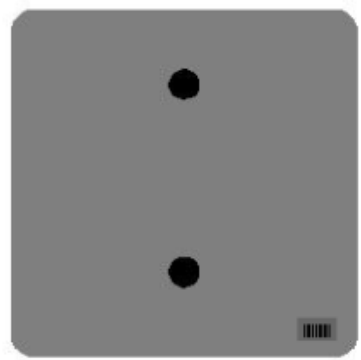


One Sign Post

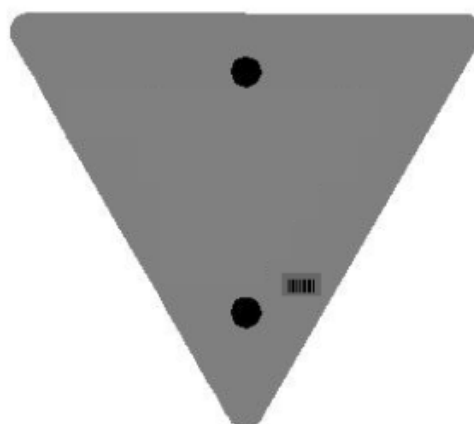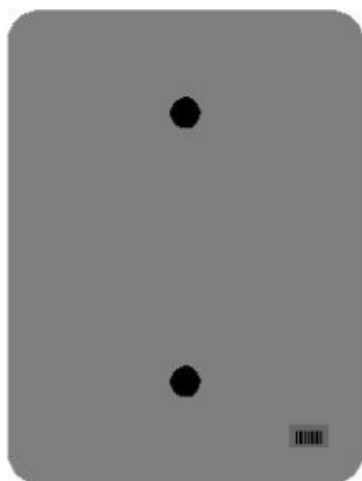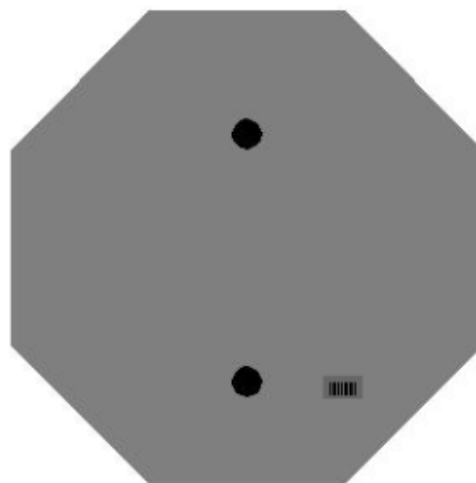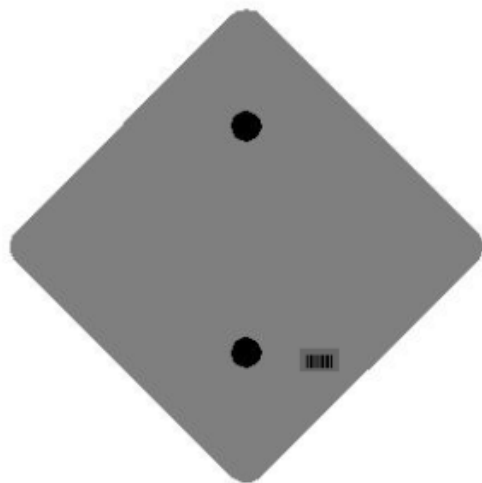


One Sign Post

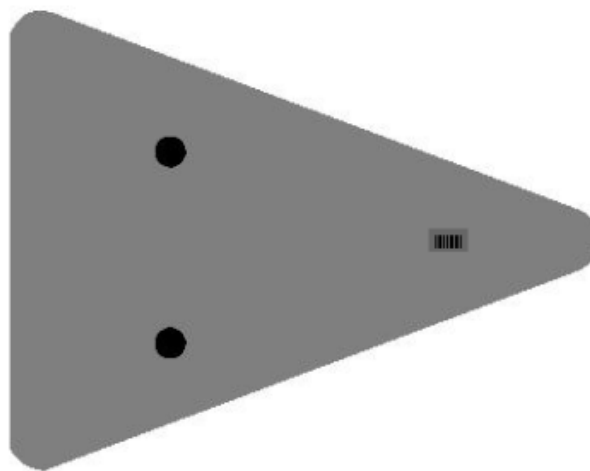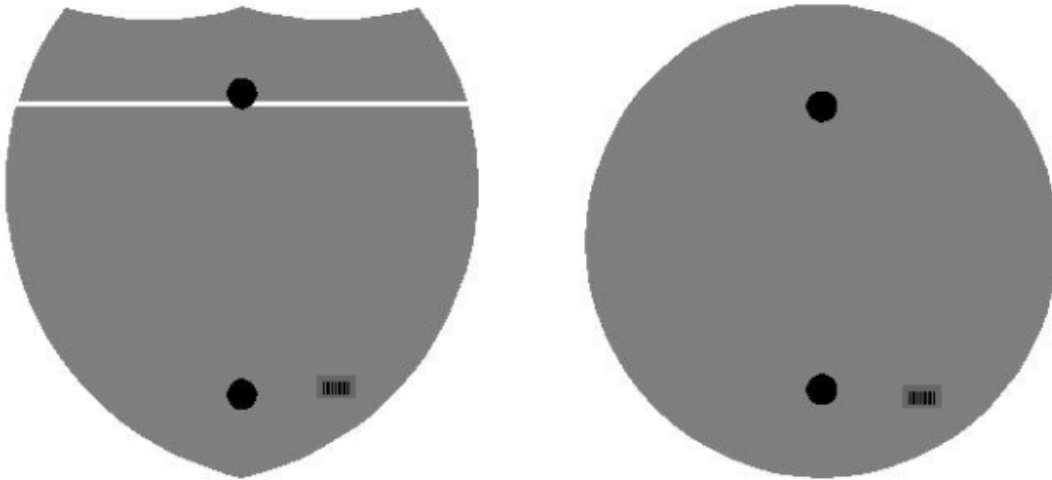

Double Sign Post

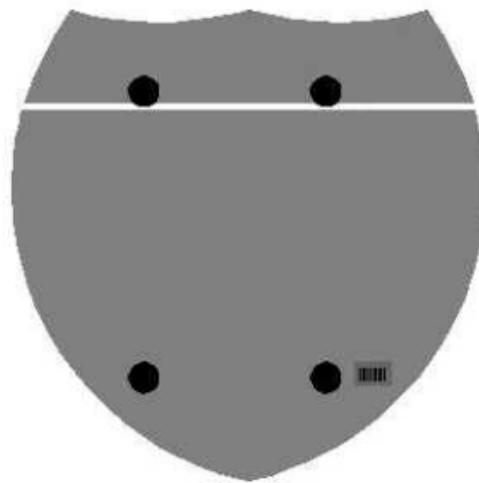

Interstate
Shield

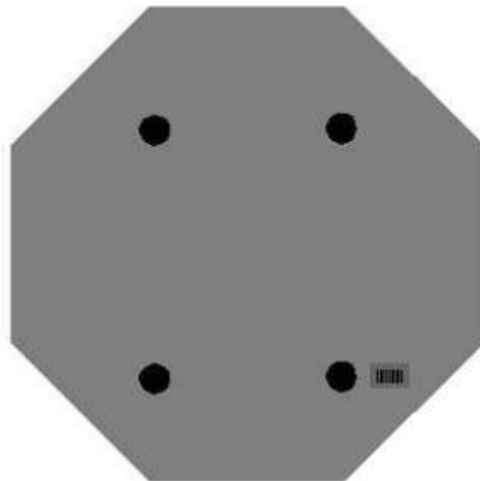


48" Stop

2 Post Signs



↑
2" Wide Post

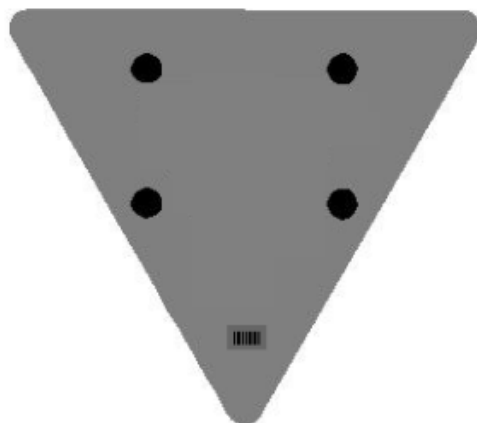

SPECIAL NOTE FOR LONGITUDINAL PAVEMENT JOINT ADHESIVE

1. DESCRIPTION. This specification covers the requirements and practices for applying an asphalt adhesive material to the longitudinal joint of the surface course of an asphalt pavement. Apply the adhesive to the face of longitudinal joint between driving lanes for the first lane paved. Then, place and compact the adjacent lane against the treated face to produce a strong, durable, waterproof longitudinal joint.
2. MATERIALS, EQUIPMENT, AND PERSONNEL.

2.1 Joint Adhesive. Provide material conforming to Subsection 2.1.1.

2.1.1 Provide an adhesive conforming to the following requirements:

Property	Specification	Test Procedure
Viscosity, 400 ° F (Pa·s)	4.0 – 10.0	ASTM D 4402
Cone Penetration, 77 ° F	60 – 100	ASTM D 5329
Flow, 140 ° F (mm)	5.0 max.	ASTM D 5329
Resilience, 77 ° F (%)	30 min.	ASTM D 5329
Ductility, 77 ° F (cm)	30.0 min.	ASTM D 113
Ductility, 39 ° F (cm)	30.0 min.	ASTM D 113
Tensile Adhesion, 77 ° F (%)	500 min.	ASTM D 5329, Type II
Softening Point, ° F	171 min.	AASHTO T 53
Asphalt Compatibility	Pass	ASTM D 5329

Ensure the temperature of the pavement joint adhesive is between 380 and 410 °F when the material is extruded in a 0.125-inch-thick band over the entire face of the longitudinal joint.

2.2. Equipment.

2.2.1 Melter Kettle. Provide an oil-jacketed, double-boiler, melter kettle equipped with any needed agitation and recirculating systems.

2.2.2 Applicator System. Provide a pressure-feed-wand applicator system with an applicator shoe attached.

2.3 Personnel. Ensure a technical representative from the manufacturer of the pavement joint adhesive is present during the initial construction activities and available upon the request of the Engineer.

3. CONSTRUCTION.

3.1 Surface Preparation. Prior to the application of the pavement joint adhesive, ensure the face of the longitudinal joint is thoroughly dry and free from dust or any other debris that would inhibit adhesion. Clean the joint face by the use of compressed air.

Ensure this preparation process occurs shortly before application to prevent the return of debris on the joint face.

3.2 Pavement Joint Adhesive Application. Ensure the ambient temperature is a minimum of 40 ° F during the application of the pavement joint adhesive. Prior to applying the adhesive, demonstrate competence in applying the adhesive according to this note to the satisfaction of the Engineer. Heat the adhesive in the melter kettle to the specified temperature range. Pump the adhesive from the melter kettle through the wand onto the vertical face of the cold joint. Apply the adhesive in a continuous band over the entire face of the longitudinal joint. Do not use excessive material in either thickness or location. Ensure the edge of the extruded adhesive material is flush with the surface of the pavement. Then, place and compact the adjacent lane against the joint face. Remove any excessive material extruded from the joint after compaction (a small line of material may remain).

3.3 Pavement Joint Adhesive Certification. Furnish the joint adhesive's certification to the Engineer stating the material conforms to all requirements herein prior to use.

3.4 Sampling and Testing. The Department will require a random sample of pavement joint adhesive from each manufacturer's lot of material. Extrude two 5 lb. samples of the heated material and forward the sample to the Division of Materials for testing. Reynolds oven bags, turkey size, placed inside small cardboard boxes or cement cylinder molds have been found suitable. Ensure the product temperature is 400°F or below at the time of sampling.

4. MEASUREMENT. The Department will measure the quantity of Pavement Joint Adhesive in linear feet. The Department will not measure for payment any extra materials, labor, methods, equipment, or construction techniques used to satisfy the requirements of this note. The Department will not measure for payment any trial applications of Pavement Joint Adhesive, the cleaning of the joint face, or furnishing and placing the adhesive. The Department will consider all such items incidental to the Pavement Joint Adhesive.
5. PAYMENT. The Department will pay for the Pavement Joint Adhesive at the Contract unit bid price and apply an adjustment for each manufacturer's lot of material based on the degree of compliance as defined in the following schedule. When a sample fails on two or more tests, the Department may add the deductions, but the total deduction will not exceed 100 percent.

11N

Pavement Joint Adhesive Price Adjustment Schedule						
Test	Specification	100% Pay	90% Pay	80% Pay	50% Pay	0% Pay
Joint Adhesive Referenced in Subsection 2.1.1						
Viscosity, 400 ° F (Pa•s) ASTM D 3236	4.0-10.0	3.5-10.5	3.0-3.4 10.6-11.0	2.5-2.9 11.1-11.5	2.0-2.4 11.6-12.0	≤1.9 ≥ 12.1
Cone Penetration, 77 ° F ASTM D 5329	60-100	57-103	54-56 104-106	51-53 107-109	48-50 110-112	≤ 47 ≥ 113
Flow, 140 ° F (mm) ASTM D 5329	≤ 5.0	≤ 5.5	5.6-6.0	6.1-6.5	6.6-7.0	≥ 7.1
Resilience, 77 ° F (%) ASTM D 5329	≥ 30	≥ 28	26-27	24-25	22-23	≤ 21
Tensile Adhesion, 77 ° F (%) ASTM D 5329	≥ 500	≥ 490	480-489	470-479	460-469	≤ 459
Softening Point, ° F AASHTO T 53	≥ 171	≥ 169	166-168	163-165	160-162	≤ 159
Ductility, 77 ° F (cm) ASTM D 113	≥ 30.0	≥ 29.0	28.0-28.9	27.0-27.9	26.0-26.9	≤ 25.9
Ductility, 39 ° F (cm) ASTM D 113	≥ 30.0	≥ 29.0	28.0-28.9	27.0-27.9	26.0-26.9	≤ 25.9

Code
20071EC

Pay Item
Joint Adhesive

Pay Unit
Linear Foot

May 7, 2014

PART III

EMPLOYMENT, WAGE AND RECORD REQUIREMENTS

FHWA-1273 -- Revised May 1, 2012

**REQUIRED CONTRACT PROVISIONS
FEDERAL-AID CONSTRUCTION CONTRACTS**

- I. General
- II. Nondiscrimination
- III. Nonsegregated Facilities
- IV. Davis-Bacon and Related Act Provisions
- V. Contract Work Hours and Safety Standards Act Provisions
- VI. Subletting or Assigning the Contract
- VII. Safety: Accident Prevention
- VIII. False Statements Concerning Highway Projects
- IX. Implementation of Clean Air Act and Federal Water Pollution Control Act
- X. Compliance with Governmentwide Suspension and Debarment Requirements
- XI. Certification Regarding Use of Contract Funds for Lobbying

ATTACHMENTS

A. Employment and Materials Preference for Appalachian Development Highway System or Appalachian Local Access Road Contracts (included in Appalachian contracts only)

I. GENERAL

1. Form FHWA-1273 must be physically incorporated in each construction contract funded under Title 23 (excluding emergency contracts solely intended for debris removal). The contractor (or subcontractor) must insert this form in each subcontract and further require its inclusion in all lower tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services).

The applicable requirements of Form FHWA-1273 are incorporated by reference for work done under any purchase order, rental agreement or agreement for other services. The prime contractor shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Form FHWA-1273 must be included in all Federal-aid design-build contracts, in all subcontracts and in lower tier subcontracts (excluding subcontracts for design services, purchase orders, rental agreements and other agreements for supplies or services). The design-builder shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Contracting agencies may reference Form FHWA-1273 in bid proposal or request for proposal documents, however, the Form FHWA-1273 must be physically incorporated (not referenced) in all contracts, subcontracts and lower-tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services related to a construction contract).

2. Subject to the applicability criteria noted in the following sections, these contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.

3. A breach of any of the stipulations contained in these Required Contract Provisions may be sufficient grounds for withholding of progress payments, withholding of final payment, termination of the contract, suspension / debarment or any other action determined to be appropriate by the contracting agency and FHWA.

4. Selection of Labor: During the performance of this contract, the contractor shall not use convict labor for any purpose within the limits of a construction project on a Federal-aid highway unless it is labor performed by convicts who are on parole, supervised release, or probation. The term Federal-aid highway does not include roadways functionally classified as local roads or rural minor collectors.

II. NONDISCRIMINATION

The provisions of this section related to 23 CFR Part 230 are applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more. The provisions of 23 CFR Part 230 are not applicable to material supply, engineering, or architectural service contracts.

In addition, the contractor and all subcontractors must comply with the following policies: Executive Order 11246, 41 CFR 60, 29 CFR 1625-1627, Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The contractor and all subcontractors must comply with: the requirements of the Equal Opportunity Clause in 41 CFR 60-1.4(b) and, for all construction contracts exceeding \$10,000, the Standard Federal Equal Employment Opportunity Construction Contract Specifications in 41 CFR 60-4.3.

Note: The U.S. Department of Labor has exclusive authority to determine compliance with Executive Order 11246 and the policies of the Secretary of Labor including 41 CFR 60, and 29 CFR 1625-1627. The contracting agency and the FHWA have the authority and the responsibility to ensure compliance with Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), and Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The following provision is adopted from 23 CFR 230, Appendix A, with appropriate revisions to conform to the U.S. Department of Labor (US DOL) and FHWA requirements.

1. Equal Employment Opportunity: Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, 29 CFR 1625-1627, 41 CFR 60 and 49 CFR 27) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under

this contract. The provisions of the Americans with Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:

a. The contractor will work with the contracting agency and the Federal Government to ensure that it has made every good faith effort to provide equal opportunity with respect to all of its terms and conditions of employment and in their review of activities under the contract.

b. The contractor will accept as its operating policy the following statement:

"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, pre-apprenticeship, and/or on-the-job training."

2. EEO Officer: The contractor will designate and make known to the contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active EEO program and who must be assigned adequate authority and responsibility to do so.

3. Dissemination of Policy: All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:

a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.

b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.

c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minorities and women.

d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.

e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.

4. Recruitment: When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minorities and women in the area from which the project work force would normally be derived.

a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minorities and women. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority and women applicants may be referred to the contractor for employment consideration.

b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, the contractor is expected to observe the provisions of that agreement to the extent that the system meets the contractor's compliance with EEO contract provisions. Where implementation of such an agreement has the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Federal nondiscrimination provisions.

c. The contractor will encourage its present employees to refer minorities and women as applicants for employment. Information and procedures with regard to referring such applicants will be discussed with employees.

5. Personnel Actions: Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:

a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.

b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.

c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.

d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with its obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of their avenues of appeal.

6. Training and Promotion:

a. The contractor will assist in locating, qualifying, and increasing the skills of minorities and women who are

applicants for employment or current employees. Such efforts should be aimed at developing full journey level status employees in the type of trade or job classification involved.

b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision. The contracting agency may reserve training positions for persons who receive welfare assistance in accordance with 23 U.S.C. 140(a).

c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.

d. The contractor will periodically review the training and promotion potential of employees who are minorities and women and will encourage eligible employees to apply for such training and promotion.

7. Unions: If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use good faith efforts to obtain the cooperation of such unions to increase opportunities for minorities and women. Actions by the contractor, either directly or through a contractor's association acting as agent, will include the procedures set forth below:

a. The contractor will use good faith efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minorities and women for membership in the unions and increasing the skills of minorities and women so that they may qualify for higher paying employment.

b. The contractor will use good faith efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.

c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the contracting agency and shall set forth what efforts have been made to obtain such information.

d. In the event the union is unable to provide the contractor with a reasonable flow of referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minorities and women. The failure of a union to provide sufficient referrals (even though it is obligated to provide exclusive referrals under the terms of a collective bargaining agreement) does not relieve the contractor from the requirements of this paragraph. In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the contracting agency.

8. Reasonable Accommodation for Applicants / Employees with Disabilities: The contractor must be familiar

with the requirements for and comply with the Americans with Disabilities Act and all rules and regulations established there under. Employers must provide reasonable accommodation in all employment activities unless to do so would cause an undue hardship.

9. Selection of Subcontractors, Procurement of Materials and Leasing of Equipment: The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment. The contractor shall take all necessary and reasonable steps to ensure nondiscrimination in the administration of this contract.

a. The contractor shall notify all potential subcontractors and suppliers and lessors of their EEO obligations under this contract.

b. The contractor will use good faith efforts to ensure subcontractor compliance with their EEO obligations.

10. Assurance Required by 49 CFR 26.13(b):

a. The requirements of 49 CFR Part 26 and the State DOT's U.S. DOT-approved DBE program are incorporated by reference.

b. The contractor or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the contracting agency deems appropriate.

11. Records and Reports: The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following the date of the final payment to the contractor for all contract work and shall be available at reasonable times and places for inspection by authorized representatives of the contracting agency and the FHWA.

a. The records kept by the contractor shall document the following:

(1) The number and work hours of minority and non-minority group members and women employed in each work classification on the project;

(2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women; and

(3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minorities and women;

b. The contractors and subcontractors will submit an annual report to the contracting agency each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on [Form FHWA-1391](#). The staffing data should represent the project work force on board in all or any part of the last payroll period preceding the end of July. If on-the-job training is being required by special provision, the contractor

will be required to collect and report training data. The employment data should reflect the work force on board during all or any part of the last payroll period preceding the end of July.

III. NONSEGREGATED FACILITIES

This provision is applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more.

The contractor must ensure that facilities provided for employees are provided in such a manner that segregation on the basis of race, color, religion, sex, or national origin cannot result. The contractor may neither require such segregated use by written or oral policies nor tolerate such use by employee custom. The contractor's obligation extends further to ensure that its employees are not assigned to perform their services at any location, under the contractor's control, where the facilities are segregated. The term "facilities" includes waiting rooms, work areas, restaurants and other eating areas, time clocks, restrooms, washrooms, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing provided for employees. The contractor shall provide separate or single-user restrooms and necessary dressing or sleeping areas to assure privacy between sexes.

IV. DAVIS-BACON AND RELATED ACT PROVISIONS

This section is applicable to all Federal-aid construction projects exceeding \$2,000 and to all related subcontracts and lower-tier subcontracts (regardless of subcontract size). The requirements apply to all projects located within the right-of-way of a roadway that is functionally classified as Federal-aid highway. This excludes roadways functionally classified as local roads or rural minor collectors, which are exempt. Contracting agencies may elect to apply these requirements to other projects.

The following provisions are from the U.S. Department of Labor regulations in 29 CFR 5.5 "Contract provisions and related matters" with minor revisions to conform to the FHWA-1273 format and FHWA program requirements.

1. Minimum wages

a. All laborers and mechanics employed or working upon the site of the work, will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the Secretary of Labor under the Copeland Act (29 CFR part 3)), the full amount of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics.

Contributions made or costs reasonably anticipated for bona fide fringe benefits under section 1(b)(2) of the Davis-Bacon Act on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions

of paragraph 1.d. of this section; also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in 29 CFR 5.5(a)(4). Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein: Provided, That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classification and wage rates conformed under paragraph 1.b. of this section) and the Davis-Bacon poster (WH-1321) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers.

b.(1) The contracting officer shall require that any class of laborers or mechanics, including helpers, which is not listed in the wage determination and which is to be employed under the contract shall be classified in conformance with the wage determination. The contracting officer shall approve an additional classification and wage rate and fringe benefits therefore only when the following criteria have been met:

- (i) The work to be performed by the classification requested is not performed by a classification in the wage determination; and
- (ii) The classification is utilized in the area by the construction industry; and
- (iii) The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.

(2) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the Administrator of the Wage and Hour Division, Employment Standards Administration, U.S. Department of Labor, Washington, DC 20210. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.

(3) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. The Wage and Hour Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or

will notify the contracting officer within the 30-day period that additional time is necessary.

(4) The wage rate (including fringe benefits where appropriate) determined pursuant to paragraphs 1.b.(2) or 1.b.(3) of this section, shall be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.

c. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly cash equivalent thereof.

d. If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program. Provided, That the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

2. Withholding

The contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor under this contract, or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to Davis-Bacon prevailing wage requirements, which is held by the same prime contractor, so much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the contracting agency may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

3. Payrolls and basic records

a. Payrolls and basic records relating thereto shall be maintained by the contractor during the course of the work and preserved for a period of three years thereafter for all laborers and mechanics working at the site of the work. Such records shall contain the name, address, and social security number of each such worker, his or her correct classification, hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in section 1(b)(2)(B) of the Davis-Bacon Act), daily and weekly number of hours worked, deductions made and actual wages paid. Whenever the Secretary of Labor has found under 29 CFR 5.5(a)(1)(iv) that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in section 1(b)(2)(B) of the Davis-

Bacon Act, the contractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits. Contractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprenticeship programs and certification of trainee programs, the registration of the apprentices and trainees, and the ratios and wage rates prescribed in the applicable programs.

b.(1) The contractor shall submit weekly for each week in which any contract work is performed a copy of all payrolls to the contracting agency. The payrolls submitted shall set out accurately and completely all of the information required to be maintained under 29 CFR 5.5(a)(3)(i), except that full social security numbers and home addresses shall not be included on weekly transmittals. Instead the payrolls shall only need to include an individually identifying number for each employee (e.g., the last four digits of the employee's social security number). The required weekly payroll information may be submitted in any form desired. Optional Form WH-347 is available for this purpose from the Wage and Hour Division Web site at <http://www.dol.gov/esa/whd/forms/wh347instr.htm> or its successor site. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors. Contractors and subcontractors shall maintain the full social security number and current address of each covered worker, and shall provide them upon request to the contracting agency for transmission to the State DOT, the FHWA or the Wage and Hour Division of the Department of Labor for purposes of an investigation or audit of compliance with prevailing wage requirements. It is not a violation of this section for a prime contractor to require a subcontractor to provide addresses and social security numbers to the prime contractor for its own records, without weekly submission to the contracting agency..

(2) Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his or her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:

(i) That the payroll for the payroll period contains the information required to be provided under §5.5 (a)(3)(ii) of Regulations, 29 CFR part 5, the appropriate information is being maintained under §5.5 (a)(3)(i) of Regulations, 29 CFR part 5, and that such information is correct and complete;

(ii) That each laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in Regulations, 29 CFR part 3;

(iii) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.

(3) The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 3.b.(2) of this section.

(4) The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under section 1001 of title 18 and section 231 of title 31 of the United States Code.

c. The contractor or subcontractor shall make the records required under paragraph 3.a. of this section available for inspection, copying, or transcription by authorized representatives of the contracting agency, the State DOT, the FHWA, or the Department of Labor, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the FHWA may, after written notice to the contractor, the contracting agency or the State DOT, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

4. Apprentices and trainees

a. Apprentices (programs of the USDOL).

Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship Training, Employer and Labor Services, or with a State Apprenticeship Agency recognized by the Office, or if a person is employed in his or her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Office of Apprenticeship Training, Employer and Labor Services or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice.

The allowable ratio of apprentices to journeymen on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman's hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.

Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeymen hourly

rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination.

In the event the Office of Apprenticeship Training, Employer and Labor Services, or a State Apprenticeship Agency recognized by the Office, withdraws approval of an apprenticeship program, the contractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

b. Trainees (programs of the USDOL).

Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the U.S. Department of Labor, Employment and Training Administration.

The ratio of trainees to journeymen on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration.

Every trainee must be paid at not less than the rate specified in the approved program for the trainee's level of progress, expressed as a percentage of the journeyman hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman wage rate on the wage determination which provides for less than full fringe benefits for apprentices. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.

In the event the Employment and Training Administration withdraws approval of a training program, the contractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

c. Equal employment opportunity. The utilization of apprentices, trainees and journeymen under this part shall be in conformity with the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR part 30.

d. Apprentices and Trainees (programs of the U.S. DOT).

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.

5. Compliance with Copeland Act requirements. The contractor shall comply with the requirements of 29 CFR part 3, which are incorporated by reference in this contract.

6. Subcontracts. The contractor or subcontractor shall insert Form FHWA-1273 in any subcontracts and also require the subcontractors to include Form FHWA-1273 in any lower tier subcontracts. The prime contractor shall be responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in 29 CFR 5.5.

7. Contract termination: debarment. A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract, and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.

8. Compliance with Davis-Bacon and Related Act requirements. All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR parts 1, 3, and 5 are herein incorporated by reference in this contract.

9. Disputes concerning labor standards. Disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the U.S. Department of Labor, or the employees or their representatives.

10. Certification of eligibility.

a. By entering into this contract, the contractor certifies that neither it (nor he or she) nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).

b. No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).

c. The penalty for making false statements is prescribed in the U.S. Criminal Code, 18 U.S.C. 1001.

V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT

The following clauses apply to any Federal-aid construction contract in an amount in excess of \$100,000 and subject to the overtime provisions of the Contract Work Hours and Safety Standards Act. These clauses shall be inserted in addition to the clauses required by 29 CFR 5.5(a) or 29 CFR 4.6. As used in this paragraph, the terms laborers and mechanics include watchmen and guards.

1. Overtime requirements. No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of forty hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of forty hours in such workweek.

2. Violation; liability for unpaid wages; liquidated damages. In the event of any violation of the clause set forth in paragraph (1.) of this section, the contractor and any subcontractor responsible therefor shall be liable for the unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or mechanic, including watchmen and guards, employed in violation of the clause set forth in paragraph (1.) of this section, in the sum of \$10 for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of forty hours without payment of the overtime wages required by the clause set forth in paragraph (1.) of this section.

3. Withholding for unpaid wages and liquidated damages. The FHWA or the contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld, from any moneys payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph (2.) of this section.

4. Subcontracts. The contractor or subcontractor shall insert in any subcontracts the clauses set forth in paragraph (1.) through (4.) of this section and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in paragraphs (1.) through (4.) of this section.

VI. SUBLETTING OR ASSIGNING THE CONTRACT

This provision is applicable to all Federal-aid construction contracts on the National Highway System.

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the contracting agency. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635.116).

a. The term "perform work with its own organization" refers to workers employed or leased by the prime contractor, and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor or lower tier subcontractor, agents of the prime contractor, or any other assignees. The term may include payments for the costs of hiring leased employees from an employee leasing firm meeting all relevant Federal and State regulatory requirements. Leased employees may only be included in this term if the prime contractor meets all of the following conditions:

(1) the prime contractor maintains control over the supervision of the day-to-day activities of the leased employees;

(2) the prime contractor remains responsible for the quality of the work of the leased employees;

(3) the prime contractor retains all power to accept or exclude individual employees from work on the project; and

(4) the prime contractor remains ultimately responsible for the payment of predetermined minimum wages, the submission of payrolls, statements of compliance and all other Federal regulatory requirements.

b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid or propose on the contract as a whole and in general are to be limited to minor components of the overall contract.

2. The contract amount upon which the requirements set forth in paragraph (1) of Section VI is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.

3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the contracting officer determines is necessary to assure the performance of the contract.

4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the contracting agency has assured that each subcontract is

evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.

5. The 30% self-performance requirement of paragraph (1) is not applicable to design-build contracts; however, contracting agencies may establish their own self-performance requirements.

VII. SAFETY: ACCIDENT PREVENTION

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.

2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704).

3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C.3704).

VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, Form FHWA-1022 shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

18 U.S.C. 1020 reads as follows:

"Whoever, being an officer, agent, or employee of the United States, or of any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined under this title or imprisoned not more than 5 years or both."

IX. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

By submission of this bid/proposal or the execution of this contract, or subcontract, as appropriate, the bidder, proposer, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any person who is or will be utilized in the performance of this contract is not prohibited from receiving an award due to a violation of Section 508 of the Clean Water Act or Section 306 of the Clean Air Act.

2. That the contractor agrees to include or cause to be included the requirements of paragraph (1) of this Section X in every subcontract, and further agrees to take such action as the contracting agency may direct as a means of enforcing such requirements.

X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, consultant contracts or any other covered transaction requiring FHWA approval or that is estimated to cost \$25,000 or more – as defined in 2 CFR Parts 180 and 1200.

1. Instructions for Certification – First Tier Participants:

a. By signing and submitting this proposal, the prospective first tier participant is providing the certification set out below.

b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this

covered transaction. The prospective first tier participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective first tier participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.

c. The certification in this clause is a material representation of fact upon which reliance was placed when the contracting agency determined to enter into this transaction. If it is later determined that the prospective participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the contracting agency may terminate this transaction for cause of default.

d. The prospective first tier participant shall provide immediate written notice to the contracting agency to whom this proposal is submitted if any time the prospective first tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.

e. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

f. The prospective first tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.

g. The prospective first tier participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transactions," provided by the department or contracting agency, entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.

h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.

i. Nothing contained in the foregoing shall be construed to require the establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of the prospective participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

j. Except for transactions authorized under paragraph (f) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion – First Tier Participants:

a. The prospective first tier participant certifies to the best of its knowledge and belief, that it and its principals:

(1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency;

(2) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;

(3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph (a)(2) of this certification; and

(4) Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.

b. Where the prospective participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

2. Instructions for Certification - Lower Tier Participants:

(Applicable to all subcontracts, purchase orders and other lower tier transactions requiring prior FHWA approval or estimated to cost \$25,000 or more - 2 CFR Parts 180 and 1200)

a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.

b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department, or agency with which

this transaction originated may pursue available remedies, including suspension and/or debarment.

c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.

d. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.

f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.

g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.

h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the

department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

* * * * *

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion--Lower Tier Participants:

1. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency.

2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

* * * * *

XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 (49 CFR 20).

1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:

a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.

b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.

2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.

3. The prospective participant also agrees by submitting its bid or proposal that the participant shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

**ATTACHMENT A - EMPLOYMENT AND MATERIALS
PREFERENCE FOR APPALACHIAN DEVELOPMENT
HIGHWAY SYSTEM OR APPALACHIAN LOCAL ACCESS
ROAD CONTRACTS**

This provision is applicable to all Federal-aid projects funded under the Appalachian Regional Development Act of 1965.

1. During the performance of this contract, the contractor undertaking to do work which is, or reasonably may be, done as on-site work, shall give preference to qualified persons who regularly reside in the labor area as designated by the DOL wherein the contract work is situated, or the subregion, or the Appalachian counties of the State wherein the contract work is situated, except:

a. To the extent that qualified persons regularly residing in the area are not available.

b. For the reasonable needs of the contractor to employ supervisory or specially experienced personnel necessary to assure an efficient execution of the contract work.

c. For the obligation of the contractor to offer employment to present or former employees as the result of a lawful collective bargaining contract, provided that the number of nonresident persons employed under this subparagraph (1c) shall not exceed 20 percent of the total number of employees employed by the contractor on the contract work, except as provided in subparagraph (4) below.

2. The contractor shall place a job order with the State Employment Service indicating (a) the classifications of the laborers, mechanics and other employees required to perform the contract work, (b) the number of employees required in each classification, (c) the date on which the participant estimates such employees will be required, and (d) any other pertinent information required by the State Employment Service to complete the job order form. The job order may be placed with the State Employment Service in writing or by telephone. If during the course of the contract work, the information submitted by the contractor in the original job order is substantially modified, the participant shall promptly notify the State Employment Service.

3. The contractor shall give full consideration to all qualified job applicants referred to him by the State Employment Service. The contractor is not required to grant employment to any job applicants who, in his opinion, are not qualified to perform the classification of work required.

4. If, within one week following the placing of a job order by the contractor with the State Employment Service, the State Employment Service is unable to refer any qualified job applicants to the contractor, or less than the number requested, the State Employment Service will forward a certificate to the contractor indicating the unavailability of applicants. Such certificate shall be made a part of the contractor's permanent project records. Upon receipt of this certificate, the contractor may employ persons who do not normally reside in the labor area to fill positions covered by the certificate, notwithstanding the provisions of subparagraph (1c) above.

5. The provisions of 23 CFR 633.207(e) allow the contracting agency to provide a contractual preference for the use of mineral resource materials native to the Appalachian region.

6. The contractor shall include the provisions of Sections 1 through 4 of this Attachment A in every subcontract for work which is, or reasonably may be, done as on-site work.

**KENTUCKY TRANSPORTATION CABINET
DEPARTMENT OF HIGHWAYS**

**EMPLOYMENT REQUIREMENTS
RELATING TO
NONDISCRIMINATION OF EMPLOYEES
(APPLICABLE TO FEDERAL-AID SYSTEM CONTRACTS)**

**AN ACT OF THE KENTUCKY GENERAL ASSEMBLY
TO PREVENT DISCRIMINATION IN EMPLOYMENT**

**KRS CHAPTER 344
EFFECTIVE JUNE 16, 1972**

The contract on this project, in accordance with KRS Chapter 344, provides that during the performance of this contract, the contractor agrees as follows:

1. The contractor shall not fail or refuse to hire, or shall not discharge any individual, or otherwise discriminate against an individual with respect to his compensation, terms, conditions, or privileges of employment, because of such individual's race, color, religion, national origin, sex, disability or age (forty and above); or limit, segregate, or classify his employees in any way which would deprive or tend to deprive an individual of employment opportunities or otherwise adversely affect his status as an employee, because of such individual's race, color, religion, national origin, sex, disability or age forty (40) and over. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided setting forth the provisions of this nondiscrimination clause.

2. The contractor shall not print or publish or cause to be printed or published a notice or advertisement relating to employment by such an employer or membership in or any classification or referral for employment by the employment agency, indicating any preference, limitation, specification, or discrimination, based on race, color, religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, except that such a notice or advertisement may indicate a preference, limitation, or specification based on religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, when religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, is a bona fide occupational qualification for employment.

3. If the contractor is in control of apprenticeship or other training or retraining, including on-the-job training programs, he shall not discriminate against an individual because of his race, color, religion, national origin, sex, disability or age forty (40) and over, in admission to, or employment in any program established to provide apprenticeship or other training.

4. The contractor will send to each labor union or representative of workers with which he has a collective bargaining agreement or other contract or understanding, a notice to be provided advising the said labor union or workers' representative of the contractor's commitments under this section, and shall post copies of the notice in conspicuous places available to employees and applicants for employment. The contractor will take such action with respect to any subcontract or purchase order as the administering agency may direct as a means of enforcing such provisions, including sanctions for non-compliance.

Revised: January 25, 2017

Standard Title VI/Non-Discrimination Assurances

During the performance of this contract, the contractor, for itself, its assignees, and successors in interest (hereinafter referred to as the "contractor") agrees as follows:

1. **Compliance with Regulations:** The contractor (hereinafter includes consultants) will comply with the Acts and the Regulations relative to Non-discrimination in Federally-assisted programs of the U.S. Department of Transportation, **Federal Highway Administration**, as they may be amended from time to time, which are herein incorporated by reference and made a part of this contract.
2. **Non-discrimination:** The contractor, with regard to the work performed by it during the contract, will not discriminate on the grounds of race, color, or national origin in the selection and retention of subcontractors, including procurements of materials and leases of equipment. The contractor will not participate directly or indirectly in the discrimination prohibited by the Acts and the Regulations, including employment practices when the contract covers any activity, project, or program set forth in Appendix B of 49 CFR Part 21.
3. **Solicitations for Subcontracts, Including Procurements of Materials and Equipment:** In all solicitations, either by competitive bidding, or negotiation made by the contractor for work to be performed under a subcontract, including procurements of materials, or leases of equipment, each potential subcontractor or supplier will be notified by the contractor of the contractor's obligations under this contract and the Acts and the Regulations relative to Non-discrimination on the grounds of race, color, or national origin.
4. **Information and Reports:** The contractor will provide all information and reports required by the Acts, the Regulations, and directives issued pursuant thereto and will permit access to its books, records, accounts, other sources of information, and its facilities as may be determined by the Recipient or the **Federal Highway Administration** to be pertinent to ascertain compliance with such Acts, Regulations, and instructions. Where any information required of a contractor is in the exclusive possession of another who fails or refuses to furnish the information, the contractor will so certify to the Recipient or the **Federal Highway Administration**, as appropriate, and will set forth what efforts it has made to obtain the information.
5. **Sanctions for Noncompliance:** In the event of a contractor's noncompliance with the Non-discrimination provisions of this contract, the Recipient will impose such contract sanctions as it or the **Federal Highway Administration** may determine to be appropriate, including, but not limited to:
 - a. withholding payments to the contractor under the contract until the contractor complies; and/or
 - b. cancelling, terminating, or suspending a contract, in whole or in part.
6. **Incorporation of Provisions:** The contractor will include the provisions of paragraphs one through six in every subcontract, including procurements of materials and leases of equipment, unless exempt by the Acts, the Regulations and directives issued pursuant thereto. The contractor will take action with respect to any subcontract or procurement as the Recipient or the **Federal Highway Administration** may direct as a means of enforcing such provisions including sanctions for noncompliance. Provided, that if the contractor becomes involved in, or is threatened with litigation by a subcontractor, or supplier because of such direction, the contractor may request the Recipient to enter into any litigation to protect the interests of the Recipient. In addition, the contractor may request the United States to enter into the litigation to protect the interests of the United States.

Standard Title VI/Non-Discrimination Statutes and Authorities

During the performance of this contract, the contractor, for itself, its assignees, and successors in interest (hereinafter referred to as the “contractor”) agrees to comply with the following non-discrimination statutes and authorities; including but not limited to:

- Title VI of the Civil Rights Act of 1964 (42 U.S.C. § 2000d *et seq.*, 78 stat. 252), (prohibits discrimination on the basis of race, color, national origin); and 49 CFR Part 21;
- The Uniform Relocation Assistance and Real Property Acquisition Policies Act of 1970, (42 U.S.C. § 4601), (prohibits unfair treatment of persons displaced or whose property has been acquired because of Federal or Federal-aid programs and projects);
- Federal-Aid Highway Act of 1973, (23 U.S.C. § 324 *et seq.*), (prohibits discrimination on the basis of sex);
- Section 504 of the Rehabilitation Act of 1973, (29 U.S.C. § 794 *et seq.*), as amended, (prohibits discrimination on the basis of disability); and 49 CFR Part 27;
- The Age Discrimination Act of 1975, as amended, (42 U.S.C. § 6101 *et seq.*), (prohibits discrimination on the basis of age);
- Airport and Airway Improvement Act of 1982, (49 USC § 471, Section 47123), as amended, (prohibits discrimination based on race, creed, color, national origin, or sex);
- The Civil Rights Restoration Act of 1987, (PL 100-209), (Broadened the scope, coverage and applicability of Title VI of the Civil Rights Act of 1964, The Age Discrimination Act of 1975 and Section 504 of the Rehabilitation Act of 1973, by expanding the definition of the terms “programs or activities” to include all of the programs or activities of the Federal-aid recipients, sub-recipients and contractors, whether such programs or activities are Federally funded or not);
- Titles II and III of the Americans with Disabilities Act, which prohibit discrimination on the basis of disability in the operation of public entities, public and private transportation systems, places of public accommodation, and certain testing entities (42 U.S.C. §§ 12131 -- 12189) as implemented by Department of Transportation regulations at 49 C.F.R. parts 37 and 38;
- The Federal Aviation Administration’s Non-discrimination statute (49 U.S.C. § 47123) (prohibits discrimination on the basis of race, color, national origin, and sex);
- Executive Order 12898, Federal Actions to Address Environmental Justice in Minority Populations and Low-Income Populations, which ensures non-discrimination against minority populations by discouraging programs, policies, and activities with disproportionately high and adverse human health or environmental effects on minority and low-income populations;
- Executive Order 13166, Improving Access to Services for Persons with Limited English Proficiency, and resulting agency guidance, national origin discrimination includes discrimination because of limited English proficiency (LEP). To ensure compliance with Title VI, you must take reasonable steps to ensure that LEP persons have meaningful access to your programs (70 Fed. Reg. at 74087 to 74100);
- Title IX of the Education Amendments of 1972, as amended, which prohibits you from discriminating because of sex in education programs or activities (20 U.S.C. 1681 *et seq.*)

EXECUTIVE BRANCH CODE OF ETHICS

In the 1992 regular legislative session, the General Assembly passed and Governor Brereton Jones signed Senate Bill 63 (codified as KRS 11A), the Executive Branch Code of Ethics, which states, in part:

KRS 11A.040 (7) provides:

No present or former public servant shall, within six (6) months following termination of his office or employment, accept employment, compensation, or other economic benefit from any person or business that contracts or does business with, or is regulated by, the state in matters in which he was directly involved during the last thirty-six (36) months of his tenure. This provision shall not prohibit an individual from returning to the same business, firm, occupation, or profession in which he was involved prior to taking office or beginning his term of employment, or for which he received, prior to his state employment, a professional degree or license, provided that, for a period of six (6) months, he personally refrains from working on any matter in which he was directly involved during the last thirty-six (36) months of his tenure in state government. This subsection shall not prohibit the performance of ministerial functions, including but not limited to filing tax returns, filing applications for permits or licenses, or filing incorporation papers, nor shall it prohibit the former officer or public servant from receiving public funds disbursed through entitlement programs.

KRS 11A.040 (9) states:

A former public servant shall not represent a person or business before a state agency in a matter in which the former public servant was directly involved during the last thirty-six (36) months of his tenure, for a period of one (1) year after the latter of:

- a) The date of leaving office or termination of employment; or
- b) The date the term of office expires to which the public servant was elected.

This law is intended to promote public confidence in the integrity of state government and to declare as public policy the idea that state employees should view their work as a public trust and not as a way to obtain private benefits.

If you have worked for the executive branch of state government within the past six months, you may be subject to the law's prohibitions. The law's applicability may be different if you hold elected office or are contemplating representation of another before a state agency.

Also, if you are affiliated with a firm which does business with the state and which employs former state executive-branch employees, you should be aware that the law may apply to them.

In case of doubt, the law permits you to request an advisory opinion from the Executive Branch Ethics Commission, 3 Fountain Place, Frankfort, Kentucky 40601; telephone (502) 564-7954.

"General Decision Number: KY20210107 01/01/2021

Superseded General Decision Number: KY20200107

State: Kentucky

Construction Type: Highway

Counties: Adair, Barren, Bell, Breathitt, Casey, Clay, Clinton, Cumberland, Estill, Floyd, Garrard, Green, Harlan, Hart, Jackson, Johnson, Knott, Knox, Laurel, Lawrence, Lee, Leslie, Letcher, Lincoln, Magoffin, Martin, McCreary, Menifee, Metcalfe, Monroe, Morgan, Owsley, Perry, Pike, Powell, Pulaski, Rockcastle, Russell, Taylor, Wayne, Whitley and Wolfe Counties in Kentucky.

HIGHWAY CONSTRUCTION PROJECTS

Note: Under Executive Order (EO) 13658, an hourly minimum wage of \$10.95 for calendar year 2021 applies to all contracts subject to the Davis-Bacon Act for which the contract is awarded (and any solicitation was issued) on or after January 1, 2015. If this contract is covered by the EO, the contractor must pay all workers in any classification listed on this wage determination at least \$10.95 per hour (or the applicable wage rate listed on this wage determination, if it is higher) for all hours spent performing on the contract in calendar year 2021. If this contract is covered by the EO and a classification considered necessary for performance of work on the contract does not appear on this wage determination, the contractor must pay workers in that classification at least the wage rate determined through the conformance process set forth in 29 CFR 5.5(a)(1)(ii) (or the EO minimum wage rate, if it is higher than the conformed wage rate). The EO minimum wage rate will be adjusted annually. Please note that this EO applies to the above-mentioned types of contracts entered into by the federal government that are subject to the Davis-Bacon Act itself, but it does not apply to contracts subject only to the Davis-Bacon Related Acts, including those set forth at 29 CFR 5.1(a)(2)-(60). Additional information on contractor requirements and worker protections under the EO is available at www.dol.gov/whd/govcontracts.

Modification Number	Publication Date
0	01/01/2021

SUKY2015-047 10/20/2015

	Rates	Fringes
BOILERMAKER.....	\$ 24.65	12.94

BRICKLAYER

Bricklayer.....	\$ 22.90	8.50
Stone Mason.....	\$ 21.50	8.50

CARPENTER

Carpenter.....	\$ 24.90	14.50
Piledriver.....	\$ 24.55	14.50

CEMENT MASON.....	\$ 21.25	8.50
-------------------	----------	------

ELECTRICIAN

Electrician.....	\$ 29.36	10.55
Equipment Operator.....	\$ 26.90	10.31
Groundsman.....	\$ 17.79	8.51
Lineman.....	\$ 30.09	10.94

When workmen are required to work from bosum chairs, trusses, stacks, tanks, scaffolds, catwalks, radio and T.V. towers, structural steel (open, unprotected, unfloored raw steel), and bridges or similar hazardous locations where workmen are subject to fall, except where using JLG's and bucket trucks up to 75 feet: Add 25% to workman's base rate for 50 to 75 feet, and add 50% to workman's base rate for over 75 feet.

IRONWORKER.....	\$ 27.56	20.57
-----------------	----------	-------

LABORER

Group 1.....	\$ 21.80	12.36
Group 2.....	\$ 22.05	12.36
Group 3.....	\$ 22.10	12.36
Group 4.....	\$ 22.70	12.36

GROUP 1: Aging and Curing of Concrete (Any Mode or Method), Asbestos Abatement Worker, Asphalt Plant Laborers, Asphalt Laborers, Batch Truck Dumpers, Carpenter Tenders, Cement Mason Tenders, Cleaning of Machines, Concrete Laborers, Demolition Laborers, Dredging Laborers, Drill Tender, Environmental Laborer - Nuclear, Radiation, Toxic and Hazardous Waste - Level D, Flagmen, Grade Checkers, All Hand Digging and Hand Back Filling, Highway Marker Placers, Landscaping Laborers, Mesh Handlers and Placers, Puddler, Railroad Laborers, Rip-rap and Grouters, Right of Way Laborers, Sign, Guard Rail and Fence Installers (All Types), Signalmen, Sound Barrier Installer, Storm and Sanitary Sewer Laborers, Swampers, Truck Spotters and Dumpers, Wrecking of Concrete Forms, General Cleanup

GROUP 2: Batter Board Men (Sanitary and Storm Sewer), Brickmason Tenders, Mortar Mixer Operator, Scaffold Builders, Burner and Welder, Bushammers, Chain Saw Operator, Concrete Saw Operators, Deckhand Scow Man, Dry Cement Handlers, Environmental Laborers - Nuclear, Radiation, Toxic and Hazardous Waste - Level C, Forklift Operators for Masonry, Form Setters, Green Concrete Cutting, Hand Operated Grouter and Grinder Machine Operator, Jack Hammers, Lead Paint Abatement, Pavement Breakers, Paving Joint Machine, Pipe Layers - Laser Operators (Non-metallic), Plastic Pipe Fusion, Power Driven Georgia Buggy and Wheel Barrow, Power Post Hole Diggers, Precast Manhole Setters, Walk-behind Tampers, Walk-behind Trenchers, Sand Blasters, Concrete Chippers, Surface Grinders, Vibrator Operators, Wagon Drillers

GROUP 3: Air Track Driller (All Types), Asphalt Luteman and Rakers, Gunnite Nozzleman, Gunnite Operators and Mixers, Grout

Pump Operator, Powderman and Blaster, Side Rail Setters, Rail Paved Ditches, Screw Operators, Tunnel Laborers (Free Air), Water Blasters

GROUP 4: Caisson Workers (Free Air), Cement Finishers, Environmental Laborer - Nuclear, Radiation, Toxic and Hazardous Waste - Level A and B, miners and Drillers (Free Air), Tunnel Blasters, and Tunnel Mockers (Free Air), Directional and Horizontal Boring, Air Track Drillers (All Types), Powder Man and Blasters, Troxler and Concrete Tester if Laborer is Utilized

PAINTER

All Excluding Bridges.....	\$ 19.92	9.57
Bridges.....	\$ 23.92	10.07

PLUMBER.....	\$ 22.52	7.80
--------------	----------	------

POWER EQUIPMENT OPERATOR:

Group 1.....	\$ 29.95	14.40
Group 2.....	\$ 29.95	14.40
Group 3.....	\$ 27.26	14.40
Group 4.....	\$ 26.96	14.40

GROUP 1: Auto Patrol, Batch Plant, Bituminous Paver, Cable-Way, Clamshell, Concrete Mixer (21 cu ft or over), Concrete Pump, Crane, Crusher Plant, Derrick, Derrick Boat, Ditching and Trenching Machine, Dragline, Dredge Engineer, Elevator (regardless of ownership when used for hoisting any building material), Elevating Grader and all types of Loaders, Hoe-type Machine, Hoisting Engine, Locomotive, LeTourneau or Carry-all Scoop, Bulldozer, Mechanic, Orangepeel Bucket, Piledriver, Power Blade, Roller (Bituminous), Roller (Earth), Roller (Rock), Scarifier, Shovel, Tractor Shovel, Truck Crane, Well Point, Winch Truck, Push Dozer, Grout Pump, High Lift, Fork Lift (regardless of lift height), all types of Boom Cats, Multiple Operator, Core Drill, Tow or Push Boat, A-Frame Winch Truck, Concrete Paver, Grade-All, Hoist, Hyster, Material Pump, Pumpcrete, Ross Carrier, Sheepfoot, Sideboom, Throttle-Valve Man, Rotary Drill, Power Generator, Mucking Machine, Rock Spreader attached to Equipment, Scoopmobile, KeCal Loader, Tower Cranes,(French, German and other types), Hydrocrane, Tugger, Backfiller Gurries, Self-propelled Compactor, Self-Contained Hydraulic Percussion Drill

GROUP 2: All Air Compressors (200 cu ft/min or greater), Bituminous Mixer, Concrete Mixer (21 cu. ft. or over), Welding Machine, Form Grader, Tractor (50 hp and over), Bull Float, Finish Machine, Outboard Motor Boat, Brakeman, Mechanic Tender, Whirly Oiler, Tract-air, Road Widening Trencher, Articulating Trucks

GROUP 3: Greaser on Grease Facilities servicing Heavy Equipment

GROUP 4: Bituminous Distributor, Cement Gun, Conveyor, Mud Jack, Paving Joint Machine, Pump, Tamping Machine, Tractor (under 50 hp), Vibrator, Oiler, Air Compressor (under 200 cu ft per minute), Concrete Saw, Burlap and Curing Machine, Hydro Seeder, Power Form Handling Equipment, Deckhand Oiler, Hydraulic Post Driver

SHEET METAL WORKER.....	\$ 20.40	7.80
-------------------------	----------	------

TRUCK DRIVER

Driver (3 Tons and Over), Driver (Truck Mounted Rotary Drill).....	\$ 23.74	14.50
Driver (3 Tons and Under), Tire Changer and Truck Mechanic Tender.....	\$ 23.53	14.50
Driver (Semi-Trailer or Pole Trailer), Driver (Dump Truck, Tandem Axle), Driver of Distributor.....	\$ 23.40	14.50
Driver on Mixer Trucks (All Types).....	\$ 23.45	14.50
Driver on Pavement Breakers.	\$ 23.55	14.50
Driver, Euclid and Other Heavy Earth Moving Equipment and Low Boy.....	\$ 24.31	14.50
Driver, Winch Truck and A- Frame when used in Transporting Materials.....	\$ 23.30	14.50
Greaser on Greasing Facilities.....	\$ 24.40	14.50
Truck Mechanic.....	\$ 23.50	14.50
Truck Tender and Warehouseman.....	\$ 23.20	14.50

 WELDERS - Receive rate prescribed for craft performing
 operation to which welding is incidental.

=====
 Note: Executive Order (EO) 13706, Establishing Paid Sick Leave
 for Federal Contractors applies to all contracts subject to the
 Davis-Bacon Act for which the contract is awarded (and any
 solicitation was issued) on or after January 1, 2017. If this
 contract is covered by the EO, the contractor must provide
 employees with 1 hour of paid sick leave for every 30 hours
 they work, up to 56 hours of paid sick leave each year.
 Employees must be permitted to use paid sick leave for their
 own illness, injury or other health-related needs, including
 preventive care; to assist a family member (or person who is
 like family to the employee) who is ill, injured, or has other
 health-related needs, including preventive care; or for reasons
 resulting from, or to assist a family member (or person who is
 like family to the employee) who is a victim of, domestic
 violence, sexual assault, or stalking. Additional information
 on contractor requirements and worker protections under the EO
 is available at www.dol.gov/whd/govcontracts.

Unlisted classifications needed for work not included within
 the scope of the classifications listed may be added after
 award only as provided in the labor standards contract clauses
 (29CFR 5.5 (a) (1) (ii)).

 The body of each wage determination lists the classification
 and wage rates that have been found to be prevailing for the

cited type(s) of construction in the area covered by the wage determination. The classifications are listed in alphabetical order of ""identifiers"" that indicate whether the particular rate is a union rate (current union negotiated rate for local), a survey rate (weighted average rate) or a union average rate (weighted union average rate).

Union Rate Identifiers

A four letter classification abbreviation identifier enclosed in dotted lines beginning with characters other than ""SU"" or ""UAVG"" denotes that the union classification and rate were prevailing for that classification in the survey. Example: PLUM0198-005 07/01/2014. PLUM is an abbreviation identifier of the union which prevailed in the survey for this classification, which in this example would be Plumbers. 0198 indicates the local union number or district council number where applicable, i.e., Plumbers Local 0198. The next number, 005 in the example, is an internal number used in processing the wage determination. 07/01/2014 is the effective date of the most current negotiated rate, which in this example is July 1, 2014.

Union prevailing wage rates are updated to reflect all rate changes in the collective bargaining agreement (CBA) governing this classification and rate.

Survey Rate Identifiers

Classifications listed under the ""SU"" identifier indicate that no one rate prevailed for this classification in the survey and the published rate is derived by computing a weighted average rate based on all the rates reported in the survey for that classification. As this weighted average rate includes all rates reported in the survey, it may include both union and non-union rates. Example: SULA2012-007 5/13/2014. SU indicates the rates are survey rates based on a weighted average calculation of rates and are not majority rates. LA indicates the State of Louisiana. 2012 is the year of survey on which these classifications and rates are based. The next number, 007 in the example, is an internal number used in producing the wage determination. 5/13/2014 indicates the survey completion date for the classifications and rates under that identifier.

Survey wage rates are not updated and remain in effect until a new survey is conducted.

Union Average Rate Identifiers

Classification(s) listed under the UAVG identifier indicate that no single majority rate prevailed for those classifications; however, 100% of the data reported for the classifications was union data. EXAMPLE: UAVG-OH-0010 08/29/2014. UAVG indicates that the rate is a weighted union average rate. OH indicates the state. The next number, 0010 in the example, is an internal number used in producing the wage determination. 08/29/2014 indicates the survey completion date for the classifications and rates under that identifier.

A UAVG rate will be updated once a year, usually in January of each year, to reflect a weighted average of the current negotiated/CBA rate of the union locals from which the rate is

based.

WAGE DETERMINATION APPEALS PROCESS

1.) Has there been an initial decision in the matter? This can be:

- * an existing published wage determination
- * a survey underlying a wage determination
- * a Wage and Hour Division letter setting forth a position on a wage determination matter
- * a conformance (additional classification and rate) ruling

On survey related matters, initial contact, including requests for summaries of surveys, should be with the Wage and Hour Regional Office for the area in which the survey was conducted because those Regional Offices have responsibility for the Davis-Bacon survey program. If the response from this initial contact is not satisfactory, then the process described in 2.) and 3.) should be followed.

With regard to any other matter not yet ripe for the formal process described here, initial contact should be with the Branch of Construction Wage Determinations. Write to:

Branch of Construction Wage Determinations
Wage and Hour Division
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

2.) If the answer to the question in 1.) is yes, then an interested party (those affected by the action) can request review and reconsideration from the Wage and Hour Administrator (See 29 CFR Part 1.8 and 29 CFR Part 7). Write to:

Wage and Hour Administrator
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

The request should be accompanied by a full statement of the interested party's position and by any information (wage payment data, project description, area practice material, etc.) that the requestor considers relevant to the issue.

3.) If the decision of the Administrator is not favorable, an interested party may appeal directly to the Administrative Review Board (formerly the Wage Appeals Board). Write to:

Administrative Review Board
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

4.) All decisions by the Administrative Review Board are final.

=====
END OF GENERAL DECISION

Fringe benefit amounts are applicable for all hours worked except when otherwise noted.

No laborer, workman or mechanic shall be paid at a rate less than that of a Journeyman except those classified as bona fide apprentices.

Apprentices or trainees shall be permitted to work as such subject to Administrative Regulations adopted by the Commissioner of Workplace Standards. Copies of these regulations will be furnished upon request from any interested person.

Before using apprentices on the job the contractor shall present to the Contracting Officer written evidence of registration of such employees in a program of a State apprenticeship and training agency approved and recognized by the U. S. Bureau of Apprenticeship and Training. In the absence of such a State agency, the contractor shall submit evidence of approval and registration by the U. S. Bureau of Apprenticeship and Training.

The contractor shall submit to the Contracting Officer, written evidence of the established apprenticeship-journeyman ratios and wage rates in the project area, which will be the basis for establishing such ratios and rates for the project under the applicable contract provisions.

TO: EMPLOYERS/EMPLOYEES

PREVAILING WAGE SCHEDULE:

The wages indicated on this wage schedule are the least permitted to be paid for the occupations indicated. When an employee works in more than one classification, the employer must record the number of hours worked in each classification at the prescribed hourly base rate.

OVERTIME:

Overtime is to be paid to an employee at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of forty (40) hours in such workweek. Wage violations or questions should be directed to the designated Engineer or the undersigned.

Director
Division of Construction Procurement
Frankfort, Kentucky 40622
502-564-3500

**NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION
TO ENSURE EQUAL EMPLOYMENT OPPORTUNITY
(Executive Order 11246)**

1. The Offeror's or Bidder's attention is called to the "Equal Opportunity Clause" and the "Standard Federal Equal Employment Specifications" set forth herein.
2. The goals and timetables for minority and female participation, expressed in percentage terms for the Contractor's aggregate work force in each trade on all construction work in the covered area, are as follows:

GOALS FOR MINORITY PARTICIPATION IN EACH TRADE	GOALS FOR FEMALE PARTICIPATION IN EACH TRADE
7.0%	6.9%

These goals are applicable to all the Contractor's construction work (whether or not it is Federal or federally-assisted) performed in the covered area. If the contractor performs construction work in a geographical area located outside of the covered area, it shall apply the goals established for such geographical area where the work is actually performed. With regard to this second area, the contractor also is subject to the goals for both its federally involved and non-federally involved construction.

The Contractor's compliance with the Executive Order and the regulations in CFR Part 60-4 shall be based on its implementation of the Equal Opportunity Clause, specific affirmative action obligations required by the specifications set forth in 41 CFR 60-4, 3(a), and its efforts to meet the goals. The hours of minority and female employment and training must be substantially uniform throughout the length of the contract, and in each trade, and the contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority or female employees or trainees from Contractor to Contractor or from project to project for the sole purpose of meeting the Contractor's goals shall be a violation of the contract, the Executive Order and the regulations in 41 CFR Part 60-4. Compliance with the goals will be measured against the total work hours performed.

3. The Contractor shall provide written notification to the Director of the Office of Federal Contract Compliance Programs within ten (10) working days of award of any construction subcontract in excess of \$10,000.00 at any tier for construction work under the contract resulting from this solicitation. The notification shall list the name, address and telephone number of the subcontractor; employer identification number of the subcontractor; estimated dollar amount of the subcontract; estimated starting and completion dates of the subcontract; and the geographical area in which the subcontract is to be performed. The notification shall be mailed to:

**Evelyn Teague, Regional Director
Office of Federal Contract Compliance Programs
61 Forsyth Street, SW, Suite 7B75
Atlanta, Georgia 30303-8609**

4. As used in this Notice, and in the contract resulting from this solicitation, the "**covered area**" is Lee County.

**NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION
TO ENSURE EQUAL EMPLOYMENT OPPORTUNITY
(Executive Order 11246)**

1. The Offeror's or Bidder's attention is called to the "Equal Opportunity Clause" and the "Standard Federal Equal Employment Specifications" set forth herein.
2. The goals and timetables for minority and female participation, expressed in percentage terms for the Contractor's aggregate work force in each trade on all construction work in the covered area, are as follows:

GOALS FOR MINORITY PARTICIPATION IN EACH TRADE	GOALS FOR FEMALE PARTICIPATION IN EACH TRADE
7.0%	6.9%

These goals are applicable to all the Contractor's construction work (whether or not it is Federal or federally-assisted) performed in the covered area. If the contractor performs construction work in a geographical area located outside of the covered area, it shall apply the goals established for such geographical area where the work is actually performed. With regard to this second area, the contractor also is subject to the goals for both its federally involved and non-federally involved construction.

The Contractor's compliance with the Executive Order and the regulations in CFR Part 60-4 shall be based on its implementation of the Equal Opportunity Clause, specific affirmative action obligations required by the specifications set forth in 41 CFR 60-4, 3(a), and its efforts to meet the goals. The hours of minority and female employment and training must be substantially uniform throughout the length of the contract, and in each trade, and the contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority or female employees or trainees from Contractor to Contractor or from project to project for the sole purpose of meeting the Contractor's goals shall be a violation of the contract, the Executive Order and the regulations in 41 CFR Part 60-4. Compliance with the goals will be measured against the total work hours performed.

3. The Contractor shall provide written notification to the Director of the Office of Federal Contract Compliance Programs within ten (10) working days of award of any construction subcontract in excess of \$10,000.00 at any tier for construction work under the contract resulting from this solicitation. The notification shall list the name, address and telephone number of the subcontractor; employer identification number of the subcontractor; estimated dollar amount of the subcontract; estimated starting and completion dates of the subcontract; and the geographical area in which the subcontract is to be performed. The notification shall be mailed to:

**Evelyn Teague, Regional Director
Office of Federal Contract Compliance Programs
61 Forsyth Street, SW, Suite 7B75
Atlanta, Georgia 30303-8609**

4. As used in this Notice, and in the contract resulting from this solicitation, the "**covered area**" is Owsley County.

PART IV
INSURANCE

Refer to
Kentucky Standard Specifications for Road and Bridge Construction,
current edition

PART V
BID ITEMS

PROPOSAL BID ITEMS

211307

Page 1 of 6

Report Date 1/28/21

Section: 0001 - PAVING

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0010	00003		CRUSHED STONE BASE	63,281.00	TON		\$	
0020	00020		TRAFFIC BOUND BASE	2,500.00	TON		\$	
0030	00100		ASPHALT SEAL AGGREGATE	424.00	TON		\$	
0040	00103		ASPHALT SEAL COAT	51.00	TON		\$	
0050	00221		CL2 ASPH BASE 0.75D PG64-22	48,277.00	TON		\$	
0060	00301		CL2 ASPH SURF 0.38D PG64-22	11,361.00	TON		\$	
0070	00356		ASPHALT MATERIAL FOR TACK	80.90	TON		\$	
0080	02099		CEM CONC ENT PAVEMENT-6 IN	63.00	SQYD		\$	
0090	02677		ASPHALT PAVE MILLING & TEXTURING	2,038.00	TON		\$	
0100	20071EC		JOINT ADHESIVE	33,497.00	LF		\$	

Section: 0002 - ROADWAY

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0110	00021		DRAINAGE BLANKET-EMBANKMENT STA. 206+25 - 208+75	600.00	CUYD		\$	
0120	00078		CRUSHED AGGREGATE SIZE NO 2 FOR PERFORATED PIPE HEADWALLS	61.00	TON		\$	
0130	00078		CRUSHED AGGREGATE SIZE NO 2 FOR SUBGRADE STABILIZATION	947.00	TON		\$	
0140	00440		ENTRANCE PIPE-15 IN	1,107.00	LF		\$	
0150	00441		ENTRANCE PIPE-18 IN	453.00	LF		\$	
0160	00443		ENTRANCE PIPE-24 IN	387.00	LF		\$	
0170	00452		ENTRANCE PIPE-24 IN EQUIV	47.00	LF		\$	
0180	00454		ENTRANCE PIPE-30 IN EQUIV	123.00	LF		\$	
0190	01000		PERFORATED PIPE-4 IN	4,567.00	LF		\$	
0200	01010		NON-PERFORATED PIPE-4 IN	1,410.00	LF		\$	
0210	01020		PERF PIPE HEADWALL TY 1-4 IN	8.00	EACH		\$	
0220	01028		PERF PIPE HEADWALL TY 3-4 IN	37.00	EACH		\$	
0230	01032		PERF PIPE HEADWALL TY 4-4 IN	5.00	EACH		\$	
0240	01314		PLUG PIPE	1.00	EACH		\$	
0250	01987		DELINEATOR FOR GUARDRAIL BI DIRECTIONAL WHITE	238.00	EACH		\$	
0260	02014		BARRICADE-TYPE III	6.00	EACH		\$	
0270	02091		REMOVE PAVEMENT	1,573.00	SQYD		\$	
0280	02159		TEMP DITCH	11,725.00	LF		\$	
0290	02160		CLEAN TEMP DITCH	5,863.00	LF		\$	
0300	02200		ROADWAY EXCAVATION	1,200,526.00	CUYD		\$	
0310	02203		STRUCTURE EXCAV-UNCLASSIFIED FOR RETAINING WALL (STA. 230+50 TO STA. 232+50)	267.00	CUYD		\$	
0320	02242		WATER	847.00	MGAL		\$	
0330	02360		GUARDRAIL TERMINAL SECTION NO 1	47.00	EACH		\$	
0340	02369		GUARDRAIL END TREATMENT TYPE 2A	5.00	EACH		\$	
0350	02371		GUARDRAIL END TREATMENT TYPE 7	28.00	EACH		\$	
0360	02381		REMOVE GUARDRAIL	2,285.50	LF		\$	
0370	02391		GUARDRAIL END TREATMENT TYPE 4A	10.00	EACH		\$	

PROPOSAL BID ITEMS

211307

Page 2 of 6

Report Date 1/28/21

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0380	02397		TEMP GUARDRAIL	6,512.00	LF		\$	
0390	02404		SEPTIC TANK TREATMENT	1.00	EACH		\$	
0400	02429		RIGHT-OF-WAY MONUMENT TYPE 1	254.00	EACH		\$	
0410	02430		RIGHT-OF-WAY MONUMENT TYPE 1A	8.00	EACH		\$	
0420	02431		WITNESS R/W MONUMENT TYPE 2	3.00	EACH		\$	
0430	02432		WITNESS POST	6.00	EACH		\$	
0440	02475		PLUG WATER WELL	4.00	EACH		\$	
0450	02483		CHANNEL LINING CLASS II	302.00	TON		\$	
0460	02484		CHANNEL LINING CLASS III	43,667.00	TON		\$	
0470	02545		CLEARING AND GRUBBING (APPROX. 86.536 ACRES IN OWSLEY CO.)	1.00	LS		\$	
0480	02545		CLEARING AND GRUBBING (APPROX. 98.562 ACRES IN LEE CO.)	1.00	LS		\$	
0490	02555		CONCRETE-CLASS B FOR PARTIALLY GROUTED RIPRAP	286.00	CUYD		\$	
0500	02555		CONCRETE-CLASS B FOR RETAINING WALL (STA. 230+50 TO STA. 232+50)	148.00	CUYD		\$	
0510	02562		TEMPORARY SIGNS	1,374.50	SQFT		\$	
0520	02585		EDGE KEY	260.00	LF		\$	
0530	02602		FABRIC-GEOTEXTILE CLASS 1	943.00	SQYD		\$	
0540	02603		FABRIC-GEOTEXTILE CLASS 2	6,075.00	SQYD		\$	
0550	02607		FABRIC-GEOTEXTILE CLASS 2 FOR PIPE	7,268.00	SQYD	\$2.00	\$	\$14,536.00
0560	02650		MAINTAIN & CONTROL TRAFFIC (LEE COUNTY)	1.00	LS		\$	
0570	02650		MAINTAIN & CONTROL TRAFFIC (OWSLEY COUNTY)	1.00	LS		\$	
0580	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #1 - OWSLEY CO)	1.00	LS		\$	
0590	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #2 - OWSLEY CO)	1.00	LS		\$	
0600	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #3 - OWSLEY CO)	1.00	LS		\$	
0610	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #4 - OWSLEY CO)	1.00	LS		\$	
0620	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #5 - LEE CO)	1.00	LS		\$	
0630	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #6 - LEE CO)	1.00	LS		\$	
0640	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #7 - LEE CO)	1.00	LS		\$	
0650	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #8 - LEE CO)	1.00	LS		\$	
0660	02651		DIVERSIONS (BY-PASS DETOURS) (DIVERSION #9 - LEE CO)	1.00	LS		\$	
0670	02671		PORTABLE CHANGEABLE MESSAGE SIGN	4.00	EACH		\$	
0680	02676		MOBILIZATION FOR MILL & TEXT (LEE COUNTY)	1.00	LS		\$	
0690	02676		MOBILIZATION FOR MILL & TEXT (OWSLEY COUNTY)	1.00	LS		\$	
0700	02690		SAFELOADING	153.67	CUYD		\$	
0710	02696		SHOULDER RUMBLE STRIPS	66,846.00	LF		\$	
0720	02701		TEMP SILT FENCE	11,725.00	LF		\$	
0730	02703		SILT TRAP TYPE A	121.00	EACH		\$	

PROPOSAL BID ITEMS

211307

Page 3 of 6

Report Date 1/28/21

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0740	02704		SILT TRAP TYPE B	121.00	EACH		\$	
0750	02705		SILT TRAP TYPE C	121.00	EACH		\$	
0760	02706		CLEAN SILT TRAP TYPE A	121.00	EACH		\$	
0770	02707		CLEAN SILT TRAP TYPE B	121.00	EACH		\$	
0780	02708		CLEAN SILT TRAP TYPE C	121.00	EACH		\$	
0790	02726		STAKING (LEE COUNTY)	1.00	LS		\$	
0800	02726		STAKING (OWSLEY COUNTY)	1.00	LS		\$	
0810	02731		REMOVE STRUCTURE (18'X8' BRIDGE STA. 51+00 LONGBRANCH)	1.00	LS		\$	
0820	02731		REMOVE STRUCTURE (5'X5' SBC STA 51+27 PINE GROVE)	1.00	LS		\$	
0830	02731		REMOVE STRUCTURE (6'X4' SBC ENT 179+85 RT.)	1.00	LS		\$	
0840	05950		EROSION CONTROL BLANKET	892.00	SQYD		\$	
0850	05952		TEMP MULCH	390,782.00	SQYD		\$	
0860	05953		TEMP SEEDING AND PROTECTION	293,086.00	SQYD		\$	
0870	05963		INITIAL FERTILIZER	49.00	TON		\$	
0880	05964		MAINTENANCE FERTILIZER	24.00	TON		\$	
0890	05985		SEEDING AND PROTECTION	470,990.00	SQYD		\$	
0900	05992		AGRICULTURAL LIMESTONE	292.00	TON		\$	
0910	06510		PAVE STRIPING-TEMP PAINT-4 IN	201,376.00	LF		\$	
0920	06514		PAVE STRIPING-PERM PAINT-4 IN	7,938.00	LF		\$	
0930	06530		PAVE STRIPING REMOVAL-4 IN	4,400.00	LF		\$	
0940	06569		PAVE MARKING-THERMO CROSS-HATCH	1,124.00	SQFT		\$	
0950	06573		PAVE MARKING-THERMO STR ARROW	2.00	EACH		\$	
0960	06574		PAVE MARKING-THERMO CURV ARROW	10.00	EACH		\$	
0970	06578		PAVE MARKING-THERMO MERGE ARROW	6.00	EACH		\$	
0980	10020NS		FUEL ADJUSTMENT	317,809.00	DOLL	\$1.00	\$	\$317,809.00
0990	10030NS		ASPHALT ADJUSTMENT	222,151.00	DOLL	\$1.00	\$	\$222,151.00
1000	21257ED		ENTRANCE PIPE-48 IN	63.00	LF		\$	
1010	21802EN		G/R STEEL W BEAM-S FACE (7 FT POST)	7,612.50	LF		\$	
1020	24489EC		INLAID PAVEMENT MARKER	348.00	EACH		\$	
1030	24540		R/W MONUMENT TYPE 3	64.00	EACH		\$	
1040	24541		R/W MONUMENT TYPE 3A	4.00	EACH		\$	
1050	24814EC		PIPELINE INSPECTION	3,949.00	LF		\$	
1060	24845EC		UTILITY COORDINATION (LEE COUNTY)	1.00	LS		\$	
1070	24845EC		UTILITY COORDINATION (OWSLEY COUNTY)	1.00	LS		\$	
1080	24995EC		PAVE STRIPING-SPRAY THERMO-6 IN W	47,812.00	LF		\$	
1090	24996EC		PAVE STRIPING-SPRAY THERMO-6 IN Y	38,367.00	LF		\$	

Section: 0003 - DRAINAGE

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1100	00462		CULVERT PIPE-18 IN	683.00	LF		\$	
1110	00464		CULVERT PIPE-24 IN	805.00	LF		\$	
1120	00466		CULVERT PIPE-30 IN	727.00	LF		\$	

PROPOSAL BID ITEMS

211307

Page 4 of 6

Report Date 1/28/21

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1130	00468		CULVERT PIPE-36 IN	241.00	LF		\$	
1140	00469		CULVERT PIPE-42 IN	214.00	LF		\$	
1150	00470		CULVERT PIPE-48 IN	678.00	LF		\$	
1160	00472		CULVERT PIPE-60 IN	99.00	LF		\$	
1170	00473		CULVERT PIPE-66 IN	148.00	LF		\$	
1180	00499		CULVERT PIPE-48 IN EQUIV	99.00	LF		\$	
1190	00502		CULVERT PIPE-66 IN EQUIV	23.00	LF		\$	
1200	00521		STORM SEWER PIPE-15 IN	70.00	LF		\$	
1210	00522		STORM SEWER PIPE-18 IN	290.00	LF		\$	
1220	00524		STORM SEWER PIPE-24 IN	300.00	LF		\$	
1230	00526		STORM SEWER PIPE-30 IN	463.00	LF		\$	
1240	01202		PIPE CULVERT HEADWALL-15 IN	1.00	EACH		\$	
1250	01204		PIPE CULVERT HEADWALL-18 IN	8.00	EACH		\$	
1260	01208		PIPE CULVERT HEADWALL-24 IN	11.00	EACH		\$	
1270	01210		PIPE CULVERT HEADWALL-30 IN	11.00	EACH		\$	
1280	01212		PIPE CULVERT HEADWALL-36 IN	4.00	EACH		\$	
1290	01214		PIPE CULVERT HEADWALL-42 IN	4.00	EACH		\$	
1300	01216		PIPE CULVERT HEADWALL-48 IN	10.00	EACH		\$	
1310	01217		PIPE CULVERT HEADWALL-48 IN EQUIV	2.00	EACH		\$	
1320	01220		PIPE CULVERT HEADWALL-60 IN	2.00	EACH		\$	
1330	01222		PIPE CULVERT HEADWALL-66 IN	4.00	EACH		\$	
1340	01222		PIPE CULVERT HEADWALL-66 IN EQUIVALENT	2.00	EACH		\$	
1350	01450		S & F BOX INLET-OUTLET-18 IN	5.00	EACH		\$	
1360	01451		S & F BOX INLET-OUTLET-24 IN	1.00	EACH		\$	
1370	01452		S & F BOX INLET-OUTLET-30 IN	5.00	EACH		\$	
1380	01490		DROP BOX INLET TYPE 1	6.00	EACH		\$	
1390	01493		DROP BOX INLET TYPE 2	2.00	EACH		\$	
1400	01496		DROP BOX INLET TYPE 3 NO APRON	1.00	EACH		\$	
1410	01535		DROP BOX INLET TYPE 6F	1.00	EACH		\$	
1420	01538		DROP BOX INLET TYPE 7	1.00	EACH		\$	
1430	01544		DROP BOX INLET TYPE 11	3.00	EACH		\$	
1440	01577		DROP BOX INLET TYPE 14	1.00	EACH		\$	
1450	01650		JUNCTION BOX (TYPE B1)	2.00	EACH		\$	
1460	08100		CONCRETE-CLASS A (INTERMEDIATE ANCHORS)	4.50	CUYD		\$	
1470	21800EN		BORE AND JACK PIPE-30 IN	75.00	LF		\$	

Section: 0004 - BRIDGE - #27342 - KY 3332 STA. 51+75 12' X 7' RCBC

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1480	08002		STRUCTURE EXCAV-SOLID ROCK	5.00	CUYD		\$	
1490	08003		FOUNDATION PREPARATION	1.00	LS		\$	
1500	08100		CONCRETE-CLASS A	132.10	CUYD		\$	
1510	08150		STEEL REINFORCEMENT	12,874.00	LB		\$	

PROPOSAL BID ITEMS

211307

Page 5 of 6

Report Date 1/28/21

Section: 0005 - BRIDGE - #27339 - KY 11 STA. 184+20 16' X 5' RCBC

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1520	08002		STRUCTURE EXCAV-SOLID ROCK	5.00	CUYD		\$	
1530	08003		FOUNDATION PREPARATION	1.00	LS		\$	
1540	08100		CONCRETE-CLASS A	113.80	CUYD		\$	
1550	08150		STEEL REINFORCEMENT	11,120.00	LB		\$	

Section: 0006 - BRIDGE - #27343 - LONG BRANCH RD STA 51+05 12X 7 RCBC

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1560	08002		STRUCTURE EXCAV-SOLID ROCK	18.00	CUYD		\$	
1570	08003		FOUNDATION PREPARATION	1.00	LS		\$	
1580	08100		CONCRETE-CLASS A	153.00	CUYD		\$	
1590	08150		STEEL REINFORCEMENT	14,507.00	LB		\$	

Section: 0007 - BRIDGE - #27340 - KY 11 STA. 208+31 5' X 5' RCBC

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1600	08002		STRUCTURE EXCAV-SOLID ROCK	5.00	CUYD		\$	
1610	08003		FOUNDATION PREPARATION	1.00	LS		\$	
1620	08100		CONCRETE-CLASS A	220.40	CUYD		\$	
1630	08150		STEEL REINFORCEMENT	20,834.00	LB		\$	

Section: 0008 - BRIDGE - #27344 - KY 11 STA. 333+20 5' X 4' RCBC

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1640	08002		STRUCTURE EXCAV-SOLID ROCK	352.00	CUYD		\$	
1650	08003		FOUNDATION PREPARATION	1.00	LS		\$	
1660	08100		CONCRETE-CLASS A	255.30	CUYD		\$	
1670	08150		STEEL REINFORCEMENT	30,276.00	LB		\$	

Section: 0009 - SIGNING

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1680	06401		FLEXIBLE DELINEATOR POST-M/W	14.00	EACH		\$	
1690	06406		SBM ALUM SHEET SIGNS .080 IN	818.00	SQFT		\$	
1700	06407		SBM ALUM SHEET SIGNS .125 IN	24.00	SQFT		\$	
1710	06410		STEEL POST TYPE 1	1,534.00	LF		\$	
1720	20418ED		REMOVE & RELOCATE SIGNS	4.00	EACH		\$	
1730	20458ES403		CENTERLINE RUMBLE STRIPS	33,423.00	LF		\$	
1740	24631EC		BARCODE SIGN INVENTORY	143.00	EACH		\$	

Section: 0010 - WATERLINE

PROPOSAL BID ITEMS

211307

Page 6 of 6

Report Date 1/28/21

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
1750	14004		W DIRECTIONAL BORE (2 INCH)	1,485.00	LF		\$	
1760	14004		W DIRECTIONAL BORE (3 INCH)	340.00	LF		\$	
1770	14004		W DIRECTIONAL BORE (4 INCH)	275.00	LF		\$	
1780	14004		W DIRECTIONAL BORE (6 INCH)	425.00	LF		\$	
1790	14007		W ENCASEMENT STEEL BORED RANGE 2 (W/4 INCH SDR17 WATERLINE)	100.00	LF		\$	
1800	14008		W ENCASEMENT STEEL BORED RANGE 3 (W/6 INCH SDR17 WATERLINE)	85.00	LF		\$	
1810	14013		W ENCASEMENT STEEL OPEN CUT RANGE 2 (W/4 INCH SDR17 WATERLINE)	200.00	LF		\$	
1820	14014		W ENCASEMENT STEEL OPEN CUT RANGE 3 (W/6 INCH SDR17 WATERLINE)	280.00	LF		\$	
1830	14022		W FLUSH HYDRANT ASSEMBLY (TYPE 1)	8.00	EACH		\$	
1840	14022		W FLUSH HYDRANT ASSEMBLY (TYPE 3)	4.00	EACH		\$	
1850	14056		W PIPE PVC 02 INCH	4,020.00	LF		\$	
1860	14057		W PIPE PVC 03 INCH	2,375.00	LF		\$	
1870	14058		W PIPE PVC 04 INCH	15,665.00	LF		\$	
1880	14059		W PIPE PVC 06 INCH	28,190.00	LF		\$	
1890	14080		W SERV PE/PLST LONG SIDE 3/4 IN	9.00	EACH		\$	
1900	14085		W SERV PE/PLST SHORT SIDE 3/4 IN	90.00	EACH		\$	
1910	14091		W TIE-IN 02 INCH	17.00	EACH		\$	
1920	14092		W TIE-IN 03 INCH	6.00	EACH		\$	
1930	14093		W TIE-IN 04 INCH	16.00	EACH		\$	
1940	14094		W TIE-IN 06 INCH	13.00	EACH		\$	
1950	14102		W VALVE 02 INCH	12.00	EACH		\$	
1960	14103		W VALVE 03 INCH	7.00	EACH		\$	
1970	14104		W VALVE 04 INCH	21.00	EACH		\$	
1980	14105		W VALVE 06 INCH	18.00	EACH		\$	
1990	14124		W VALVE SPECIAL (6 INCH PRV ASSEMBLY)	1.00	EACH		\$	
2000	14130		W METER WITH PRV 3/4 INCH	61.00	EACH		\$	

Section: 0011 - DEMOBILIZATION &/OR MOBILIZATION

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
2010	02568		MOBILIZATION	1.00	LS		\$	
2020	02569		DEMOBILIZATION	1.00	LS		\$	