



CALL NO. 300

CONTRACT ID. 261522

GRAYSON COUNTY

FED/STATE PROJECT NUMBER BC53 043 K2I3 KY26-52

DESCRIPTION PAPI REPLACEMENT AT ROUGH RIVER STATE PARK AIRPORT

WORK TYPE AIRPORT CONSTRUCTION

PRIMARY COMPLETION DATE 3/1/2027

LETTING DATE: October 22,2026

Sealed Bids will be received electronically through the Bid Express bidding service until 10:00 AM EASTERN DAYLIGHT TIME October 22,2026. Bids will be publicly announced at 10:00 AM EASTERN DAYLIGHT TIME.

PLANS AVAILABLE FOR THIS PROJECT.

REQUIRED BID PROPOSAL GUARANTY: Not less than 5% of the total bid.

TABLE OF CONTENTS

PART I	SCOPE OF WORK - PROJECT(S), COMPLETION DATE(S), & LIQUIDATED DAMAGES - CONTRACT NOTES - STATE CONTRACT NOTES - SPECIAL NOTE(S) APPLICABLE TO PROJECT
PART II	SPECIFICATIONS AND STANDARD DRAWINGS STANDARD AND SUPPLEMENTAL SPECIFICATIONS
PART III	EMPLOYMENT, WAGE AND RECORD REQUIREMENTS - LABOR AND WAGE REQUIREMENTS - EXECUTIVE BRANCH CODE OF ETHICS - KENTUCKY EQUAL EMPLOYMENT OPPORTUNITY ACT OF 1978 LOCALITY / STATE - PROJECT WAGE RATES / STATE FUNDED
PART IV	BID ITEMS

PART I

SCOPE OF WORK

ADMINISTRATIVE DISTRICT - 04

CONTRACT ID - 261522
BC53 043 K2I3 KY26-52
COUNTY - GRAYSON
PCN - DE0430AIR2616
BC53 043 K2I3 KY26-52

PAPI REPLACEMENT AT ROUGH RIVER STATE PARK AIRPORT PAPI REPLACEMENT AT ROUGH RIVER STATE
PARK AIRPORTAIRPORT CONSTRUCTION
GEOGRAPHIC COORDINATES LATITUDE 0:00:00.00 LONGITUDE 0:00:00.00
ADT

COMPLETION DATE(S):
14 CALENDAR Days RUNWAY MAY BE SHUT DOWN FOR A MAXIMUM OF 14 DAYS
COMPLETED BY 03/01/2027 APPLIES TO ENTIRE CONTRACT

CONTRACT NOTES

INSURANCE

Refer to Kentucky Standard Specifications for Road and Bridge Construction, current edition.

PROPOSAL ADDENDA

All addenda to this proposal must be applied when calculating bid and certified in the bid packet submitted to the Kentucky Department of Highways. Failure to use the correct and most recent addenda may result in the bid being rejected.

BID SUBMITTAL

Bidder must use the Department's electronic bidding software. The Bidder must download the bid file located on the Bid Express website (www.bidx.com) to prepare a bid packet for submission to the Department. The bidder must submit electronically using Bid Express.

JOINT VENTURE BIDDING

Joint venture bidding is permissible. All companies in the joint venture must be prequalified in one of the work types in the Qualifications for Bidders for the project. The bidders must get a vendor ID for the joint venture from the Division of Construction Procurement and register the joint venture as a bidder on the project. Also, the joint venture must obtain a digital ID from Bid Express to submit a bid. A joint bid bond of 5% may be submitted for both companies or each company may submit a separate bond of 5%.

UNDERGROUND FACILITY DAMAGE PROTECTION

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. When prescribed in said directives, the contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom shall be contacted through their individual Protection Notification Center. Non-compliance with these directives can result in the enforcement of penalties.

REGISTRATION WITH THE SECRETARY OF STATE BY A FOREIGN ENTITY

Pursuant to KRS 176.085(1)(b), an agency, department, office, or political subdivision of the Commonwealth of Kentucky shall not award a state contract to a person that is a foreign entity required by [KRS 14A.9-010](#) to obtain a certificate of authority to transact business in the Commonwealth ("certificate") from the Secretary of State under [KRS 14A.9-030](#) unless the person produces the certificate within fourteen (14) days of the bid or proposal opening. If the

foreign entity is not required to obtain a certificate as provided in [KRS 14A.9-010](#), the foreign entity should identify the applicable exception. Foreign entity is defined within [KRS 14A.1-070](#).

For all foreign entities required to obtain a certificate of authority to transact business in the Commonwealth, if a copy of the certificate is not received by the contracting agency within the time frame identified above, the foreign entity's solicitation response shall be deemed non-responsive or the awarded contract shall be cancelled.

Businesses can register with the Secretary of State at <https://secure.kentucky.gov/sos/ftbr/welcome.aspx>.

SPECIAL NOTE FOR PROJECT QUESTIONS DURING ADVERTISEMENT

Questions about projects during the advertisement should be submitted in writing to the Division of Construction Procurement. This may be done by email to kytc.projectquestions@ky.gov. The Department will attempt to answer all submitted questions. The Department reserves the right not to answer if the question is not pertinent or does not aid in clarifying the project intent.

The deadline for posting answers will be 3:00 pm Eastern Daylight Time, the day preceding the Letting. Questions may be submitted until this deadline with the understanding that the later a question is submitted, the less likely an answer will be able to be provided.

The questions and answers will be posted for each Letting under the heading "Questions & Answers" on the Construction Procurement website (www.transportation.ky.gov/construction-procurement). The answers provided shall be considered part of this Special Note and, in case of a discrepancy, will govern over all other bidding documents.

HARDWOOD REMOVAL RESTRICTIONS

The US Department of Agriculture has imposed a quarantine in Kentucky and several surrounding states, to prevent the spread of an invasive insect, the emerald ash borer. Hardwood cut in conjunction with the project may not be removed from the state. Chipping or burning on site is the preferred method of disposal.

INSTRUCTIONS FOR EXCESS MATERIAL SITES AND BORROW SITES

Identification of excess material sites and borrow sites shall be the responsibility of the Contractor. The Contractor shall be responsible for compliance with all applicable state and federal laws and may wish to consult with the US Fish and Wildlife Service to seek protection under Section 10 of the Endangered Species Act for these activities.

ACCESS TO RECORDS

The state agency certifies that it is in compliance with the provisions of KRS 45A.150, "Access to contractor's books, documents, papers, records, or other evidence directly pertinent to the contract." The Contractor, as defined in KRS 45A.030, agrees that the contracting agency, the

Finance and Administration Cabinet, the Auditor of Public Accounts, and the Legislative Research Commission, or their duly authorized representatives, shall have access to any books, documents, papers, records, or other evidence, which are directly pertinent to this agreement for the purpose of financial audit or program review. The Contractor also recognizes that any books, documents, papers, records, or other evidence, received during a financial audit or program review shall be subject to the Kentucky Open Records Act, KRS 61.870 to 61.884. Records and other prequalification information confidentially disclosed as part of the bid process shall not be deemed as directly pertinent to the agreement and shall be exempt from disclosure as provided in KRS 61.878(1)(c).

BOYCOTT PROVISIONS

If applicable, the contractor represents that, pursuant to [KRS 45A.607](#), they are not currently engaged in, and will not for the duration of the contract engage in, the boycott of a person or an entity based in or doing business with a jurisdiction with which Kentucky can enjoy open trade. **Note:** The term Boycott does not include actions taken for bona fide business or economic reasons, or actions specifically required by federal or state law.

If applicable, the contractor verifies that, pursuant to KRS 41.480, they do not engage in, and will not for the duration of the contract engage in, in energy company boycotts as defined by KRS 41.472.

LOBBYING PROHIBITIONS

The contractor represents that they, and any subcontractor performing work under the contract, have not violated the agency restrictions contained in [KRS 11A.236](#) during the previous ten (10) years, and pledges to abide by the restrictions set forth in such statute for the duration of the contract awarded.

The contractor further represents that, pursuant to [KRS 45A.328](#), they have not procured an original, subsequent, or similar contract while employing an executive agency lobbyist who was convicted of a crime related to the original, subsequent, or similar contract within five (5) years of the conviction of the lobbyist.

Revised: 1/1/2025

SPECIAL NOTE FOR RECIPROCAL PREFERENCE

RECIPROCAL PREFERENCE TO BE GIVEN BY PUBLIC AGENCIES TO RESIDENT BIDDERS

By reference, KRS 45A.490 to 45A.494 are incorporated herein and in compliance regarding the bidders residency. Bidders who want to claim resident bidder status should complete the Affidavit for Claiming Resident Bidder Status along with their bid in the electronic bidding software. Submittal of the Affidavit should be done along the bid in Bid Express.

April 30, 2018

SPECIFICATIONS AND CONTRACT DOCUMENTS

ROUGH RIVER STATE PARK AIRPORT (2I3)

KENTUCKY DEPARTMENT OF AVIATION

PAPI REPLACEMENT PROJECT

KDA Grant No. KY26-52
Garver Project No. 2600131

Prepared For:

KENTUCKY DEPARTMENT OF AVIATION

MAY 2026



Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport

PAPI Replacement

00 00 01 CERTIFICATIONS

PAPI REPLACEMENT GARVER PROJECT NO. 2600131	
I hereby certify that the applicable portions of this project plans and specifications were prepared by me or under my direct supervision and that I am a duly Licensed Engineer under the laws of the State of Kentucky.	
SEAL AND SIGNATURE	APPLICABLE DIVISION OR PROJECT RESPONSIBILITY
Dakota L. Ellis, P.E.  Digitally Signed 06/22/2026	Electrical Plans and Specifications

GARVER, LLC CERTIFICATE OF AUTHORIZATION:
KY ENGINEERING PERMIT NO. 1944 Expiration Date: December 31, 2027

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport

PAPI Replacement

00 01 10 TABLE OF CONTENTS

CONTRACT DOCUMENTS AND GENERAL REQUIREMENTS

	BIDDING REQUIREMENTS
00 00 01	CERTIFICATIONS
00 01 10	TABLE OF CONTENTS
	KENTUCKY TRANSPORTATION CABINET
DIV. 100	GENERAL PROVISIONS
	CONDITIONS OF THE CONTRACT
00 72 00	FAA GENERAL PROVISIONS
00 73 00	SPECIAL PROVISIONS
	SUPPLEMENTAL SPECIFICATIONS
SS-101	SAFETY PLAN COMPLIANCE DOCUMENT
SS-110	STANDARD SPECIFICATIONS
SS-120	CONSTRUCTION SAFETY AND SECURITY
SS-300	BASIC ELECTRICAL REQUIREMENTS
SS-301	ELECTRICAL DEMOLITION AND RELOCATION WORK
SS-310	AIRPORT LIGHTING SYSTEMS

PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

00 72 00 GENERAL PROVISIONS

SECTION 10 DEFINITION OF TERMS

In addition to the KYTC abbreviations and definitions listed in Section 101 of the KYTC Standard Specifications, whenever the following terms are used in the specifications, in the contract, or in any documents or other instruments pertaining to the contraction where these specifications govern, the intent and meaning shall be interpreted as follows:

When the following terms are used in these specifications, in the contract, or in any documents or other instruments pertaining to construction where these specifications govern, the intent and meaning shall be defined as follows:

Paragraph Number	Term	Definition
10-01	AASHTO	The American Association of State Highway and Transportation Officials.
10-02	Access Road	The right-of-way, the roadway and all improvements constructed thereon connecting the airport to a public roadway.
10-03	Advertisement	A public announcement, as required by local law, inviting bids for work to be performed and materials to be furnished.
10-03.01	Agreement	<i>The written instrument, executed by Owner and Contractor, that sets forth the Contract Price and Contract Times, identifies the parties and the Engineer, and designates the specific items that are Contract Documents. See also "Contract."</i>
10-04	Airport	Airport means an area of land or water which is used or intended to be used for the landing and takeoff of aircraft; an appurtenant area used or intended to be used for airport buildings or other airport facilities or rights of way; airport buildings and facilities located in any of these areas, and a heliport.
10-05	Airport Improvement Program (AIP)	A grant-in-aid program, administered by the Federal Aviation Administration (FAA).
10-06	Air Operations Area (AOA)	The term air operations area (AOA) shall mean any area of the airport used or intended to be used for the landing, takeoff, or surface maneuvering of aircraft. An air operation area shall include such paved or unpaved areas that are used or intended to be used for the unobstructed movement of aircraft in addition to its associated runway, taxiway, or apron.
10-07	Apron	Area where aircraft are parked, unloaded or loaded, fueled and/or serviced.
10-08	ASTM International (ASTM)	Formerly known as the American Society for Testing and Materials (ASTM).

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

Paragraph Number	Term	Definition
10-09	Award	The Owner's notice to the successful bidder of the acceptance of the submitted bid.
10-09.01	Bid	<i>The written offer of the Bidder (when submitted on the approved proposal form) to perform the contemplated work and furnish the necessary materials in accordance with the provisions of the plans and specifications. See also "Proposal."</i>
10-10	Bidder	Any individual, partnership, firm, or corporation, acting directly or through a duly authorized representative, who submits a proposal for the work contemplated.
10-10.01	Bidding Documents	<i>The Bidding Requirements, the proposed Contract Documents, and all Addenda.</i>
10-11	Building Area	An area on the airport to be used, considered, or intended to be used for airport buildings or other airport facilities or rights-of-way together with all airport buildings and facilities located thereon.
10-12	Calendar Day	Every day shown on the calendar.
10-13	Certificate of Analysis (COA)	The COA is the manufacturer's Certificate of Compliance (COC) including all applicable test results required by the specifications.
10-14	Certificate of Compliance (COC)	The manufacturer's certification stating that materials or assemblies furnished fully comply with the requirements of the contract. The certificate shall be signed by the manufacturer's authorized representative.
10-15	Change Order	A written order to the Contractor covering changes in the plans, specifications, or proposal quantities and establishing the basis of payment and contract time adjustment, if any, for work within the scope of the contract and necessary to complete the project.
10-16	Contract	A written agreement between the Owner and the Contractor that establishes the obligations of the parties including but not limited to performance of work, furnishing of labor, equipment and materials and the basis of payment. The awarded Contract includes but may not be limited to: Advertisement, Contract form, Proposal, Performance bond, Payment bond, General provisions, certifications and representations, Technical Specifications, Plans, Supplemental Provisions, standards incorporated by reference and issued addenda. <i>See also "Agreement."</i>
10-17	Contract Item (Pay Item)	A specific unit of work for which a price is provided in the contract.

Rough River State Park Airport

AC 150/5370-10H

PAPI Replacement

12/21/2018

Paragraph Number	Term	Definition
10-18	Contract Time	The number of calendar days or working days, stated in the proposal, allowed for completion of the contract, including authorized time extensions. If a calendar date of completion is stated in the proposal, in lieu of a number of calendar or working days, the contract shall be completed by that date.
10-19	Contractor	The individual, partnership, firm, or corporation primarily liable for the acceptable performance of the work contracted and for the payment of all legal debts pertaining to the work who acts directly or through lawful agents or employees to complete the contract work.
10-20	Contractors Quality Control (QC) Facilities	The Contractor's QC facilities in accordance with the Contractor Quality Control Program (CQCP).
10-21	Contractor Quality Control Program (CQCP)	Details the methods and procedures that will be taken to assure that all materials and completed construction required by the contract conform to contract plans, technical specifications and other requirements, whether manufactured by the Contractor, or procured from subcontractors or vendors.
10-22	Control Strip	A demonstration by the Contractor that the materials, equipment, and construction processes results in a product meeting the requirements of the specification.
10-23	Construction Safety and Phasing Plan (CSPP)	The overall plan for safety and phasing of a construction project developed by the airport operator, or developed by the airport operator's consultant and approved by the airport operator. It is included in the invitation for bids and becomes part of the project specifications.
10-24	Drainage System	The system of pipes, ditches, and structures by which surface or subsurface waters are collected and conducted from the airport area.
10-25	Engineer	The individual, partnership, firm, or corporation duly authorized by the Owner to be responsible for engineering, inspection, and/or observation of the contract work and acting directly or through an authorized representative.
10-26	Equipment	All machinery, together with the necessary supplies for upkeep and maintenance; and all tools and apparatus necessary for the proper construction and acceptable completion of the work.
10-27	Extra Work	An item of work not provided for in the awarded contract as previously modified by change order or supplemental agreement, but which is found by the Owner's Engineer or Resident Project Representative (RPR) to be necessary to complete the work within the intended scope of the contract as previously modified.

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

Paragraph Number	Term	Definition
10-28	FAA	The Federal Aviation Administration. When used to designate a person, FAA shall mean the Administrator or their duly authorized representative.
10-29	Federal Specifications	The federal specifications and standards, commercial item descriptions, and supplements, amendments, and indices prepared and issued by the General Services Administration.
10-30	Force Account	a. Contract Force Account - A method of payment that addresses extra work performed by the Contractor on a time and material basis. b. Owner Force Account - Work performed for the project by the Owner's employees.
10-30.01	Hazardous Environmental Condition	<i>The presence at the Site of Constituents of Concern in such quantities or circumstances that may present a danger to persons or property exposed thereto. The presence at the Site of materials that are necessary for the execution of the Work, or that are to be incorporated in the Work, and that are controlled and contained pursuant to industry practices, Laws and Regulations, and the requirements of the Contract, does not establish a Hazardous Environmental Condition.</i>
10-31	Intention of Terms	Whenever, in these specifications or on the plans, the words "directed," "required," "permitted," "ordered," "designated," "prescribed," or words of like import are used, it shall be understood that the direction, requirement, permission, order, designation, or prescription of the Engineer and/or Resident Project Representative (RPR) is intended; and similarly, the words "approved," "acceptable," "satisfactory," or words of like import, shall mean approved by, or acceptable to, or satisfactory to the Engineer and/or RPR, subject in each case to the final determination of the Owner. Any reference to a specific requirement of a numbered paragraph of the contract specifications or a cited standard shall be interpreted to include all general requirements of the entire section, specification item, or cited standard that may be pertinent to such specific reference.
10-32	Lighting	A system of fixtures providing or controlling the light sources used on or near the airport or within the airport buildings. The field lighting includes all luminous signals, markers, floodlights, and illuminating devices used on or near the airport or to aid in the operation of aircraft landing at, taking off from, or taxiing on the airport surface.
10-33	Major and Minor Contract Items	A major contract item shall be any item that is listed in the proposal, the total cost of which is equal to or greater than

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

Paragraph Number	Term	Definition
		20% of the total amount of the award contract. All other items shall be considered minor contract items.
10-34	Materials	Any substance specified for use in the construction of the contract work.
10-35	Modification of Standards (MOS)	Any deviation from standard specifications applicable to material and construction methods in accordance with FAA Order 5300.1.
10-36	Notice to Proceed (NTP)	A written notice to the Contractor to begin the actual contract work on a previously agreed to date. If applicable, the Notice to Proceed shall state the date on which the contract time begins.
10-37	Owner	The term "Owner" shall mean the party of the first part or the contracting agency signatory to the contract. Where the term "Owner" is capitalized in this document, it shall mean airport Sponsor only. The Owner for this project is Kentucky Department of Aviation .
10-38	Passenger Facility Charge (PFC)	Per 14 Code of Federal Regulations (CFR) Part 158 and 49 United States Code (USC) § 40117, a PFC is a charge imposed by a public agency on passengers enplaned at a commercial service airport it controls.
10-39	Pavement Structure	The combined surface course, base course(s), and subbase course(s), if any, considered as a single unit.
10-40	Payment bond	The approved form of security furnished by the Contractor and their own surety as a guaranty that the Contractor will pay in full all bills and accounts for materials and labor used in the construction of the work.
10-41	Performance bond	The approved form of security furnished by the Contractor and their own surety as a guaranty that the Contractor will complete the work in accordance with the terms of the contract.
10-42	Plans	The official drawings or exact reproductions which show the location, character, dimensions and details of the airport and the work to be done and which are to be considered as a part of the Contract, supplementary to the specifications. Plans may also be referred to as "contract drawings," or "drawings."
10-43	Project	The agreed scope of work for accomplishing specific airport development with respect to a particular airport.
10-44	Proposal	The written offer of the Bidder (when submitted on the approved proposal form) to perform the contemplated work and furnish the necessary materials in accordance with the provisions of the plans and specifications. <i>See also</i> "Bid."

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

Paragraph Number	Term	Definition
10-45	Proposal guaranty	The security furnished with a proposal to guarantee that the bidder will enter into a contract if their own proposal is accepted by the Owner.
10-46	Quality Assurance (QA)	Owner's responsibility to assure that construction work completed complies with specifications for payment.
10-47	Quality Control (QC)	Contractor's responsibility to control material(s) and construction processes to complete construction in accordance with project specifications.
10-48	Quality Assurance (QA) Inspector	An authorized representative of the Engineer and/or Resident Project Representative (RPR) assigned to make all necessary inspections, observations, tests, and/or observation of tests of the work performed or being performed, or of the materials furnished or being furnished by the Contractor.
10-49	Quality Assurance (QA) Laboratory	The official quality assurance testing laboratories of the Owner or such other laboratories as may be designated by the Engineer or RPR. May also be referred to as Engineer's, Owner's, or QA Laboratory.
10-50	Resident Project Representative (RPR)	The individual, partnership, firm, or corporation duly authorized by the Owner to be responsible for all necessary inspections, observations, tests, and/or observations of tests of the contract work performed or being performed, or of the materials furnished or being furnished by the Contractor, and acting directly or through an authorized representative.
10-51	Runway	The area on the airport prepared for the landing and takeoff of aircraft.
10-52	Runway Safety Area (RSA)	A defined surface surrounding the runway prepared or suitable for reducing the risk of damage to aircraft. See the construction safety and phasing plan (CSPP) for limits of the RSA.
10-53	Safety Plan Compliance Document (SPCD)	Details how the Contractor will comply with the CSPP.
10-54	Specifications	A part of the contract containing the written directions and requirements for completing the contract work. Standards for specifying materials or testing which are cited in the contract specifications by reference shall have the same force and effect as if included in the contract physically.
10-54.01	Site	<i>Has the meaning set forth in Section 4.01 of the Instructions to Bidders.</i>
10-55	Sponsor	A Sponsor is defined in 49 USC § 47102(24) as a public agency that submits to the FAA for an AIP grant; or a private

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

Paragraph Number	Term	Definition
		Owner of a public-use airport that submits to the FAA an application for an AIP grant for the airport.
10-56	Structures	Airport facilities such as bridges; culverts; catch basins, inlets, retaining walls, cribbing; storm and sanitary sewer lines; water lines; underdrains; electrical ducts, manholes, handholes, lighting fixtures and bases; transformers; navigational aids; buildings; vaults; and, other manmade features of the airport that may be encountered in the work and not otherwise classified herein.
10-57	Subgrade	The soil that forms the pavement foundation.
10-58	Superintendent	The Contractor's executive representative who is present on the work during progress, authorized to receive and fulfill instructions from the RPR, and who shall supervise and direct the construction.
10-59	Supplemental Agreement	A written agreement between the Contractor and the Owner that establishes the basis of payment and contract time adjustment, if any, for the work affected by the supplemental agreement. A supplemental agreement is required if: (1) in scope work would increase or decrease the total amount of the awarded contract by more than 25%; (2) in scope work would increase or decrease the total of any major contract item by more than 25%; (3) work that is not within the scope of the originally awarded contract; or (4) adding or deleting of a major contract item.
10-60	Surety	The corporation, partnership, or individual, other than the Contractor, executing payment or performance bonds that are furnished to the Owner by the Contractor.
10-61	Taxilane	A taxiway designed for low speed movement of aircraft between aircraft parking areas and terminal areas.
10-62	Taxiway	The portion of the air operations area of an airport that has been designated by competent airport authority for movement of aircraft to and from the airport's runways, aircraft parking areas, and terminal areas.
10-63	Taxiway/Taxilane Safety Area (TSA)	A defined surface alongside the taxiway prepared or suitable for reducing the risk of damage to an aircraft. See the construction safety and phasing plan (CSPP) for limits of the TSA.
10-63.01	Technical Data	<i>Those items expressly identified as Technical Data in the Special Provisions, with respect to either (a) subsurface conditions at the Site, or physical conditions relating to existing surface or subsurface structures at the Site (except Underground Facilities) or (b) Hazardous Environmental Conditions at the Site. If no such express identifications of Technical Data have been made with respect to conditions at the Site, then the data contained in boring logs, recorded</i>

Rough River State Park Airport

AC 150/5370-10H

PAPI Replacement

12/21/2018

Paragraph Number	Term	Definition
		<i>measurements of subsurface water levels, laboratory test results, and other factual, objective information regarding conditions at the Site that are set forth in any geotechnical or environmental report prepared for the Project and made available to Contractor are hereby defined as Technical Data with respect to conditions at the Site.</i>
10-63.02	Underground Facilities	All underground pipelines, conduits, ducts, cables, wires, manholes, vaults, tanks, tunnels, or other such facilities or attachments, and any encasements containing such facilities, including but not limited to those that convey electricity, gases, steam, liquid petroleum products, telephone or other communications, fiber optic transmissions, cable television, water, wastewater, storm water, other liquids or chemicals, or traffic or other control systems.
10-64	Work	The furnishing of all labor, materials, tools, equipment, and incidentals necessary or convenient to the Contractor's performance of all duties and obligations imposed by the contract, plans, and specifications.
10-65	Working day	A working day shall be any day other than a legal holiday, Saturday, or Sunday on which the normal working forces of the Contractor may proceed with regular work for at least six (6) hours toward completion of the contract. When work is suspended for causes beyond the Contractor's control, it will not be counted as a working day. Saturdays, Sundays and holidays on which the Contractor's forces engage in regular work will be considered as working days.
10-66	Owner Defined terms	None

END OF SECTION 10

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

SECTION 20 PROPOSAL REQUIREMENTS AND CONDITIONS

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in the KYTC Standard Specifications Section 102 "Bidding Requirements and Conditions."

20-01 Advertisement (Notice to Bidders). See *KYTC Bid Package*.

20-02 Qualification of bidders. See *KYTC Bid Package*. Each bidder shall submit evidence of competency and evidence of financial responsibility to perform the work to the Owner at the time of bid opening.

Evidence of competency, unless otherwise specified, shall consist of statements covering the bidder's past experience on similar work, and a list of equipment and a list of key personnel that would be available for the work.

~~Each bidder shall furnish the Owner satisfactory evidence of their financial responsibility. Evidence of financial responsibility, unless otherwise specified, shall consist of a confidential statement or report of the bidder's financial resources and liabilities as of the last calendar year or the bidder's last fiscal year. Such statements or reports shall be certified by a public accountant. At the time of submitting such financial statements or reports, the bidder shall further certify whether their financial responsibility is approximately the same as stated or reported by the public accountant. If the bidder's financial responsibility has changed, the bidder shall qualify the public accountant's statement or report to reflect the bidder's true financial condition at the time such qualified statement or report is submitted to the Owner.~~

~~Unless otherwise specified, a bidder may submit evidence that they are prequalified with the State Highway Division and are on the current "bidder's list" of the state in which the proposed work is located. Evidence of State Highway Division prequalification may be submitted as evidence of financial responsibility in lieu of the certified statements or reports specified above.~~

20-03 Contents of proposal forms. The Owner's *bidding documents* ~~proposal forms~~ state the location and description of the proposed construction; the place, date, and time of opening of the proposals; and the estimated quantities of the various items of work to be performed and materials to be furnished for which unit bid prices are asked. The proposal form states the time in which the work must be completed, and the amount of the proposal guaranty that must accompany the proposal. The Owner will accept only those Proposals properly executed on physical forms or electronic forms provided by the Owner. Bidder actions that may cause the Owner to deem a proposal irregular are given in paragraph 20-09 *Irregular proposals*.

Mobilization is limited to 10 percent of the total project cost.

20-04 Issuance of proposal forms. The Owner reserves the right to refuse to issue a proposal form to a prospective bidder if the bidder is in default for any of the following reasons:

- a. Failure to comply with any prequalification regulations of the Owner, if such regulations are cited, or otherwise included, in the proposal as a requirement for bidding.
- b. Failure to pay, or satisfactorily settle, all bills due for labor and materials on former contracts in force with the Owner at the time the Owner issues the proposal to a prospective bidder.
- c. Documented record of Contractor default under previous contracts with the Owner.
- d. Documented record of unsatisfactory work on previous contracts with the Owner.

20-05 Interpretation of estimated proposal quantities. An estimate of quantities of work to be done and materials to be furnished under these specifications is given in the proposal. It is the result of careful calculations and is believed to be correct. It is given only as a basis for comparison of proposals and the award of the contract. The Owner does not expressly, or by implication, agree that the actual quantities involved will correspond exactly therewith; nor shall the bidder plead misunderstanding or deception because of such estimates of quantities, or of the character, location, or other conditions pertaining to the work. Payment to the Contractor will be made only for the actual quantities of work performed or materials

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

furnished in accordance with the plans and specifications. It is understood that the quantities may be increased or decreased as provided in the Section 40, paragraph 40-02, Alteration of Work and Quantities, without in any way invalidating the unit bid prices.

20-06 Examination of plans, specifications, and site. The bidder is expected to carefully examine the site of the proposed work, the proposal, plans, specifications, and contract forms. Bidders shall satisfy themselves to the character, quality, and quantities of work to be performed, materials to be furnished, and to the requirements of the proposed contract. The submission of a proposal shall be prima facie evidence that the bidder has made such examination and is satisfied to the conditions to be encountered in performing the work and the requirements of the proposed contract, plans, and specifications.

Boring logs and other records of subsurface investigations and tests are available for inspection of bidders. It is understood and agreed that such subsurface information, whether included in the plans, specifications, or otherwise made available to the bidder, was obtained and is intended for the Owner's design and estimating purposes only. Such information has been made available for the convenience of all bidders. It is further understood and agreed that each bidder is solely responsible for all assumptions, deductions, or conclusions which the bidder may make or obtain from their own examination of the boring logs and other records of subsurface investigations and tests that are furnished by the Owner.

20-07 Preparation of proposal. ~~See KYTC Bid Package. The bidder shall submit their proposal on the forms furnished by the Owner. All blank spaces in the proposal forms, unless explicitly stated otherwise, must be correctly filled in where indicated for each and every item for which a quantity is given. If so requested, the bidder shall state the price (written in ink or typed) both in words and numerals which they propose for each pay item furnished in the proposal. In case of conflict between words and numerals, the words, unless obviously incorrect, shall govern.~~

~~The bidder shall correctly sign the proposal in ink. If the proposal is made by an individual, their name and post office address must be shown. If made by a partnership, the name and post office address of each member of the partnership must be shown. If made by a corporation, the person signing the proposal shall give the name of the state where the corporation was chartered and the name, titles, and business address of the president, secretary, and the treasurer. Anyone signing a proposal as an agent shall file evidence of their authority to do so and that the signature is binding upon the firm or corporation.~~

20-08 Responsive and responsible bidder. ~~See KYTC Bid Package.. A responsive bid conforms to all significant terms and conditions contained in the Owner's invitation for bid. It is the Owner's responsibility to decide if the exceptions taken by a bidder to the solicitation are material or not and the extent of deviation it is willing to accept.~~

~~A responsible bidder has the ability to perform successfully under the terms and conditions of a proposed procurement, as defined in 2 CFR § 200.318(h). This includes such matters as Contractor integrity, compliance with public policy, record of past performance, and financial and technical resources.~~

20-09 Irregular proposals. Proposals shall be considered irregular for the following reasons:

- a. If the proposal is on a form other than that furnished by the Owner, or if the Owner's form is altered, or if any part of the proposal form is detached.
- b. If there are unauthorized additions, conditional or alternate pay items, or irregularities of any kind that make the proposal incomplete, indefinite, or otherwise ambiguous.
- c. If the proposal does not contain a unit price for each pay item listed in the proposal, except in the case of authorized alternate pay items, for which the bidder is not required to furnish a unit price.
- d. If the proposal contains unit prices that are obviously unbalanced.
- e. If the proposal is not accompanied by the proposal guaranty specified by the Owner.
- f. If the applicable Disadvantaged Business Enterprise information is incomplete.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

The Owner reserves the right to reject any irregular proposal and the right to waive technicalities if such waiver is in the best interest of the Owner and conforms to local laws and ordinances pertaining to the letting of construction contracts.

20-10 Bid guarantee. Each separate proposal shall be accompanied by a bid bond, certified check, or other specified acceptable collateral, in the amount specified in the proposal form. Such bond, check, or collateral, shall be made payable to the Owner.

20-11 Delivery of proposal. *The proposals shall be submitted via the KYTC bid portal..* ~~Each proposal submitted shall be placed in a sealed envelope plainly marked with the project number, location of airport, and name and business address of the bidder on the outside. When sent by mail, preferably registered, the sealed proposal, marked as indicated above, should be enclosed in an additional envelope. No proposal will be considered unless received at the place specified in the advertisement or as modified by Addendum before the time specified for opening all bids. Proposals received after the bid opening time shall be returned to the bidder unopened.~~

20-12 Withdrawal or revision of proposals. *See KYTC Bid Package..* ~~A bidder may withdraw or revise (by withdrawal of one proposal and submission of another) a proposal provided that the bidder's request for withdrawal is received by the Owner [in writing] [by fax] [by email] before the time specified for opening bids. Revised proposals must be received at the place specified in the advertisement before the time specified for opening all bids.~~

20-13 Public opening of proposals. *KYTC Construction Procurement shall be responsible for the bid opening .* ~~Proposals shall be opened, and read, publicly at the time and place specified in the advertisement. Bidders, their authorized agents, and other interested persons are invited to attend. Proposals that have been withdrawn (by written or telegraphic request) or received after the time specified for opening bids shall be returned to the bidder unopened.~~

20-14 Disqualification of bidders. A bidder shall be considered disqualified for any of the following reasons:

a. Submitting more than one proposal from the same partnership, firm, or corporation under the same or different name.

b. Evidence of collusion among bidders. Bidders participating in such collusion shall be disqualified as bidders for any future work of the Owner until any such participating bidder has been reinstated by the Owner as a qualified bidder.

c. If the bidder is considered to be in "default" for any reason specified in paragraph 20-04, *Issuance of Proposal Forms*, of this section.

20-15 Discrepancies and Omissions. *See KYTC Bid Package..* ~~A Bidder who discovers discrepancies or omissions with the project bid documents shall immediately notify the Owner's Engineer of the matter. A bidder that has doubt as to the true meaning of a project requirement may submit to the Owner's Engineer a written request for interpretation no later than [] days prior to bid opening.~~

~~Any interpretation of the project bid documents by the Owner's Engineer will be by written addendum issued by the Owner. The Owner will not consider any instructions, clarifications or interpretations of the bidding documents in any manner other than written addendum.~~

END OF SECTION 20

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

**Rough River State Park Airport
PAPI Replacement**

**AC 150/5370-10H
12/21/2018**

SECTION 30 AWARD AND EXECUTION OF CONTRACT

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in the KYTC Standard Specifications Section 103 "Award and Execution of Contract."

30-01 Consideration of proposals. ~~See KYTC Bid Package.. After the proposals are publicly opened and read, they will be compared on the basis of the summation of the products obtained by multiplying the estimated quantities shown in the proposal by the unit bid prices. If a bidder's proposal contains a discrepancy between unit bid prices written in words and unit bid prices written in numbers, the unit bid price written in words shall govern.~~

Until the award of a contract is made, the Owner reserves the right to reject a bidder's proposal for any of the following reasons:

a. ~~If the proposal is irregular as specified in Section 20, paragraph 20-09, *Irregular Proposals*.~~

b. ~~If the bidder is disqualified for any of the reasons specified Section 20, paragraph 20-14, *Disqualification of Bidders*.~~

~~In addition, until the award of a contract is made, the Owner reserves the right to reject any or all proposals, waive technicalities, if such waiver is in the best interest of the Owner and is in conformance with applicable state and local laws or regulations pertaining to the letting of construction contracts; advertise for new proposals; or proceed with the work otherwise. All such actions shall promote the Owner's best interests.~~

30-02 Award of contract. ~~The award of a contract, if it is to be awarded, shall be in accordance with KYTC Section 103, unless otherwise specified herein. In accordance with Section 103.02 of the Standard Specifications for Road and Bridge Construction, the Department may hold and not award the contract for a period not to exceed sixty (60) calendar days from the date of letting. The award of a contract, if it is to be awarded, shall be made within [] calendar days of the date specified for publicly opening proposals, unless otherwise specified herein.~~

If the Owner elects to proceed with an award of contract, the Owner will make award to the responsible bidder whose bid, conforming with all the material terms and conditions of the bid documents, is the lowest in price.

30-03 Cancellation of award. The Owner reserves the right to cancel the award without liability to the bidder, except return of proposal guaranty, at any time before a contract has been fully executed by all parties and is approved by the Owner in accordance with paragraph 30-07 *Approval of Contract*.

30-04 Return of proposal guaranty. All proposal guaranties, except those of the two lowest bidders, will be returned immediately after the Owner has made a comparison of bids as specified in the paragraph 30-01, *Consideration of Proposals*. Proposal guaranties of the two lowest bidders will be retained by the Owner until such time as an award is made, at which time, the unsuccessful bidder's proposal guaranty will be returned. The successful bidder's proposal guaranty will be returned as soon as the Owner receives the contract bonds as specified in paragraph 30-05, *Requirements of Contract Bonds*.

30-05 Requirements of contract bonds. At the time of the execution of the contract, the successful bidder shall furnish the Owner a surety bond or bonds that have been fully executed by the bidder and the surety guaranteeing the performance of the work and the payment of all legal debts that may be incurred by reason of the Contractor's performance of the work. The surety and the form of the bond or bonds shall be acceptable to the Owner. Unless otherwise specified in this subsection, the surety bond or bonds shall be in a sum equal to the full amount of the contract.

30-06 Execution of contract. The successful bidder shall sign (execute) the necessary agreements for entering into the contract and return the signed contract to the Owner, along with the fully executed surety bond or bonds specified in paragraph 30-05, *Requirements of Contract Bonds*, of this section, within *the time specified in the proposal* ~~15 calendar days from the date mailed or otherwise delivered to the successful bidder.~~

Rough River State Park Airport

AC 150/5370-10H

PAPI Replacement

12/21/2018

30-07 Approval of contract. Upon receipt of the contract and contract bond or bonds that have been executed by the successful bidder, the Owner shall complete the execution of the contract in accordance with local laws or ordinances, and return the fully executed contract to the Contractor. Delivery of the fully executed contract to the Contractor shall constitute the Owner’s approval to be bound by the successful bidder’s proposal and the terms of the contract.

30-08 Failure to execute contract. Failure of the successful bidder to execute the contract and furnish an acceptable surety bond or bonds within the period specified in paragraph 30-06, *Execution of Contract*, of this section shall be just cause for cancellation of the award and forfeiture of the proposal guaranty, not as a penalty, but as liquidated damages to the Owner.

END OF SECTION 30

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

SECTION 40 SCOPE OF WORK

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in the KYTC Standard Specifications Section 104 "Scope of Work."

40-01 Intent of contract. The intent of the contract is to provide for construction and completion, in every detail, of the work described. It is further intended that the Contractor shall furnish all labor, materials, equipment, tools, transportation, and supplies required to complete the work in accordance with the plans, specifications, and terms of the contract.

40-02 Alteration of work and quantities. The Owner reserves the right to make such changes in quantities and work as may be necessary or desirable to complete, in a satisfactory manner, the original intended work. Unless otherwise specified in the Contract, the Owner's Engineer or RPR shall be and is hereby authorized to make, in writing, such in-scope alterations in the work and variation of quantities as may be necessary to complete the work, provided such action does not represent a significant change in the character of the work.

For purpose of this section, a significant change in character of work means: any change that is outside the current contract scope of work; any change (increase or decrease) in the total contract cost by more than 25%; or any change in the total cost of a major contract item by more than 25%.

Work alterations and quantity variances that do not meet the definition of significant change in character of work shall not invalidate the contract nor release the surety. Contractor agrees to accept payment for such work alterations and quantity variances in accordance with Section 90, paragraph 90-03, *Compensation for Altered Quantities*.

Should the value of altered work or quantity variance meet the criteria for significant change in character of work, such altered work and quantity variance shall be covered by a supplemental agreement. Supplemental agreements shall also require consent of the Contractor's surety and separate performance and payment bonds. If the Owner and the Contractor are unable to agree on a unit adjustment for any contract item that requires a supplemental agreement, the Owner reserves the right to terminate the contract with respect to the item and make other arrangements for its completion.

40-03 Omitted items. The Owner, the Owner's Engineer or the RPR may provide written notice to the Contractor to omit from the work any contract item that does not meet the definition of major contract item. Major contract items may be omitted by a supplemental agreement. Such omission of contract items shall not invalidate any other contract provision or requirement.

Should a contract item be omitted or otherwise ordered to be non-performed, the Contractor shall be paid for all work performed toward completion of such item prior to the date of the order to omit such item. Payment for work performed shall be in accordance with Section 90, paragraph 90-04, *Payment for Omitted Items*.

40-04 Extra work. Should acceptable completion of the contract require the Contractor to perform an item of work not provided for in the awarded contract as previously modified by change order or supplemental agreement, Owner may issue a Change Order to cover the necessary extra work. Change orders for extra work shall contain agreed unit prices for performing the change order work in accordance with the requirements specified in the order, and shall contain any adjustment to the contract time that, in the RPR's opinion, is necessary for completion of the extra work.

When determined by the RPR to be in the Owner's best interest, the RPR may order the Contractor to proceed with extra work as provided in Section 90, paragraph 90-05, *Payment for Extra Work*. Extra work that is necessary for acceptable completion of the project, but is not within the general scope of the work covered by the original contract shall be covered by a supplemental agreement as defined in Section 10, paragraph 10-59, *Supplemental Agreement*.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

If extra work is essential to maintaining the project critical path, RPR may order the Contractor to commence the extra work under a Time and Material contract method. Once sufficient detail is available to establish the level of effort necessary for the extra work, the Owner shall initiate a change order or supplemental agreement to cover the extra work.

Any claim for payment of extra work that is not covered by written agreement (change order or supplemental agreement) shall be rejected by the Owner.

40-05 Maintenance of traffic. It is the explicit intention of the contract that the safety of aircraft, as well as the Contractor's equipment and personnel, is the most important consideration. The Contractor shall maintain traffic in the manner detailed in the Construction Safety and Phasing Plan (CSPP).

a. It is understood and agreed that the Contractor shall provide for the free and unobstructed movement of aircraft in the air operations areas (AOAs) of the airport with respect to their own operations and the operations of all subcontractors as specified in Section 80, paragraph 80-04, *Limitation of Operations*. It is further understood and agreed that the Contractor shall provide for the uninterrupted operation of visual and electronic signals (including power supplies thereto) used in the guidance of aircraft while operating to, from, and upon the airport as specified in Section 70, paragraph 70-15, *Contractor's Responsibility for Utility Service and Facilities of Others*.

b. With respect to their own operations and the operations of all subcontractors, the Contractor shall provide marking, lighting, and other acceptable means of identifying personnel, equipment, vehicles, storage areas, and any work area or condition that may be hazardous to the operation of aircraft, fire-rescue equipment, or maintenance vehicles at the airport in accordance with the construction safety and phasing plan (CSPP) and the safety plan compliance document (SPCD).

c. When the contract requires the maintenance of an existing road, street, or highway during the Contractor's performance of work that is otherwise provided for in the contract, plans, and specifications, the Contractor shall keep the road, street, or highway open to all traffic and shall provide maintenance as may be required to accommodate traffic. The Contractor, at their expense, shall be responsible for the repair to equal or better than preconstruction conditions of any damage caused by the Contractor's equipment and personnel. The Contractor shall furnish, erect, and maintain barricades, warning signs, flag person, and other traffic control devices in reasonable conformity with the Manual on Uniform Traffic Control Devices (MUTCD) (<http://mutcd.fhwa.dot.gov/>), unless otherwise specified. The Contractor shall also construct and maintain in a safe condition any temporary connections necessary for ingress to and egress from abutting property or intersecting roads, streets or highways. Unless otherwise specified herein, the Contractor will not be required to furnish snow removal for such existing road, street, or highway.

40-06 Removal of existing structures. All existing structures encountered within the established lines, grades, or grading sections shall be removed by the Contractor, unless such existing structures are otherwise specified to be relocated, adjusted up or down, salvaged, abandoned in place, reused in the work or to remain in place. The cost of removing such existing structures shall not be measured or paid for directly, but shall be included in the various contract items.

Should the Contractor encounter an existing structure (above or below ground) in the work for which the disposition is not indicated on the plans, the Resident Project Representative (RPR) shall be notified prior to disturbing such structure. The disposition of existing structures so encountered shall be immediately determined by the RPR in accordance with the provisions of the contract.

Except as provided in Section 40, paragraph 40-07, *Rights in and Use of Materials Found in the Work*, it is intended that all existing materials or structures that may be encountered (within the lines, grades, or grading sections established for completion of the work) shall be used in the work as otherwise provided for in the contract and shall remain the property of the Owner when so used in the work.

40-07 Rights in and use of materials found in the work. Should the Contractor encounter any material such as (but not restricted to) sand, stone, gravel, slag, or concrete slabs within the established lines,

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

grades, or grading sections, the use of which is intended by the terms of the contract to be embankment, the Contractor may at their own option either:

- a. Use such material in another contract item, providing such use is approved by the RPR and is in conformance with the contract specifications applicable to such use; or,
- b. Remove such material from the site, upon written approval of the RPR; or
- c. Use such material for the Contractor's own temporary construction on site; or,
- d. Use such material as intended by the terms of the contract.

Should the Contractor wish to exercise option a., b., or c., the Contractor shall request the RPR's approval in advance of such use.

Should the RPR approve the Contractor's request to exercise option a., b., or c., the Contractor shall be paid for the excavation or removal of such material at the applicable contract price. The Contractor shall replace, at their expense, such removed or excavated material with an agreed equal volume of material that is acceptable for use in constructing embankment, backfills, or otherwise to the extent that such replacement material is needed to complete the contract work. The Contractor shall not be charged for use of such material used in the work or removed from the site.

Should the RPR approve the Contractor's exercise of option a., the Contractor shall be paid, at the applicable contract price, for furnishing and installing such material in accordance with requirements of the contract item in which the material is used.

It is understood and agreed that the Contractor shall make no claim for delays by reason of their own exercise of option a., b., or c.

The Contractor shall not excavate, remove, or otherwise disturb any material, structure, or part of a structure which is located outside the lines, grades, or grading sections established for the work, except where such excavation or removal is provided for in the contract, plans, or specifications.

40-08 Final cleanup. Upon completion of the work and before acceptance and final payment will be made, the Contractor shall remove from the site all machinery, equipment, surplus and discarded materials, rubbish, temporary structures, and stumps or portions of trees. The Contractor shall cut all brush and woods within the limits indicated and shall leave the site in a neat and presentable condition. Material cleared from the site and deposited on adjacent property will not be considered as having been disposed of satisfactorily, unless the Contractor has obtained the written permission of the property Owner.

END OF SECTION 40

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

SECTION 50 CONTROL OF WORK

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in the KYTC Standard Specifications Section 105 "Control of Work."

50-01 Authority of the Resident Project Representative (RPR). The RPR has final authority regarding the interpretation of project specification requirements. The RPR shall determine acceptability of the quality of materials furnished, method of performance of work performed, and the manner and rate of performance of the work. The RPR does not have the authority to accept work that does not conform to specification requirements.

50-02 Conformity with plans and specifications. All work and all materials furnished shall be in reasonably close conformity with the lines, grades, grading sections, cross-sections, dimensions, material requirements, and testing requirements that are specified (including specified tolerances) in the contract, plans, or specifications.

If the RPR finds the materials furnished, work performed, or the finished product not within reasonably close conformity with the plans and specifications, but that the portion of the work affected will, in their opinion, result in a finished product having a level of safety, economy, durability, and workmanship acceptable to the Owner, the RPR will advise the Owner of their determination that the affected work be accepted and remain in place. The RPR will document the determination and recommend to the Owner a basis of acceptance that will provide for an adjustment in the contract price for the affected portion of the work. Changes in the contract price must be covered by contract change order or supplemental agreement as applicable.

If the RPR finds the materials furnished, work performed, or the finished product are not in reasonably close conformity with the plans and specifications and have resulted in an unacceptable finished product, the affected work or materials shall be removed and replaced or otherwise corrected by and at the expense of the Contractor in accordance with the RPR's written orders.

The term "reasonably close conformity" shall not be construed as waiving the Contractor's responsibility to complete the work in accordance with the contract, plans, and specifications. The term shall not be construed as waiving the RPR's responsibility to insist on strict compliance with the requirements of the contract, plans, and specifications during the Contractor's execution of the work, when, in the RPR's opinion, such compliance is essential to provide an acceptable finished portion of the work.

The term "reasonably close conformity" is also intended to provide the RPR with the authority, after consultation with the Sponsor and FAA, to use sound engineering judgment in their determinations to accept work that is not in strict conformity, but will provide a finished product equal to or better than that required by the requirements of the contract, plans and specifications.

The RPR will not be responsible for the Contractor's means, methods, techniques, sequences, or procedures of construction or the safety precautions incident thereto.

50-03 Coordination of contract, plans, and specifications. The contract, plans, specifications, and all referenced standards cited are essential parts of the contract requirements. If electronic files are provided and used on the project and there is a conflict between the electronic files and hard copy plans, the hard copy plans shall govern. A requirement occurring in one is as binding as though occurring in all. They are intended to be complementary and to describe and provide for a complete work. In case of discrepancy, calculated dimensions will govern over scaled dimensions; contract technical specifications shall govern over contract general provisions, plans, cited standards for materials or testing, and cited advisory circulars (ACs); contract general provisions shall govern over plans, cited standards for materials or testing, and cited ACs; plans shall govern over cited standards for materials or testing and cited ACs. If any paragraphs contained in the Special Provisions conflict with General Provisions or Technical Specifications, the Special Provisions shall govern.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

From time to time, discrepancies within cited testing standards occur due to the timing of the change, edits, and/or replacement of the standards. If the Contractor discovers any apparent discrepancy within standard test methods, the Contractor shall immediately ask the RPR for an interpretation and decision, and such decision shall be final.

The Contractor shall not take advantage of any apparent error or omission on the plans or specifications. In the event the Contractor discovers any apparent error or discrepancy, Contractor shall immediately notify the Owner or the designated representative in writing requesting their written interpretation and decision.

50-04 List of Special Provisions. See Special Provisions (Section 00 73 00)

50-05 Cooperation of Contractor. The Contractor shall be supplied with three hard copies or an electronic PDF of the plans and specifications. The Contractor shall have available on the construction site at all times one hardcopy each of the plans and specifications. Additional hard copies of plans and specifications may be obtained by the Contractor for the cost of reproduction.

The Contractor shall give constant attention to the work to facilitate the progress thereof, and shall cooperate with the RPR and their inspectors and with other Contractors in every way possible. The Contractor shall have a competent superintendent on the work at all times who is fully authorized as their agent on the work. The superintendent shall be capable of reading and thoroughly understanding the plans and specifications and shall receive and fulfill instructions from the RPR or their authorized representative.

50-06 Cooperation between Contractors. The Owner reserves the right to contract for and perform other or additional work on or near the work covered by this contract.

When separate contracts are let within the limits of any one project, each Contractor shall conduct the work not to interfere with or hinder the progress of completion of the work being performed by other Contractors. Contractors working on the same project shall cooperate with each other as directed.

Each Contractor involved shall assume all liability, financial or otherwise, in connection with their own contract and shall protect and hold harmless the Owner from any and all damages or claims that may arise because of inconvenience, delays, or loss experienced because of the presence and operations of other Contractors working within the limits of the same project.

The Contractor shall arrange their work and shall place and dispose of the materials being used to not interfere with the operations of the other Contractors within the limits of the same project. The Contractor shall join their work with that of the others in an acceptable manner and shall perform it in proper sequence to that of the others.

50-07 Construction layout and stakes. The Engineer/RPR shall establish necessary horizontal and vertical control. The establishment of Survey Control and/or reestablishment of survey control shall be by a State Licensed Land Surveyor. Contractor is responsible for preserving integrity of horizontal and vertical controls established by Engineer/RPR. In case of negligence on the part of the Contractor or their employees, resulting in the destruction of any horizontal and vertical control, the resulting costs will be deducted as a liquidated damage against the Contractor.

Prior to the start of construction, the Contractor will check all control points for horizontal and vertical accuracy and certify in writing to the RPR that the Contractor concurs with survey control established for the project. All lines, grades and measurements from control points necessary for the proper execution and control of the work on this project will be provided to the RPR. The Contractor is responsible to establish all layout required for the construction of the project.

Copies of survey notes will be provided to the RPR for each area of construction and for each placement of material as specified to allow the RPR to make periodic checks for conformance with plan grades, alignments and grade tolerances required by the applicable material specifications. Surveys will be provided to the RPR prior to commencing work items that cover or disturb the survey staking. Survey(s) and notes shall be provided in the following format(s): AutoCAD Civil 3D.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

Laser, GPS, String line, or other automatic control shall be checked with temporary control as necessary. In the case of error, on the part of the Contractor, their surveyor, employees or subcontractors, resulting in established grades, alignment or grade tolerances that do not concur with those specified or shown on the plans, the Contractor is solely responsible for correction, removal, replacement and all associated costs at no additional cost to the Owner.

No direct payment will be made, unless otherwise specified in contract documents, for this labor, materials, or other expenses. The cost shall be included in the price of the bid for the various items of the Contract.

50-08 Authority and duties of Quality Assurance (QA) inspectors. QA inspectors shall be authorized to inspect all work done and all material furnished. Such QA inspection may extend to all or any part of the work and to the preparation, fabrication, or manufacture of the materials to be used. QA inspectors are not authorized to revoke, alter, or waive any provision of the contract. QA inspectors are not authorized to issue instructions contrary to the plans and specifications or to act as foreman for the Contractor.

QA Inspectors are authorized to notify the Contractor or their representatives of any failure of the work or materials to conform to the requirements of the contract, plans, or specifications and to reject such nonconforming materials in question until such issues can be referred to the RPR for a decision.

50-09 Inspection of the work. All materials and each part or detail of the work shall be subject to inspection. The RPR shall be allowed access to all parts of the work and shall be furnished with such information and assistance by the Contractor as is required to make a complete and detailed inspection.

If the RPR requests it, the Contractor, at any time before acceptance of the work, shall remove or uncover such portions of the finished work as may be directed. After examination, the Contractor shall restore said portions of the work to the standard required by the specifications. Should the work thus exposed or examined prove acceptable, the uncovering, or removing, and the replacing of the covering or making good of the parts removed will be paid for as extra work; but should the work so exposed or examined prove unacceptable, the uncovering, or removing, and the replacing of the covering or making good of the parts removed will be at the Contractor's expense.

Provide advance written notice to the RPR of work the Contractor plans to perform each week and each day. Any work done or materials used without written notice and allowing opportunity for inspection by the RPR may be ordered removed and replaced at the Contractor's expense.

Should the contract work include relocation, adjustment, or any other modification to existing facilities, not the property of the (contract) Owner, authorized representatives of the Owners of such facilities shall have the right to inspect such work. Such inspection shall in no sense make any facility owner a party to the contract, and shall in no way interfere with the rights of the parties to this contract.

50-10 Removal of unacceptable and unauthorized work. All work that does not conform to the requirements of the contract, plans, and specifications will be considered unacceptable, unless otherwise determined acceptable by the RPR as provided in paragraph 50-02, *Conformity with Plans and Specifications*.

Unacceptable work, whether the result of poor workmanship, use of defective materials, damage through carelessness, or any other cause found to exist prior to the final acceptance of the work, shall be removed immediately and replaced in an acceptable manner in accordance with the provisions of Section 70, paragraph 70-14, *Contractor's Responsibility for Work*.

No removal work made under provision of this paragraph shall be done without lines and grades having been established by the RPR. Work done contrary to the instructions of the RPR, work done beyond the lines shown on the plans or as established by the RPR, except as herein specified, or any extra work done without authority, will be considered as unauthorized and will not be paid for under the provisions of the contract. Work so done may be ordered removed or replaced at the Contractor's expense.

Upon failure on the part of the Contractor to comply with any order of the RPR made under the provisions of this subsection, the RPR will have authority to cause unacceptable work to be remedied or removed and

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

replaced; and unauthorized work to be removed and recover the resulting costs as a liquidated damage against the Contractor.

50-11 Load restrictions. The Contractor shall comply with all legal load restrictions in the hauling of materials on public roads beyond the limits of the work. A special permit will not relieve the Contractor of liability for damage that may result from the moving of material or equipment.

The operation of equipment of such weight or so loaded as to cause damage to structures or to any other type of construction will not be permitted. Hauling of materials over the base course or surface course under construction shall be limited as directed. No loads will be permitted on a concrete pavement, base, or structure before the expiration of the curing period. The Contractor, at their own expense, shall be responsible for the repair to equal or better than preconstruction conditions of any damage caused by the Contractor's equipment and personnel.

50-12 Maintenance during construction. The Contractor shall maintain the work during construction and until the work is accepted. Maintenance shall constitute continuous and effective work prosecuted day by day, with adequate equipment and forces so that the work is maintained in satisfactory condition at all times.

In the case of a contract for the placing of a course upon a course or subgrade previously constructed, the Contractor shall maintain the previous course or subgrade during all construction operations.

All costs of maintenance work during construction and before the project is accepted shall be included in the unit prices bid on the various contract items, and the Contractor will not be paid an additional amount for such work.

50-13 Failure to maintain the work. Should the Contractor at any time fail to maintain the work as provided in paragraph 50-12, *Maintenance during Construction*, the RPR shall immediately notify the Contractor of such noncompliance. Such notification shall specify a reasonable time within which the Contractor shall be required to remedy such unsatisfactory maintenance condition. The time specified will give due consideration to the exigency that exists.

Should the Contractor fail to respond to the RPR's notification, the Owner may suspend any work necessary for the Owner to correct such unsatisfactory maintenance condition, depending on the exigency that exists. Any maintenance cost incurred by the Owner, shall be recovered as a liquidated damage against the Contractor.

50-14 Partial acceptance. If at any time during the execution of the project the Contractor substantially completes a usable unit or portion of the work, the occupancy of which will benefit the Owner, the Contractor may request the RPR to make final inspection of that unit. If the RPR finds upon inspection that the unit has been satisfactorily completed in compliance with the contract, the RPR may accept it as being complete, and the Contractor may be relieved of further responsibility for that unit. Such partial acceptance and beneficial occupancy by the Owner shall not void or alter any provision of the contract.

50-15 Final acceptance. Upon due notice from the Contractor of presumptive completion of the entire project, the RPR and Owner will make an inspection. If all construction provided for and contemplated by the contract is found to be complete in accordance with the contract, plans, and specifications, such inspection shall constitute the final inspection. The RPR shall notify the Contractor in writing of final acceptance as of the date of the final inspection.

If, however, the inspection discloses any work, in whole or in part, as being unsatisfactory, the RPR will notify the Contractor and the Contractor shall correct the unsatisfactory work. Upon correction of the work, another inspection will be made which shall constitute the final inspection, provided the work has been satisfactorily completed. In such event, the RPR will make the final acceptance and notify the Contractor in writing of this acceptance as of the date of final inspection.

50-16 Claims for adjustment and disputes. If for any reason the Contractor deems that additional compensation is due for work or materials not clearly provided for in the contract, plans, or specifications or previously authorized as extra work, the Contractor shall notify the RPR in writing of their intention to

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

claim such additional compensation before the Contractor begins the work on which the Contractor bases the claim. If such notification is not given or the RPR is not afforded proper opportunity by the Contractor for keeping strict account of actual cost as required, then the Contractor hereby agrees to waive any claim for such additional compensation. Such notice by the Contractor and the fact that the RPR has kept account of the cost of the work shall not in any way be construed as proving or substantiating the validity of the claim. When the work on which the claim for additional compensation is based has been completed, the Contractor shall, within 10 calendar days, submit a written claim to the RPR who will present it to the Owner for consideration in accordance with local laws or ordinances.

Nothing in this subsection shall be construed as a waiver of the Contractor's right to dispute final payment based on differences in measurements or computations.

END OF SECTION 50

Rough River State Park Airport

PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

SECTION 60 CONTROL OF MATERIALS

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in KYTC Standard Specifications Section 106 "Control of Materials."

60-01 Source of supply and quality requirements. The materials used in the work shall conform to the requirements of the contract, plans, and specifications. Unless otherwise specified, such materials that are manufactured or processed shall be new (as compared to used or reprocessed).

In order to expedite the inspection and testing of materials, the Contractor shall furnish documentation to the RPR as to the origin, composition, and manufacture of all materials to be used in the work. Documentation shall be furnished promptly after execution of the contract but, in all cases, prior to delivery of such materials.

At the RPR's option, materials may be approved at the source of supply before delivery. If it is found after trial that sources of supply for previously approved materials do not produce specified products, the Contractor shall furnish materials from other sources.

The Contractor shall furnish airport lighting equipment that meets the requirements of the specifications; and is listed in AC 150/5345-53, *Airport Lighting Equipment Certification Program and Addendum*, that is in effect on the date of advertisement.

60-02 Samples, tests, and cited specifications. All materials used in the work shall be inspected, tested, and approved by the RPR before incorporation in the work unless otherwise designated. Any work in which untested materials are used without approval or written permission of the RPR shall be performed at the Contractor's risk. Materials found to be unacceptable and unauthorized will not be paid for and, if directed by the RPR, shall be removed at the Contractor's expense.

Unless otherwise designated, quality assurance tests will be made by and at the expense of the Owner in accordance with the cited standard methods of ASTM, American Association of State Highway and Transportation Officials (AASHTO), federal specifications, Commercial Item Descriptions, and all other cited methods, which are current on the date of advertisement for bids.

The testing organizations performing on-site quality assurance field tests shall have copies of all referenced standards on the construction site for use by all technicians and other personnel. Unless otherwise designated, samples for quality assurance will be taken by a qualified representative of the RPR. All materials being used are subject to inspection, test, or rejection at any time prior to or during incorporation into the work. Copies of all tests will be furnished to the Contractor's representative at their request after review and approval of the RPR.

A copy of all Contractor QC test data shall be provided to the RPR daily, along with printed reports, in an approved format, on a weekly basis. After completion of the project, and prior to final payment, the Contractor shall submit a final report to the RPR showing all test data reports, plus an analysis of all results showing ranges, averages, and corrective action taken on all failing tests.

The Contractor shall employ a Quality Control (QC) testing organization to perform all Contractor required QC tests in accordance with Item C-100 Contractor Quality Control Program (CQCP).

60-03 Certification of compliance/analysis (COC/COA). The RPR may permit the use, prior to sampling and testing, of certain materials or assemblies when accompanied by manufacturer's COC stating that such materials or assemblies fully comply with the requirements of the contract. The certificate shall be signed by the manufacturer. Each lot of such materials or assemblies delivered to the work must be accompanied by a certificate of compliance in which the lot is clearly identified. The COA is the manufacturer's COC and includes all applicable test results.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

Materials or assemblies used on the basis of certificates of compliance may be sampled and tested at any time and if found not to be in conformity with contract requirements will be subject to rejection whether in place or not.

The form and distribution of certificates of compliance shall be as approved by the RPR.

When a material or assembly is specified by "brand name or equal" and the Contractor elects to furnish the specified "or equal," the Contractor shall be required to furnish the manufacturer's certificate of compliance for each lot of such material or assembly delivered to the work. Such certificate of compliance shall clearly identify each lot delivered and shall certify as to:

- a. Conformance to the specified performance, testing, quality or dimensional requirements; and,
- b. Suitability of the material or assembly for the use intended in the contract work.

The RPR shall be the sole judge as to whether the proposed "or equal" is suitable for use in the work.

The RPR reserves the right to refuse permission for use of materials or assemblies on the basis of certificates of compliance.

60-04 Plant inspection. The RPR or their authorized representative may inspect, at its source, any specified material or assembly to be used in the work. Manufacturing plants may be inspected from time to time for the purpose of determining compliance with specified manufacturing methods or materials to be used in the work and to obtain samples required for acceptance of the material or assembly.

Should the RPR conduct plant inspections, the following conditions shall exist:

- a. The RPR shall have the cooperation and assistance of the Contractor and the producer with whom the Contractor has contracted for materials.
- b. The RPR shall have full entry at all reasonable times to such parts of the plant that concern the manufacture or production of the materials being furnished.
- c. If required by the RPR, the Contractor shall arrange for adequate office or working space that may be reasonably needed for conducting plant inspections. Place office or working space in a convenient location with respect to the plant.

It is understood and agreed that the Owner shall have the right to retest any material that has been tested and approved at the source of supply after it has been delivered to the site. The RPR shall have the right to reject only material which, when retested, does not meet the requirements of the contract, plans, or specifications.

60-05 Engineer/ Resident Project Representative (RPR) field office. An Engineer/RPR field office is not required.

60-06 Storage of materials. Materials shall be stored to assure the preservation of their quality and fitness for the work. Stored materials, even though approved before storage, may again be inspected prior to their use in the work. Stored materials shall be located to facilitate their prompt inspection. The Contractor shall coordinate the storage of all materials with the RPR. Materials to be stored on airport property shall not create an obstruction to air navigation nor shall they interfere with the free and unobstructed movement of aircraft. Unless otherwise shown on the plans and/or CSPP, the storage of materials and the location of the Contractor's plant and parked equipment or vehicles shall be as directed by the RPR. Private property shall not be used for storage purposes without written permission of the Owner or lessee of such property. The Contractor shall make all arrangements and bear all expenses for the storage of materials on private property. Upon request, the Contractor shall furnish the RPR a copy of the property Owner's permission.

All storage sites on private or airport property shall be restored to their original condition by the Contractor at their expense, except as otherwise agreed to (in writing) by the Owner or lessee of the property.

Rough River State Park Airport

AC 150/5370-10H

PAPI Replacement

12/21/2018

60-07 Unacceptable materials. Any material or assembly that does not conform to the requirements of the contract, plans, or specifications shall be considered unacceptable and shall be rejected. The Contractor shall remove any rejected material or assembly from the site of the work, unless otherwise instructed by the RPR.

Rejected material or assembly, the defects of which have been corrected by the Contractor, shall not be returned to the site of the work until such time as the RPR has approved its use in the work.

60-08 Owner furnished materials. The Contractor shall furnish all materials required to complete the work, except those specified, if any, to be furnished by the Owner. Owner-furnished materials shall be made available to the Contractor at the location specified.

All costs of handling, transportation from the specified location to the site of work, storage, and installing Owner-furnished materials shall be included in the unit price bid for the contract item in which such Owner-furnished material is used.

After any Owner-furnished material has been delivered to the location specified, the Contractor shall be responsible for any demurrage, damage, loss, or other deficiencies that may occur during the Contractor's handling, storage, or use of such Owner-furnished material. The Owner will deduct from any monies due or to become due the Contractor any cost incurred by the Owner in making good such loss due to the Contractor's handling, storage, or use of Owner-furnished materials.

END OF SECTION 60

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

SECTION 70 LEGAL REGULATIONS AND RESPONSIBILITY TO PUBLIC

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in the KYTC Standard Specifications Section 107 "Legal Relations and Responsibilities to Public."

70-01 Laws to be observed. The Contractor shall keep fully informed of all federal and state laws, all local laws, ordinances, and regulations and all orders and decrees of bodies or tribunals having any jurisdiction or authority, which in any manner affect those engaged or employed on the work, or which in any way affect the conduct of the work. The Contractor shall at all times observe and comply with all such laws, ordinances, regulations, orders, and decrees; and shall protect and indemnify the Owner and all their officers, agents, or servants against any claim or liability arising from or based on the violation of any such law, ordinance, regulation, order, or decree, whether by the Contractor or the Contractor's employees.

70-02 Permits, licenses, and taxes. The Contractor shall procure all permits and licenses, pay all charges, fees, and taxes, and give all notices necessary and incidental to the due and lawful execution of the work.

70-03 Patented devices, materials, and processes. If the Contractor is required or desires to use any design, device, material, or process covered by letters of patent or copyright, the Contractor shall provide for such use by suitable legal agreement with the Patentee or Owner. The Contractor and the surety shall indemnify and hold harmless the Owner, any third party, or political subdivision from any and all claims for infringement by reason of the use of any such patented design, device, material or process, or any trademark or copyright, and shall indemnify the Owner for any costs, expenses, and damages which it may be obliged to pay by reason of an infringement, at any time during the execution or after the completion of the work.

70-04 Restoration of surfaces disturbed by others. The Owner reserves the right to authorize the construction, reconstruction, or maintenance of any public or private utility service, FAA or National Oceanic and Atmospheric Administration (NOAA) facility, or a utility service of another government agency at any time during the progress of the work. To the extent that such construction, reconstruction, or maintenance has been coordinated with the Owner, such authorized work (by others) must be shown on the plans and is indicated as follows:

Except as listed above, the Contractor shall not permit any individual, firm, or corporation to excavate or otherwise disturb such utility services or facilities located within the limits of the work without the written permission of the RPR.

Should the Owner of public or private utility service, FAA, or NOAA facility, or a utility service of another government agency be authorized to construct, reconstruct, or maintain such utility service or facility during the progress of the work, the Contractor shall cooperate with such Owners by arranging and performing the work in this contract to facilitate such construction, reconstruction or maintenance by others whether or not such work by others is listed above. When ordered as extra work by the RPR, the Contractor shall make all necessary repairs to the work which are due to such authorized work by others, unless otherwise provided for in the contract, plans, or specifications. It is understood and agreed that the Contractor shall not be entitled to make any claim for damages due to such authorized work by others or for any delay to the work resulting from such authorized work.

70-05 Federal Participation. The United States Government has agreed to reimburse the Owner for some portion of the contract costs. The contract work is subject to the inspection and approval of duly authorized representatives of the FAA Administrator. No requirement of this contract shall be construed as making the United States a party to the contract nor will any such requirement interfere, in any way, with the rights of either party to the contract.

70-06 Sanitary, health, and safety provisions. The Contractor's worksite and facilities shall comply with applicable federal, state, and local requirements for health, safety and sanitary provisions.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

70-07 Public convenience and safety. The Contractor shall control their operations and those of their subcontractors and all suppliers, to assure the least inconvenience to the traveling public. Under all circumstances, safety shall be the most important consideration.

The Contractor shall maintain the free and unobstructed movement of aircraft and vehicular traffic with respect to their own operations and those of their own subcontractors and all suppliers in accordance with Section 40, paragraph 40-05, *Maintenance of Traffic*, and shall limit such operations for the convenience and safety of the traveling public as specified in Section 80, paragraph 80-04, *Limitation of Operations*.

The Contractor shall remove or control debris and rubbish resulting from its work operations at frequent intervals, and upon the order of the RPR. If the RPR determines the existence of Contractor debris in the work site represents a hazard to airport operations and the Contractor is unable to respond in a prompt and reasonable manner, the RPR reserves the right to assign the task of debris removal to a third party and recover the resulting costs as a liquidated damage against the Contractor.

70-08 Construction Safety and Phasing Plan (CSPP). The Contractor shall complete the work in accordance with the approved Construction Safety and Phasing Plan (CSPP) developed in accordance with AC 150/5370-2, Operational Safety on Airports During Construction. The CSPP is *in* the project plans.

70-09 Use of explosives. The use of explosives is not permitted on this project.

70-10 Protection and restoration of property and landscape. The Contractor shall be responsible for the preservation of all public and private property, and shall protect carefully from disturbance or damage all land monuments and property markers until the Engineer/RPR has witnessed or otherwise referenced their location and shall not move them until directed.

The Contractor shall be responsible for all damage or injury to property of any character, during the execution of the work, resulting from any act, omission, neglect, or misconduct in manner or method of executing the work, or at any time due to defective work or materials, and said responsibility shall not be released until the project has been completed and accepted.

When or where any direct or indirect damage or injury is done to public or private property by or on account of any act, omission, neglect, or misconduct in the execution of the work, or in consequence of the non-execution thereof by the Contractor, the Contractor shall restore, at their expense, such property to a condition similar or equal to that existing before such damage or injury was done, by repairing, or otherwise restoring as may be directed, or the Contractor shall make good such damage or injury in an acceptable manner.

70-11 Responsibility for damage claims. The Contractor shall indemnify and hold harmless the Engineer/RPR and the Owner and their officers, agents, and employees from all suits, actions, or claims, of any character, brought because of any injuries or damage received or sustained by any person, persons, or property on account of the operations of the Contractor; or on account of or in consequence of any neglect in safeguarding the work; or through use of unacceptable materials in constructing the work; or because of any act or omission, neglect, or misconduct of said Contractor; or because of any claims or amounts recovered from any infringements of patent, trademark, or copyright; or from any claims or amounts arising or recovered under the "Workmen's Compensation Act," or any other law, ordinance, order, or decree. Money due the Contractor under and by virtue of their own contract considered necessary by the Owner for such purpose may be retained for the use of the Owner or, in case no money is due, their own surety may be held until such suits, actions, or claims for injuries or damages shall have been settled and suitable evidence to that effect furnished to the Owner, except that money due the Contractor will not be withheld when the Contractor produces satisfactory evidence that he or she is adequately protected by public liability and property damage insurance.

70-12 Third party beneficiary clause. It is specifically agreed between the parties executing the contract that it is not intended by any of the provisions of any part of the contract to create for the public or any member thereof, a third-party beneficiary or to authorize anyone not a party to the contract to maintain a suit for personal injuries or property damage pursuant to the terms or provisions of the contract.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

70-13 Opening sections of the work to traffic. If it is necessary for the Contractor to complete portions of the contract work for the beneficial occupancy of the Owner prior to completion of the entire contract, such "phasing" of the work must be specified below and indicated on the approved Construction Safety and Phasing Plan (CSPP) and the project plans. When so specified, the Contractor shall complete such portions of the work on or before the date specified or as otherwise specified.

Detailed phasing information is provided in the Construction Safety and Phasing Plan.

Upon completion of any portion of work listed above, such portion shall be accepted by the Owner in accordance with Section 50, paragraph 50-14, *Partial Acceptance*.

No portion of the work may be opened by the Contractor until directed by the Owner in writing. Should it become necessary to open a portion of the work to traffic on a temporary or intermittent basis, such openings shall be made when, in the opinion of the RPR, such portion of the work is in an acceptable condition to support the intended traffic. Temporary or intermittent openings are considered to be inherent in the work and shall not constitute either acceptance of the portion of the work so opened or a waiver of any provision of the contract. Any damage to the portion of the work so opened that is not attributable to traffic which is permitted by the Owner shall be repaired by the Contractor at their expense.

The Contractor shall make their own estimate of the inherent difficulties involved in completing the work under the conditions herein described and shall not claim any added compensation by reason of delay or increased cost due to opening a portion of the contract work.

The Contractor must conform to safety standards contained AC 150/5370-2 and the approved CSPP.

Contractor shall refer to the plans, specifications, and the approved CSPP to identify barricade requirements, temporary and/or permanent markings, airfield lighting, guidance signs and other safety requirements prior to opening up sections of work to traffic.

70-14 Contractor's responsibility for work. Until the RPR's final written acceptance of the entire completed work, excepting only those portions of the work accepted in accordance with Section 50, paragraph 50-14, *Partial Acceptance*, the Contractor shall have the charge and care thereof and shall take every precaution against injury or damage to any part due to the action of the elements or from any other cause, whether arising from the execution or from the non-execution of the work. The Contractor shall rebuild, repair, restore, and make good all injuries or damages to any portion of the work occasioned by any of the above causes before final acceptance and shall bear the expense thereof except damage to the work due to unforeseeable causes beyond the control of and without the fault or negligence of the Contractor, including but not restricted to acts of God such as earthquake, tidal wave, tornado, hurricane or other cataclysmic phenomenon of nature, or acts of the public enemy or of government authorities.

If the work is suspended for any cause whatever, the Contractor shall be responsible for the work and shall take such precautions necessary to prevent damage to the work. The Contractor shall provide for normal drainage and shall erect necessary temporary structures, signs, or other facilities at their own expense. During such period of suspension of work, the Contractor shall properly and continuously maintain in an acceptable growing condition all living material in newly established planting, seeding, and sodding furnished under the contract, and shall take adequate precautions to protect new tree growth and other important vegetative growth against injury.

70-15 Contractor's responsibility for utility service and facilities of others. As provided in paragraph 70-04, *Restoration of Surfaces Disturbed by Others*, the Contractor shall cooperate with the owner of any public or private utility service, FAA or NOAA, or a utility service of another government agency that may be authorized by the Owner to construct, reconstruct or maintain such utility services or facilities during the progress of the work. In addition, the Contractor shall control their operations to prevent the unscheduled interruption of such utility services and facilities.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

To the extent that such public or private utility services, FAA, or NOAA facilities, or utility services of another governmental agency are known to exist within the limits of the contract work, the approximate locations have been indicated on the plans and/or in the contract documents.

It is understood and agreed that the Owner does not guarantee the accuracy or the completeness of the location information relating to existing utility services, facilities, or structures that may be shown on the plans or encountered in the work. Any inaccuracy or omission in such information shall not relieve the Contractor of the responsibility to protect such existing features from damage or unscheduled interruption of service.

It is further understood and agreed that the Contractor shall, upon execution of the contract, notify the Owners of all utility services or other facilities of their plan of operations. Such notification shall be in writing addressed to "The Person to Contact" as provided in this paragraph and paragraph 70-04, *Restoration of Surfaces Disturbed By Others*. A copy of each notification shall be given to the RPR.

In addition to the general written notification provided, it shall be the responsibility of the Contractor to keep such individual Owners advised of changes in their plan of operations that would affect such Owners.

Prior to beginning the work in the general vicinity of an existing utility service or facility, the Contractor shall again notify each such Owner of their plan of operation. If, in the Contractor's opinion, the Owner's assistance is needed to locate the utility service or facility or the presence of a representative of the Owner is desirable to observe the work, such advice should be included in the notification. Such notification shall be given by the most expeditious means to reach the utility owner's "Person to Contact" no later than two normal business days prior to the Contractor's commencement of operations in such general vicinity. The Contractor shall furnish a written summary of the notification to the RPR.

The Contractor's failure to give the two days' notice shall be cause for the Owner to suspend the Contractor's operations in the general vicinity of a utility service or facility.

Where the outside limits of an underground utility service have been located and staked on the ground, the Contractor shall be required to use hand excavation methods within 3 feet (1 m) of such outside limits at such points as may be required to ensure protection from damage due to the Contractor's operations.

Should the Contractor damage or interrupt the operation of a utility service or facility by accident or otherwise, the Contractor shall immediately notify the proper authority and the RPR and shall take all reasonable measures to prevent further damage or interruption of service. The Contractor, in such events, shall cooperate with the utility service or facility owner and the RPR continuously until such damage has been repaired and service restored to the satisfaction of the utility or facility owner.

The Contractor shall bear all costs of damage and restoration of service to any utility service or facility due to their operations whether due to negligence or accident. The Owner reserves the right to deduct such costs from any monies due or which may become due the Contractor, or their own surety.

70-16 Furnishing rights-of-way. The Owner will be responsible for furnishing all rights-of-way upon which the work is to be constructed in advance of the Contractor's operations.

70-17 Personal liability of public officials. In carrying out any of the contract provisions or in exercising any power or authority granted by this contract, there shall be no liability upon the Engineer, RPR, their authorized representatives, or any officials of the Owner either personally or as an official of the Owner. It is understood that in such matters they act solely as agents and representatives of the Owner.

70-18 No waiver of legal rights. Upon completion of the work, the Owner will expeditiously make final inspection and notify the Contractor of final acceptance. Such final acceptance, however, shall not preclude or stop the Owner from correcting any measurement, estimate, or certificate made before or after completion of the work, nor shall the Owner be precluded or stopped from recovering from the Contractor or their surety, or both, such overpayment as may be sustained, or by failure on the part of the Contractor

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

to fulfill their obligations under the contract. A waiver on the part of the Owner of any breach of any part of the contract shall not be held to be a waiver of any other or subsequent breach.

The Contractor, without prejudice to the terms of the contract, shall be liable to the Owner for latent defects, fraud, or such gross mistakes as may amount to fraud, or as regards the Owner's rights under any warranty or guaranty.

70-19 Environmental protection. The Contractor shall comply with all federal, state, and local laws and regulations controlling pollution of the environment. The Contractor shall take necessary precautions to prevent pollution of streams, lakes, ponds, and reservoirs with fuels, oils, asphalts, chemicals, or other harmful materials and to prevent pollution of the atmosphere from particulate and gaseous matter.

70-20 Archaeological and historical findings. Unless otherwise specified in this subsection, the Contractor is advised that the site of the work is not within any property, district, or site, and does not contain any building, structure, or object listed in the current National Register of Historic Places published by the United States Department of Interior.

Should the Contractor encounter, during their operations, any building, part of a building, structure, or object that is incongruous with its surroundings, the Contractor shall immediately cease operations in that location and notify the RPR. The RPR will immediately investigate the Contractor's finding and the Owner will direct the Contractor to either resume operations or to suspend operations as directed.

Should the Owner order suspension of the Contractor's operations in order to protect an archaeological or historical finding, or order the Contractor to perform extra work, such shall be covered by an appropriate contract change order or supplemental agreement as provided in Section 40, paragraph 40-04, *Extra Work*, and Section 90, paragraph 90-05, *Payment for Extra Work*. If appropriate, the contract change order or supplemental agreement shall include an extension of contract time in accordance with Section 80, paragraph 80-07, *Determination and Extension of Contract Time*.

70-21 Insurance Requirements. *The contractor shall, at a minimum, maintain insurance coverage in the amounts listed on the proposal forms for the duration of the project.*

END OF SECTION 70

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

SECTION 80 EXECUTION AND PROGRESS

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in the KYTC Standard Specifications Section 108 "Prosecution and Progress."

80-01 Subletting of contract. The Owner will not recognize any subcontractor on the work. The Contractor shall at all times when work is in progress be represented either in person, by a qualified superintendent, or by other designated, qualified representative who is duly authorized to receive and execute orders of the Resident Project Representative (RPR).

The Contractor shall perform, with his organization, an amount of work equal to at least 30 percent of the total contract cost.

Should the Contractor elect to assign their contract, said assignment shall be concurred in by the surety, shall be presented for the consideration and approval of the Owner, and shall be consummated only on the written approval of the Owner.

If requested, the Contractor shall provide copies of all subcontracts to the RPR 14 days prior to being utilized on the project. As a minimum, the information shall include the following:

- Subcontractor's legal company name.
- Subcontractor's legal company address, including County name.
- Principal contact person's name, telephone and fax number.
- Complete narrative description, and dollar value of the work to be performed by the subcontractor.
- Copies of required insurance certificates in accordance with the specifications.
- Minority/ non-minority status.

80-02 Notice to proceed (NTP). The Owners notice to proceed will state the date on which contract time commences. The Contractor is expected to commence project operations within 10 days of the NTP date. The Contractor shall notify the RPR at least 48 hours in advance of the time contract operations begins. The Contractor shall not commence any actual operations prior to the date on which the notice to proceed is issued by the Owner.

80-03 Execution and progress. Unless otherwise specified, the Contractor shall submit their coordinated construction schedule showing all work activities for the RPR's review and acceptance at least 10 days prior to the start of work *and in advance of the preconstruction meeting*. The Contractor's progress schedule, once accepted by the RPR, will represent the Contractor's baseline plan to accomplish the project in accordance with the terms and conditions of the Contract. The RPR will compare actual Contractor progress against the baseline schedule to determine that status of the Contractor's performance. The Contractor shall provide sufficient materials, equipment, and labor to guarantee the completion of the project in accordance with the plans and specifications within the time set forth in the proposal.

If the Contractor falls significantly behind the submitted schedule, the Contractor shall, upon the RPR's request, submit a revised schedule for completion of the work within the contract time and modify their operations to provide such additional materials, equipment, and labor necessary to meet the revised schedule. Should the execution of the work be discontinued for any reason, the Contractor shall notify the RPR at least 24 hours in advance of resuming operations.

The Contractor shall not commence any actual construction prior to the date on which the NTP is issued by the Owner.

The project schedule shall be prepared as a network diagram in Critical Path Method (CPM), Program Evaluation and Review Technique (PERT), or other format, or as otherwise specified. It shall include

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

information on the sequence of work activities, milestone dates, and activity duration. The schedule shall show all work items identified in the project proposal for each work area and shall include the project start date and end date.

The Contractor shall maintain the work schedule and provide an update and analysis of the progress schedule on a monthly basis, or as otherwise specified in the contract. Submission of the work schedule shall not relieve the Contractor of overall responsibility for scheduling, sequencing, and coordinating all work to comply with the requirements of the contract.

80-04 Limitation of operations. The Contractor shall control their operations and the operations of their subcontractors and all suppliers to provide for the free and unobstructed movement of aircraft in the air operations areas (AOA) of the airport.

When the work requires the Contractor to conduct their operations within an AOA of the airport, the work shall be coordinated with airport operations (through the RPR) at least 48 hours prior to commencement of such work. The Contractor shall not close an AOA until so authorized by the RPR and until the necessary temporary marking, signage and associated lighting is in place as provided in Section 70, paragraph 70-08, *Construction Safety and Phasing Plan (CSPP)*.

When the contract work requires the Contractor to work within an AOA of the airport on an intermittent basis (intermittent opening and closing of the AOA), the Contractor shall maintain constant communications as specified; immediately obey all instructions to vacate the AOA; and immediately obey all instructions to resume work in such AOA. Failure to maintain the specified communications or to obey instructions shall be cause for suspension of the Contractor's operations in the AOA until satisfactory conditions are provided. The areas of the AOA identified in the Construction Safety Phasing Plan (CSPP) ~~and as listed below~~, cannot be closed to operating aircraft to permit the Contractor's operations on a continuous basis and will therefore be closed to aircraft operations intermittently ~~as follows~~:

The Contractor shall be required to conform to safety standards contained in AC 150/5370-2, Operational Safety on Airports During Construction and the approved CSPP.

80-04.1 Operational safety on airport during construction. All Contractors' operations shall be conducted in accordance with the approved project Construction Safety and Phasing Plan (CSPP) and the Safety Plan Compliance Document (SPCD) and the provisions set forth within the current version of AC 150/5370-2, Operational Safety on Airports During Construction. The CSPP included within the contract documents conveys minimum requirements for operational safety on the airport during construction activities. The Contractor shall prepare and submit a SPCD that details how it proposes to comply with the requirements presented within the CSPP.

The Contractor shall implement all necessary safety plan measures prior to commencement of any work activity. The Contractor shall conduct routine checks to assure compliance with the safety plan measures.

The Contractor is responsible to the Owner for the conduct of all subcontractors it employs on the project. The Contractor shall assure that all subcontractors are made aware of the requirements of the CSPP and SPCD and that they implement and maintain all necessary measures.

No deviation or modifications may be made to the approved CSPP and SPCD unless approved in writing by the Owner. The necessary coordination actions to review Contractor proposed modifications to an approved CSPP or approved SPCD can require a significant amount of time.

80-05 Character of workers, methods, and equipment. The Contractor shall, at all times, employ sufficient labor and equipment for prosecuting the work to full completion in the manner and time required by the contract, plans, and specifications.

All workers shall have sufficient skill and experience to perform properly the work assigned to them. Workers engaged in special work or skilled work shall have sufficient experience in such work and in the operation of the equipment required to perform the work satisfactorily.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

Any person employed by the Contractor or by any subcontractor who violates any operational regulations or operational safety requirements and, in the opinion of the RPR, does not perform his work in a proper and skillful manner or is intemperate or disorderly shall, at the written request of the RPR, be removed immediately by the Contractor or subcontractor employing such person, and shall not be employed again in any portion of the work without approval of the RPR.

Should the Contractor fail to remove such person or persons, or fail to furnish suitable and sufficient personnel for the proper execution of the work, the RPR may suspend the work by written notice until compliance with such orders.

All equipment that is proposed to be used on the work shall be of sufficient size and in such mechanical condition as to meet requirements of the work and to produce a satisfactory quality of work. Equipment used on any portion of the work shall not cause injury to previously completed work, adjacent property, or existing airport facilities due to its use.

When the methods and equipment to be used by the Contractor in accomplishing the work are not prescribed in the contract, the Contractor is free to use any methods or equipment that will accomplish the work in conformity with the requirements of the contract, plans, and specifications.

When the contract specifies the use of certain methods and equipment, such methods and equipment shall be used unless otherwise authorized by the RPR. If the Contractor desires to use a method or type of equipment other than specified in the contract, the Contractor may request authority from the RPR to do so. The request shall be in writing and shall include a full description of the methods and equipment proposed and of the reasons for desiring to make the change. If approval is given, it will be on the condition that the Contractor will be fully responsible for producing work in conformity with contract requirements. If, after trial use of the substituted methods or equipment, the RPR determines that the work produced does not meet contract requirements, the Contractor shall discontinue the use of the substitute method or equipment and shall complete the remaining work with the specified methods and equipment. The Contractor shall remove any deficient work and replace it with work of specified quality, or take such other corrective action as the RPR may direct. No change will be made in basis of payment for the contract items involved nor in contract time as a result of authorizing a change in methods or equipment under this paragraph.

80-06 Temporary suspension of the work. The Owner shall have the authority to suspend the work wholly, or in part, for such period or periods the Owner may deem necessary, due to unsuitable weather, or other conditions considered unfavorable for the execution of the work, or for such time necessary due to the failure on the part of the Contractor to carry out orders given or perform any or all provisions of the contract.

In the event that the Contractor is ordered by the Owner, in writing, to suspend work for some unforeseen cause not otherwise provided for in the contract and over which the Contractor has no control, the Contractor may be reimbursed for actual money expended on the work during the period of shutdown. No allowance will be made for anticipated profits. The period of shutdown shall be computed from the effective date of the written order to suspend work to the effective date of the written order to resume the work. Claims for such compensation shall be filed with the RPR within the time period stated in the RPR's order to resume work. The Contractor shall submit with their own claim information substantiating the amount shown on the claim. The RPR will forward the Contractor's claim to the Owner for consideration in accordance with local laws or ordinances. No provision of this article shall be construed as entitling the Contractor to compensation for delays due to inclement weather or for any other delay provided for in the contract, plans, or specifications.

If it becomes necessary to suspend work for an indefinite period, the Contractor shall store all materials in such manner that they will not become an obstruction nor become damaged in any way. The Contractor shall take every precaution to prevent damage or deterioration of the work performed and provide for normal drainage of the work. The Contractor shall erect temporary structures where necessary to provide for traffic on, to, or from the airport.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

80-07 Determination and extension of contract time. The number of calendar days shall be stated in the proposal (*bid form*) and contract (*agreement*) and shall be known as the Contract Time.

If the contract time requires extension for reasons beyond the Contractor's control, it shall be adjusted as follows:

80-07.1 Contract time based on calendar days. Contract Time based on calendar days shall consist of the number of calendar days stated in the contract counting from the effective date of the Notice to Proceed and including all Saturdays, Sundays, holidays, and non-work days. All calendar days elapsing between the effective dates of the Owner's orders to suspend and resume all work, due to causes not the fault of the Contractor, shall be excluded.

At the time of final payment, the contract time shall be increased in the same proportion as the cost of the actually completed quantities bears to the cost of the originally estimated quantities in the proposal. Such increase in the contract time shall not consider either cost of work or the extension of contract time that has been covered by a change order or supplemental agreement. Charges against the contract time will cease as of the date of final acceptance.

80-08 Failure to complete on time. For each calendar day or working day, as specified in the contract, that any work remains uncompleted after the contract time (including all extensions and adjustments as provided in paragraph 80-07, *Determination and Extension of Contract Time*) the sum specified in the contract and proposal as liquidated damages (LD) will be deducted from any money due or to become due the Contractor or their own surety. Such deducted sums shall not be deducted as a penalty but shall be considered as liquidation of a reasonable portion of damages including but not limited to additional engineering services that will be incurred by the Owner should the Contractor fail to complete the work in the time provided in their contract.

Details of liquidated damages are included in the Contract.

Construction time shall be as included in the Contract (Agreement). ~~The maximum construction time allowed for Schedules [] will be the sum of the time allowed for individual schedules but not more than [] days.~~ Permitting the Contractor to continue and finish the work or any part of it after the time fixed for its completion, or after the date to which the time for completion may have been extended, will in no way operate as a waiver on the part of the Owner of any of its rights under the contract.

80-09 Default and termination of contract. The Contractor shall be considered in default of their contract and such default will be considered as cause for the Owner to terminate the contract for any of the following reasons, if the Contractor:

- a. Fails to begin the work under the contract within the time specified in the Notice to Proceed, or
- b. Fails to perform the work or fails to provide sufficient workers, equipment and/or materials to assure completion of work in accordance with the terms of the contract, or
- c. Performs the work unsuitably or neglects or refuses to remove materials or to perform anew such work as may be rejected as unacceptable and unsuitable, or
- d. Discontinues the execution of the work, or
- e. Fails to resume work which has been discontinued within a reasonable time after notice to do so, or
- f. Becomes insolvent or is declared bankrupt, or commits any act of bankruptcy or insolvency, or
- g. Allows any final judgment to stand against the Contractor unsatisfied for a period of 10 days, or
- h. Makes an assignment for the benefit of creditors, or
- i. For any other cause whatsoever, fails to carry on the work in an acceptable manner.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

Should the Owner consider the Contractor in default of the contract for any reason above, the Owner shall immediately give written notice to the Contractor and the Contractor's surety as to the reasons for considering the Contractor in default and the Owner's intentions to terminate the contract.

If the Contractor or surety, within a period of 10 days after such notice, does not proceed in accordance therewith, then the Owner will, upon written notification from the RPR of the facts of such delay, neglect, or default and the Contractor's failure to comply with such notice, have full power and authority without violating the contract, to take the execution of the work out of the hands of the Contractor. The Owner may appropriate or use any or all materials and equipment that have been mobilized for use in the work and are acceptable and may enter into an agreement for the completion of said contract according to the terms and provisions thereof, or use such other methods as in the opinion of the RPR will be required for the completion of said contract in an acceptable manner.

All costs and charges incurred by the Owner, together with the cost of completing the work under contract, will be deducted from any monies due or which may become due the Contractor. If such expense exceeds the sum which would have been payable under the contract, then the Contractor and the surety shall be liable and shall pay to the Owner the amount of such excess.

80-10 Termination for national emergencies. The Owner shall terminate the contract or portion thereof by written notice when the Contractor is prevented from proceeding with the construction contract as a direct result of an Executive Order of the President with respect to the execution of war or in the interest of national defense.

When the contract, or any portion thereof, is terminated before completion of all items of work in the contract, payment will be made for the actual number of units or items of work completed at the contract price or as mutually agreed for items of work partially completed or not started. No claims or loss of anticipated profits shall be considered.

Reimbursement for organization of the work, and other overhead expenses, (when not otherwise included in the contract) and moving equipment and materials to and from the job will be considered, the intent being that an equitable settlement will be made with the Contractor.

Acceptable materials, obtained or ordered by the Contractor for the work and that are not incorporated in the work shall, at the option of the Contractor, be purchased from the Contractor at actual cost as shown by receipted bills and actual cost records at such points of delivery as may be designated by the RPR.

Termination of the contract or a portion thereof shall neither relieve the Contractor of their responsibilities for the completed work nor shall it relieve their surety of its obligation for and concerning any just claim arising out of the work performed.

80-11 Work area, storage area and sequence of operations. The Contractor shall obtain approval from the RPR prior to beginning any work in all areas of the airport. No operating runway, taxiway, or air operations area (AOA) shall be crossed, entered, or obstructed while it is operational. The Contractor shall plan and coordinate work in accordance with the approved CSPP and SPCD.

END OF SECTION 80

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

SECTION 90 MEASUREMENT AND PAYMENT

Unless modified herein, the Proposal Requirements and Conditions shall follow those listed in the KYTC Standard Specifications Section 109 "Measurement and Payment."

90-01 Measurement of quantities. All work completed under the contract will be measured by the RPR, or their authorized representatives, using United States Customary Units of Measurement.

The method of measurement and computations to be used in determination of quantities of material furnished and of work performed under the contract will be those methods generally recognized as conforming to good engineering practice.

Unless otherwise specified, longitudinal measurements for area computations will be made horizontally, and no deductions will be made for individual fixtures (or leave-outs) having an area of 9 square feet (0.8 square meters) or less. Unless otherwise specified, transverse measurements for area computations will be the neat dimensions shown on the plans or ordered in writing by the RPR.

Unless otherwise specified, all contract items which are measured by the linear foot such as electrical ducts, conduits, pipe culverts, underdrains, and similar items shall be measured parallel to the base or foundation upon which such items are placed.

The term "lump sum" when used as an item of payment will mean complete payment for the work described in the contract. When a complete structure or structural unit (in effect, "lump sum" work) is specified as the unit of measurement, the unit will be construed to include all necessary fittings and accessories.

When requested by the Contractor and approved by the RPR in writing, material specified to be measured by the cubic yard (cubic meter) may be weighed, and such weights will be converted to cubic yards (cubic meters) for payment purposes. Factors for conversion from weight measurement to volume measurement will be determined by the RPR and shall be agreed to by the Contractor before such method of measurement of pay quantities is used.

MEASUREMENT AND PAYMENT TERMS

Term	Description
Excavation and Embankment Volume	In computing volumes of excavation, the average end area method will be used unless otherwise specified.
Measurement and Proportion by Weight	The term "ton" will mean the short ton consisting of 2,000 pounds avoirdupois. All materials that are measured or proportioned by weights shall be weighed on accurate, independently certified scales by competent, qualified personnel at locations designated by the RPR. If material is shipped by rail, the car weight may be accepted provided that only the actual weight of material is paid for. However, car weights will not be acceptable for material to be passed through mixing plants. Trucks used to haul material being paid for by weight shall be weighed empty daily at such times as the RPR directs, and each truck shall bear a plainly legible identification mark.
Measurement by Volume	Materials to be measured by volume in the hauling vehicle shall be hauled in approved vehicles and measured therein at the point of delivery. Vehicles for this purpose may be of any size or type acceptable for the materials hauled, provided that the body is of such shape that the actual contents may be readily and accurately determined. All vehicles shall be loaded to at least their water level capacity, and all loads shall be leveled when the vehicles arrive at the point of delivery.

Term	Description
Asphalt Material	Asphalt materials will be measured by the gallon or ton. When measured by volume, such volumes will be measured at 60°F (16°C) or will be corrected to the volume at 60°F (16°C) using ASTM D1250 for asphalts. Net certified scale weights or weights based on certified volumes in the case of rail shipments will be used as a basis of measurement, subject to correction when asphalt material has been lost from the car or the distributor, wasted, or otherwise not incorporated in the work. When asphalt materials are shipped by truck or transport, net certified weights by volume, subject to correction for loss or foaming, will be used for computing quantities.
Cement	Cement will be measured by the ton or hundredweight.
Structure	Structures will be measured according to neat lines shown on the plans or as altered to fit field conditions.
Timber	Timber will be measured by the thousand feet board measure (MFBM) actually incorporated in the structure. Measurement will be based on nominal widths and thicknesses and the extreme length of each piece.
Plates and Sheets	The thickness of plates and galvanized sheet used in the manufacture of corrugated metal pipe, metal plate pipe culverts and arches, and metal cribbing will be specified and measured in decimal fraction of inch.
Miscellaneous Items	When standard manufactured items are specified such as fence, wire, plates, rolled shapes, pipe conduit, etc., and these items are identified by gauge, unit weight, section dimensions, etc., such identification will be considered to be nominal weights or dimensions. Unless more stringently controlled by tolerances in cited specifications, manufacturing tolerances established by the industries involved will be accepted.
Scales	Scales must be tested for accuracy and serviced before use. Scales for weighing materials which are required to be proportioned or measured and paid for by weight shall be furnished, erected, and maintained by the Contractor, or be certified permanently installed commercial scales. Platform scales shall be installed and maintained with the platform level and rigid bulkheads at each end. Scales shall be accurate within 0.5% of the correct weight throughout the range of use. The Contractor shall have the scales checked under the observation of the RPR before beginning work and at such other times as requested. The intervals shall be uniform in spacing throughout the graduated or marked length of the beam or dial and shall not exceed 0.1% of the nominal rated capacity of the scale, but not less than one pound. The use of spring balances will not be permitted. In the event inspection reveals the scales have been “overweighing” (indicating more than correct weight) they will be immediately adjusted. All materials received subsequent to the last previous correct weighting-accuracy test will be reduced by the percentage of error in excess of 0.5%. In the event inspection reveals the scales have been under-weighing (indicating less than correct weight), they shall be immediately adjusted. No additional payment to the Contractor will be allowed for materials previously weighed and recorded. Beams, dials, platforms, and other scale equipment shall be so arranged that the operator and the RPR can safely and conveniently view them.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

Term	Description
	Scale installations shall have available ten standard 50-pound weights for testing the weighing equipment or suitable weights and devices for other approved equipment. All costs in connection with furnishing, installing, certifying, testing, and maintaining scales; for furnishing check weights and scale house; and for all other items specified in this subsection, for the weighing of materials for proportioning or payment, shall be included in the unit contract prices for the various items of the project.
Rental Equipment	Rental of equipment will be measured by time in hours of actual working time and necessary traveling time of the equipment within the limits of the work. Special equipment ordered in connection with extra work will be measured as agreed in the change order or supplemental agreement authorizing such work as provided in paragraph 90-05 <i>Payment for Extra Work</i> .
Pay Quantities	When the estimated quantities for a specific portion of the work are designated as the pay quantities in the contract, they shall be the final quantities for which payment for such specific portion of the work will be made, unless the dimensions of said portions of the work shown on the plans are revised by the RPR. If revised dimensions result in an increase or decrease in the quantities of such work, the final quantities for payment will be revised in the amount represented by the authorized changes in the dimensions.

90-02 Scope of payment. The Contractor shall receive and accept compensation provided for in the contract as full payment for furnishing all materials, for performing all work under the contract in a complete and acceptable manner, and for all risk, loss, damage, or expense of whatever character arising out of the nature of the work or the execution thereof, subject to the provisions of Section 70, paragraph 70-18, *No Waiver of Legal Rights*.

When the "basis of payment" subsection of a technical specification requires that the contract price (price bid) include compensation for certain work or material essential to the item, this same work or material will not also be measured for payment under any other contract item which may appear elsewhere in the contract, plans, or specifications.

90-03 Compensation for altered quantities. When the accepted quantities of work vary from the quantities in the proposal, the Contractor shall accept as payment in full, so far as contract items are concerned, payment at the original contract price for the accepted quantities of work actually completed and accepted. No allowance, except as provided for in Section 40, paragraph 40-02, *Alteration of Work and Quantities*, will be made for any increased expense, loss of expected reimbursement, or loss of anticipated profits suffered or claimed by the Contractor which results directly from such alterations or indirectly from their own unbalanced allocation of overhead and profit among the contract items, or from any other cause.

90-04 Payment for omitted items. As specified in Section 40, paragraph 40-03, *Omitted Items*, the RPR shall have the right to omit from the work (order nonperformance) any contract item, except major contract items, in the best interest of the Owner.

Should the RPR omit or order nonperformance of a contract item or portion of such item from the work, the Contractor shall accept payment in full at the contract prices for any work actually completed and acceptable prior to the RPR's order to omit or non-perform such contract item.

Acceptable materials ordered by the Contractor or delivered on the work prior to the date of the RPR's order will be paid for at the actual cost to the Contractor and shall thereupon become the property of the Owner.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

In addition to the reimbursement hereinbefore provided, the Contractor shall be reimbursed for all actual costs incurred for the purpose of performing the omitted contract item prior to the date of the RPR's order. Such additional costs incurred by the Contractor must be directly related to the deleted contract item and shall be supported by certified statements by the Contractor as to the nature the amount of such costs.

90-05 Payment for extra work. Extra work, performed in accordance with Section 40, paragraph 40-04, *Extra Work*, will be paid for at the contract prices or agreed prices specified in the change order or supplemental agreement authorizing the extra work.

90-06 Partial payments. Partial payments will be made to the Contractor at least once each month as the work progresses. Said payments will be based upon estimates, prepared by the RPR, of the value of the work performed and materials complete and in place, in accordance with the contract, plans, and specifications. Such partial payments may also include the delivered actual cost of those materials stockpiled and stored in accordance with paragraph 90-07, *Payment for Materials on Hand*. No partial payment will be made when the amount due to the Contractor since the last estimate amounts to less than five hundred dollars.

a. From the total of the amount determined to be payable on a partial payment, five (5) percent of such total amount will be deducted and retained by the Owner for protection of the Owner's interests. Unless otherwise instructed by the Owner, the amount retained by the Owner will be in effect until the final payment is made except as follows:

(1) Contractor may request release of retainage on work that has been partially accepted by the Owner in accordance with Section 50-14. Contractor must provide a certified invoice to the RPR that supports the value of retainage held by the Owner for partially accepted work.

(2) In lieu of retainage, the Contractor may exercise at its option the establishment of an escrow account per paragraph 90-08.

b. The Contractor is required to pay all subcontractors for satisfactory performance of their contracts no later than 30 days after the Contractor has received a partial payment. Contractor must provide the Owner evidence of prompt and full payment of retainage held by the prime Contractor to the subcontractor within 30 days after the subcontractor's work is satisfactorily completed. A subcontractor's work is satisfactorily completed when all the tasks called for in the subcontract have been accomplished and documented as required by the Owner. When the Owner has made an incremental acceptance of a portion of a prime contract, the work of a subcontractor covered by that acceptance is deemed to be satisfactorily completed.

c. When at least 95% of the work has been completed to the satisfaction of the RPR, the RPR shall, at the Owner's discretion and with the consent of the surety, prepare estimates of both the contract value and the cost of the remaining work to be done. The Owner may retain an amount not less than twice the contract value or estimated cost, whichever is greater, of the work remaining to be done. The remainder, less all previous payments and deductions, will then be certified for payment to the Contractor.

It is understood and agreed that the Contractor shall not be entitled to demand or receive partial payment based on quantities of work in excess of those provided in the proposal or covered by approved change orders or supplemental agreements, except when such excess quantities have been determined by the RPR to be a part of the final quantity for the item of work in question.

No partial payment shall bind the Owner to the acceptance of any materials or work in place as to quality or quantity. All partial payments are subject to correction at the time of final payment as provided in paragraph 90-09, *Acceptance and Final Payment*.

The Contractor shall deliver to the Owner a complete release of all claims for labor and material arising out of this contract before the final payment is made. If any subcontractor or supplier fails to furnish such a release in full, the Contractor may furnish a bond or other collateral satisfactory to the Owner to indemnify

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

the Owner against any potential lien or other such claim. The bond or collateral shall include all costs, expenses, and attorney fees the Owner may be compelled to pay in discharging any such lien or claim.

90-07 Payment for materials on hand. Partial payments may be made to the extent of the delivered cost of materials to be incorporated in the work, provided that such materials meet the requirements of the contract, plans, and specifications and are delivered to acceptable sites on the airport property or at other sites in the vicinity that are acceptable to the Owner. Such delivered costs of stored or stockpiled materials may be included in the next partial payment after the following conditions are met:

a. The material has been stored or stockpiled in a manner acceptable to the RPR at or on an approved site.

b. The Contractor has furnished the RPR with acceptable evidence of the quantity and quality of such stored or stockpiled materials.

c. The Contractor has furnished the RPR with satisfactory evidence that the material and transportation costs have been paid.

d. The Contractor has furnished the Owner legal title (free of liens or encumbrances of any kind) to the material stored or stockpiled.

e. The Contractor has furnished the Owner evidence that the material stored or stockpiled is insured against loss by damage to or disappearance of such materials at any time prior to use in the work.

It is understood and agreed that the transfer of title and the Owner's payment for such stored or stockpiled materials shall in no way relieve the Contractor of their responsibility for furnishing and placing such materials in accordance with the requirements of the contract, plans, and specifications.

In no case will the amount of partial payments for materials on hand exceed the contract price for such materials or the contract price for the contract item in which the material is intended to be used.

No partial payment will be made for stored or stockpiled living or perishable plant materials.

The Contractor shall bear all costs associated with the partial payment of stored or stockpiled materials in accordance with the provisions of this paragraph.

90-08 Payment of withheld funds. At the Contractor's option, if an Owner withholds retainage in accordance with the methods described in paragraph 90-06 *Partial Payments*, the Contractor may request that the Owner deposit the retainage into an escrow account. The Owner's deposit of retainage into an escrow account is subject to the following conditions:

a. The Contractor shall bear all expenses of establishing and maintaining an escrow account and escrow agreement acceptable to the Owner.

b. The Contractor shall deposit to and maintain in such escrow only those securities or bank certificates of deposit as are acceptable to the Owner and having a value not less than the retainage that would otherwise be withheld from partial payment.

c. The Contractor shall enter into an escrow agreement satisfactory to the Owner.

d. The Contractor shall obtain the written consent of the surety to such agreement.

90-09 Acceptance and final payment. When the contract work has been accepted in accordance with the requirements of Section 50, paragraph 50-15, *Final Acceptance*, the RPR will prepare the final estimate of the items of work actually performed. The Contractor shall approve the RPR's final estimate or advise the RPR of the Contractor's objections to the final estimate which are based on disputes in measurements or computations of the final quantities to be paid under the contract as amended by change order or supplemental agreement. The Contractor and the RPR shall resolve all disputes (if any) in the measurement and computation of final quantities to be paid within 30 calendar days of the Contractor's receipt of the

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

RPR's final estimate. If, after such 30-day period, a dispute still exists, the Contractor may approve the RPR's estimate under protest of the quantities in dispute, and such disputed quantities shall be considered by the Owner as a claim in accordance with Section 50, paragraph 50-16, *Claims for Adjustment and Disputes*.

After the Contractor has approved, or approved under protest, the RPR's final estimate, and after the RPR's receipt of the project closeout documentation required in paragraph 90-11, *Contractor Final Project Documentation*, final payment will be processed based on the entire sum, or the undisputed sum in case of approval under protest, determined to be due the Contractor less all previous payments and all amounts to be deducted under the provisions of the contract. All prior partial estimates and payments shall be subject to correction in the final estimate and payment.

If the Contractor has filed a claim for additional compensation under the provisions of Section 50, paragraph 50-16, *Claims for Adjustments and Disputes*, or under the provisions of this paragraph, such claims will be considered by the Owner in accordance with local laws or ordinances. Upon final adjudication of such claims, any additional payment determined to be due the Contractor will be paid pursuant to a supplemental final estimate.

90-10 Construction warranty.

a. In addition to any other warranties in this contract, the Contractor warrants that work performed under this contract conforms to the contract requirements and is free of any defect in equipment, material, workmanship, or design furnished, or performed by the Contractor or any subcontractor or supplier at any tier.

b. This warranty shall continue for a period of one year from the date of final acceptance of the work, except as noted. If the Owner takes possession of any part of the work before final acceptance, this warranty shall continue for a period of one year from the date the Owner takes possession. [However, this will not relieve the Contractor from corrective items required by the final acceptance of the project work. Light Emitting Diode emitting diode (LED) light fixtures with the exception of obstruction lighting, must be warranted by the manufacturer for a minimum of four (4) years after date of installation inclusive of all electronics.

c. The Contractor shall remedy at the Contractor's expense any failure to conform, or any defect. In addition, the Contractor shall remedy at the Contractor's expense any damage to Owner real or personal property, when that damage is the result of the Contractor's failure to conform to contract requirements; or any defect of equipment, material, workmanship, or design furnished by the Contractor.

d. The Contractor shall restore any work damaged in fulfilling the terms and conditions of this clause. The Contractor's warranty with respect to work repaired or replaced will run for one year from the date of repair or replacement.

e. The Owner will notify the Contractor, in writing, within seven (7) days after the discovery of any failure, defect, or damage.

f. If the Contractor fails to remedy any failure, defect, or damage within 14 days after receipt of notice, the Owner shall have the right to replace, repair, or otherwise remedy the failure, defect, or damage at the Contractor's expense.

g. With respect to all warranties, express or implied, from subcontractors, manufacturers, or suppliers for work performed and materials furnished under this contract, the Contractor shall: (1) Obtain all warranties that would be given in normal commercial practice; (2) Require all warranties to be executed, in writing, for the benefit of the Owner, as directed by the Owner, and (3) Enforce all warranties for the benefit of the Owner.

h. This warranty shall not limit the Owner's rights with respect to latent defects, gross mistakes, or fraud.

Rough River State Park Airport
PAPI Replacement

AC 150/5370-10H
12/21/2018

90-11 Contractor Final Project Documentation. Approval of final payment to the Contractor is contingent upon completion and submittal of the items listed below. The final payment will not be approved until the RPR approves the Contractor's final submittal. The Contractor shall:

- a. Provide two (2) copies of all manufacturers warranties specified for materials, equipment, and installations.
- b. Provide weekly payroll records (not previously received) from the general Contractor and all subcontractors.
- c. Complete final cleanup in accordance with Section 40, paragraph 40-08, *Final Cleanup*.
- d. Complete all punch list items identified during the Final Inspection.
- e. Provide complete release of all claims for labor and material arising out of the Contract.
- f. Provide a certified statement signed by the subcontractors, indicating actual amounts paid to the Disadvantaged Business Enterprise (DBE) subcontractors and/or suppliers associated with the project.
- g. When applicable per state requirements, return copies of sales tax completion forms.
- h. Manufacturer's certifications for all items incorporated in the work.
- i. All required record drawings, as-built drawings or as-constructed drawings.
- j. Project Operation and Maintenance (O&M) Manual(s).
- k. Security for Construction Warranty.
- l. Equipment commissioning documentation submitted, if required.

END OF SECTION 90

Rough River State Park Airport

PAPI Replacement

AC 150/5370-10H

12/21/2018

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

00 73 00 SPECIAL PROVISIONS

TABLE OF CONTENTS

A-01	ACCESS TO RECORDS AND REPORTS
A-02	BREACH OF CONTRACT
A-03	BUY AMERICAN PREFERENCE
A-04	CIVIL RIGHTS - GENERAL
A-05	CIVIL RIGHTS – TITLE VI ASSURANCES
A-06	CLEAN AIR AND WATER POLLUTION CONTROL
A-07	CONTRACT WORK HOURS AND SAFETY STANDARDS
A-08	COPELAND “ANTI-KICKBACK” ACT
A-09	DAVIS-BACON REQUIREMENTS
A-10	DEBARMENT AND SUSPENSION
A-11	DISADVANTAGED BUSINESS ENTERPRISE ¹
A-12	DISTRACTED DRIVING
A-13	PROHIBITION ON CERTAIN TELECOMMUNICATIONS AND VIDEO SURVEILLANCE SERVICES OR EQUIPMENT
A-14	DRUG FREE WORKPLACE REQUIREMENTS
A-15	FEDERAL FAIR LABOR STANDARDS ACT
A-16	LOBBYING FEDERAL EMPLOYEES
A-17	OCCUPATIONAL SAFETY AND HEALTH ACT OF 1970
A-18	PROCUREMENT OF RECOVERED MATERIALS
A-19	RIGHT TO INVENTIONS
A-20	SEISMIC SAFETY
A-21	TAX DELINQUENCY AND FELONY CONVICTION
A-22	TERMINATION OF CONTRACT
A-23	TRADE RESTRICTION CERTIFICATION
A-24	VETERAN’S PREFERENCE
A-25	DOMESTIC PREFERENCES FOR PROCUREMENTS
A-26	PROHIBITION OF COVERED UNMANNED AIRCRAFT SYSTEMS (UAS)

¹ UNDER 49 CFR §§ 26.13(B) AND 26.21, ANY SPONSOR WITH MORE THAN \$250,000 IN TOTAL CONTRACTING OPPORTUNITIES IN 1 YEAR MUST INCORPORATE REQUIRED LANGUAGE IN EACH CONTRACT, REGARDLESS OF THE PARTICULAR CONTRACT’S DOLLAR VALUE.

B. STATE TERMS AND CONDITIONS

B-01	GENERAL
B-02	AIRSPACE PERMITS
B-03	CLOSEOUT

C. LOCAL TERMS AND CONDITIONS

C-01	CONTRACTOR’S INSURANCE
C-02	UTILITIES
C-03	LEGAL HOLIDAYS
C-04	PROJECT MEETINGS AND COORDINATION
C-05	EXTENSIONS OF TIME
C-06	QUALITY ASSURANCE/MATERIALS TESTING
C-07	RECORD DOCUMENTS
C-08	CONTRACTOR/SUBCONTRACTOR/SUPPLIER LEGAL DISPUTES

Rough River State Park Airport

PAPI Replacement

- C-09
- CONSTRUCTION WARRANTY OBSERVATION COST
- C-10
- CONTRACTOR'S RELEASE AND AFFIDAVIT
- C-11
- SUBMITTALS
- C-12
- STORMWATER POLLUTION PREVENTION PLAN
- C-13
- SUBSURFACE AND PHYSICAL CONDITIONS; HAZARDOUS ENVIRONMENTAL
CONDITIONS
- C-14
- OWNER'S SAFETY PROGRAM
- C-15
- PROJECT SUPERINTENDENT
- C-16
- SALES AND USE TAXES

**Rough River State Park Airport
PAPI Replacement**

SECTION A – FEDERAL AVIATION ADMINISTRATION REQUIREMENTS

A-01 ACCESS TO RECORDS AND REPORTS

Not Applicable.

A-02 BREACH OF CONTRACT

Not Applicable.

A-03 BUY AMERICAN PREFERENCES

Not Applicable.

A-04 CIVIL RIGHTS – GENERAL

In all its activities within the scope of its airport program, the Contractor agrees to comply with pertinent statutes, Executive Orders, and such rules as identified in Title VI List of Pertinent Nondiscrimination Acts and Authorities to ensure that no person shall, on the grounds of race, color, national origin, creed, sex, age, or disability be excluded from participating in any activity conducted with or benefiting from Federal assistance. This provision is in addition to that required by Title VI of the Civil Rights Act of 1964.

This provision binds the Contractor and subcontractors from the bid solicitation period through the completion of the contract.

A-05 CIVIL RIGHTS – TITLE VI ASSURANCES

Title VI Solicitation Notice:

As a condition of a grant award, the Sponsor shall demonstrate that it complies with the provisions of Title VI of the Civil Rights Act of 1964 (42 U.S.C. §§ 2000d et seq) and implementing regulations (49 CFR part 21) including amendments thereto, the Airport and Airway Improvement Act of 1982 (49 U.S.C. § 47123), the Age Discrimination Act of 1975 (42 U.S.C. 6101 et seq.), Section 504 of the Rehabilitation Act of 1973 (29 U.S.C. § 794 et seq.), the Americans with Disabilities Act of 1990 (42 U.S.C. § 12101, et seq.), U.S. Department of Transportation and Federal Aviation Administration (FAA) Assurances, and other relevant civil rights statutes, regulations, or authorities, including any amendments or updates thereto. This may include, as applicable, providing a current Title VI Program Plan to the FAA for approval, in the format and according to the timeline required by the FAA, and other information about the communities that will be benefited and impacted by the project. A completed FAA Title VI Pre-Grant Award Checklist is required for every grant application, unless excused by the FAA. The Sponsor shall affirmatively ensure that when carrying out any project supported by this grant that it complies with all federal nondiscrimination and civil rights laws based on race, color, national origin, sex, creed, age, disability, genetic information, in consideration for federal financial assistance. The Department's and FAA's Office of Civil Rights may provide resources and technical assistance to recipients to ensure full and sustainable compliance with Federal civil rights requirements. Failure to comply with civil rights requirements will be considered a violation of the agreement or contract and be subject to any enforcement action as authorized by law.

Title VI List of Pertinent Nondiscrimination Acts and Authorities:

During the performance of this contract, the Contractor, for itself, its assignees, and successors in interest (hereinafter referred to as the "Contractor") agrees to comply with the following non-discrimination statutes and authorities; including but not limited to:

- Title VI of the Civil Rights Act of 1964 (42 U.S.C. § 2000d et seq., 78 stat. 252) (prohibits discrimination on the basis of race, color, national origin);

Rough River State Park Airport
PAPI Replacement

- 49 CFR Part 21 (Non-discrimination in Federally-Assisted programs of the Department of Transportation—Effectuation of Title VI of the Civil Rights Act of 1964) including amendments thereto;
- The Uniform Relocation Assistance and Real Property Acquisition Policies Act of 1970, (42 U.S.C. § 4601) (prohibits unfair treatment of persons displaced or whose property has been acquired because of Federal or Federal-aid programs and projects);
- Section 504 of the Rehabilitation Act of 1973 (29 U.S.C. § 794 et seq.), as amended (prohibits discrimination on the basis of disability); and 49 CFR part 27 (Nondiscrimination on the Basis of Disability in Programs or Activities Receiving Federal Financial Assistance);
- The Age Discrimination Act of 1975, as amended (42 U.S.C. § 6101 et seq.) (prohibits discrimination on the basis of age);
- Airport and Airway Improvement Act of 1982 (49 U.S.C. § 47123), as amended (prohibits discrimination based on race, creed, color, national origin, or sex);
- The Civil Rights Restoration Act of 1987 (P.L. 100-259) (broadened the scope, coverage and applicability of Title VI of the Civil Rights Act of 1964, the Age Discrimination Act of 1975 and Section 504 of the Rehabilitation Act of 1973, by expanding the definition of the terms “programs or activities” to include all of the programs or activities of the Federal-aid recipients, sub-recipients and contractors, whether such programs or activities are Federally funded or not);
- Titles II and III of the Americans with Disabilities Act of 1990 (42 U.S.C. § 12101, et seq) (prohibit discrimination on the basis of disability in the operation of public entities, public and private transportation systems, places of public accommodation, and certain testing entities) as implemented by U.S. Department of Transportation regulations at 49 CFR Parts 37 and 38;
- Title IX of the Education Amendments of 1972, as amended, which prohibits you from discriminating because of sex in education programs or activities (20 U.S.C. § 1681, et seq).

Compliance with Nondiscrimination Requirements:

During the performance of this contract, the contractor, for itself, its assignees, and successors in interest (hereinafter referred to as the “Contractor”) agrees as follows:

1. **Compliance with Regulations:** The contractor (hereinafter includes consultants) will comply with the **Title VI List of Pertinent Nondiscrimination Acts and Authorities**, as they may be amended from time to time, which are herein incorporated by reference and made a part of this contract.
2. **Nondiscrimination:** The Contractor, with regard to the work performed by it during the contract, will not discriminate on the grounds of race, color, national origin, creed, sex, age, or disability in the selection and retention of subcontractors, including procurements of materials and leases of equipment. The Contractor will not participate directly or indirectly in the discrimination prohibited by the Nondiscrimination Acts and Authorities, including employment practices when the contract covers any activity, project, or program set forth in Appendix B of 49 CFR part 21 including amendments thereto.
3. **Solicitations for Subcontracts, Including Procurements of Materials and Equipment:** In all solicitations, either by competitive bidding or negotiation made by the Contractor for work to be performed under a subcontract, including procurements of materials, or leases of equipment, each potential subcontractor or supplier will be notified by the Contractor of the contractor’s obligations under this contract and the Nondiscrimination Acts And Authorities on the grounds of race, color, or national origin.

Rough River State Park Airport
PAPI Replacement

- 4. Information and Reports:** The Contractor will provide all information and reports required by the Acts, the Regulations, and directives issued pursuant thereto and will permit access to its books, records, accounts, other sources of information, and its facilities as may be determined by the Sponsor or the Federal Aviation Administration to be pertinent to ascertain compliance with such Nondiscrimination Acts and Authorities and instructions. Where any information required of a contractor is in the exclusive possession of another who fails or refuses to furnish the information, the Contractor will so certify to the Sponsor or the Federal Aviation Administration, as appropriate, and will set forth what efforts it has made to obtain the information.
- 5. Sanctions for Noncompliance:** In the event of a Contractor's noncompliance with the non-discrimination provisions of this contract, the Sponsor will impose such contract sanctions as it or the Federal Aviation Administration may determine to be appropriate, including, but not limited to:
- a. Withholding payments to the Contractor under the contract until the Contractor complies; and/or
 - b. Cancelling, terminating, or suspending a contract, in whole or in part.
- 6. Incorporation of Provisions:** The Contractor will include the provisions of paragraphs one through six in every subcontract, including procurements of materials and leases of equipment, unless exempt by the Acts, the Regulations, and directives issued pursuant thereto. The Contractor will take action with respect to any subcontract or procurement as the Sponsor or the Federal Aviation Administration may direct as a means of enforcing such provisions including sanctions for noncompliance. Provided, that if the Contractor becomes involved in, or is threatened with litigation by a subcontractor, or supplier because of such direction, the Contractor may request the Sponsor to enter into any litigation to protect the interests of the Sponsor. In addition, the Contractor may request the United States to enter into the litigation to protect the interests of the United States.

A-06 CLEAN AIR AND WATER POLLUTION CONTROL

Not Applicable.

A-07 CONTRACT WORK HOURS AND SAFETY STANDARDS ACT REQUIREMENTS

Not Applicable.

A-08 COPELAND "ANTI-KICKBACK" ACT

Not Applicable.

A-09 DAVIS-BACON REQUIREMENTS

Not Applicable.

A-10 DEBARMENT AND SUSPENSION

Not Applicable.

A-11 DISADVANTAGED BUSINESS ENTERPRISE

The Contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26, including any amendments thereto, in the award and administration of DOT-assisted contracts. Failure by the Contractor to carry out these requirements is a material breach of this contract,

Rough River State Park Airport
PAPI Replacement

which may result in the termination of this contract or such other remedy as the recipient deems appropriate, which may include, but is not limited to:

- 1) Withholding monthly progress payments;
- 2) Assessing sanctions;
- 3) Liquidated damages; and/or
- 4) Disqualifying the Contractor from future bidding as non-responsible.

Prompt Payment (49 CFR § 26.29)

The prime contractor agrees to pay each subcontractor under this prime contract for satisfactory performance of its contract no later than 30 days from the receipt of each payment the prime contractor receives from the Owner. The prime contractor agrees further to return retainage payments to each subcontractor within 30 days after the subcontractor's work is satisfactorily completed. Any delay or postponement of payment from the above referenced time frame may occur only for good cause following written approval of the Owner. This clause applies to both DBE and non-DBE subcontractors.

Termination of DBE Subcontracts (49 CFR § 26.53)

The prime contractor must not terminate a DBE subcontractor listed in bid (or an approved substitute DBE firm) without prior written consent of the Owner. This includes, but is not limited to, instances in which the prime contractor seeks to perform work originally designated for a DBE subcontractor with its own forces or those of an affiliate, a non-DBE firm, or with another DBE firm.

The prime contractor shall utilize the specific DBEs listed to perform the work and supply the materials for which each is listed unless the contractor obtains written consent from the Owner. Unless the Owner consent is provided, the prime contractor shall not be entitled to any payment for work or material unless it is performed or supplied by the listed DBE.

The Owner may provide such written consent only if the Owner agrees, for reasons stated in the concurrence document, that the prime contractor has good cause to terminate the DBE firm. For purposes of this paragraph, good cause includes the circumstances listed in 49 CFR §26.53.

Before transmitting to the Owner its request to terminate and/or substitute a DBE subcontractor, the prime contractor must give notice in writing to the DBE subcontractor, with a copy to the Owner, of its intent to request to terminate and/or substitute, and the reason for the request.

The prime contractor must give the DBE five days to respond to the prime contractor's notice and advise the Owner and the contractor of the reasons, if any, why it objects to the proposed termination of its subcontract and why the Owner should not approve the prime contractor's action. If required in a particular case as a matter of public necessity (e.g., safety), the Owner may provide a response period shorter than five days.

In addition to post-award terminations, the provisions of this section apply to pre-award deletions of or substitutions for DBE firms put forward by offerors in negotiated procurements.

Rough River State Park Airport
PAPI Replacement

A-12 DISTRACTED DRIVING

Not Applicable.

A-13 PROHIBITION ON CERTAIN TELECOMMUNICATIONS AND VIDEO SURVEILLANCE SERVICES OR EQUIPMENT

Not Applicable.

A-14 DRUG FREE WORKPLACE REQUIREMENTS

This provision applies to all AIP funded projects, but not to the contracts between the grantee (the Sponsor) and a contractor, subcontractors, suppliers, or subgrantees.

A-15 FEDERAL FAIR WORKPLACE REQUIREMENTS

Not Applicable.

A-16 LOBBYING FEDERAL EMPLOYEES

Not Applicable.

A-17 OCCUPATIONAL SAFETY AND HEALTH ACT

All contracts and subcontracts that result from this solicitation incorporate by reference the requirements of 29 CFR Part 1910 with the same force and effect as if given in full text. The employer must provide a work environment that is free from recognized hazards that may cause death or serious physical harm to the employee. The employer retains full responsibility to monitor its compliance and their subcontractor's compliance with the applicable requirements of the Occupational Safety and Health Act of 1970 (29 CFR Part 1910). The employer must address any claims or disputes that pertain to a referenced requirement directly with the U.S. Department of Labor – Occupational Safety and Health Administration.

A-18 PROCUREMENT OF RECOVERED MATERIALS

Not Applicable.

A-19 RIGHT TO INVENTIONS

Not Applicable.

A-20 SEISMIC SAFETY

Not Applicable.

A-21 TAX DELINQUENCY AND FELONY CONVICTION

Not Applicable.

A-22 TERMINATION OF CONTRACT

Not Applicable.

Rough River State Park Airport

PAPI Replacement

A-23 TRADE RESTRICTION CERTIFICATION

Not Applicable.

A-24 VETERANS PREFERENCE

Not Applicable.

A-25 DOMESTIC PREFERENCES FOR PROCUREMENT

Not Applicable.

A-26 PROHIBITION OF COVERED UNMANNED AIRCRAFT SYSTEMS (UAS)

Not Applicable.

Rough River State Park Airport

PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

SECTION B – STATE TERMS AND CONDITIONS

B-01 GENERAL

The intent of these specifications is to outline the requirements set forth by the FAA and the Commonwealth of Kentucky; however, this document does not include all applicable State laws. All requirements set forth by the Commonwealth of Kentucky for bidding, bonding and wages shall be included by reference herein. If for any reason that the Federal and/or State requirements conflict with the requirements set forth in this contract, the more stringent of the requirements shall govern.

The Bidder shall complete the Statement of Bidder's Qualifications as a part of their bid package.

The Contractor shall perform, with his organization, an amount of work equal to at least 30 percent of the total contract cost.

The successful Bidder, if a corporation created under the laws of some state other than the Commonwealth of Kentucky, will be required to have a license to do business in the Commonwealth of Kentucky.

B-02 AIRSPACE PERMITS

In accordance with 602 KAR 50:030 relating to KRS 183.861, 183.865, 183.867 and 183.870, the Kentucky Airport Zoning Commission (KAZC) has jurisdiction over zoning for all public use and military airports. A permit from the KAZC to construct or alter a structure is required. This has been submitted and completed by the Engineer. The KAZC form is still pending approval, however it is not anticipated to delay the project. The previous application has been approved to use men and equipment (excluding cranes).

If a crane is to be used on the project, the Contractor shall be responsible for completing the required application (TC 55-20) and obtaining the required permit for construction practices and activities. The Engineer shall assist in the completion of this application at the request of the Contractor. The Contractor shall be responsible for any fines or imprisonment for failing to comply with the KAZC statutes and regulations as set forth in KRS 183.990(3). In addition, applications and permits required by the Commonwealth of Kentucky for individual trades shall be the responsibility of the Contractor and his/her Subcontractors. The Engineer shall not be held responsible for failure to comply with Kentucky trade specific requirements.

B-03 PROJECT CLOSEOUT

Project closeout is hereby defined to include general requirements near end of contract time, in preparation for final acceptance, final payment, normal termination of contract, occupancy by Owner, and similar actions evidencing completion of the work.

Specific requirements for individual units of work are specified in other sections. Time of closeout is directly related to substantial completion and, therefore, may be a single time period for entire work or a series of time periods for individual parts of the work which have been certified as substantially completed at different dates. The time variation, if any, shall be applicable to other provisions of this section.

Upon completion of the project, the Contractor shall complete the certificate of warranty and submit to the Engineer along with the following:

Prior to requesting final payment, as required by the General Provisions, complete the following and list known exceptions in request:

1. Submit final payment request with final releases and supporting documentation not previously submitted and accepted. Included certificates of insurance for products and completed operations where required. Also, include Contractor's Affidavit of Payment of Debts and Claims;

Rough River State Park Airport
PAPI Replacement

2. Submit specific warranties, workmanship, maintenance bonds, maintenance agreements, final certifications, and similar documents. Certificate of Warranty Form (follows this section);
3. Submit lien waivers from all subcontractors and suppliers;
4. Submit consent of surety;
5. Maintain on-site one set of Contract Documents (plans and specifications) to be utilized for record documents and submit at project closeout. Legibly mark and record actual products installed and indicate any changes to the plans;
6. Submit written certification that the Contract Documents (plans and specifications) have been reviewed, work has been inspected, and the work is complete in accordance with the Contract Documents (plans and specifications) and ready for final inspection by the Engineer and Owner.
7. Copy of the Contractor's daily reports and quality control testing results.
8. Provide two (2) copies of all manufacturers warranties specified for materials, equipment, and installations.
9. Provide weekly payroll records (not previously received) from the general Contractor and all subcontractors.
10. Complete final cleanup in accordance with Section 40, paragraph 40-08, *Final Cleanup*.
11. Complete all punch list items identified during the Final Inspection.
12. Provide a certified statement signed by the subcontractors, indicating actual amounts paid to the Disadvantaged Business Enterprise (DBE) subcontractors and/or suppliers associated with the project.
13. Manufacturer's certifications for all items incorporated in the work.
14. Project Operation and Maintenance (O&M) Manual(s).

Rough River State Park Airport

PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

SECTION C – LOCAL TERMS AND CONDITIONS

C-01 CONTRACTOR'S INSURANCE

Insurance shall meet the requirements of the Kentucky Transportation Cabinet.

Owner and Garver, LLC shall be included as an insured under the CGL, (using ISO Additional Insured Endorsement CG 20 10 11 85 or a substitute providing equivalent coverage), and under the commercial automobile liability (using ISO Additional Insured Endorsement CA 2048 or a substitute providing equivalent coverage), and commercial umbrella, if any. This insurance, including insurance provided under the commercial umbrella, if any, shall apply as primary and non-contributory insurance with respect to any other insurance or self-insurance programs afforded to, or maintained by, Owner.

C-02 UTILITIES

All work in this contract shall be in accordance with the Kentucky Underground Facilities Damage Prevention Act. The Contractor shall abide by the most current edition of this Act.

C-03 LEGAL HOLIDAYS

Holidays shall be defined in KYTC Standard Specifications. No construction observation will be furnished on legal holidays or on Sundays, except in an emergency. The Contractor shall observe these legal holidays and all Sundays, and no work shall be performed on these days except in an emergency.

C-04 PROJECT MEETINGS AND COORDINATION

A preconstruction conference will be called by the Engineer at a time convenient to the Owner and before the issuance of the "Notice to Proceed". The Engineer and the Contractor and such subcontractors as the Contractor may desire shall attend this meeting with the Owner.

The Owner and/or Engineer will call such coordination conferences as may seem expedient to him for the purpose of assuring coordination of the work covered by this Contract. The Contractor shall attend all such conferences. This in no way relieves the Contractor of his responsibility to fully coordinate his work under this Contract.

C-05 EXTENSIONS OF TIME

Time extensions shall be per KYTC specifications.

C-06 QUALITY ASSURANCE/MATERIALS TESTING

The Owner shall be responsible for quality assurance testing as stated in these specifications; however, the Contractor shall be responsible for payment of any subsequent tests made necessary by previous unsatisfactory tests. In this event, the Owner's quality assurance representative shall conduct the additional testing and payment for such tests shall be directly deducted from the Contractor's payment. The Contractor shall pay for additional testing at the Owner's contract rate.

C-07 RECORD DOCUMENTS

The Contractor shall keep one record copy of all Specifications, Drawings, Addenda, Modifications, Shop Drawings and samples at the site, in good order, and annotated to show all changes made during the construction process. In addition, the Contractor shall note any differences between locations of underground existing facilities shown in the plans and the actual location located during construction. These record

Rough River State Park Airport
PAPI Replacement

documents shall be available to the Engineer for examination and shall be delivered to the Engineer upon completion of the work.

C-08 CONTRACTOR/SUBCONTRACTOR/SUPPLIER LEGAL DISPUTES

Any fees, expenses, charges, fines or other costs borne by the Owner as a result of legal disputes or lawsuits between the contractor and his subcontractors, or between the contractor and his suppliers, shall be deducted from monies due or which may thereafter become due the contractor.

C-09 CONSTRUCTION WARRANTY OBSERVATION COST

The Contractor will be responsible for all costs associated with construction observation and oversight for work related to warranty repair as described in the General Provisions.

C-10 CONTRACTOR'S RELEASE AND AFFIDAVIT

At the project's completion, the Contractor shall execute the attached Release and Lien Waiver to release all claims against the Owner arising under and by virtue of his Contract. The date of the Release shall be that agreed to for the final acceptance of the project with the Owner.

C-11 SUBMITTALS

The Contractor shall prepare and submit information required by the individual Specification sections sufficiently in advance of the related work to allow an appropriate review time by the Engineer. The types of submittals are indicated in the individual Specification sections.

During the preconstruction conference, the Contractor shall review his submittal schedule and procedures. The Contractor shall provide one of the following submittal package types:

1. Submit electronic submittals via email as PDF electronic files directly to the Engineer's designated representative, or post these PDF electronic files directly to the Engineer's FTP site specifically established for this project. Electronic submittals shall be in Adobe Acrobat (*.PDF) format and shall be legible when printed.

Submittals shall be neat, organized, and easy to interpret. Assemble complete submittal package into a single indexed electronic file, incorporating submittal requirements of an individual Specification section, the transmittal form with unique submittal numbering system, and electronic links or tabs enabling navigation to each item. Unless approved otherwise by the Engineer, all submittals for the individual Specification section shall be submitted at one time.

Submittals must come directly from the Prime Contractor; submittals from subcontractors or suppliers will not be reviewed.

Incomplete submittals are unacceptable, will be considered nonresponsive, and will be returned for resubmittal without review. Faxed submittals or submittals with extremely small or otherwise unreadable print will not be accepted. Submittals not required by the Contract Documents will be returned by the Engineer without action.

The Contractor shall be responsible for payment of any subsequent submittal reviews beyond the second iteration of a specific item as indicated by the construction submittal log. In this event, the Owner's representative shall conduct the submittal review and payment for the submittal review shall be directly deducted from the Contractor's payment. The Contractor shall pay for additional submittal reviews at the Owner's contract rate.

Rough River State Park Airport
PAPI Replacement

The Contractor shall retain complete copies of submittals on project site. Use only final submittals that are marked with approval notation from Engineer’s submittal review stamp with comments form.

Resubmittals shall continue the unique, sequential, submittal numbering system. Resubmittals without unique numbering, example resubmittals transmitted as 005A or 005REV, are unacceptable and will be returned un-reviewed.

END OF SPECIAL PROVISIONS

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

RELEASE OF LIEN

FROM: Contractor's Name: _____

Address: _____

TO: Owner's Name: _____

Address: _____

DATE OF CONTRACT: _____

Upon receipt of the final payment and in consideration of that amount, the undersigned does hereby release the Owner and its agents from any and all claims arising under or by virtue of this Contract or modification thereof occurring from the undersigned's performance in connection with the

project.

Contractor's Signature: _____

Title: _____

Subscribed and sworn to before me this _____ day of _____, 20____.

Notary Public

My Commission Expires:

Rough River State Park Airport
PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
PAPI Replacement

CONTRACTOR'S AFFIDAVIT

FROM: Contractor's Name: _____

Address: _____

TO: Owner's Name: _____

Address: _____

DATE OF CONTRACT: _____

I hereby certify that all claims for material, labor, and supplies entered into contingent and incident to the construction or used in the course of the performance of the work on the

_____ project have been fully satisfied.

Contractor's Signature: _____

Title: _____

Subscribed and sworn to before me this _____ day of _____, 20____.

Notary Public

My Commission Expires:

The Surety Company consents to the release of the retained percentage on this project with the understanding that should any unforeseen contingencies arise having a right of action on the bond that the Surety Company will not waive liability through the consent to the release of the retained percentage.

Dated: _____

Surety Company: _____

By: _____
Resident Agent, State of Kentucky

Rough River State Park Airport

PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport

2I3 PAPI Replacement

ITEM SS-101 SAFETY PLAN COMPLIANCE DOCUMENT (SPCD)

DESCRIPTION

101-1.1 The Contractor must thoroughly review the approved Construction Safety and Phasing Plan (CSPP) and comply with the approved CSPP. The Contractor must certify such compliance by completing the attached SPCD and submitting to the Engineer for approval. No separate payment will be made for completion of the SPCD.

Rough River State Park Airport

2I3 PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport

2I3 PAPI Replacement

Contractor Safety Plan Compliance Documents

Owner Name: KENTUCKY DEPARTMENT OF AVIATION

Airport: Rough River State Park Airport

Project Description: PAPI Replacement

Contractor:

Each item listed below corresponds to a specific section of the approved CSPP. The Contractor shall certify that he/she will comply with each section of the approved CSPP. Each certified section with a "no" response must be fully explained in an attachment to the SPCD. The document shall be signed and dated by a principal or owner in the Contractor's company. All other requested information shall be completed by the Contractor and submitted to the Engineer for approval as part of the SPCD.

1. Section 1 - Coordination: This project shall be completed in accordance with Section 1 "Coordination" of the approved Construction Safety and Phasing Plan.

Owner: KENTUCKY DEPARTMENT OF AVIATION	
Contact:	Phone:
Engineer:	
Project Manager:	Phone:
Project Engineer:	Phone:
Construction Observer:	Phone:
Materials Testing:	Phone:
Contractor:	
Project Manager:	Phone:
Superintendent:	Phone:
Subcontractors:	Phone:
LIST ALL SUBS	

Yes No

2. Section 2 - Phasing: This project shall be completed in accordance with Section 2 "Phasing" of the approved Construction Safety and Phasing Plan.

Yes No

3. Section 3 – Areas of Operations Affected by Construction Activity: This project shall be completed in accordance with Section 3 "Areas of Operations Affected by Construction Activity" of the approved Construction Safety and Phasing Plan.

Yes No

Rough River State Park Airport

2I3 PAPI Replacement

4. **Section 4 – Protection of Navigational Aids (NAVAIDS):** This project shall be completed in accordance with Section 4 “Protection of Navigational Aids (NAVAIDS)” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

5. **Section 5 – Contractor Access:** This project shall be completed in accordance with Section 5 “Contractor Access” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

6. **Section 6 – Wildlife Management:** This project shall be completed in accordance with Section 6 “Wildlife Management” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

7. **Section 7 – Foreign Object Debris (FOD) Management:** This project shall be completed in accordance with Section 7 “Foreign Object Debris (FOD) Management” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

8. **Section 8 – Hazardous Materials (HAZMAT) Management:** This project shall be completed in accordance with Section 8 “Hazardous Materials (HAZMAT) Management” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

9. **Section 9 – Notification of Construction Activities:** This project shall be completed in accordance with Section 9 “Notification of Construction Activities” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

10. **Section 10 – Inspection Requirements:** This project shall be completed in accordance with Section 10 “Inspection Requirements” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

11. **Section 11 – Underground Utilities:** This project shall be completed in accordance with Section 11 “Underground Utilities” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

12. **Section 12 – Penalties:** This project shall be completed in accordance with Section 12 “Penalties” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

13. **Section 13 – Special Conditions:** This project shall be completed in accordance with Section 13 “Special Conditions” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

Rough River State Park Airport
2I3 PAPI Replacement

14. **Section 14 – Runway and Taxiway Visual Aids:** This project shall be completed in accordance with Section 14 “Runway and Taxiway Visual Aids” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

15. **Section 15 – Marking and Signs for Access Routes:** This project shall be completed in accordance with Section 15 “Marking and Signs for Access Routes” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

16. **Section 16 – Hazard Marking and Lighting:** This project shall be completed in accordance with Section 16 “Hazard Marking and Lighting” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

17. **Section 17 – Work Zone Lighting for Nighttime Construction:** This project shall be completed in accordance with Section 17 “Work Zone Lighting for Nighttime Construction” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

18. **Section 18 – Protection of Safety Areas, Object Free Areas, Object Free Zones, and Approach / Departure Surfaces:** This project shall be completed in accordance with Section 18 “Protection of Safety Areas, Object Free Areas, Object Free Zones, and Approach / Departure Surfaces” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

19. **Section 19 – Other Limitations on Construction:** This project shall be completed in accordance with Section 19 “Other Limitations on Construction” of the approved Construction Safety and Phasing Plan.

Yes_____No_____

I certify that, for the project identified herein, the responses to the foregoing items are correct as marked, and that I shall comply with the approved Construction Safety and Plan.

Signed: _____
Contractor's Authorized Representative

Date: _____

Print Name and Title of Contractor's Representative

END OF ITEM SS-101

Rough River State Park Airport
2I3 PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport

2I3 PAPI Replacement

MEASUREMENT AND PAYMENT

110-4.1 Standard Specifications will not be measured for separate payment unless otherwise noted.

110-4.2 KYTC Seed and Topsoil shall not be measured for separate payment but will be considered subsidiary to the contract.

110-4.3 Demobilization will be measured and paid in accordance with the schedule included in Section 110 of the Standard Specifications.

Payment will be made under:

Item 02569 DEMOBILIZATION – per Lump Sum

END OF ITEM SS-110

Rough River State Park Airport

2I3 PAPI Replacement

ITEM SS-120 CONSTRUCTION SAFETY AND SECURITY

DESCRIPTION

120-1.1 This item covers safety and security for construction of the proposed improvements

The attention of the bidder is directed to the necessity for careful examination of the entire project site to determine, at the time of bid preparation, the full extent of work to be done under the item "Construction Safety and Security."

The item "Construction Safety and Security" includes:

- 1. Low Profile Barricades
- 2. Runway Closure Markers
- 3. Airport Security Requirements
- 4. Airport Safety Requirements

CONSTRUCTION METHODS

120-2.1 Low profile barricades. The Contractor must furnish, install, maintain, and remove low profile barricades in accordance with details on the plans and as directed by the Engineer. The low profile barricades must be constructed and installed as shown on the plans. All low profile barricades must be constructed in accordance with AC 150/5370-2G Operational Safety on Airports During Construction.

120-2.2 Runway closure markers. The Contractor must furnish, install, maintain, and remove runway closure markers in accordance with details on the plans and as directed by the Engineer. The runway closure markers must be aviation yellow, nylon-reinforced vinyl or lighted closure Xs as required by the plans. The markers must be secured to the pavement/ground as shown on the plans and as directed by the Engineer. All runway closure markers must be constructed in accordance with AC 150/5370-2G Operational Safety on Airports During Construction.

120-2.3 Airport security requirements. The Contractor must abide by the Airport Security requirements that are outlined in the Construction Safety and Phasing Plan (CSPP). Any costs associated with the Airport Security requirements will not be measured for separate payment but will be considered subsidiary to the bid item "Construction Safety and Security."

120-2.4 Airport safety requirements. The Contractor must abide by the Airport Safety requirements that are outlined in the Construction Safety and Phasing Plan (CSPP). Any costs associated with the Airport Safety requirements will not be measured for separate payment but will be considered subsidiary to the bid item "Construction Safety and Security."

METHOD OF MEASUREMENT

120-3.1 Construction safety and security will be measured as a lump sum complete item. The Contractor will be required to provide a cost breakdown of lump sum items after the bid, if requested by the Owner. The breakdown must include overhead, labor, materials, and equipment items. Based upon the contract lump sum price for "Construction safety and security" partial payments will be allowed as follows:

- a. With the first pay request following installation of construction safety devices, 25%.
- b. When 25% or more of the original contract is earned, an additional 25%.
- c. When 50% or more of the original contract is earned, an additional 40%.
- d. After Final Inspection, work area clean-up, and turn over of the project area to Owner use, the final 10%.

Rough River State Park Airport
213 PAPI Replacement

- 120-3.2** Low profile barricades will not be measured for separate payment.
- 120-3.3** Runway closure markers will not be measured for separate payment.
- 120-3.4** Abiding by the Airport Security requirements will not be measured for separate payment.
- 120-3.5** Abiding by the Airport Safety requirements will not be measured for separate payment.

BASIS OF PAYMENT

- 120-4.1** Periodic payments will be made under this item in proportion to the amount of work accomplished, as determined by the Engineer. Based upon the contract lump sum price for "Construction safety and security" partial payments will be allowed as follows:
- a. With the first pay request following installation of construction safety devices, 20%.
 - b. When 25% or more of the original contract is earned, an additional 20%.
 - c. When 50% or more of the original contract is earned, an additional 25%.
 - d. When 75% or more of the original contract is earned, an additional 25%.
 - e. After Final Inspection, work area clean-up, and turn over of the project area to Owner use, the final 10%.

Payment is full compensation for furnishing all materials, installation, removal, maintenance, labor, equipment, tools, and incidentals required to complete the item.

Payment will be made under:

Item 40000	SITE PREPARATION (SAFETY AND SECURITY) - per Lump Sum
------------	---

END OF ITEM SS-120

Rough River State Park Airport
213 PAPI Replacement

ITEM SS-300 BASIC ELECTRICAL REQUIREMENTS

DESCRIPTION

300-1.1 This item shall consist of furnishing and installing complete electrical systems as defined in the plans and in these specifications. The work includes the installation, connection and testing of new electrical systems, equipment and all required appurtenances to construct and demonstrate proper operation of the completed electrical systems.

300-1.2 The Contractor shall maintain current copies of all referenced and applicable standards on the job site. The Contractor is responsible to make known to the Engineer any conflict between plans and specifications that he observes or of which he is made aware.

EQUIPMENT AND MATERIALS

300-2.1 Standards.

- a. Applicable National Fire Protection Association (NFPA) codes, including but not limited to:
 - (1) NFPA 70 - National Electrical Code.
 - (2) NFPA 70E - Standard for Electrical Safety in the Workplace.
 - (3) NFPA 101 - Life Safety Code.
 - (4) Internet Website: <http://www.nfpa.org>
- b. Applicable Code of Federal Regulations (CFR) codes, including but not limited to:
 - (1) 29 CFR 1910 - Occupational Safety and Health Standards (OSHA)
 - (2) 29 CFR 1926 - Safety and Health Regulations for Construction.
 - (3) Internet Website: <http://www.gpoaccess.gov/cfr/index.html>
- c. ANSI/IEEE C2 - National Electrical Safety Code.
- d. NECA 1 – Standard for Good Workmanship in Electrical Construction.
- e. Applicable Federal, State and Local Electrical Codes.
- f. Applicable Federal, State and Local Energy Codes.
- g. Applicable Federal, State and Local Building Codes.
- h. Applicable Federal, State and Local Fire Codes.
- i. Applicable City Electrical Code.
- j. Applicable City Ordinances pertaining to electrical work.
- k. Applicable Federal, State and Local - Environmental, Health and Safety Laws and Regulations.

Contractor shall utilize the most current editions of standards, which are current at time of bid and as recognized by the Authority Having Jurisdiction for the respective standard.

300-2.2 General.

a. Airport lighting equipment and materials covered by Federal Aviation Administration (FAA) specifications shall be certified and listed under Advisory Circular (AC) 150/5345-53, Airport Lighting Equipment Certification Program, current version on the date that the submittals are received by the Engineer. When an equipment advisory circular is being updated and two equipment lists for the same specific equipment are listed in the current certified equipment AC 150/5345-53 addendum, only that equipment qualified to the latest advisory circular will be acceptable.

b. All equipment and materials covered by referenced specifications shall be subject to acceptance through manufacturer's certification of compliance with the applicable specification when requested by the Engineer. All equipment and materials shall be new and meet applicable manufacturer's standards. All electrical components and products shall be tested and listed by an OSHA accepted,

Rough River State Park Airport
213 PAPI Replacement

nationally recognized testing laboratory (NRTL) to conform to the standards indicated in these contract documents and to the industry standards required in the NEC, NEMA, IEEE, UL, and applicable FAA advisory circulars.

c. Manufacturer's certifications shall not relieve the Contractor of the Contractor's responsibility to provide materials in accordance with these specifications and acceptable to the Engineer. Materials supplied and/or installed that do not materially comply with these specifications shall be removed, when directed by the Engineer and replaced with materials, which do comply with these specifications, at the sole cost of the Contractor.

d. All materials and equipment used to construct this item shall be submitted to the Engineer for approval prior to ordering the equipment. Submittals consisting of marked catalog sheets or shop drawings shall be provided. Submittal data shall be presented in a clear, precise and thorough manner. Original catalog sheets are preferred. Photocopies are acceptable provided they are as good a quality as the original. Clearly and boldly mark each copy to identify pertinent products or models applicable to this project. Indicate all optional equipment and delete non-pertinent data. Submittals for components or electrical equipment and systems shall identify the equipment for which they apply on each submittal sheet. Markings shall be boldly and clearly made with arrows or circles (highlighting is not acceptable). Contractor is solely responsible for delays in project accruing directly or indirectly from late submissions or resubmissions of submittals.

e. The data submitted shall be sufficient, in the opinion of the Engineer, to determine compliance with the Contract Documents plans and specifications. The Engineer reserves the right to reject all equipment, materials or procedures, which, in the Engineer's opinion, does not meet the system design and the standards and codes, specified herein.

f. All equipment and materials furnished and installed under this section shall be guaranteed against defects in materials and workmanship for a period of at least twelve (12) months from final acceptance by the Owner. The defective materials and/or equipment shall be repaired or replaced, at the Owner's discretion, with no additional cost to the Owner.

- (1) All LED light fixtures, except for obstruction lighting, shall be warranted by the manufacturer for a minimum of 4 years after date of installation, final acceptance testing by the Engineer, and Owner's beneficial use of the equipment, inclusive of all electronics. Refer to FAA Engineering Brief No. 67D for additional requirements.

g. After approval of submitted equipment, the Contractor shall supply the following Operation and Maintenance Manual documentation to the Owner. Two (2) complete sets of documentation shall be supplied for each model of equipment. The documentation shall be securely bound in heavy-duty 3-ring binders. The information for each piece of equipment shall be indexed using typewritten label tabs. The spine of each binder shall have a typewritten label, which indicates the included equipment types. The documentation shall include:

- (1) Approved Submittals and Shop Drawings
- (2) Cable Splicer Qualifications, Type and Voltage
- (3) State Contractors License with Electrical Classification
- (4) Master, Journeyman and Apprentice Electrician Licenses and Certifications
- (5) Lockout/Tagout Program
- (6) Installation Manuals
- (7) Operation Manuals
- (8) Maintenance Manuals
- (9) Parts Lists, including recommended spare parts. Recommended spare parts shall be furnished with the respective equipment.
- (10) Ground Rod Impedance Test Reports
- (11) Cable Pulling Tension Value Logs
- (12) Insulation Resistance Test Reports

Rough River State Park Airport
213 PAPI Replacement

h. After approval of the O&M Manuals, the Contractor shall provide three (3) complete electronic copies of all documentation in Adobe PDF file format on CD-R (non-rewriteable) discs storage media. The electronic files shall contain searchable text and include a hyperlink index for ease in locating information with the PDF file.

i. All requirements herein Item SS-300 shall be applicable to all referenced sections in these contract documents and applicable to all sections, which reference Item SS-300.

300-2.3 Operation and maintenance data.

Assemble a complete set of operation and maintenance data indicating operation and maintenance of each system, subsystem, and piece of equipment. Provide bound hard copies and electronic copies as noted in section 300-2.2.

a. Certificate of Substantial Completion, Release and Contractor's Affidavit, executed copies.

b. Final approved equipment submittals, including product data sheets and shop drawings, clearly labeled.

c. Installation manuals: Description of function, installation and calibration manuals, normal operating characteristics and limitations, performance curves, engineering data and tests, and complete nomenclature and commercial numbers of all replaceable parts.

d. Operations manuals: Manufacturer's printed operating instructions and procedures to include start-up, break-in, routine and normal operating instructions; regulation, control, stopping, shutdown, and emergency instructions; summer and winter operating instructions; and all programming and equipment settings.

e. Maintenance manuals: Maintenance procedures for routine preventative maintenance and troubleshooting; disassembly, repair, and reassembly; aligning and adjusting instructions.

f. Service manuals: Servicing instructions and lubrication charts and schedules, including the names and telephone numbers of personnel to contact for both routine periodic and warranty service for equipment and materials provided under this Specification.

g. Final test reports, clearly labeled, including but not limited to, insulation resistance test reports, ground rod impedance test reports, cable pulling tension values logs, and equipment certification tests.

h. Final certified calibration sheets for all equipment and instruments.

i. Preventive maintenance programs for the visual aid facilities and equipment installed in this project, including the applicable equipment sections within Chapter 5 "Preventive Maintenance" from AC 150/5340-26 (latest edition) "Maintenance of Airport Visual Aid Facilities".

300-2.4 Overcurrent protective devices.

a. Circuit Breakers: Circuit breakers shall be the molded-case type, as indicated, with each pole equipped with inverse time and instantaneous overcurrent tripping devices. Circuit breakers shall be UL listed. Single pole breakers shall be full module size; two poles shall not be installed in a single module. Multi-pole breakers shall be of the common-trip type having a single operating handle, and for sizes of 50 amperes or less may consist of single pole breakers permanently assembled at the factory into a multi-pole unit. Circuit breakers used for motor disconnects and not in sight of the motor controller shall be capable of being locked in the open position. Minimum interrupting rating shall be as shown.

Rough River State Park Airport
213 PAPI Replacement

300-2.5 Panelboards. Furnish and install panelboards as indicated on the Drawings. Breakers shall be bolted type and have available fault current interrupting capacity as scheduled. Single pole breakers shall be full module size; two poles shall not be installed in a single module. All multi-pole breakers shall be common trip.

- a. Panels shall be fully rated; series rated panels are not acceptable.
- b. The panels shall be load balanced by measuring the loads and making circuit changes. Record the load readings before and after changes and submit test records. Differences exceeding 20 percent between phase loads, within a panelboard, are not acceptable. Rebalance and recheck as necessary to meet this minimum requirement.
- c. The panel shall be UL listed, service entrance rated, and fully bussed with copper bussing, copper neutral bussing, and copper ground bar. All bolts used to connect current carrying parts together shall be front accessible. The panel shall have a securely attached metal nameplate listing the manufacturer, shop order number, panel type, voltage, ampacity and short circuit withstand rating. An individual terminal or lug shall be provided for each neutral allowing one wire per terminal.
- d. The panel shall be surface mounted with semi-flush locking doors and matching keys. The Contractor shall provide a typed directory and install the same in the holder behind the transparent protective covering in the panels. Provide an exterior nameplate with panel and name, mounted at the top of the panel above the door. Doors shall match enclosures. Indoor surface mounted enclosures shall have pre-punched knockouts. The panels shall be General Electric, Square D, Cutler Hammer, or approved equal.
- e. Panelboards and breakers shall conform to the requirements of Fed. Spec. W-P-115.

300-2.6 Control and timing relays. All relays shall be plug-in type relays and shall be furnished with socket base and all required mounting accessories; provide Allen-Bradley Bulletin 700 Type or approved equal. Provide relays with contacts meeting the ampacity rating requirements as indicated in the plans and as required for the equipment load to be connected and controlled.

300-2.7 Wire.

Wire (in conduit) rated up to 5,000 volts shall conform to AC 150/5345-7, Specification for L-824 Underground Electrical Cable for Airport Lighting Circuits.

For ratings up to 600 volts, moisture and heat resistant thermoplastic wire conforming to Commercial Item Description A-A-59544A Type THWN-2 shall be used. The wires shall be of the type, size, number of conductors, and voltage shown in the plans or in the proposal.

Service, underground feeder, and underground branch circuit wiring shall be minimum Type THHN/THWN-2 unless otherwise noted.

Indoor feeder and indoor branch circuit wiring shall be minimum Type THHN/THWN-2 unless otherwise noted.

Unless otherwise indicated, conductors No. 10 AWG and smaller shall be solid, and conductors No. 8 AWG and larger shall be stranded.

For electrical work of 600 volts or less, all conductors, terminations, terminal blocks, lugs, connectors, devices and equipment shall be listed, marked, and rated 75 degrees C minimum unless otherwise noted.

Rough River State Park Airport
213 PAPI Replacement

Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips that will not damage cables or raceway. Pull ropes and pull wires shall have sufficient tensile strength for the cable(s) to be pulled and installed. Damaged cable or raceway shall be replaced at no additional cost to the Owner. Calculate and do not exceed the maximum allowable pulling tension or maximum allowable sidewall bearing pressure for all conductors and cables.

Install pull wires in empty raceways. Use a polypropylene plastic line with not less than 200-pound tensile strength. Secure and leave at least 12 inches of slack at each end of pull wire to prevent it from slipping back into the conduit. Cap spare raceways with removable tapered plugs, designed for this purpose.

300-2.8 Conduit. Rigid steel conduit and fittings shall conform to the requirements of Underwriters Laboratories Standard 6, 514, and 1242.

300-2.9 Plastic conduit (for use below grade only). Plastic conduit and fittings shall conform to the requirements of Fed Spec. W-C-1094 and Underwriters Laboratories Standards UL-651 and shall be one of the following, as shown in the plans:

- a. Type I - Schedule 40 PVC suitable for underground use either direct-buried or encased in concrete.
- b. Type II - Schedule 40 PVC suitable for either above ground or underground use.
- c. Type III - Schedule 80 PVC suitable for either above ground or underground use either direct-buried or encased in conduit.

Plastic conduit adhesive shall be a solvent cement manufactured specifically for gluing the specific type of plastic conduit and fitting.

300-2.10 Tape. Rubber and plastic electrical tapes shall be Scotch Electrical Tape Numbers 23 and 88, respectively, as manufactured by the Minnesota Mining and Manufacturing Company, or an approved equal.

The electrical installation shall conform to the requirements of the latest edition of National Fire Protection Association, NFPA-70, National Electrical Code.

Copies of the National Electrical Code may be obtained from the National Fire Protection Associations, Inc., One Batterymarch Park, Quincy, Massachusetts 02269.

300-2.11 Concrete. Concrete shall be a commercial grade ready mix with a minimum 28-day compressive strength of 3500 PSI (unless otherwise noted) using 1-inch (25-mm) maximum size course aggregate, as determined by test cylinders made in accordance with ASTM C 31 and tested in accordance with ASTM C 39. Concrete located within one foot of the proposed ground surface shall contain 4 to 6 percent air content.

Mixing Conditions: Concrete shall not be mixed while the air temperature is below 40°F (4°C) without permission of the Engineer. If permission is granted for mixing under such conditions, aggregates or water, or both, shall be heated and the concrete shall be placed at a temperature not less than 50°F (10°C) nor more than 100°F (38°C). The Contractor shall be held responsible for any defective work, resulting from freezing or injury in any manner during placing and curing, and shall replace such work at his/her expense.

Placing Concrete: All concrete shall be placed during daylight, unless otherwise approved by the Engineer.

Cold Weather Protection: When concrete is placed at temperatures below 40°F (4°C), the Contractor shall provide satisfactory methods and means to protect the mix from injury by freezing. The aggregates, or water, or both, shall be heated to place the concrete at temperatures between 50°F and 100°F (10°C and 38°C). After the concrete has been placed, the Contractor shall provide sufficient protection such as cover, canvas, framework, heating apparatus, etc., to enclose and protect the structure and maintain the

Rough River State Park Airport
213 PAPI Replacement

temperature of the mix at not less than 50°F (10°C) until at least 60% of the designed strength has been attained.

Reinforcing: All reinforcing steel bars shall conform to ASTM A615, Grade 60.

Refer to the concrete foundation and footing details in the Plans. Submit professional engineer stamped shop drawings for the required state location for review and approval by the Engineer.

Flowable backfill material may only be used where specifically indicated in the Plan details.

300-2.12 Constant current regulators. Constant current regulators shall be:

- a. L-829, constant current regulator with integral control, monitoring, and meggering, Ferroresonant type
- b. Class 1, (6.6 amps)
- c. Style 2 (5 brightness steps)
- d. 240 VAC, 1-phase, 60 Hz
- e. Integral S-1 Cutout
- f. Integral distributed control and monitoring system including current voltage module (output power monitoring of the current, voltage, apparent power in VA, true power in Watts, and power factor), and insulation resistance monitoring module.

The output power rating of the regulators shall be as noted on plans and meet the criteria set forth in the most current version of AC 150/5345-10, Specification for Constant Current Regulators and Regulator Monitors. The output power rating of all existing and new regulators within the electrical vault shall be tested, checked and adjusted to meet the AC criteria prior to placing the airfield lighting circuits into service.

Regulators with output winding power taps shall have a dedicated separate nameplate on the front of the regulator indicating the power tap setting and this setting shall also be recorded in the as-built drawings. Power taps shall be set as shown on the plans or as indicated by the Engineer to provide the highest operation efficiency for the specified lighting load.

Each regulator shall be equipped with the following options:

- a. Internal 120 VAC control power transformer
- b. Remote/Local and Intensity control selector switches
- c. Output ammeter
- d. Input and output current surge limitation
- e. Circuit isolation
- f. Open circuit protection
- g. Overcurrent protection
- h. Lightning arresters across the output terminals

The regulators shall be supplied with all features and accessories required for a complete installation as defined in these Specifications and as shown on the plans.

The trip rating of all circuit breakers which are used to protect constant current lighting circuit regulators shall be coordinated with the approved regulator manufacturer. The manufacturer's recommended circuit breaker size shall be submitted to the Engineer for approval.

The Contractor shall submit his initial regulator load test reports prior to any work on the electrical system. The Contractor shall test all regulators within the electrical vault and submit these reports to the Engineer prior to Contractor proceeding with his work.

Rough River State Park Airport
213 PAPI Replacement

The Contractor shall calibrate all new and existing regulators following construction and prior to final acceptance testing in accordance with FAA AC 150/5340-26 "Maintenance of Airport Visual Aid Facilities" and manufacturer's recommendations. Contractor shall submit calibration report to Engineer.

After final acceptance testing has been completed, the Contractor shall complete and submit his final regulator load test reports to the Engineer for all regulators and insert copies of the final regulator load test reports in the Operation and Maintenance Manuals

CONSTRUCTION METHODS

300-3.1 Lockout/tagout program. The Contractor shall provide a complete copy of an electrical energy source Lockout/Tagout Program to the Owner, with copy to the Engineer. The document shall clearly identify the on-site master electricians and their contact information, including office and mobile telephone numbers.

The Lockout/Tagout Program shall comply with Part 1910 – Occupational Safety and Health Standards (OSHA) Subpart S – Electrical, and meet the requirements of 29 CFR 1910.147, The Control of Hazardous Energy (Lockout/Tagout), including requirements listed in 1910.331 through 1910.335.

Implementation of the Lockout/Tagout Program and all other related safety requirements are the sole responsibility of the Contractor.

300-3.2 Safety program. The Contractor shall implement an electrical safety program that complies with NFPA 70E and 29 CFR 1926.

Implementation of the Electrical Safety Program, determining and providing proper Personal Protective Equipment (PPE), training and enforcing personnel to wear the prescribed PPE, conducting work area safety inspections (including correcting deficiencies), and all other related safety requirements are the sole responsibility of the Contractor.

All work involved in the preparation and implementation of the safety program will not be measured for separate payment but will be considered subsidiary to the lockout/tagout bid item.

300-3.3 Preconstruction meeting.

A preconstruction meeting will be held with the Airport, State, Engineer and Contractor, prior to any work. Complete submittals and shop drawings will be submitted at this time for review. An equipment procurement schedule will be provided by the Contractor with an anticipated field construction start date. The progress construction schedule will be submitted for review each week and shall outline all installation, testing and demolition work.

300-3.4 General.

The Contractor shall be responsible for coordinating all electrical work with the Utility. The Contractor shall provide temporary service conductors and raceway system. The Contractor shall then provide and connect permanent service conductors and raceway system after the completion.

All secondary conductors and controls, signaling and lighting shown in or on buildings are included in this project. Electrical service shall be extended from the service equipment as indicated.

In general, the various electrical equipment and material to be installed by the various trades under this specification shall be run as indicated, as specified herein, as required by particular conditions at the site, and as required to conform to the generally accepted standards to complete the work in a neat and satisfactory manner. The following is a general outline concerning the running of various systems and is

Rough River State Park Airport
213 PAPI Replacement

to be expected where the drawings or conditions at the buildings necessitate deviating from these standards.

The drawings and specifications are complementary; any work required by one, but not by the other, shall be performed as though required by both.

The Contractor shall maintain copies of all equipment installation manuals on site during construction.

All conduits shall be run exposed in the equipment rooms or run concealed as indicated.

The construction details of the building are illustrated on the drawings. Each Contractor shall thoroughly acquaint himself with the details before submitting his bid as no allowances will be made because of the Contractor's unfamiliarity with these details.

The electrical plans do not give exact locations, etc., and do not show all the offsets, control lines, junction boxes, and other installation details. Each Contractor shall carefully lay out his work at the site to conform to the job conditions, to conform to details of installation supplied by the manufacturers of the equipment to be installed, and thereby to provide complete operating systems.

The electrical plans show diagrammatically the locations of the various electrical outlets and apparatus and the method of circulating and controlling them. Exact locations of these outlets and apparatus shall be determined by reference to the general plans and to all detail drawings, etc., by measurements at the buildings, and in cooperation with other crafts, and in all cases shall be subject to the approval of the Engineer. The Engineer reserves the right to make any reasonable change in location of any outlet or apparatus before installation, without additional cost to the Owner.

These Specifications and the accompanying Drawings are intended to cover systems which will not interfere with the structure of the buildings, which will fit into the several available spaces, and which will insure complete and satisfactory systems. Each bidder shall be responsible for the proper fitting of his material and apparatus into the buildings.

Should the particular equipment which any bidder proposes to install require other space conditions than those indicated on the Drawings, he shall arrange for such space with the Engineer before submitting his bid. Should changes become necessary because of failure to comply with this clause, the Contractor shall make such changes at the Contractor's expense.

Should the particular equipment which any bidder proposes to install require other installation methods, such as larger light base junction structures, etc., he shall include all such equipment and appurtenances in his bid. Should changes become necessary because of failure to coordinate equipment requirements and comply with this clause, the Contractor shall make such changes at the Contractor's expense.

The Contractor shall be responsible to see that each party furnishes electrical equipment which meets the electrical requirements specified herein and that all systems work together to produce the specified operation.

Where two or more units of the same kind or class of equipment are required, these shall be products of a single manufacturer; however, the component parts need not be the products of one manufacturer.

Each Contractor shall submit working scale drawings of all his apparatus and equipment which in any way varies from these Specifications and Plans, which shall be checked by the Engineer and approved before the work is started, and interferences with the structural conditions shall be corrected by the Contractor before the work proceeds.

Electrical equipment, such as switchgear, switchboards, panelboards, load centers and other power supply equipment, shall not be used as a common enclosure, pull box or junction box for routing conductors of

Rough River State Park Airport
213 PAPI Replacement

different systems, unless the equipment is specifically designed for this purpose and indicated as such on the Plans.

All electrical equipment shall be securely mounted as indicated in the plans, as required by the contract specifications, as required by guidelines and codes, and as required by the manufacturer using hardware compliant with the environmental conditions.

Interior components of electrical enclosures shall be securely mounted using appropriate hardware within the enclosure. Adhesives or adhesive tapes/strips are not allowed and are prohibited.

Electrical components, including but not limited to, relays, circuit boards, electronics, etc., shall be installed within approved enclosures.

The Contractor shall keep ends of conduits, including those extending through roofs, equipment and fixtures covered or closed with caps or plugs to prevent foreign material from entering during construction.

Where portions of raceways are known to be subjected to different temperatures, where condensation is a problem, and where passing from interior to exterior of a building, the portion of raceway or sleeve shall be filled with an approved material to prevent the circulation of air, prevent condensation, and prevent moisture entry. Sealing of raceways shall not occur until after the conductors and cables have been installed, tested and accepted by the Engineer.

The Contractor shall install any temporary lines and connections required to maintain electric services and safely remove and dispose of them when complete.

All temporary wiring shall conform to OSHA standards. Remove temporary services when work is complete. Any damage to electrical equipment caused by the Contractor shall be repaired at no cost to the Owner.

All non-current carrying parts and neutrals shall be grounded as indicated on the Drawings or as required by the Codes.

White and/or gray outer finish conductors may only be used as grounded conductors or neutral conductors in accordance with NEC.

Install insulated green equipment grounding conductors with all feeder and branch circuits.

Provide separate insulated equipment grounding conductors from grounding system to each electrical equipment, telecommunication equipment, other special electrical system equipment, and appurtenance item location in accordance with NFPA 70 and other applicable standard requirements.

The bidder shall inspect the site, thoroughly acquaint himself with conditions to be met and work to be accomplished. Failure to comply with this shall not constitute grounds for any additional payments.

Where electrical equipment is installed that causes electrical noise interference with other systems either existing or installed under this contract, the offending equipment shall be equipped with isolating transformers, filters, reactors, shielding, or any other means as required for the satisfactory suppression of the interferences, as determined by the Engineer.

All junction boxes, expansion joints, flexible connections, instruments and similar items requiring servicing or repairs shall be installed in an accessible location.

All salvage and equipment removed by the work shall remain the property of the Owner. Material removed from the project shall be stored on the project site where and as directed. Debris shall be removed from the job site and disposed of by the Contractor.

Rough River State Park Airport
213 PAPI Replacement

The Contractor shall maintain his work area clean and orderly at all times. Debris shall be removed promptly. The electrical system shall be thoroughly cleaned inside and outside of all enclosures to remove all metal shavings or other work debris, dust, concrete splatter, plaster, paint and lint.

The Contractor shall do all excavating and backfilling made necessary by electrical work and shall remove all surplus or supply any earth required to establish the proper finished grade.

The Contractor shall do all cutting and patching made necessary by electrical work, but in no case shall he cut through or into any structural member without written permission of the Engineer.

All steel conduits, supports, channels, fittings, nuts, bolts, etc. shall be galvanized, corrosion-resistant type unless otherwise noted.

An approved anti-seize compound shall be used on all threads to prevent equipment and thread damage.

Equipment shall be installed in accordance with manufacturer's recommendation. Make all final electrical connections and coordinate all items with other trades.

Correct unnecessary damage caused due to installation of work, brought about through carelessness or lack of coordination. All openings, sleeves, and holes to be properly sealed, fire proofed and waterproofed. Any water leaks arising from project construction will be immediately corrected to the satisfaction of the Owner and the Engineer.

300-3.5 Power supply equipment. Electrical equipment, such as switchgear, switchboards, panelboards, load centers, and other power supply equipment, shall not be used as a common enclosure, pull box or junction box for routing conductors of different systems, unless the equipment is specifically designed for this purpose and indicated as such on the Plans.

If shown in the plans, the power supply equipment shall be set on concrete housekeeping pads to provide a minimum space of 3-1/2 inches between the equipment and the floor. All equipment shall be secured to the floor or wall in accordance with the manufacturer's recommendations and these contract document requirements.

300-3.6 Duct and conduit. Conduits shall be galvanized rigid steel unless otherwise indicated or specified. Refer to one-line diagram conduit notes for specific requirements.

Conduit runs shall be one trade size continuously with no reducers allowed. Changing of conduit size is only permitted at manholes, handholes, and boxes and conduit bodies used as outlet, device, junction, or pull boxes, including approved, listed fittings with removable covers.

Use an approved, listed adapter/coupling to convert to other types of conduit. Reducer couplings are not allowed.

For underground service entrance, feeder and branch circuit raceways, offsets and bends over 30 degrees and elbows in Schedule 40 PVC conduit runs shall be Schedule 80 PVC conduit. Underground service entrance PVC conduits shall be concrete encased unless otherwise noted. Underground PVC conduits shall be concrete encased under driveways, roadways, parking lots and other paved areas.

Non-encased conduits shall convert to concrete encased ducts under all paved areas and shall extend at least 3 feet beyond the edges of the pavement unless otherwise noted.

The Contractor shall provide a staked centerline or offset for the duct and manhole system - utilizing the drawings and a site inspection of the existing grounds, grades and utility crossings. The Owner and Engineer shall approve the staking plan that shall be indicated on a drawing submitted for approval before starting any excavation for the ducts. The staking plan shall indicate the proposed location, elevation and

Rough River State Park Airport
213 PAPI Replacement

dimensions of manholes and handholes. The Engineer reserves the right to adjust duct, manhole and handhole locations and elevations before installation at no additional cost to the Owner.

The bottom surface of trenches shall be essentially smooth and free from coarse aggregate.

Install grounding-and-bonding type bushings and bonding jumpers on all service entrance conduits and on all feeder and branch circuit conduits.

Use conduit bushings at each conduit termination. Where No. 4 AWG or larger ungrounded wire is installed, use insulated bushings.

When EMT is allowed, utilize only steel compression fittings. Die-cast and set-screw fittings shall not be used.

Use double lock nuts at each conduit termination. Use weather tight hubs in damp and wet locations. Sealing lock nuts shall not be used.

Grounding continuity to rigid metal conduit shall be accomplished by grounding bushings/adapters with lugs for connection to grounding counterpoise and/or grounding electrode conductor as defined by NEC.

All exposed wiring shall be run in not less than 1/2 inch (12 mm) galvanized rigid steel conduit. All conduits shall be installed to provide for drainage. Conduit shall be attached to wooden structures with galvanized pipe straps and fastened with galvanized wood screws not less than No. 8 nor less than 1-1/4 inches (31 mm) long. There shall be at least two fastenings for each 10-foot (3 m) length.

Existing ducts may require clearing before use. It is the responsibility of the Contractor to locate the existing ducts, identify empty or partially empty conduits and clear the conduits as required. Where new cable is to be installed in existing duct, the full length of the duct shall be cleared of debris by mechanical means before the installation of the new cable. Acceptable methods of clearing existing ducts include "hydro-jetting" and "roto-rooting." All existing cables in each re-used duct shall be replaced for the length of the duct and properly spliced in a method approved by the Engineer. Clearing of existing duct banks or conduits is incidental to the cable pay item.

Dedicated ground rods shall be installed and exothermically welded to the counterpoise wire at each end of a duct bank crossing under pavement.

For concrete markers, the impression of letters shall be done in a manner, approved by the Engineer, to affect a neat, professional appearance. The letters shall be stenciled neatly. After placement, all markers shall be given one coat of high-visibility aviation orange paint, as approved by the Engineer.

300-3.7 Junction boxes.

Junction cans shall have both internal and external ground lugs. Size (diameter) and depth shall be as specified in the plans.

Galvanized cans shall have an external ground lug for mechanical connection/bolting ground clamps bonding.

300-3.8 Backfill, compaction, and restoration. Refer to the backfill, compaction and restoration requirements within Item P-152 where other compaction requirements are specified (under pavements, embankments, etc.)

Rough River State Park Airport
213 PAPI Replacement

Trenches shall be backfilled and compacted in 6" layers to 90% maximum density for cohesive soils and to 100% maximum density for non-cohesive soils, as determined by ASTM D1557. The in-place field density shall be determined in accordance with ASTM D1556, D2167, or D6938.

Backfilling from two directions will not be allowed. No backfilling will be accomplished without the approval of the Engineer or Construction Observer. The Contractor shall ensure all trenches are inspected prior to being covered and prior to encasement. Any uninspected trenches which are prematurely covered shall be exposed for inspection at the Engineer and Owner's convenience at no additional cost to the Owner. The Construction Observer will coordinate with the Contractor for advance scheduling of trench inspection.

Following restoration of all trenching near airport movement surfaces, the Contractor shall thoroughly visually inspect the area for foreign object debris (FOD) and remove any such FOD that is found. This FOD inspection and removal shall be considered incidental to the pay item of which it is a component part.

300-3.9 Cable and utility coordination. The existing and the proposed locations of lighting cable are approximate. The Contractor shall be responsible for field locating and identifying the existing lighting circuits to determine their exact routing. The Contractor shall also be responsible for maintaining the lighting systems in a working condition until the new lighting circuits have been installed and tested. The Contractor shall proactively and expeditiously accomplish this cable identification work prior to performing any modifications to the lighting circuits. Coordinate identification work with the Owner and Engineer and make all corrections, additions, etc. on the as-built drawings.

Underground cable and utilities exist within and adjacent to the limits of construction. An attempt has been made to locate these cables and utilities on the Plans. All existing cable and utilities may not be shown on the Plans and the location of the cables and utilities shown may vary from the location shown on the Plans. Prior to beginning of any type of excavation, the Contractor shall contact the utilities, the airport maintenance staff, FAA field personnel and other organizations as required and make arrangements for the location of the utilities on the ground. The Contractor shall maintain the cable and utility location markings until they are no longer required.

The Contractor shall replace or repair any underground cable or utility that has been damaged by the Contractor during excavation to the satisfaction of the owner of the cable or utility at no additional cost to the Owner.

The Contractor shall be responsible for all coordination work associated with existing and new utilities, their marking, their identification, proposed outages/shutoffs, connections, cutovers, etc.

300-3.10 Wiring. The Contractor shall furnish all labor and materials and shall make complete electrical connections in accordance with the wiring diagram furnished with the project plans. The electrical installation shall conform to the requirements of the latest edition of National Fire Protection Association, NFPA-70, National Electrical Code.

Provide color-coding for phase identification.

Colors for 240/120V Circuits:

- a. Phase A: Black
- b. Phase B: Red
- c. Neutral: White

Colors for 208Y/120V Circuits:

- a. Phase A: Black
- b. Phase B: Red
- c. Phase C: Blue
- d. Neutral: White

Rough River State Park Airport

213 PAPI Replacement

All new electrical cable shall be marked using color-coded plastic electrical tape, which is specifically designed for application on polyethylene-jacketed cable. The tape shall be applied as detailed on the Plans. Marking tape shall be Scotch 35 Vinyl Plastic tape or approved equal.

300-3.11 Marking and labeling. Properly identify all electrical equipment.

Wire/Cable Designation Tape Markers:

- a. Indoor Dry Locations: UL Recognized Materials, vinyl or vinyl-cloth, self-adhesive, wraparound, self-laminating, cable/conductor markers with computer printer-generated numbers and letters, minimum 1" width. Provide Brady B-427 with thermal transfer print type or approved equal.
- b. Outdoor Locations and Indoor Wet and Damp Locations: White polyolefin, non-adhesive, full circle, heat-shrinkable sleeve, cable/conductor markers with computer printer-generated numbers and letters, minimum 1" width. Provide Brady B-342 with thermal transfer print type or approved equal.

Properly identify all electrical equipment, including but not limited to the following:

- a. Switchgear, switchboards, and control panels.
- b. Main distribution panel and individual devices within it.
- c. Panelboards and individual devices within it.
- d. Safety switches and disconnects.
- e. Contactors and lighting control center, including all branch circuits.
- f. Individually mounted circuit breakers.
- g. Starters and relays.
- h. Transformers.
- i. Generators and automatic transfer switches.

Use permanently attached black phenolic plates with 3/8" white engraved lettering on the face of each, attached with minimum two sheet metal screws. Starters and relays connected under this Specification shall be identified whether furnished under this Specification or under other Specifications of this contract. Plates shall be indoor or outdoor rated as required by installation location.

Panelboard identification plates shall indicate panel by identification name, voltage system, ampacity rating and type, AIC rating, and feeder source description.

Identify each receptacle, light switch, junction box, etc. with panelboard identification and circuit number. For all wiring device covers, use hot, stamped, or engraved machine printing with black-filled lettering on face of plate, and durable wire markers or tags inside outlet boxes.

Identify fire alarm junction boxes with red covers and mechanical control junction boxes with blue covers.

Install all identification as required by current adopted editions of the NFPA 70 - National Electrical Code and NFPA 70E - Standard for Electrical Safety in the Workplace.

300-3.12 Removal and relocation of existing equipment. The Contractor shall carefully remove all salvageable equipment as indicated on the Plans. Any equipment which is damaged during the removal operation shall be subject to a reduction in payment for removal of the equipment. All equipment which is removed during this project shall be transported to a site on the Airfield or removed from the Airfield and properly disposed of as directed by the Owner and the Engineer.

The Contractor shall carefully relocate existing equipment as indicated in the Plans. Any equipment that is damaged during the relocation operation shall be replaced at no additional cost to the Owner.

Rough River State Park Airport
213 PAPI Replacement

Any existing electrical equipment, conduit, cables, etc. that is damaged during construction shall be replaced at no additional cost to the Owner to the satisfaction of the Owner and the Engineer.

300-3.13 Electrical transclosure conduit and wiring. Electrical work within the electrical transclosure shall be installed in accordance with specific FAA Advisory Circular requirements, including but not limited to the following:

Install all conduit and wiring in the electrical transclosure or shelter in accordance with NEC and local electrical code requirements.

Install all power and control cables in conduit or enclosed wire ways. The standard L-824 airfield lighting primary series circuit cable does not comply with NEC for installation in open cable trays. High voltage conductors (exceeding 600 volts) shall be installed within rigid steel galvanized conduit, intermediate metal conduit, flexible metal conduit, liquid tight flexible metal conduit, metal wire ways, or PVC conduit. Low voltage feeders and control wires shall be installed within rigid steel galvanized conduit, intermediate metal conduit, or electrical metallic tubing (EMT) when run on the walls or ceiling; and in cable trays supported from the ceiling or walls when there are many cables and the possibility of future expansion. Do not install conduit in concrete slabs on grade.

Install the primary series cables from the regulators and various other feeders out of the vault in coated rigid steel galvanized conduit or PVC conduit, a minimum of 2 feet below grade.

Do not use PVC above the ground-level slab of buildings, vaults or shelters. PVC shall convert to coated galvanized rigid steel conduit prior to its emergence; no PVC shall emerge from the ground or concrete slab or encasement. Use manufactured sweep bend, coated galvanized rigid steel conduit elbows for stub-up risers. Coated galvanized rigid steel conduit shall transition to non-coated galvanized rigid steel conduit no sooner than 3" above finished grade

300-3.14 5 kv and under 600v cable connections.

Cable splicing/terminating personnel shall be licensed electricians who have the minimum continuous experience in terminating/splicing medium voltage cable as listed in Item L-108. The qualifications for these airfield lighting cable splicers shall be submitted for review and approval by the Engineer prior to any work. The Engineer may request sample splices be performed in his presence by the proposed personnel to clearly demonstrate that they have the skill and experience to perform this work. Connector kits and cables shall be provided in sufficient quantity by the Contractor in demonstrating these qualifications at no additional cost to the Owner.

Field-attached plug-in splices using FAA certified L-823 plug and receptacle connector kits, properly sized to the cable being used, shall be installed as shown in the plans. This work shall include the taping and heat shrinking. Refer to Item L-108 for additional requirements.

As an option, the Contractor may utilize enhanced FAA certified L-823 connector kits, such as the Amerace 54Super Kit. These kits do not require taping or heat shrinking. These kits shall be installed in accordance with the manufacturer's installation requirements. Note that the mixing of connector kits is unacceptable. The Contractor shall clearly list and submit the connector kits he proposes to utilize on the project for approval prior to any field construction work, and he shall only install that type during construction unless otherwise noted by the Engineer.

For under 600V cable connections of voltage powered circuits, splices whether direct buried or within an underground enclosure shall only utilize approved cast splices, employing a plastic mold and using epoxy resin equivalent to that manufactured by 3M Company, or an approved equivalent.

Rough River State Park Airport
213 PAPI Replacement

300-3.15 Certification and performance. Equipment and materials covered by FAA Advisory Circulars are referred to by item numbers and approved equipment is listed within the AC 150/5345-53 Airport Lighting Equipment Certification Program's monthly Addendum, which contains a complete and updated listing of the certified equipment and manufacturers and is listed in the FAA Buy American Preference equipment list, which is also updated monthly. The Contractor shall provide and install new certified equipment that works reliably and efficiently with the existing equipment to remain in service. The Contractor shall provide any additional accessories and/or appurtenances required to provide fully functional electrical systems to the satisfaction of the Owner and Engineer, at no additional cost to the Owner.

The Contractor shall ascertain that all lighting system components furnished (including FAA certified and approved equipment) are compatible in all respects with each other and the remainder of the new and existing systems. Any non-compatible components furnished by the Contractor shall be replaced at no additional cost to the Owner with a similar unit that is approved by the Engineer and compatible with the remainder of the airport lighting system.

300-3.16 As-built drawings. The Contractor shall keep one (1) full-sized set of prints for As-Built Drawings at the site, in good order, and annotated to show all changes made during the construction process.

The Contractor shall locate all underground and concealed work, identifying all equipment, conduit, circuit numbers, motors, feeders, breakers, switches, and starters. The Contractor will certify accuracy by endorsement. As-Built drawings shall be correct in every detail, so Owner can properly operate, maintain, and repair exposed and concealed work.

The As-Built drawings shall indicate all control system labeling and marking.

The Contractor shall store the As-Built drawings on the site. Drawings shall not be rolled. Make corrections, additions, etc., with pencil, with date and authorization of change.

As-Built drawings must be submitted to Engineer before project will be accepted.

Minor deviations from the Plans and Specifications shall be as approved by the Engineer.

Upon completion of the installation, the Contractor shall adjust the systems to the satisfaction of the Engineer.

300-3.17 Testing.

General Electrical Testing: Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification and certify compliance with test parameters. Tests shall be conducted in the presence of the Engineer and shall be to his/her satisfaction. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest. Perform infrared scan tests and inspections of service and power distribution equipment at the respective buildings and provide reports. Electrical equipment will be considered defective if it does not pass tests and inspections. Reports shall include notations of deficiencies, remedial action taken and observations after remedial action.

System and Equipment Testing: All installations shall be fully tested by continuous operation for not less than 24 hours as completed systems prior to acceptance. These tests shall include the functioning of each control not less than 10 times.

Test equipment and instruments utilized by the Contractor shall have been calibrated following the manufacturer's recommended schedule to verify their accuracy prior to performing the testing work. The Contractor shall provide instrument calibration certificates on test equipment when requested by the

Rough River State Park Airport
213 PAPI Replacement

Engineer. Retesting work due to inaccurate or defective instruments shall be performed by the Contractor to the satisfaction of the Engineer at no additional cost to the Owner.

a. Regulator Calibration:

The Contractor shall check and calibrate both new and existing regulators utilizing the enclosed "Constant Current Regulator Calibration Report". Refer to the material section on constant current regulators for additional requirements.

New regulators are calibrated at the factory prior to shipping, while existing regulators typically need checks and calibrations on a routine basis so that they do not get out of tolerance. The intent is to check and/or calibrate these regulators using a high accuracy meter prior to energizing and placing the airfield lighting system in service.

Utilize a high accuracy true RMS ammeter with high accuracy clamp-on current probe when making these measurements (use round type probes, accuracy + or – 2% required, sized per the cable diameter and circuit ampacity to achieve the best accuracy). Adjust regulators per manufacturer's instructions to meet the output currents on each brightness step as listed in Tables 5-2 and 5-3 in AC 150/5340-26.

b. Megger Testing:

The Contractor shall perform megger testing on each existing regulator circuit prior to any work on the electrical system. This information shall be recorded and documented by the Contractor and submitted to the Engineer. The Contractor shall perform megger tests on each regulator circuit after the acceptance test period. This acceptance test information shall be recorded and documented by the Contractor and submitted to the Engineer. Megger test shall be performed in accordance with the requirements of Item L-108.

The Contractor shall submit his initial megger test reports on the enclosed "Insulation-Resistance Test Report" form prior to any work on the electrical system. This report shall be submitted to the Engineer and approved by the Owner prior to Contractor proceeding with his work.

After final acceptance testing has been completed, the Contractor shall complete and submit his final megger test reports to the Engineer and insert copies of the initial and final megger test reports in the Operation and Maintenance Manuals.

Megger testing shall be performed using an insulation meter, such as a Fluke 1507 Insulation Resistance Multimeter, Ideal 61-797 Digital Insulation Meter, or approved equal having an insulation test range up to 10 Gigohms or greater.

Insulation resistance testers for 5kV series circuits shall utilize the 1000V DC source output for testing. The test equipment shall be submitted for review and approval by the Engineer prior to performing the tests.

The Contractor shall be responsible to maintain an insulation resistance equal to minimum 80% of the initial testing value through the end of the contract warranty period. This requirement is based on AC 150/5340-26C which states that resistance values inevitably decline over the service life of the circuit and that a 10-20 percent decline per year is considered normal. Note that AC 150/5340-26C cancels AC 150/5340-26B; thus, refer to the current edition of the maintenance AC for requirements in this project.

For existing circuit insulation resistance requirements, refer to "Existing Circuits" section of Item L-108.

Rough River State Park Airport
213 PAPI Replacement

The insulation resistance to ground for 600V rated cables shall be not less than 100 Megohms when measured per NETA standards.

The installations shall be tested in operation as a completed unit prior to acceptance. Tests shall include taking megger and voltage readings in accordance with manufacturer's requirements. Testing equipment shall be furnished by the Contractor.

c. **Ground Rod Impedance Testing:**

The enclosed "Ground Rod Impedance Test Report" form shall be used, and testing shall be performed in the presence of the Engineer.

As-Built drawings shall indicate the location of all installed ground rods. Each ground rod shall have a unique identifier that corresponds with its submitted ground impedance test report.

Three-pole fall-of-potential testers that can measure the ground resistance of a ground rod using auxiliary electrodes (staked testing), such as a Fluke 1621 Earth Ground Tester, shall be used for testing individual dedicated equipment ground rods at fixtures and equipment, or for testing isolated counterpoise ground rods not yet connected to the counterpoise wire.

Clamp-on testers that can measure the ground resistance of a ground rod without using auxiliary ground rods (stakeless testing), such as a Fluke 1630 Earth Ground Clamp Meter or approved equal, shall be used for testing counterpoise ground rods which have already been connected to the counterpoise wire, or ground ring ground rods which have already been connected to the established ground ring system.

Ground impedance test equipment shall be submitted for review and approval by the Engineer prior to performing the tests.

If the ground rod's impedance exceeds 25 ohms, an additional rod shall be driven in a location suitable and approved by the Engineer. However, the additional rod must satisfy the requirements of NEC 250.53 and not be less than 6 feet away from any other ground rod electrode. Additional ground rods shall not be measured for separate payment but shall be considered subsidiary to the counterpoise or respective equipment pay item.

The Contractor shall perform additional tests if required and requested by the Engineer at no additional cost.

The Contractor shall coordinate with the resident Engineer to approve tests daily before proceeding. The Contractor shall fill out a separate test report for each date. Test reports shall be submitted weekly to the Engineer.

d. **Cable Pulling Tension Values Log:**

The enclosed "Cable Pulling Tension Values Log" form shall be used for monitoring cable pull tension values in the presence of the Engineer.

Airport lighting equipment and special systems shall be tested in accordance with applicable FAA Advisory Circular requirements and the manufacturer's installation instructions. These tests shall also include those system requirements listed within AC 150/5340-26 Maintenance of Airport Visual Aid Facilities.

300-3.18 Inspection fees and permits. The Contractor shall obtain and pay for all necessary construction permits, licenses, government charges, and inspection fees necessary for prosecution of the Work. Unless

Rough River State Park Airport
213 PAPI Replacement

otherwise noted, the Contractor shall pay all charges of utility owners for connections for providing permanent service to the Work, ready for subsequent utility account transfer to the Owner after final acceptance.

300-3.19 Work supervision.

State of Kentucky: The electrical contractor (whether the general contractor or a subcontractor) shall be a licensed contractor in the state of Kentucky having an electrical classification suitable for performing the work required in these contract documents.

The Contractor shall designate in writing the qualified electrical supervisor who shall provide supervision to all electrical work on this project. The minimum qualifications for the electrical supervisor shall be a master electrician as defined by the Kentucky Electrical Licensing Section of the Department of Housing, Buildings and Construction. The supervisor or his appointed alternate possessing at least an electrician license shall be on site whenever electrical work is being performed. The qualifications of the electrical supervisor shall be subject to approval of the Owner and the Engineer.

All master electricians and electricians shall be licensed in accordance with Kentucky Administrative Regulations Title 815 Chapter 35 - Electrical. The website located at <http://dhbc.ky.gov> publishes the text of this statutory requirement. No unlicensed electrical workers shall perform electrical work on this project. Apprentice electricians in a ratio of not more than one apprentice per electrician will be allowed if the apprentices are licensed and actively participating in an apprenticeship program recognized and approved by the Kentucky Electrical Licensing Section.

METHOD OF MEASUREMENT

300-4.1 The quantity of lockout/tagout procedures to be paid for shall consist of all lockout/tagout procedure work and all constant current regulator calibration work completed in place, accepted and ready for operation. This item does not include measurement for constant current regulator equipment.

300-4.2 Cable or counterpoise wire installed in trench, duct bank or conduit shall be measured by the number of linear feet installed and grounding connectors, and trench marking tape ready for operation, and accepted as satisfactory. Separate measurement shall be made for each cable or counterpoise wire installed in trench, duct bank or conduit. The measurement for this item shall include additional quantities required for slack.

300-4.3 No separate payment will be made for ground rods.

300-4.4 The quantity of regulators to be paid for shall be the number of regulators, installed as completed units, in place, accepted and ready for operation. The quantity of regulators to be paid for shall be the number of regulators, removed and stored as completed units, in place, and accepted.

300-4.5 Payment will be made at the contract unit price per linear foot for each type and size of conduit and duct bank completed and accepted, including trench and backfill with the designated material, and, for drain lines, the termination at the drainage structure. This price shall be full compensation for removal and disposal of existing duct banks and conduits as shown on the plans, furnishing all materials and for all preparation, assembly, and installation of these materials, and for all labor, equipment, tools, and incidentals necessary to complete this item per the provisions and intent of the plans and specifications

BASIS OF PAYMENT

300-5.1 Payment will be made at the contract unit price for each complete item, measured as provided above, and accepted by the Engineer. This price shall be full compensation for furnishing all materials and for all

Rough River State Park Airport

213 PAPI Replacement

preparation, assembly, and installation of these materials, and for all labor, equipment, tools, and incidentals necessary to complete this item to the satisfaction of the Engineer.

300-5.2 Payment will be made at the contract unit price for trenching, cable and bare counterpoise wire installed in trench (direct-buried), or cable and equipment ground installed in duct bank or conduit, in place by the Contractor and accepted by the RPR. This price shall be full compensation for furnishing all materials and for all preparation and installation of these materials, and for all labor, equipment, tools, and incidentals, including ground rods and ground connectors and trench marking tape, necessary to complete this item.

300-5.3 Payment will be made at the contract unit price per linear foot for each type and size of conduit and duct bank completed and accepted, including trench and backfill with the designated material, and, for drain lines, the termination at the drainage structure. This price shall be full compensation for removal and disposal of existing duct banks and conduits as shown on the plans, furnishing all materials and for all preparation, assembly, and installation of these materials, and for all labor, equipment, tools, and incidentals necessary to complete this item per the provisions and intent of the plans and specifications.

Lump sum payments will be based on successful completion of three major portions of the work to the satisfaction of the Engineer.

- 50% Infrastructure in the ground is completed, including items such as concrete foundations, reinforcing, conduits, wiring, etc.
- 25% System equipment is installed, equipment is mounted and aimed, support structures installed, wires pulled/terminated between equipment items, system energized and tested, system is fully functional, ready for commissioning.
- 25% System is commissioned and determined to be fully functional to users as approved by the State and Engineer.

Payment will be made under:

Item 40003	LOCKOUT-TAGOUT AND CC REGULATOR CAL PRO – per Lump Sum
Item 40054	AWG 5KV CABLE NO.8 L824C-INSTALLED – per Linear Foot
Item 40055	AWG COUNTERPOISE NO.6-INSTALLED – per Linear Foot
Item 40118	4KW CONSTANT CURRENT REGULATOR (LIGHTING REGULATOR) – per Each
Item 40164	NON-ENC ELEC COND-1W-2-IN C- 18-IN CVER – per Linear Foot

MATERIAL REQUIREMENTS

Commercial Item Description A-A-59544	Cable and Wire, Electrical (Power, Fixed Installation)
Fed. Spec. W-C-1094	Conduit and Conduit Fittings; Plastic, Rigid
Fed. Spec. W-P-115	Panel, Power Distribution
Fed. Std. 595	Colors
Underwriters Laboratories	Rigid Metal Conduit

Rough River State Park Airport

213 PAPI Replacement

Standard 6	
Underwriters Laboratories Standard 514	Fittings for Conduit and Outlet Boxes
Underwriters Laboratories Standard 651	Schedule 40 and 80 Rigid PVC Conduit (for Direct Burial)
Underwriters Laboratories Standard 1242	Intermediate Metal Conduit
CFR 1910	Occupational Safety and Health Regulations
CFR 1926	Safety and Health Regulations for Construction
ANSI/IEEE C2	National Electrical Safety Code
NFPA 70	National Electrical Code (NEC)
NFPA 70E	Standard for Electrical Safety in the Workplace
NFPA 101	Life Safety Code
NFPA 780	Standard for the Installation of Lightning Protection Systems
29 CFR 1910	Occupational Safety and Health Standards (OSHA)
29 CFR 1926	Safety and Health Regulations for Construction
Jaquith Industries, Inc.	The Design, Installation, and Maintenance of In-Pavement Airport Lighting

FAA ADVISORY CIRCULARS

AC 150/5300-13	Airport Design
AC 150/5340-18	Standards for Airport Sign Systems
AC 150/5340-26	Maintenance of Airport Visual Aid Facilities
AC 150/5340-30	Design and Installation Details for Airport Visual Aids
AC 150/5345-3	Specification for L-821 Panels for Control of Airport Lighting
AC 150/5345-7	Specification for L-824 for Underground Electrical Cable for Airport Lighting Circuits
AC 150/5345-10	Specification for Constant Current Regulators and Regulator Monitors

Rough River State Park Airport

213 PAPI Replacement

AC 150/5345-26	Specification for L-823 Plug and Receptacle, Cable Connectors
AC 150/5345-28	Standard for Precision Approach Path Indicator (PAPI) Systems
AC 150/5345-42	Specification for Airport Light Base and Transformer Housings, Junction Boxes, and Accessories
AC 150/5345-47	Isolation Transformers for Airport Lighting Systems
AC 150/5346-49	Specification L-854, Radio Control Equipment
AC 150/5345-53	Airport Lighting Equipment Certification Program

END OF ITEM SS-300

Rough River State Park Airport
213 PAPI Replacement

INSULATION RESISTANCE TEST REPORT

Owner / Sponsor: _____Engineer: Garver, LLC

Airport: _____Contractor: _____

Project Title: _____Garver Project Number: _____

Vault ID / Location: _____Date Initial / Final Tests: _____

Weather / Site Conditions (Initial Test): _____Last Two Weeks of Rain: _____inches

Weather / Site Conditions (Final Test): _____Last Two Weeks of Rain: _____inches

		Initial Test Results		Final Test Results	
	Circuit Designation and Color Code	Regulator Size (kW)	Megger Reading Before Field Work (Megohms)	Regulator Size (kW)	Megger Reading After Field Work (Megohms)
1					
2					
3					
4					
5					
6					
Tested By:					
Test Equipment:					
Engineer Witness:					
Owner/Sponsor Witness:					

Provide signature/date and manufacturer/model no. as required in the fields above.

Initial Test Record – Owner Disposition

Owner / Sponsor: _____(Signature and Date)

Check one only: ☐ Proceed with Installation ☐ Hold

Rough River State Park Airport

213 PAPI Replacement

GROUND ROD IMPEDANCE TEST REPORT

Owner / Sponsor: _____

Airport: _____

Project Title: _____

Date: _____

Fall-of-Potential Style Tester (F):
Manufacturer: _____

Clamp-On Style Tester (C):
Manufacturer: _____

Engineer: Garver, LLC

Contractor: _____

Garver Project Number: _____

Weather / Site Conditions: _____

Model #: _____

Model #: _____

Ground Rod #	Test Equipment Style (F or C)	Impedance Value (Ohms)	Ground Rod #	Test Equipment Style (F or C)	Impedance Value (Ohms)
Tested By:					
Engineer Witness:					

Provide signature/date in the fields above.

Page ____ of ____

Rough River State Park Airport

213 PAPI Replacement

CABLE PULLING TENSION VALUES LOG

Owner / Sponsor: _____

Airport: _____

Project Title: _____

Date: _____

Dynamometer
Manufacturer/Model #: _____

Engineer: Garver, LLC

Contractor: _____

Garver Project Number: _____

Weather / Site Conditions: _____

Cable / Wire
Manufacturer: _____

From / To Locations	Wire/Cable Size	Length of Pull	Pull Method	Maximum Value	Measured Value
Tested By:					
Engineer Witness:					

Provide signature/date in the fields above.

Page ____ of ____

Rough River State Park Airport

2I3 PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
213 PAPI Replacement

ITEM SS-301 ELECTRICAL DEMOLITION WORK

DESCRIPTION

301-1.1 This item shall consist of the removal and satisfactory disposal of existing runway and taxiway edge lights, in-pavement lights, guidance signs, markers, manholes, handholes, junction structures, racks, pads, equipment, poles, towers, shelters, and other incidentals, all of which are not designated or permitted to remain, in accordance with this specification, the referenced specifications and drawings, and applicable advisory circulars. This work shall include the removal of indicated equipment, materials, and incidentals necessary for a complete item removal, including all restoration work, as a completed unit to the satisfaction of the Engineer.

301-1.2 The Contractor shall maintain current copies of all referenced and applicable standards on the job site. The Contractor is responsible to make known to the Engineer any conflict between plans and specifications that he observes or of which he is made aware.

301-1.3 Additional details pertaining to the lighting system covered in this item are contained in the advisory circular, AC 150/5340-30, Design and Installation Details for Airport Visual Aids. Additional details pertaining to the PAPI system covered in this item are contained in the advisory circular, AC 150/5345-28, Standard for Precision Approach Path Indicator (PAPI) Systems.

301-1.4 This item shall consist of relocating Precision Approach Path Indicators (PAPIs) in accordance with these specifications. This work shall include the mounting, leveling, wiring, and testing of the lighting equipment and all materials and incidentals necessary to place it in operating condition as a completed unit to the satisfaction of the Engineer. This item shall include mounting accessories, controls, relays, circuit breakers, transformers, inter-unit wiring, disconnect switches and concrete pads specified in the plans.

MATERIALS

301-2.1 All backfill and repair materials used in electrical demolition, repair and restoration work shall comply with the referenced specifications and be approved by the Engineer.

Airport lighting equipment and materials shall meet the requirements outlined in Item SS-300.

For pre-cast or prefabricated concrete encased light base installations, the Contractor shall submit and coordinate the construction of the proposed pre-cast units with the Engineer onsite to review and approve the construction process. The Contractor shall submit his proposed installation process for review and approval by the Engineer. The Contractor shall provide additional items and work if required and requested by the Engineer for the construction and installation of the pre-cast units at no additional cost to the Owner.

CONSTRUCTION METHODS

301-3.1 General. No demolition shall be started until the removal and/or relocation work has been laid out and approved by the Engineer. All material shall be disposed of off-site. All hauling and disposal will be considered a necessary and incidental part of the work. Hauling cost shall be considered by the Contractor and included in the contract unit price for the pay of items of work involved. No payment will be made separately or directly for hauling on any part of the work.

Equipment removal shall typically include removing the equipment and its accessories, removing foundations/pads, removing existing conduits, conductors and appurtenances, removal of conduit to below grade, and removal of existing circuits back to source. The work shall include restoring the area to match existing, including filling and tamping all holes with earth, and clearing and leveling the site.

Rough River State Park Airport

213 PAPI Replacement

The Contractor shall remove all existing underground cable, which is unused or rendered unusable by this project, when such is exposed or made accessible during this work. All such wiring removed shall become property of the Contractor and shall be immediately removed from the project. Wiring in conduit shall be removed as indicated or if new wiring is shown to be installed in its place. Existing wiring shall not be reused or reinstalled.

Wiring not exposed shall be abandoned in place, if a reasonable effort will not remove it. No measurement or payment will be made for this cable removal work. Damage to turf or other systems will not be permitted to salvage or retrieve existing cable.

Any damage to electrical equipment, systems, structures, conduits, cables, and accessories or other utilities, designated to remain in place, shall be repaired or replaced expeditiously at no additional cost to the Owner and to the satisfaction of the Owner and Engineer.

Holes, ditches, or other abrupt changes in elevation caused by the removal operations that could obstruct drainage or be considered hazardous or unsightly shall be backfilled, compacted, and left in a workmanlike condition.

Trenches or voids resulting from the removal or demolition of existing electrical equipment or other structures shall be filled with approved material placed in layers in accordance with Item P-152.

Concrete foundations and pads to be removed shall be obliterated full depth.

301-3.2 Removal and/or relocation of light fixtures and equipment. Light fixtures and other equipment which are to be removed shall be carefully excavated. All concrete bases and concrete anchors shall be removed by the Contractor. The removed lights, guidance signs, isolation transformers and wiring harnesses shall then be given to the Owner, or properly disposed of if so directed by the Owner. The ground around the removed lighting equipment shall be backfilled and properly compacted. Light fixtures and equipment which are to be relocated shall be stored on site and reinstalled with new lamps, new transformers, and all other new required accessories as indicated in the plans.

301-3.3 Removal of existing equipment. The Contractor shall carefully remove all salvageable equipment as indicated in the plans. Any equipment that is damaged during the removal and/or relocation operation shall be subject to a reduction in payment for removal and/or relocation of the equipment. All equipment that is removed during this project shall be transported to a site on the Airfield or removed from the Airfield and properly disposed of as directed by the Owner and the Engineer.

301-3.4 Clearing of existing duct banks or conduits. Where new cable is to be installed in an existing duct bank or conduit, the full length of the duct bank or conduit shall be cleared of debris by mechanical means before installation of the new cable. Acceptable means of clearing existing duct banks or conduits may include using a mandrel, "hydro-jetting" method, or "roto-rooting" method as approved by the Engineer.

Where existing cables are being removed from an existing duct bank or conduit and replaced with new cables, the Contractor shall use the existing cable to clear the conduit and to pull in the new cable. No separate payment will be made for clearing these duct banks or conduits or for the existing cable removal. Clearing of these existing duct banks or conduits is incidental to the cable pay item unless otherwise noted.

METHOD OF MEASUREMENT

301-4.1 Measurement for the removal of the PAPI system shall be the number of each removed for a completed and accepted removal of a complete PAPI system. Equipment shall be carefully removed and stored as directed by the Engineer and Owner. Concrete bases and appurtenances shall be demolished

Rough River State Park Airport

2I3 PAPI Replacement

and removed. The area shall be restored to match existing including seeding and topsoiling. This item shall also include removal of the existing PAPI power feeder, including circuit breaker, labeling, waterproof cast splicing, splice marker and all appurtenances to the satisfaction of the Engineer.

BASIS OF PAYMENT

301-5.1 Payment will be made at the contract unit price for each complete item, measured as provided above, and accepted by the Engineer. This price shall be full compensation for furnishing all materials and for all preparation, assembly, and installation of these materials, and for all labor, equipment, tools, and incidentals necessary to complete this item to the satisfaction of the Engineer.

Payment will be made under:

- Item 40150EX L-880 PAPI SYS-REMOVED -- per Each
- Item 40066REGULATOR REMOVED (ELECTRICAL DEMOLITION) – per Each

END OF ITEM SS-301

Rough River State Park Airport

2I3 PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

Rough River State Park Airport
213 PAPI Replacement

ITEM SS-310 AIRPORT LIGHTING SYSTEMS

DESCRIPTION

310-1.1 This item shall consist of furnishing and installing airport runway and taxiway edge lighting systems, retroreflective markers, guidance signs, runway centerline and touchdown zone lighting systems, other taxiway lighting systems, and other approach lighting aid systems, in accordance with this specification, the referenced specifications and drawings, and applicable advisory circulars. The system shall be installed at the locations and in accordance with the dimensions, design and details shown on the plans. This work shall include the furnishing of all equipment, materials, services and incidentals necessary to place it in operating condition as a completed unit to the satisfaction of the Engineer.

310-1.2 The Contractor shall maintain current copies of all referenced and applicable standards on the job site. The Contractor is responsible to make known to the Engineer any conflict between plans and specifications that he observes or of which he is made aware.

310-1.3 Additional details pertaining to the lighting system covered in this item are contained in the advisory circular, AC 150/5340-30, Design and Installation Details for Airport Visual Aids. Additional details pertaining to the PAPI system covered in this item are contained in the advisory circular, AC 150/5345-28, Standard for Precision Approach Path Indicator (PAPI) Systems.

310-1.4 This item shall consist of furnishing and installing Precision Approach Path Indicators (PAPIs) in accordance with these specifications. This work shall include the mounting, leveling, wiring, and testing of the lighting equipment and all materials and incidentals necessary to place it in operating condition as a completed unit to the satisfaction of the Engineer. This item shall include mounting accessories, controls, relays, circuit breakers, transformers, inter-unit wiring, disconnect switches and concrete pads specified in the plans.

EQUIPMENT AND MATERIALS

310-2.1 General.

a. Airport lighting equipment and materials shall meet the requirements outlined in Item SS-300 and the applicable Item L Series Specifications.

b. For pre-cast or prefabricated concrete encased light base installations, the Contractor shall submit and coordinate the construction of the proposed pre-cast units with the Engineer onsite to review and approve the construction process. The Contractor shall submit his proposed installation process for review and approval by the Engineer. The Contractor shall provide additional items and work if required and requested by the Engineer for the construction and installation of the pre-cast units at no additional cost to the Owner.

Pre-cast or prefabricated concrete encased light bases may only be assembled at the Contactor's staging area at the airport to allow the Engineer to check and approve all such construction items. Pre-cast bases assembled offsite will not be allowed.

310-2.2 PAPI. The PAPI systems shall be furnished and installed in accordance with AC 150/5345-28, Specification for Precision Approach Path Indicator, the manufacturer's installation requirements and these contract documents.

Rough River State Park Airport

213 PAPI Replacement

Utilize and install three-leg version (for ease of alignment) light units and provide consolidating harness equipment and all other appurtenances as required for a complete and operable system.

The Contractor shall obtain complete installation instructions including wiring diagrams and schematics from the manufacturer prior to any work and maintain copies of these manuals on site for use during installation work. The unit shall be mounted on a frangible support system as detailed on the plans.

All PAPI light boxes shall have a tilt switch and provision for grounding. All wiring, which enters the PAPI box, shall be through plugs and receptacles which will separate if struck by an aircraft.

Each light unit shall be aimed outward into the approach zone on a line parallel to the runway centerline within a tolerance of $\pm 1/2$ degree.

The beam centers of all light units shall be within ± 1 inch of a horizontal plane. This horizontal plane shall be within ± 1 foot of the elevation of the runway centerline at the intercept point of the visual glidepath with the runway.

The front face of each light unit in the bar shall be located on a line perpendicular to the runway centerline within ± 6 inches.

If current powered, the lighting control panel and photocell controls at the vault will automatically control the brightness of the beam via the dedicated PAPI regulator.

All PAPI light boxes shall be provided with baffles to set the limits of the obstacle clearance surface (OCS) to 10 degrees either side of runway centerline (20 degrees total) to restrict excess horizontal light beam distribution.

The manufacturer shall furnish his recommended spare parts, instruction manual, and input voltage surge protection. The system shall be warranted for one year from acceptance of this project. Any failure that occurs in this warranty period shall be replaced by new factory tested assemblies at no additional cost to the Owner. At the end of the warranty period, the Contractor shall replace all the PAPI lamps and return useable lamps to the Owner.

The Contractor shall conduct an operating test for one week of continuous duty before acceptance. Failure to complete the test will require restarting the test without use of any spare parts. Two failures will be reason to reject the entire PAPI system at no cost to the Owner.

310-2.3 Light fixtures. Airfield lights shall be supplied with all features and accessories including isolation transformers, light bases, base covers, safety ground rods, concrete pads and incidentals required for a complete installation as defined in these Specifications and as shown on the plans.

310-2.4 Lamps. Lamps for elevated edge lights shall be LED type as specified.

310-2.5 Spare equipment Provide one complete spare lamp set for each PAPI system. PAPI spare lamps shall not be measured for separate payment but shall be considered subsidiary to the respective system pay items.

310-2.6 Isolation transformers. New isolation transformers shall be Type L-830 and have a wattage rating suitable for the wattage of the fixture and sign lamps. The transformer shall be listed in FAA Circular AC 150/5345-47.

CONSTRUCTION METHODS

310-3.5 Placing lights. All equipment shall be installed at locations indicated in the plans. Lights shall be laid out by locating the two control points by station as indicated on the plans and measuring the indicated individual separation distances. Light bases shall be located within 1 inch +/- longitudinally and 0.5 inches

Rough River State Park Airport

213 PAPI Replacement

+/- transversely of the location indicated unless deviation is approved by the Engineer. Excavation for installation of light bases shall be backfilled with at least 4 inches of granular leveling course, as approved by the Engineer. Fixture height shall be as indicated on the Drawings.

For pre-cast or prefabricated concrete encased light base installations, a leveling course of sand shall be placed in the bottom of the excavated hole, sufficient for accurately installing, leveling and placing the lights in accordance with the requirements in this specification and AC 150/5340-30. Concrete encased light bases shall be allowed to cure a minimum of 7 days prior to installation.

Utilize a bubble level device to level all light fixtures in the horizontal light plane during the day, and then check at night to ensure uniformity in light output.

Provide factory-approved alignment tools and aiming devices to properly level and align fixtures as required by the FAA Advisory Circulars and manufacturer's installation instructions. After all light fixture installations are completed and accepted by the Engineer, these alignment tools and aiming devices shall become property of the Owner and shall be delivered and stored as directed by the Owner.

310-3.6 Transformer installation. The transformer for base mounted fixtures shall be placed inside the base. The transformer for stake mounted fixtures shall be located uniformly as shown on the plans. The primary cable connections shall be made with L-823 connectors and have 3 feet of slack cable. The secondary leads connected to the lamp leads by means of a disconnecting plug and receptacle provided with the unit, and this joint shall not be taped. The secondary joint shall be fastened with a holding ring provided for this purpose.

310-3.7 Unit assembly. All electrical equipment, including edge lights, guidance signs and other visual aid units shall be assembled in accordance with the manufacturer's installation procedures. Anti-seize compound shall be used on all screws, nuts, and threads, including frangible coupling threads. If coated bolts are used (ceramic metallic/fluoropolymer coating), then do not apply anti-seize compound.

Provide and install all spacers, shims, and gaskets as required, and verify they are in place before installing the light fixture on the base.

Bolts and washers for new and existing bases shall be new. Do not reuse existing hardware.

The minimum thread engagement into top flange of the base shall be 0.5 inches.

Coordinate recommended torque values with the light fixture manufacturer, light base can manufacturer, stainless steel bolts and hardware used, and exact anti-seize compound used, to prevent light base thread damage. Utilize a dial-type torque wrench for accuracy and to prevent over-tightening bolts. Never use impact wrenches/drills when removing or installing bolts.

The Contractor shall obtain complete installation manuals for the new airfield lighting equipment and the existing equipment to be reinstalled prior to any removal or installation work. Copies of these manuals shall be maintained in 3-ring binders within the Contractor's onsite field office.

310-3.8 Identification numbers. An identifying number shall be assigned to each light and sign in accordance with the plans or as approved by the Engineer and Owner. This number shall be imprinted with reflective black with 1/2" letters on a non-corrosive metal disc 2" minimum diameter and attached to the pavement side of the fixture with a metal screw.

310-3.9 Precision approach path indicator flight check mobilization. The Contractor shall be

Rough River State Park Airport

213 PAPI Replacement

responsible for being present at the site when the FAA performs a flight check on the Precision Approach Path Indicator (PAPI). Flight checking of the PAPI system shall occur on the FAA's schedule, therefore, the Contractor must provide for a separate mobilization to the site for this item of work.

310-3.10 Testing. The installation shall be tested in operation as a completed unit prior to acceptance. Tests shall include taking megger and voltage readings as outlined in Item SS-300 and Item L-108. Testing equipment shall be furnished by the Contractor. Refer to Item L-108 for additional test requirements.

Tests shall be conducted in the presence of the Engineer and shall be to his/her satisfaction.

All installations shall be fully tested by continuous operation for not less than 24 hours as completed systems prior to acceptance. These tests shall include the functioning of each control not less than 10 times.

Equipment and materials covered by FAA Advisory Circulars are referred to by item numbers and approved equipment is listed within the AC 150/5345-53 Airport Lighting Equipment Certification Program's monthly Addendum, which contains a complete and updated listing of the certified equipment and manufacturers, and is listed in the FAA Buy American Preference equipment list, which is also updated monthly. The Contractor shall provide and install new certified equipment that works reliably and efficiently with the existing equipment to remain in service. The Contractor shall provide any additional accessories and/or appurtenances required to provide fully functional electrical systems to the satisfaction of the Owner and Engineer, at no additional cost to the Owner.

The Contractor shall ascertain that all lighting system components furnished (including FAA certified and approved equipment) are compatible in all respects with each other and the remainder of the new and existing systems. Any non-compatible components furnished by the Contractor shall be replaced at no additional cost to the Owner with a similar unit that is approved by the Engineer and compatible with the remainder of the airport lighting system.

310-3.11 FAA flight inspection commissioning. The Contractor shall be present on site during any FAA flight check(s) of all electrical systems and pavement markings. The Contractor shall be able to adjust VGSI, fixture lenses, radio performance, and other parameters while on site during the flight check to the satisfaction of the FAA Flight Services personnel, Owner, and Engineer. All tools and manuals necessary to perform adjustments shall be present. Failure to attend all required flight check(s) will result in reduction of payment.

METHOD OF MEASUREMENT

310-4.1 Precision Approach Path Indicator shall be measured by each system *lump sum* installed as a completed unit, in place, ready for operation, and accepted by the RPR. Abbreviated Precision Approach Path Indicator shall be measured by each system installed as a completed unit, in place, ready for operation, and accepted by the RPR.

310-4.2 Mobilization for the Contractor to return to the site to be present during the FAA's flight check of the Precision Approach Path Indicator (PAPI) shall be measured per each complete item, including all equipment and man-hours needed to complete the item. In the event the PAPI system fails the FAA's flight check, the Contractor will not be compensated for the next mobilization to the site for the flight check of the PAPI. In addition, the Contractor will be responsible for compensating the FAA for costs associated with additional flight checks. In the event the FAA cancels the flight check, the Contractor will be allowed an additional mobilization charge and shall not be responsible for the flight check cost.

Rough River State Park Airport

213 PAPI Replacement

BASIS OF PAYMENT

310-5.1 Payment will be made at the contract unit price for each complete item, measured as provided above, and accepted by the Engineer. This price shall be full compensation for furnishing all materials and for all preparation, assembly, and installation of these materials, and for all labor, equipment, tools, and incidentals necessary to complete this item to the satisfaction of the Engineer.

310-5.2 Payment will be made at the contract lump sum price for each complete item, measured as provided above, and accepted by the Engineer. This price shall be full compensation for furnishing all materials and for all preparation, assembly, and installation of these materials, and for all labor, equipment, tools, and incidentals necessary to complete this item to the satisfaction of the Engineer.

Lump sum payments will be based on successful completion of three major portions of the work to the satisfaction of the Engineer.

- 50% Infrastructure in the ground is completed, including items such as concrete foundations, reinforcing, conduits, wiring, etc.
- 25% System equipment is installed, equipment is mounted and aimed, support structures installed, wires pulled/terminated between equipment items, system energized and tested, system is fully functional, ready for commissioning.
- 25% System is commissioned and determined to be fully functional to users as approved by the State and Engineer.

Payment will be made under:

Item 40132	PAPI SYSTEM – per Lump Sum
Item 40178	FAA FLIGHT CHECK (MOBILIZATION) -- per Lump Sum

END OF ITEM SS-310

Rough River State Park Airport

2I3 PAPI Replacement

PAGE INTENTIONALLY LEFT BLANK

GARVER PROJECT NO. 2600131
KDA GRANT NO. KY26-52
MAY 2026



One Paragon Center
525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(859) 219-0659

Sheet Number	Sheet Title
GI001	COVER SHEET
GI002	GENERAL NOTES AND SUMMARY OF QUANTITIES
GI003	GENERAL NOTES AND SUMMARY OF QUANTITIES
GI004	SURVEY CONTROL PLAN
GI005	CONSTRUCTION SAFETY AND PHASING NOTES 1
GI006	CONSTRUCTION SAFETY AND PHASING NOTES 2
GI007	CONSTRUCTION SAFETY AND PHASING NOTES 3
GI008	CONSTRUCTION SAFETY AND PHASING PLAN
GI009	CONSTRUCTION SAFETY DETAILS
GI010	ELECTRICAL NOTES
EL001	ELECTRICAL DEMOLITION PLAN 1
EL002	ELECTRICAL INSTALLATION PLAN 1
EL003	ELECTRICAL DETAILS 1
EL004	ELECTRICAL DETAILS 2
EL005	ELECTRICAL DETAILS 3

EV.	DATE	DESCRIPTION	BY

KENTUCKY DEPARTMENT OF AVIATION
ROUGH RIVER STATE PARK AIRPORT
FALLS OF ROUGH, KENTUCKY

COVER SHEET

JOB NO.: 2600131
DATE: MAY 2026
DESIGNED BY: DLE
DRAWN BY: ABC

BAR IS ONE INCH ON
ORIGINAL DRAWING

0 [REDACTED] T
IF NOT ONE INCH ON THIS SHEET,
AD LIST OF LIES ACCORDING TO

DRAWING NUMBER

GI001SHEET
NUMBER
1

Pa

Y26-52

3 GARVER

©1998 GARVER, LLC
THIS DOCUMENT, ALONG WITH THE
DIEAS AND DESIGNS CONVEYED
HEREIN, SHALL BE CONSIDERED
THE PROPERTY OF GARVER, LLC.
SERVICE AND ARE PROPERTY OF
GARVER, LLC ANY USE,
REPRODUCTION, OR DISTRIBUTION
OF THIS DOCUMENT OR THE
DIEAS AND DESIGN CONTAINED
HEREIN, IS PROHIBITED UNLESS
AUTHORIZED IN WRITING BY
GARVER, LLC. NO REUSE OR
ALLOWED IN THE GROUNDING
PROFESSIONAL, SERVING

One Paragon Center
2525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(859) 219-0659



Digitally Signed 05/22/2026

Last plotted by: Ellis, Dakota L. Plot Style: AECmono.ctb Plot Scale: 1:1 Plot Date: 5/22/2026 9:33 AM Plotter used: AutoCAD PDF (General Documentation).pc3

Garver

Garver Engineering, Inc.

1100 EAST 10TH AVENUE, SUITE 100
DENVER, CO 80218
TEL: 303.733.8800
WWW.GARVERINC.COM

Garver

Garver Engineering, Inc.

1100 EAST 10TH AVENUE, SUITE 100
DENVER, CO 80218
TEL: 303.733.8800
WWW.GARVERINC.COM

Garver

Garver Engineering, Inc.

1100 EAST 10TH AVENUE, SUITE 100
DENVER, CO 80218
TEL: 303.733.8800
WWW.GARVERINC.COM

One Paragon Center
2525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(606) 219-0659



REV.	DATE	DESCRIPTION	BY

KENTUCKY DEPARTMENT OF AVIATION
FALLS OF ROUGH, KENTUCKY
PAPI REPLACEMENT
SURVEY CONTROL
PLAN
JOB NO. 7-2000131
DATE: MAY 2026
DESIGNED BY: DLE
DRAWN BY: ABC
SCALE: ONE INCH = ONE FOOT
SHEET NO. 131 OF 152
DRAWING NUMBER
G1101
SHEET NUMBER
3



ITEMS OF WORK

BASE BID: REMOVE EXISTING RW 20 4-BOX PAPI AND ASSOCIATED CABLEING. INSTALL NEW RW 20 4-BOX PAPI AND ASSOCIATED CABLEING. FLIGHT CHECK RW 20 PAPI.

SURVEY CONTROL POINTS		
POINT NO.	NORTHING	EASTING
CP #100	2107649.75	1421537.42
CP #101	2106982.26	1420570.54
CP #1	2106982.23	1421645.35
CP #2	2107443.52	1421615.53
CP #3	2107012.33	1421072.52
CP #4	2106887.53	1421176.81
CP #5	2105420.98	1420960.03
CP #6	2104731.77	1420738.29

NOTES:

1. CONTRACTOR SHALL PROTECT ALL CONTROL POINTS. ANY DAMAGE TO THESE CONTROL POINTS SHALL BE REPAIRED AT NO COST TO THE OWNER. REPAIRS SHALL BE COORDINATED WITH THE ENGINEER AND SHALL BE COMPLETED BY A LICENSED SURVEYOR. FINAL RESULTS OF THE RE-SET MONUMENT SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL.

2. CONTRACTOR SHALL VERIFY CONTROL POINTS AND NOTIFY ENGINEER OF ANY DISCREPANCIES PRIOR TO BEGINNING CONSTRUCTION.

3. BASIS FOR BEARINGS SHOWN HEREON IS THE KENTUCKY STATE PLANE COORDINATE SYSTEM. BEARINGS ARE BASED ON THE KENTUCKY STATE PLANE COORDINATE SYSTEM. THE KENTUCKY STATE PLANE COORDINATE SYSTEM WAS ESTABLISHED ON FEBRUARY 18, 2008. COORDINATES CONVERTED TO KENTUCKY STATE PLANE COORDINATE SYSTEM NORTH AMERICAN DATUM OF 1983 (NAD 83), SOUTH ZONE, BY THOROUGH-BRED ON APRIL 27, 2026.

LEGEND

Survey Control Point

Runway Safety Area

Runway Object Free Area

— RSA —

— ROFA —

0 100' 200' 400' 600'

(IN FEET)



One Paragon Center
525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(859) 219-0659



DATE	DESCRIPTION	DEBIT	CREDIT

MENT OF AVIATION
E PARK AIRPORT
KY

KENTUCKY DEPARTMENT OF
ROUGH RIVER STATE
FALLS OF ROUGH, KENTUCKY
PAPI REPLACEMENT

CONSTRUCTION
SAFETY AND PHASING
NOTES 1

JOB NO.: 2600131
DATE: MAY 2026
DESIGNED BY: DLE
DRAWN BY: ABC

BAR IS ONE INCH ON ORIGINAL DRAWING

0 1"

IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER

SHEET NUMBER	4
GC001	

CONSTRUCTION SAFETY AND PHASING PLAN (CSPP) - PAGE 1 OF 2

1. TRASH - THE CONTRACTOR SHALL PERFORM TRASH CLEAN-UP ON A DAILY BASIS.
2. STANDING WATER - THE CONTRACTOR SHALL PROVIDE TEMPORARY DRAINAGE DURING CONSTRUCTION TO AVOID STANDING WATER.
3. TALL GRASS AND SEEDS - THE CONTRACTOR SHALL ADHERE TO THE REQUIREMENTS OF SECTION 1-801, SEEDING OF THE CONTRACT DOCUMENTS AND SPECIAL SPECIFICATIONS.
4. POORLY MAINTAINED FENCING AND GATES - THE CONTRACTOR SHALL IMMEDIATELY REPORT ANY DAMAGE TO GATES OR FENCES. THE CONTRACTOR WILL BE RESPONSIBLE FOR REPAIRS TO ANY GATES OR FENCES CAUSED BY NEGLIGENCE BY THE CONTRACTOR.
5. DISRUPTION OF EXISTING WILDLIFE HABITAT - THE CONTRACTOR SHALL NOTIFY THE AIRPORT IMMEDIATELY OF ANY WILDLIFE SIGHTINGS.
6. FOREIGN OBJECT DEBRIS (FOD) MANAGEMENT
- THE CONTRACTOR SHALL ENSURE THAT THE PAVEMENT SURFACES ARE KEPT CLEAN FROM DIRT, MUD, AND OTHER DEBRIS FROM THE CONTRACTOR'S EQUIPMENT. FREQUENT CLEANUP IN THE VICINITY OF THE CONTRACTOR'S WORK AREAS IS REQUIRED. SEE AC 150/5210-24, FOREIGN OBJECT DEBRIS (FOD) MANAGEMENT (www.faa.gov) FOR FURTHER INSTRUCTION.
7. HAZARDOUS MATERIALS (HAZMAT) MANAGEMENT
- IF ANY CONSTRUCTION VEHICLE OR EQUIPMENT IS OPERATED WITHIN AIRPORT PROPERTY, THE CONTRACTOR MUST BE ADEQUATELY PREPARED TO EXPEDITIOUSLY CONTAIN AND CLEAN-UP SPILLS RESULTING FROM FUEL OR HYDRAULIC FLUID LEAKS. SPECIAL CARE MUST ALSO BE TAKEN WHEN HANDLING OR TRANSPORTING HAZARDOUS MATERIALS ON AIRPORT PROPERTY. SEE AC 150/5320-15, MANAGEMENT OF AIRPORT INDUSTRIAL WASTE (www.faa.gov), FOR FURTHER INSTRUCTION.
8. NOTIFICATION OF CONSTRUCTION ACTIVITIES
- A. LIST OF RESPONSIBLE REPRESENTATIVES - A POINT OF CONTACT LIST WILL BE COMPLETED AS PART OF THE SAFETY PLAN COMPLIANCE DOCUMENT (SPCD) AND WILL BE DELIVERED TO ALL PARTIES PRIOR TO CONSTRUCTION.
- B. NOTICES TO AIR MISSIONS (NOTAM) - BEFORE BEGINNING ANY CONSTRUCTION ACTIVITY, THE CONTRACTOR MUST, THROUGH THE AIRPORT OPERATOR, GIVE NOTICE USING THE NOTAM SYSTEM OF PROPOSED LOCATION, TIME, AND DATE OF COMMENCEMENT OF CONSTRUCTION, UPON COMPLETION OF WORK, AND RETURN OF ALL SUCH AREAS TO STANDARD CONDITIONS. THE CONTRACTOR MUST, THROUGH THE AIRPORT OPERATOR, VERIFY THE CANCELLATION OF ALL NOTICES ISSUED VIA THE NOTAM SYSTEM.
- C. EMERGENCY NOTIFICATION PROCEDURES - IN THE EVENT OF AN EMERGENCY, THE CONTRACTOR SHALL CALL 911, THEN NOTIFY THE ENGINEER AND AIRPORT MANAGER.
- D. GOVERNMENT WITH AIRCRAFT PERSONNEL - ANY DEVIATION OF WATER LINES OR HYDRANTS - REROUTING OF ACCESS ROUTES - OR USE OF HAZARDOUS MATERIALS ON THE AIRFIELD SHALL BE COORDINATED AND APPROVED BY THE AIRPORTS AIRCRAFT PERSONNEL PRIOR TO EXECUTION OF SUCH ACTIVITIES.
- E. NOTIFICATION TO THE FAA - THE CONTRACTOR SHALL ENSURE, THROUGH THE ENGINEER, THAT ALL CONSTRUCTION EQUIPMENT OVER 10 FT IN HEIGHT IS AIR SPACED THROUGH THE APPROPRIATE FAA REGIONAL OR DISTRICT OFFICE PRIOR TO USING SUCH EQUIPMENT ON SITE.
- F. SHUTDOWN OF ANY NAV AID (AIRPORT OR FAA OWNED) SHALL BE COORDINATED WITH THE FAA AT LEAST 45 DAYS PRIOR TO THE PROPOSED SHUTDOWN. THE CONTRACTOR SHALL PROVIDE AN ADDITIONAL SEVEN DAYS ADVANCE NOTICE TO THE AIRPORT AND COORDINATE WITH THE FAA TO THE EFFECT OF: "THE SHUTDOWN OF ANY NAV AID SHALL BE COORDINATED WITH THE FAA AT LEAST 45 DAYS PRIOR TO THE PROPOSED SHUTDOWN. THE SHUTDOWN SHALL BE COORDINATED WITH THE FAA AT LEAST 45 DAYS PRIOR TO THE SHUTDOWN."
9. INSPECTION REQUIREMENTS
- A. DAILY INSPECTIONS - THE CONTRACTOR SHALL PERFORM DAILY SAFETY INSPECTIONS TO VERIFY ALL CONSTRUCTION OPERATIONS ARE IN CONFORMANCE WITH THE CONSTRUCTION SAFETY AND PHASING PLAN (CSPP).
- B. INTERIM INSPECTIONS - PRIOR TO OPENING ANY PORTION OF THE AIRPORT TO TRAFFIC, THE CONTRACTOR, ENGINEER, AND AIRPORT OPERATOR SHALL PERFORM A SAFETY INSPECTION OF THE AREA TO BE OPENED TO TRAFFIC TO VERIFY CONFORMANCE WITH THE CSPP AND FAA STANDARDS.
- C. FINAL INSPECTIONS - PRIOR TO OPENING ANY PORTION OF THE AIRPORT TO TRAFFIC, THE CONTRACTOR, ENGINEER, AND AIRPORT OPERATOR SHALL PERFORM A SAFETY INSPECTION OF THE AREA TO BE OPENED TO TRAFFIC TO VERIFY CONFORMANCE WITH THE CSPP AND FAA STANDARDS.
10. UNDERGROUND UTILITIES
- UNDERGROUND UTILITIES EXIST WITHIN AND ADJACENT TO THE LIMITS OF CONSTRUCTION. AN ATTEMPT HAS BEEN MADE TO LOCATE THESE UTILITIES ON THE PLANS. HOWEVER, ALL EXISTING UTILITIES MAY NOT BE SHOWN AND THE ACTUAL LOCATIONS OF THE UTILITIES MAY VARY FROM THE LOCATIONS SHOWN. PRIOR TO BEGINNING ANY TYPE OF EXCAVATION, THE CONTRACTOR SHALL CONTACT THE UTILITIES INVOLVED AND MAKE ARRANGEMENTS FOR THE LOCATION OF THE UTILITIES ON THE GROUND. THE CONTRACTOR SHALL MAINTAIN THE UTILITY LOCATION MARKINGS UNTIL THEY ARE NO LONGER NECESSARY.
- KENTUCKY STATE LAW, THE UNDERGROUND FACILITIES DAMAGE PREVENTION ACT, REQUIRES TWO WORKING DAYS ADVANCE NOTIFICATION THROUGH THE ONE-CALL SYSTEM CENTER BEFORE EXCAVATING USING MECHANIZED EQUIPMENT OR EXPLOSIVES (EXCEPT IN THE CASE OF AN EMERGENCY). THE ONE-CALL SYSTEM PHONE NUMBER IS 1-800-752-6007. THE CONTRACTOR IS ADVISED THAT THERE IS A SEVERE PENALTY FOR NOT MAKING THIS CALL. NOT ALL UTILITY COMPANIES ARE MEMBERS OF THE KENTUCKY ONE-CALL SYSTEM. THEREFORE, THE CONTRACTOR IS ADVISED TO CONTACT ALL NON-MEMBER UTILITIES AS WELL AS THE ONE-CALL SYSTEM.
11. PENALTIES
- FAILURE OF THE CONTRACTOR (INCLUDING EMPLOYEES) OR ANY OF HIS SUBCONTRACTORS (INCLUDING EMPLOYEES) TO COMPLY WITH THE INSTRUCTIONS OF THE AIRPORT SAFETY PLAN OR ANY OF THE OTHER REQUIREMENTS OF THE AIRPORT WHILE OPERATING ON AIRPORT PROPERTY, SHALL BE SUBJECT TO THE FOLLOWING:
- A. FIRST OFFENSE - THE CONTRACTOR SHALL RECEIVE A FINE OF \$1,000.00, AND THE VEHICLE OPERATOR WILL RECEIVE A LOSS OF DRIVING PRIVILEGES ON THE AIRPORT. IN ADDITION, ANY FINES OR PENALTIES IMPOSED ON THE AIRPORT AS A RESULT OF THE INCIDENT WILL BE ASSESSED TO THE CONTRACTOR.
- B. SECOND OFFENSE - THE CONTRACTOR SHALL RECEIVE A FINE OF \$5,000.00 TO BE DEDUCTED FROM ANY MONIES DUE HIM, AND THE VEHICLE OPERATOR WILL RECEIVE A LOSS OF DRIVING PRIVILEGES ON THE AIRPORT. IN ADDITION, ANY FINES OR PENALTIES IMPOSED ON THE AIRPORT AS A RESULT OF THE INCIDENT WILL BE ASSESSED TO THE CONTRACTOR.
- C. THIRD OFFENSE - WORK WILL BE SUSPENDED. THE CONTRACTOR (INCLUDING EMPLOYEES) AND ANY OF HIS SUBCONTRACTORS (INCLUDING EMPLOYEES) WHO WILL OPERATE GROUND VEHICLES ON THE AIRPORT SHALL SUCCESSFULLY COMPLETE, FOR A SECOND TIME, FORMALIZED AIRPORT SAFETY TRAINING. TO BE CONDUCTED BY AIRPORT STAFF. WHEN THE CONTRACTOR'S EMPLOYEES HAVE COMPLETED AIRPORT SAFETY TRAINING TO THE SATISFACTION OF THE OWNER, WORK MAY CONTINUE AT THE DISCRETION OF THE OWNER.

- COORDINATION
- A. CONTRACTOR PROGRESS MEETINGS - THE OWNER, ENGINEER AND CONTRACTOR WILL HOLD PROGRESS MEETINGS ON A COORDINATED SCHEDULE DURING CONSTRUCTION. OPERATIONAL SAFETY WILL BE A STANDING AGENDA ITEM IN SUCH MEETINGS.
- B. SCOPE OR SCHEDULE CHANGES - THE OWNER AND/OR ENGINEER WILL CALL SUCH COORDINATION CONFERENCE(S) AS MAY SEEM EXPEDIENT TO HIM FOR THE PURPOSE OF ASSURING COORDINATION OF THE WORK COVERED BY THIS CONTRACT AND/OR SCOPE OR SCHEDULE CHANGES. THE CONTRACTOR SHALL ATTEND ALL SUCH CONFERENCES.
- C. FAA-TO-COORDINATION - COORDINATION WITH THE FAA IS REQUIRED FOR THE REQUIRED SHUT-DOWN OF FAA FACILITIES FOR THIS PROJECT HAS BEEN COMPLETED. THE FAA IS TO CONTACT FOR THE PROJECT ID: XXXX-XXX-XXXX-XXXX.
- DURING PERFORMANCE OF THIS PROJECT, THE AIRPORT RUNWAYS, TAXIWAYS, AND AIRCRAFT PARKING APRONS SHALL REMAIN IN USE BY AIRCRAFT TO THE MAXIMUM EXTENT POSSIBLE. THE PROJECT SHALL BE PHASED TO REDUCE OPERATIONAL IMPACTS AT THE AIRPORT.
- A. PHASE ELEMENTS - IF NECESSARY FOR A GIVEN PHASE, EACH PHASE OF THE CONSTRUCTION SAFETY DRAWINGS SHALL DETAIL THE AREAS CLOSED TO AIRCRAFT OPERATIONS, ESTIMATED DURATION OF CLOSURES, TAXI ROUTES, ARFT ACCESS ROUTES, CONSTRUCTION STAGING AREAS, CONSTRUCTION ACCESS AND HALL ROUTES, MAINTENANCE IMPACTS, LIGHTING AND MARKING CHANGES, AVAILABLE RUNWAY LENGTH, DECLARED DISTANCES, HAZARD MARKING AND LIGHTING, AND REQUIRED LEAD TIME FOR NOTAMS.
- B. CONSTRUCTION SAFETY DRAWINGS - SEE SHEET GC-101 FOR CONSTRUCTION SAFETY DRAWINGS.
- AREAS OF OPERATIONS AFFECTED BY CONSTRUCTION ACTIVITY
- A. IDENTIFICATION OF AFFECTED AREAS - SEE "AIRFIELD AREAS OF OPERATION AFFECTED BY CONSTRUCTION" TABLE AND CONSTRUCTION SAFETY DRAWINGS FOR AIRFIELD AREAS OF OPERATIONS AFFECTED BY CONSTRUCTION.
- B. MITIGATION EFFORTS - SEE TABLE ON PAGE 2 OF THE CSPP AND CONSTRUCTION SAFETY DRAWINGS FOR MITIGATION EFFORTS OF OPERATIONS AFFECTED BY CONSTRUCTION.
- PROTECTION OF NAVIGATION AIDS (NAVDADS)
- PLANNED CONSTRUCTION ACTIVITIES WILL HAVE NO NEGATIVE IMPACTS ON THE FUNCTIONALITY AND SERVICEABILITY OF THE NAVDADS.
- CONTRACTOR ACCESS
- A. LOCATION OF STOCKPILED MATERIALS - THE CONTRACTOR SHALL INSTALL A TEMPORARY FENCE AROUND HIS CONSTRUCTION STAGING AREA TO SEPARATE HIS BATCH PLANT, MATERIAL STOCKPILE STORAGE, AND PARKING AREAS FROM THE PUBLIC. NO PERSONAL VEHICLES OF THE CONTRACTOR'S EMPLOYEES WILL BE ALLOWED INSIDE THE SECURED AREA OF THE AIRPORT. ALL MATERIAL DELIVERIES SHALL BE RECEIVED IN THE STAGING AREA. STOCKPILED MATERIALS AND EQUIPMENT ARE NOT PERMITTED WITHIN THE ACTIVE RUNWAY SAFETY AREA AND OBSTACLE FREE ZONE. THE CONTRACTOR SHALL RECEIVE APPROVAL FROM THE ENGINEER AND FAA AIR SPACING OFFICE PRIOR TO LOCATING STOCKPILES OR EQUIPMENT WITHIN THE OBJECT FREE AREA, SAFETY AREA, OR OBSTACLE FREE ZONE. NO STOCKPILE SHALL BE GREATER THAN 15-FT IN HEIGHT.
- B. VEHICLE AND PEDESTRIAN OPERATIONS - SEE THE CONSTRUCTION SAFETY DRAWINGS FOR CONSTRUCTION SITE PARKING, EQUIPMENT STORAGE AREAS, AND ACCESS AND HALL ROUTES. VEHICULAR TRAFFIC SHALL ALWAYS YIELD TO AIRCRAFT TRAFFIC.
- WHEN ANY VEHICLE, OTHER THAN ONE THAT HAS PRIOR APPROVAL FROM THE AIRPORT OPERATOR, MUST PARK OVER ANY PORTION OF AN AIRCRAFT MOVEMENT AREA, IT WILL BE ESCORTED AND PROPERLY IDENTIFIED. TO OPERATE IN THOSE AREAS DURING DAYLIGHT HOURS, THE VEHICLE MUST HAVE A FLUORESCENT BANNER AFFIXED TO IT TO MAKE IT MORE VISIBILE TO AIRCRAFT. THE BANNER MUST BE USED DURING HOURS OF DARKNESS ON REDUCED VISIBILITY MUST BE EQUIPPED WITH FLASHING DOME-TYPE LIGHT, THE COLOR OF WHICH IS IN ACCORDANCE WITH LOOK OR STATE CODES.
- ALL CONSTRUCTION VEHICLES SHALL BE CLEARLY IDENTIFIED FOR CONTROL PURPOSES BY PROMINENTLY DISPLAYING THE COMPANY NAME ON EACH SIDE OF THE VEHICLE. THE IDENTIFICATION SYMBOLS SHOULD BE A MINIMUM 8-INCH BLOCK-TYPE CHARACTERS OF A CONTRASTING COLOR AND EASY TO READ. THEY MAY BE APPLIED EITHER BY USING TAPE OR WATER-SOLUBLE PAINT TO FACILITATE REMOVAL. MAGNETIC SIGNS ARE ALSO ACCEPTABLE. IN ADDITION, VEHICLES MUST DISPLAY IDENTIFICATION MEDIA AS SPECIFIED IN THE APPROVED SECURITY PLAN.
- AT 14 CFR PART 139 CERTIFIED AND TOWERED AIRPORTS, ALL VEHICLE OPERATORS HAVING ACCESS TO THE MOVEMENT AREA MUST BE FAMILIAR WITH THE AIRPORT PROCEDURES FOR THE OPERATION OF GROUND VEHICLES AND THE CONSEQUENCES OF NONCOMPLIANCE, OR BE ESCORTED BY SOMEONE WHOH IS PERSONNEL ENTERING THE SECURED AREA MUST BE IN POSSESSION OF AND DISPLAY A VALID AIRPORT IDENTIFICATION BADGE AT ALL TIMES OR MUST BE ESCORTED BY A PERSON WITH A VALID AIRPORT IDENTIFICATION BADGE. ANY PERSON WHOSE ESCORTING INDIVIDUALS MUST BE IN DIRECT CONTROL OF THE ESCORTED INDIVIDUALS AT ALL TIMES. ANY PERSON WHO HAS BEEN ISSUED A BADGE BUT IS NOT IN POSSESSION OF THE BADGE, MAY NOT ENTER THE SECURED AREA OF THE AIRPORT. AIRPORT IDENTIFICATION BADGES MAY BE OBTAINED AT THE LOGGON BUILDING REGULAR 6-HOUR SETBACK TIMES FOR EXCHANGE OF BADGES. THERE IS A \$100 FEE FOR ISSUANCE OF THE BADGE AND \$500 CHARGE FOR THE IDENTIFICATION AND BACKGROUND CHECKS FOR THE PROJECT UNLESS DIRECTED OTHERWISE BY THE AIRPORT. ANY TIME INCLUDING ANY AND ALL ASSIGNED PORTS, ASSESSED THE AIRPORT FOR FAILURE TO MAINTAIN SECURITY OF THE AIRPORT WHICH ARE A RESULT OF THE NEGLIGENCE OF THE PRIME CONTRACTOR, ANY OF HIS SUBCONTRACTORS, OR ANY SUPPLY DELIVERY PERSONNEL, WILL BE ASSESSED TO THE PRIME CONTRACTOR AND SHALL BE DEDEDUCTED FROM ANY MONIES DUE HIM.
- VEHICULAR TRAFFIC LOCATED IN OR CROSSING AN ACTIVE MOVEMENT AREA MUST HAVE A WORKING TWO-WAY RADIO IN CONTACT WITH THE CONTROL TOWER OR BE ESCORTED BY A PERSON IN RADIO CONTACT WITH THE TOWER. THE DRIVER, THROUGH PERSONAL OBSERVATION, SHOULD CONFIRM THAT NO AIRCRAFT IS APPROACHING THE VEHICLE POSITION. CONSTRUCTION PERSONNEL MAY OPERATE IN A MOVEMENT AREA WITHOUT TWO-WAY RADIO COMMUNICATION PROVIDED AN APPROPRIATE SIGNAGE IS USED TO CLOSE THE AREA AND THE AREA IS PROPERLY MARKED TO PREVENT INCURSIONS. TWO-WAY RADIO COMMUNICATIONS ARE REQUIRED BETWEEN CONTRACTORS AND UNCOMMERCIAL FREQUENCY 122.8. CONTINUOUS MONITORING IS REQUIRED ONLY WHEN EQUIPMENT OR VEHICLES ARE NECESSARY IN CERTAIN AREAS).
- C. CONTROL OF GATES - THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING THE SECURITY OF THE ACCESS GATES BY KEEPING THE ACCESS GATES LOCKED OR GUARDED AT ALL TIMES. SHOULD THE CONTRACTOR FAIL AT ANY TIME, TO KEEP THE ACCESS GATES LOCKED OR GUARDED, THERE SHALL BE A FINE OF \$2000 PER ASSESSMENT TO THE CONTRACTOR FOR EACH OCCURRENCE THAT THE CONTRACTOR FAILS TO MAINTAIN THE SECURITY OF THE ACCESS GATE. ALL TIMES ASSESSED TO THE CONTRACTOR SHALL BE DEDUCTED FROM ANY PAYMENT DUE TO HIMHER.
- LIFELIFE MANAGEMENT
- IF APPLICABLE, THE CONTRACTOR SHALL REVIEW AND ADHERE TO THE CONTENTS OF THE AIRPORT OPERATORS' WILDLIFE HAZARD MANAGEMENT PLAN. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF WILDLIFE AND HABITATS. THE CONTRACTOR SHALL CAREFULLY CONTROL AND CONTINUOUSLY REMOVE WASTE OR LOOSE MATERIALS THAT MIGHT ATTRACT WILDLIFE. THE CONTRACTOR PERSONNEL MUST BE AWARE OF AND AVOID CONSTRUCTION ACTIVITIES THAT CAN CREATE WILDLIFE HAZARDS ON AIRPORTS. THE CONTRACTOR SHALL MITIGATE THE FOLLOWING ITEMS.

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

13. SPECIAL CONDITIONS		19. OTHER LIMITATIONS ON CONSTRUCTION	
NONE.		A. PROHIBITIONS - THE USE OF TALL EQUIPMENT (I.E. CRANES, CONCRETE PUMPS) SHALL NOT BE PERMITTED UNLESS APPROVED BY THE ENGINEER. OPEN FLAME WELDING AND TORCH CUTTING OPERATIONS ARE NOT PERMITTED UNLESS ADEQUATE FIRE SAFETY PRECAUTIONS ARE PROVIDED AND THESE OPERATIONS ARE AUTHORIZED BY THE AIRPORT OPERATOR AND THE ENGINEER. ELECTRICAL BLASTING CAPS SHALL NOT BE PERMITTED WITHIN 1,000-FT OF THE AIRPORT PROPERTY. FLARE POTS ARE NOT PERMITTED WITHIN THE AIR OPERATIONS AREA.	
14. RUNWAY AND TAXIWAY VISUAL AIDS		B. RESTRICTIONS - CONSTRUCTION PERSONNEL SHALL BE RESTRICTED FROM ALL AIRPORT BUILDINGS UNLESS SPECIFICALLY REQUIRED FOR PERFORMANCE OF WORK. CONTRACTOR SHALL PROVIDE PORTA-JOHN AND TRASH CONTAINER WITH AN ATTACHABLE LID TO BE USED BY CONSTRUCTION EMPLOYEES.	
A. GENERAL - ALL AIRPORT MARKINGS, LIGHTING, SIGNS, AND VISUAL NAVAIDS THAT ARE IN OPERATION MUST BE CLEAR FROM ALL OBSTRUCTIONS. ALL TEMPORARY MARKINGS, SIGNS, LIGHTS, OR OTHER VISUAL AIDS MUST BE SECURED IN PLACE TO PREVENT DAMAGE OR DISPLACEMENT BY PROP WASH, JET BLAST, WING VORTICES, OR OTHER WIND CURRENTS.		C. CONSTRUCTION SAFETY LIMIT - THE RUNWAY SHALL BE CLOSED WHENEVER ANY WORK OR PERSONNEL ARE WITHIN 200' OF THE RUNWAY CENTERLINE. THE CONTRACTOR WILL BE REQUIRED TO STAKE OUT AND FLAG THE CONSTRUCTION SAFETY LIMIT AS SHOWN ON THE SAFETY AND PHASING SHEETS.	
B. MARKINGS - ALL TEMPORARY OR PERMANENT RUNWAY AND TAXIWAY VISUAL AIDS SHALL CONFORM TO THE REQUIREMENTS OF THE MOST RECENT EDITION OF FAA AC 150/5346-1 (www.faa.gov). MARKINGS FOR THIS PROJECT INCLUDE THE FOLLOWING:		D. THE INTENT OF THE CONTRACT DOCUMENTS IS TO ORGANIZE AND CONTROL THE WORK SO IT IS ACCOMPLISHED WITH MINIMUM INCONVENIENCES TO THE AIRPORT AND TO ENSURE THE SAFETY OF THE AIRCRAFT MOVEMENTS AT THE AIRPORT DURING THE CONSTRUCTION PERIOD. ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH FAA AC 150/5370-3H, OPERATION SAFETY ON AIRPORTS DURING CONSTRUCTION.	
• TEMPORARILY CLOSED RUNWAYS - THE CONTRACTOR SHALL BE RESPONSIBLE FOR FURNISHING, INSTALLING, AND MAINTAINING RUNWAY CLOSURE MARKERS ON TOP OF THE RUNWAY DESIGNATION MARKERS. SEE DETAILS ON CONSTRUCTION SAFETY DRAWINGS FOR CLOSED RUNWAY MARKER DETAIL.		CONTRACTOR SHALL ENSURE ALL EQUIPMENT AND VEHICLES INSIDE THE AIR OPERATIONS AREA HAS A FLAG OR BEACON ATTACHED TO IT ALL TIMES. NOTE: SOME APPLICABLE SAFETY NOTES, BUT NOT ALL APPLICABLE SAFETY NOTES REQUIRE ON AIRPORT PROJECTS, ARE INCLUDED IN THESE PLANS AND SPECIFICATIONS. CONTRACTOR SHALL ACQUIRE AND MAKE THEMSELVES AWARE OF ALL REQUIREMENTS AND REGULATIONS LISTED IN THE BELOW REFERENCE MATERIALS.	
• TEMPORARILY CLOSED TAXIWAYS - THE CONTRACTOR SHALL BE RESPONSIBLE FOR FURNISHING, INSTALLING, AND MAINTAINING TAXIWAY CLOSURE MARKERS AT THE ENTRANCE TO THE CLOSED TAXIWAY FROM THE APRON ADJACENT RUNWAY. THE TAXIWAY CLOSURE MARKERS SHALL BE INSTALLED INSIDE THE RUNWAY SAFETY AREA. THE CONTRACTOR SHALL ALSO FURNISH AND INSTALL LOW PROFILE BARRICADES AT THE ENTRANCE TO THE CLOSED TAXIWAY FROM AN ADJACENT APRON TAXIWAY. BARRICADES SHALL BE INSTALLED OUTSIDE ALL ACTIVE TAXIWAY SAFETY AREAS. SEE DETAILS ON CONSTRUCTION SAFETY DRAWINGS FOR CLOSED TAXIWAY MARKER AND LOW-PROFILE AIRCRAFT BARRICADE DETAILS.		REFERENCE MATERIALS	
C. LIGHTING AND VISUAL NAVAIDS - ALL TEMPORARY LIGHTING FOR RUNWAY AND TAXIWAY SYSTEMS SHALL CONFORM TO THE REQUIREMENTS OF THE MOST RECENT EDITION OF FAA AC 150/5346-30 AND 150/5345-50 (www.faa.gov). THE CONTRACTOR SHALL BE RESPONSIBLE FOR DISCONNECTING ISOLATION TRANSFORMERS ASSOCIATED WITH ANY RUNWAY OR TAXIWAY LIGHT FIXTURES THAT ARE BEING DISCONNECTED. IF APPLICABLE, ALL CONSTRUCTION, ALTERATION, OR REMOVAL OF FAA OWNED EQUIPMENT SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS SET FORTH IN THE APPROVED FAA REMBURSABLE AGREEMENT. NO WORK SHALL BE COMPLETED ON FAA OWNED EQUIPMENT PRIOR TO COMPLETION OF THE FAA REMBURSABLE AGREEMENT.		AC 150/5370-2G AC 150/5370-10H AC 150/53200-18D AC 150/5320-10 AC 150/5210-5D IPRF 01-G-002-05-1 OSHA PART 1926 ACG OF AMERICA	
D. SIGNS - THE CONTRACTOR SHALL INSTALL ALL SIGNS IN ACCORDANCE WITH THE MOST RECENT EDITION OF FAA AC 150/5345-44 AND 150/5340-18. ANY SIGN THAT IS NOT PERFORMING ITS NORMAL FUNCTION MUST BE COVERED OR REMOVED TO PREVENT MISLEADING PILOTS.		OPERATIONAL SAFETY ON AIRPORTS DURING CONSTRUCTION STANDARDS FOR SPECIFYING CONSTRUCTION OF AIRPORTS AIRPORT SAFETY SELF INSPECTION AIRPORT SAFETY SELF INSPECTION PAINTING, MARKING, & LIGHTING OF VEHICLES USED ON AIRPORT AIRFIELD MARKING HANDBOOK SAFETY AND HEALTH REGULATIONS FOR CONSTRUCTION MANUAL OF ACCIDENT PREVENTION IN CONSTRUCTION	
15. MARKING AND SIGNS FOR ACCESS ROUTES		PROJECT CONTACT INFORMATION	
THE CONTRACTOR SHALL BE RESPONSIBLE FOR SUPPLYING AND INSTALLING ALL NECESSARY MARKINGS AND SIGNAGE FOR ALL ACCESS ROUTES TO AND FROM THE CONSTRUCTION AREA. THE CONTRACTOR PERSONNEL, SUBCONTRACTOR PERSONNEL, OR DELIVERY OPERATIONS, ALL SIGNAGE IN THE AIR OPERATIONS AREA SHALL BE FRANGIBLY MOUNTED.		AIRPORT MANAGER GARVER CIVIL PM GARVER ELECTRICAL PM FIRE DEPARTMENT POLICE DEPARTMENT ELECTRIC WATER SANITARY SEWER	
16. HAZARD MARKING AND LIGHTING		MICHAEL RICKS WILLIAM C. ADAMS IV DAKOTA ELLIS FALLS OF ROUGH FIRE DEPT. GRAYSON COUNTY SHERIFF MEADE COUNTY RECC GRAYSON COUNTY WATER DISTRICT KY DEPT. OF PARKS	
A. PURPOSE - HAZARD MARKING AND LIGHTING PREVENTS PILOTS FROM ENTERING AREAS CLOSED TO AIRCRAFT AND PREVENTS CONTRACTOR PERSONNEL FROM ENTERING AREAS OPEN TO AIRCRAFT.		270-989-1180 859-410-2827 615-567-0969 270-287-1613 270-259-3024 270-422-2162 270-259-2917 270-237-2511	
B. EQUIPMENT - THE CONTRACTOR SHALL FURNISH, INSTALL, AND MAINTAIN LOW-PROFILE BARRICADES IN HAZARDOUS AREAS INSIDE MOVEMENT AREAS. BARRICADES SHALL RESTRICT ACCESS AND MAKE HAZARDS OBVIOUS TO AIRCRAFT, PERSONNEL, AND VEHICLES DURING PERIODS OF LOW VISIBILITY AND AT NIGHT. BARRICADES SHALL BE EQUIPPED WITH RED FLASHING OR RED STEADY BURNING LIGHTS. THE SPACING OF BARRICADES SHALL BE SUCH THAT A PILOT WILL BE ABLE TO SEE THEM FROM A DISTANCE OF 1000 FEET. PILOTS OF PEDESTRIANS, THEN THEY SHALL BE LINKED. SEE DETAILS ON CONSTRUCTION SAFETY DRAWINGS FOR LOW-PROFILE AIRCRAFT BARRICADE DETAIL.		PROJECT CONTACT INFORMATION	
WORK ZONE LIGHTING FOR NIGHTTIME CONSTRUCTION		MICHAEL RICKS WILLIAM C. ADAMS IV DAKOTA ELLIS FALLS OF ROUGH FIRE DEPT. GRAYSON COUNTY SHERIFF MEADE COUNTY RECC GRAYSON COUNTY WATER DISTRICT KY DEPT. OF PARKS	
ALL WORK CONDUCTED AT NIGHT SHALL BE ACCOMPANIED BY ADEQUATE LIGHT FACILITIES TO COMPLETE THE WORK. ALL LIGHT FACILITIES SHALL BE AIMED OR SHIELDED AS NECESSARY TO AVOID IMPACTING AIRCRAFT OR ATO OPERATIONS. THE CONTRACTOR SHALL BE REQUIRED TO SUBMIT A LIGHTING PLAN SHOWING THE LOCATION AND AIMING DIRECTION OF ALL LIGHT FACILITIES PRIOR TO THE COMPLETION OF ANY NIGHT WORK.		PROJECT CONTACT INFORMATION	
18. PROTECTION OF SAFETY AREAS, OBJECT FREE AREAS, OBJECT FREE ZONES, AND APPROACH/DEPARTURE SURFACES.		MICHAEL RICKS WILLIAM C. ADAMS IV DAKOTA ELLIS FALLS OF ROUGH FIRE DEPT. GRAYSON COUNTY SHERIFF MEADE COUNTY RECC GRAYSON COUNTY WATER DISTRICT KY DEPT. OF PARKS	
A. RUNWAY SAFETY AREAS (RSA) - NO WORK SHALL BE PERMITTED WITHIN AN ACTIVE RUNWAY SAFETY AREA IF REQUIRED, ADJUSTMENTS TO THE RSA DIMENSIONS THROUGH RESTRICTED OPERATIONS SHALL BE COORDINATED WITH THE FAA AIRPORTS REGIONAL OR DISTRICT OFFICE PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL ENSURE ADEQUATE DISTANCE PROTECTION FOR BLAST PROTECTION, AS NEEDED, ALL OPEN TRENCHES OR EXCAVATIONS WITHIN THE LIMITS OF THE RSA SHALL BE BACK FILLED OR COVERED PRIOR TO OPENING THE RUNWAY TO OPERATIONS. IN ADDITION, EROSION CONTROL MEASURES SHALL BE PROVIDED IN THE RSA TO PREVENT RUTS, HUMPS, OR DEPRESSIONS INSIDE THE LIMITS OF THE RSA.		PROJECT CONTACT INFORMATION	
B. RUNWAY OBJECT FREE AREAS (ROFA) - NO MATERIAL SHALL BE STOCKPILED INSIDE THE LIMITS OF THE ACTIVE ROFA UNLESS APPROVED BY AIR SPACING THROUGH THE APPROPRIATE FAA AIRPORTS REGIONAL OR DISTRICT OFFICE.		MICHAEL RICKS WILLIAM C. ADAMS IV DAKOTA ELLIS FALLS OF ROUGH FIRE DEPT. GRAYSON COUNTY SHERIFF MEADE COUNTY RECC GRAYSON COUNTY WATER DISTRICT KY DEPT. OF PARKS	
C. TAXIWAY SAFETY AREAS (TSA) - NO WORK SHALL BE PERMITTED WITHIN AN ACTIVE TSA IF REQUIRED, ADJUSTMENTS TO THE TAXIWAY TSA DIMENSIONS THROUGH RESTRICTED OPERATIONS SHALL BE COORDINATED WITH THE FAA AIRPORTS REGIONAL OR DISTRICT OFFICE PRIOR TO CONSTRUCTION. ALL OPERATIONS WITHIN THE TSA SHALL BE BACK FILLED OR COVERED PRIOR TO OPENING THE TSA TO PREVENT RUTS, HUMPS, OR DEPRESSIONS INSIDE THE LIMITS OF THE TSA.		PROJECT CONTACT INFORMATION	
D. TAXIWAY OBJECT FREE AREAS (TOFA) - NO CONSTRUCTION SHALL BE PERMITTED INSIDE AN ACTIVE TOFA UNLESS THE TAXIWAY HAS BEEN RESTRICTED TO ONE WAY OPERATION. ALL TAXIWAY OBJECTS SHALL BE REMOVED FROM THE TOFA PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE TAXIWAY CENTERLINE MARKINGS ARE OFFSET WITH CENTERLINE REFLECTORS OR LIGHTING OR APPROPRIATE NOTAMS ARE ISSUED. CONSTRUCTION MAY ALSO BE PERMITTED INSIDE THE TOFA IF A FIVE FOOT WING TIP CLEARANCE IS MAINTAINED FOR ALL CONSTRUCTION EQUIPMENT AND VEHICLES. IN THIS SCENARIO, FLAGGERS AND WING WALKERS MUST BE USED TO DIRECT TRAFFIC THROUGH THE CONSTRUCTION SITE.		PROJECT CONTACT INFORMATION	
E. OBSTACLE FREE ZONE (OFZ) - NO PERSONNEL, MATERIAL, OR EQUIPMENT SHALL PENETRATE THE OFZ WHILE THE RUNWAY IS OPEN TO OPERATIONS. THE DIMENSIONS OF THE OFZ ARE AS DEFINED IN FAA AC 150/5306-13 (www.faa.gov).		PROJECT CONTACT INFORMATION	
F. APPROACH/DEPARTURE SURFACES - ALL CONTRACTOR PERSONNEL, MATERIALS, AND EQUIPMENT SHALL REMAIN CLEAR OF THE APPLICABLE THRESHOLD SITING SURFACES AS DEFINED IN CHAPTER 3 OF FAA AC 150/5300-13 (www.faa.gov). CONSTRUCTION ACTIVITIES THAT REQUIRE PENETRATION INTO THE THRESHOLD SITING SURFACE SHALL BE ACCOMPLISHED THROUGH DISPLACING OR PARTIALLY CLOSING THE RUNWAY. SUCH CONSTRUCTION ACTIVITIES SHALL REQUIRE COORDINATION WITH THE FAA AIRPORT'S REGIONAL OR DISTRICT OFFICE.		PROJECT CONTACT INFORMATION	

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 043 K213 KY26-52

GRAYSON COUNTY

BC53 04

Garver

Garver

Garver

Garver

Garver

Garver

Garver

Garver

One Paragon Center
2525 Haroldsburg Road
Suite 405
Lexington, KY 40504
(606) 219-0559



REV.	DATE	DESCRIPTION	BY

DESIGNED BY: DAKOTA L. GARVER
CHECKED BY: DAKOTA L. GARVER
DATE: 08/2018
SCALE: AS SHOWN


PAPER REPLACEMENT
KENTUCKY DEPARTMENT OF AVIATION
FALLS OF ROUGH STATE PARK AIRPORT
ROUGH RIVER STATE PARK AIRPORT

CONSTRUCTION
SAFETY AND PHASING
PLAN

JOB NO.: 2000131
DATE: MAY 2026
DESIGNED BY: DLE
DRAWN BY: ABC

DRAWING NUMBER
GC101

SHEET
NUMBER
6



LEGEND

PHASE 1 WORK AREA

RSA

ROFA

ACCESS GATE

EQUIPMENT STORAGE

EMPLOYEE PARKING

CONTRACTOR ROUTE

LOW PROFILE

AIRCRAFT BARRICADE

RUNWAY CLOSURE MARKER

PHASE 1 WORK AREA

RSA

ROFA

ACCESS GATE

EQUIPMENT STORAGE

EMPLOYEE PARKING

CONTRACTOR ROUTE

LOW PROFILE


AIRCRAFT BARRICADE

RUNWAY CLOSURE MARKER

ITEMS OF WORK

1

ENSURE NOTAM IS ISSUED, INSTALL SAFETY DEVICES, REMOVE EXISTING PAPER AND CABLEING, INSTALL NEW CABLEING, INSTALL NEW PAPER, PERFORM VAULT WORK, REMOVE SAFETY DEVICES.

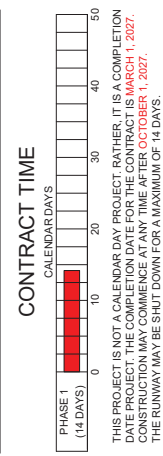

1. PRINT NOTE SHEET SHALL BE PRINTED IN COLOR.
2. SEE CONSTRUCTION SAFETY AND PHASING NOTES FOR ADDITIONAL INFORMATION.
3. LIGHTED BARRICADES SHOWN ARE FOR GRAPHIC PURPOSES ONLY. THE CONTRACTOR SHALL DETERMINE THE QUANTITY OF LIGHTED BARRICADES REQUIRED TO COMPLETE THE WORK AS SHOWN AND MUST BE IN ACCORDANCE WITH CURRENT FAA ADVISORY CIRCULARS.
4. CONTRACTOR SHALL HAVE AN APPROVED PAVEMENT BROOM OR VACUUM TRUCK AVAILABLE ON SITE AT ALL TIMES. HYDRANTS TO FILL VACUUM TRUCK WILL BE AVAILABLE ON AIRPORT PROPERTY.
5. THE CONTRACTOR WILL BE RESPONSIBLE FOR PROVIDING SUFFICIENT LIGHTING TO COMPLETE THE WORK. PORTABLE LIGHTING SHALL NOT BE ORIENTED IN SUCH A WAY TO CAUSE IMPACT TO AIRPORT OPERATIONS.
6. IN NO EVENT SHALL CONSTRUCTION VEHICLES, EQUIPMENT, OR MATERIALS BE PARKED/STORED WITHIN 50' OF BARRICADES OR ACTIVE AIRFIELD PAVEMENT.

2. ALL DELIVERIES, MATERIAL OR OTHERWISE, SHALL BE MADE TO THE DELIVERY ADDRESS OF THE CONTRACTOR'S STAGING AREA. THE NAME, ROAD, RIVER, STATE, PARK, AIRPORT, SHALL NOT BE USED IN THE DELIVERY ADDRESS.
3. THE LOCATION AND SIZE OF THE CONTRACTOR'S STAGING AREA IS SHOWN FOR REFERENCE ONLY. THE EXACT LIMITS OF THE CONTRACTOR'S PARKING AND STAGING AREA FOR MATERIAL, STOCKPILING, OFFICE, TRAILERS, AND DELIVERIES SHALL BE PROPOSED BY THE CONTRACTOR FOR THE APPROVAL OF THE ENGINEER. THE CONTRACTOR STAGING PLANS SHALL BE APPROVED BY THE OWNER PRIOR TO CONSTRUCTION.
4. THE CONTRACTOR SHALL OBTAIN NECESSARY PERMITS TO DEVELOP AND USE THE SITE FOR STAGING AND OTHER ACTIVITIES AS REQUIRED.
5. THE STAGING AREA SHALL BE PREPARED TO A STABLE AND DRAINABLE CONDITION. THE CONTRACTOR MAY HAVE THE OPTION OF ERECTING ADDITIONAL CHAINLINK SECURITY FENCING TO DELINEATE AND PROTECT THE AREA.
6. THE CONTRACTOR MAY DO SOME GRADING AND DRAINAGE WORK TO ADAPT THE AREA TO SPECIFIC NEEDS. UPON COMPLETION OF THE WORK, THE AREA WILL BE GRADED AND DRESSED TO THE SATISFACTION OF THE ENGINEER AND OWNER UPON COMPLETION OF THE CONTRACT WORK.
7. THE CONTRACTOR IS RESPONSIBLE FOR ALL UTILITY CONNECTIONS TO THE STAGING AREA. ALL REQUIRED UTILITIES FOR THE CONTRACTOR'S STAGING AREA SHALL BE COORDINATED WITH THE APPROPRIATE UTILITY AGENCY BY THE CONTRACTOR. THE CONTRACTOR SHALL OBTAIN ANY APPLICABLE METERS AND PERMITS. UTILITY ARRANGEMENTS SHALL BE SUBJECT TO THE APPROVAL OF THE ENGINEER.
8. NO SEPARATE PAY ITEM SHALL BE MADE FOR ANY ITEM REQUIRED FOR THE CONTRACTOR TO ENCLOSE AND DEVELOP THEIR STAGING AREA.
9. THE OWNER SHALL NOT BE RESPONSIBLE FOR ANY LOST OR STOLEN PROPERTY.
10. NO EQUIPMENT OR VEHICLES SHALL BE PARKED WITHIN 10 FEET OF ANY AIRPORT OPERATIONS AREA OR PERIMETER FENCE.

SCALE: NONE



1. ALL CONSTRUCTION EQUIPMENT AND VEHICLES SHALL HAVE A FLAG OR BEACON COMPLYING TO FM SAFETY AND PHASING REGULATIONS.
2. FLAGS AND OR BEACONS WILL BE REQUIRED ON ALL CONSTRUCTION EQUIPMENT AND VEHICLES WITHIN THE AIR OPERATIONS AREA.
3. FOR CONSTRUCTION OPERATIONS FROM AN HOUR BEFORE DUSK TO AN HOUR AFTER DAWN, ALL CONSTRUCTION EQUIPMENT AND VEHICLES WILL BE REQUIRED TO HAVE A YELLOW FLASHING BEACON MOUNTED TO THE TOPMOST PORTION OF THE VEHICLE SO THAT IS VISIBLE FROM ALL DIRECTIONS.
4. THE CONTRACTOR IS RESPONSIBLE FOR SUPPLYING FLAGS AND BEACONS. NO SEPARATE MEASUREMENT OR PAYMENT WILL BE MADE FOR THE SUPPLY OF FLAGS AND BEACONS. THE COMPLETION OF THE PROJECT BY THE CONTRACTOR AT THE COMPLETION OF THE PROJECT.

SCALE: NONE



NOTE:

1. OWNER TO FURNISH RUNWAY CLOSURE MARKERS FOR PROJECT. CONTRACTOR SHALL INSTALL, MAINTAIN, AND REMOVE THE MARKERS AS REQUIRED AND RETURN THE CLOSURE MARKERS TO THE OWNER IN THE CONDITION THEY WERE RECEIVED OR BETTER.
2. OTHERWISE APPROVED BY ENGINEER.
3. CONTRACTOR SHALL FURNISH, INSTALL, AND MAINTAIN WEIGHTED DEVICES TO FIRMLY SECURE THE CLOSURE MARKERS TO THE GROUND. THESE WEIGHTED DEVICES (SAND BAGS) SHALL BE THE SAME COLOR AS THE CLOSURE MARKERS. CONTRACTOR SHALL SUBMIT MATERIAL FOR ANCHORING DEVICES PRIOR TO USE. WHITE TOPSOIL BAGS WILL NOT BE PERMITTED.
4. ALL LABOR AND MATERIAL REQUIRED FOR THE INSTALLATION, RELOCATION, MAINTENANCE, AND REMOVAL SHALL BE CONSIDERED SUBSIDIARY TO SS-120 CONSTRUCTION SAFETY AND SECURITY.
5. THE CONTRACTOR WILL ENSURE ALL REQUIRED NOTAMS AND THE PROPER SAFETY DEVICES ARE PROPERLY INSTALLED BEFORE PERFORMING ANY WORK WITHIN THE AOA.
6. CONTRACTOR IS RESPONSIBLE FOR ENSURING ALL AIRFIELD LIGHTING, BEACON, AND OTHER NAVAIDS ARE SHUT OFF AND THE PILOT CONTROL LIGHTING IS NOT IN OPERATION DURING RUNWAY CLOSURE.



GC201
2

SCALE: NONE

5. INTENDED USE FOR THE FOLLOWING:
 - MARKING/LIGHTING OF TEMPORARY HAZARDS WITHIN THE AOA
 - LONG TERM CLOSURE OF AIRCRAFT ROUTES.
6. INSTALL AT 12" C/S SPACING ALONG FULL WIDTH OF PAVEMENT.
7. BARRICADE SHALL BE EQUIPPED WITH ALTERNATING ORANGE AND WHITE 20"x20" FLAIDS. IN ADDITION TO THE FLAGS, THE BARRICADES SHALL BE EQUIPPED WITH FLASHING RED CAUTION LIGHT.
8. BARRICADES SHALL BE VETER-FILLED AND MODULAR TO ASSEMBLE/DISASSEMBLE AND NEAR FOR COMPACT STORAGE.
9. THE CONTRACTOR SHALL FURNISH, INSTALL, AND MAINTAIN ALL BARRICADES THROUGHOUT THE PROJECT. BARRICADES SHALL BECOME THE PROPERTY OF THE AGENCY AND WILL BE RECALLED AT THE COMPLETION OF CONSTRUCTION.

One Paragon Center
525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(859) 219-0659



STATE PARK AIRPORT
JUCKY

CONSTRUCTION SAFETY DETAILS

OB NO.: 2600131
ATE: MAY 2026
ESIGNED BY: DLE

ORIGINAL DRAWING
0  1"
IF NOT ONE INCH ON THIS SHEET,
ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER

SHEET NUMBER	7
-----------------	---

Garver Engineering & Construction, Inc.

Garver Engineering & Construction, Inc. is an Equal Opportunity Employer. Minorities and women are encouraged to apply. Garver Engineering & Construction, Inc. is an Equal Opportunity Employer. Minorities and women are encouraged to apply.

Garver Engineering & Construction, Inc.
10000 Highway 100, Suite 100
Lexington, KY 40504
(606) 259-0000
www.garver.com

One Paragon Center
2525 Harborsburg Road
Suite 405
Lexington, KY 40504
(606) 219-0659

SYMBOL		ITEM DESCRIPTION
NEW EQUIPMENT		
	EXISTING EQUIPMENT	EXISTING EQUIPMENT TO BE COMPLETELY REMOVED AND REMOVED AREA TO BE RESTORED
	BASE MOUNTED LIGHT	
	STAKE MOUNTED LIGHT	
	JUNCTION STRUCTURE PLAZA, NUMBER AND SIZE OF CANS AS INDICATED	
	L-807 WIND CONE WITH SEGMENTED ORCLE	
	L-880 PRECISION APPROACH PATH INDICATOR (PAPI)	
	L-849A RUNWAY END IDENTIFICATION LIGHT (REIL)	
	3/4" x 10' COPPER CLAD STEEL GROUND ROD	
	SERIES LIGHTING CIRCUIT WITH COUNTERPOISE, NUMBER OF HASH MARKS INDICATES NUMBER OF CABLES	
	ABOVE FINISHED GRADE AIRCRAFT OPERATIONS AREA	
	OBJECT FREE AREA	
	OBSTACLE FREE ZONE	
	RUNWAY SAFETY AREA	
	TAXIWAY SAFETY AREA	
	POINT OF CURVATURE	
	POLYETHYLENE CONDUIT	
	POINT OF TANGENCY	
	DIRECT EARTH BURIED WEATHERPROOF	
	UNLESS OTHERWISE NOTED	

CONSTRUCTION NOTES:

1. THE CONTRACTOR SHALL STAKE THE AIRFIELD LIGHTING SYSTEMS, PRIOR TO INSTALLATION OF ANY TRENCH, CABLE, OR LIGHTING FIXTURES. THE INTERMEDIATE STAKES SHALL BE INSTALLED AT THE LOCATIONS INDICATED, AND THE CONTRACTOR SHALL OBTAIN THE SERVICES OF AN EXPERIENCED AND LICENSED SURVEYOR TO PERFORM THIS WORK.

2. THE ENGINEER WILL PROVIDE ELECTRONIC CAD FILES TO THE CONTRACTOR FOR THIS STAKING WORK. THE CONTRACTOR SHALL STAKE THE ITEMS AND HIS SURVEYOR SHALL PROVIDE A CAD FILE SUBMITTAL BACK TO THE ENGINEER. THE CONTRACTOR SHALL OBTAIN THE SERVICES OF AN EXPERIENCED AND LICENSED SURVEYOR TO PERFORM THIS WORK. ADJUSTMENTS NECESSARY TO MEET EXISTING FIELD CONDITION REQUIREMENTS AND COMPLY WITH FAA ADVISORY CIRCULAR REQUIREMENTS ON THE LAYOUT AND SPACING OF EQUIPMENT.

3. THE CONTRACTOR AND HIS SURVEYOR SHALL THEN MAKE ANY ELECTRONIC CAD FILE SPACING ADJUSTMENTS AND / OR FIELD STAKING ADJUSTMENTS PRIOR TO INSTALLATION AT NO ADDITIONAL COST TO THE OWNER.

4. THE EXISTING AND THE PROPOSED LOCATIONS OF LIGHTING CABLES ARE APPROXIMATE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD LOCATION AND IDENTIFYING THE EXISTING LIGHTING CIRCUITS TO DETERMINE THEIR EXACT ROUTING. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE FOR MAINTAINING THE LIGHTING SYSTEMS IN A WORKING CONDITION UNTIL THE NEW LIGHTING CIRCUITS HAVE BEEN INSTALLED AND TESTED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING THE LIGHTING SYSTEMS IN A WORKING CONDITION UNTIL THE NEW LIGHTING CIRCUITS HAVE BEEN INSTALLED AND TESTED. TO PERFORM ANY MODIFICATIONS TO THE LIGHTING CIRCUITS, COORDINATE IDENTIFICATION WORK WITH THE OWNER AND ENGINEER AND MAKE ALL CORRECTIONS, ADDITIONS, ETC. ON THE AS-BUILT DRAWINGS.

5. THE CONTRACTOR SHALL BE EXTREMELY CAREFUL WHILE EXCAVATING IN THE AREA OF LIGHTING CIRCUITS. ANY EXCAVATION SHALL BE MADE WITH EXTREME CARE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFYING EXISTING LIGHTING CIRCUITS AND THE LENGTH OF CABLE AND CONDUIT. DUCT REPLACEMENT, A SPICE OR CONDUIT / DUCT MARKER SHALL BE INSTALLED AT ALL SPICE OR OTHER REPAIR LOCATIONS MORE THAN 2' AWAY FROM A LIGHT, SIGN, HANDHOLE, MANHOLE, OR JUNCTION STRUCTURE. ALL REPAIR AND / OR REPLACEMENT WORK AND MATERIALS SHALL BE SUPPLIED AND INSTALLED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER AND TO THE SATISFACTION OF THE OWNER AND ENGINEER.

6. FOR NEW L-824C CABLE INSTALLED ON THIS PROJECT, THE BASIS-OF-DESIGN OUTSIDE DIAMETER THAT WAS USED IS 0.415 INCHES. IF THE CONTRACTOR USES L-824C CABLE WITH A LARGER OUTSIDE DIAMETER, ANY CONDUIT OR DUCT BANK INCREASES IN SIZE NECESSARY TO MAINTAIN CABLE FILL CODE COMPLIANCE SHALL BE INSTALLED AND PAID FOR BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER AND TO THE SATISFACTION OF THE OWNER AND ENGINEER. THE CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFYING EXISTING LIGHTING CIRCUITS AND THE LENGTH OF CABLE AND CONDUIT. DUCT REPLACEMENT, A SPICE OR CONDUIT / DUCT MARKER SHALL BE INSTALLED AT ALL SPICE OR OTHER REPAIR LOCATIONS MORE THAN 2' AWAY FROM A LIGHT, SIGN, HANDHOLE, MANHOLE, OR JUNCTION STRUCTURE. ALL REPAIR AND / OR REPLACEMENT WORK AND MATERIALS SHALL BE SUPPLIED AND INSTALLED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER AND TO THE SATISFACTION OF THE OWNER AND ENGINEER.

7. ALL ELECTRICAL CABLES SHALL BE CLEARLY IDENTIFIED, LABELED, AND TAGGED AT ALL POINTS WHERE THEY ARE AVAILABLE FOR CONNECTIONS OR INSPECTION, INCLUDING, BUT NOT LIMITED TO MANHOLES, HANDHOLES, PULL BOXES, JUNCTION BOXES, AND LIGHT BASES.

8. THE CONTRACTOR SHALL PERFORM MEGGER TESTS ON EACH EXISTING SERIES CIRCUIT PRIOR TO ANY WORK ON THE ELECTRICAL SYSTEM AND EACH NEW AND EXISTING SERIES CIRCUIT AFTER THE ACCEPTANCE TEST PERIOD. MEGGER TESTING REQUIREMENTS SHALL BE SUBSIDIARY TO AND PAID FOR BY L-108 PAY ITEMS.

9. THE CONTRACTOR SHALL COORDINATE WITH THE ON-SITE ENGINEER FOR OWNER AND ENGINEER WITNESSES OF ALL MEGGER TESTING. THE CONTRACTOR SHALL SUBMIT HIS INITIAL MEGGER TEST REPORTS TO THE OWNER AND ENGINEER PRIOR TO ANY WORK ON THE ELECTRICAL SYSTEM. THIS REPORT SHALL BE APPROVED AND SIGNED BY THE OWNER AND ENGINEER PRIOR TO THE CONTRACTOR PROCEEDING WITH HIS WORK.

10. LOCKOUT / TAGOUT PROCEDURES SHALL BE PAID FOR BY SS-300 PAY ITEMS UNLESS OTHERWISE NOTED.

11. CONDUITS AND DUCTS UNDER PAVED AREAS SHALL BE CONCRETE ENCASED.

12. CONDUITS AND DUCTS UNDER NON-PAVED AREAS SHALL BE NON-ENCASED, UNLESS OTHERWISE NOTED.

13. DURING CONSTRUCTION, PROTECT ALL EQUIPMENT, DUCTS, CONDUITS, CABLES, ETC. THAT ARE TO REMAIN IN PLACE. WHERE EXISTING ITEMS ARE CUT, BROKEN, OR DAMAGED, THE CONTRACTOR SHALL REPLACE OR REPAIR PROACTIVELY AND EXPEDITIOUSLY THE ITEMS WITH THE SAME TYPE OF ORIGINAL MATERIAL AND CONSTRUCTION OR BETTER AT NO ADDITIONAL COST TO THE OWNER AND TO THE SATISFACTION OF THE OWNER AND ENGINEER.

CAUTION NOTES:

1. UNDERGROUND UTILITIES EXIST WITHIN AND ADJACENT TO THE LIMITS OF CONSTRUCTION. AN ATTEMPT HAS BEEN MADE TO LOCATE THESE UTILITIES ON THE PLANS, HOWEVER, ALL EXISTING UTILITIES MAY NOT BE SHOWN AND THE ACTUAL LOCATIONS OF THE UTILITIES MAY VARY FROM THE PLANS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFYING EXISTING UTILITIES AND CONTACT THE UTILITIES INVOLVED AND MAKE ARRANGEMENTS FOR THE LOCATION OF THE UTILITIES ON THE GROUND. THE CONTRACTOR SHALL MAINTAIN THE UTILITY LOCATION MARKINGS UNTIL THEY ARE NO LONGER NECESSARY.

2. KENTUCKY STATE LAW, THE UNDERGROUND FACILITIES DAMAGE PREVENTION ACT, REQUIRES TWO WORKING DAYS ADVANCE NOTIFICATION THROUGH THE KENTUCKY ONE-CALL SYSTEM CENTER BEFORE EXCAVATING USING MECHANIZED EQUIPMENT OR EXPLOSIVES EXCEPT IN THE CASE OF AN EMERGENCY. THE ONE-CALL SYSTEM PHONE NUMBER IS 1-800-752-6007. THE CONTRACTOR IS ADVISED THAT THERE IS A SEVERE PENALTY FOR NOT MAKING THIS CALL. NOT ALL UTILITY COMPANIES ARE MEMBERS OF THE KENTUCKY ONE-CALL SYSTEM. THEREFORE, THE CONTRACTOR IS ADVISED TO CONTACT ALL NON-MEMBER UTILITIES AS WELL AS THE ONE-CALL SYSTEM.

ELECTRICAL SAFETY NOTES:

1. SERIES CIRCUITS CAN BE DANGEROUS AND / OR FATAL.

2. LOCKOUT / TAGOUT PROCEDURES SHALL BE FOLLOWED.

3. LIGHTING REGULATORS SHALL BE TURNED OFF, LOCKED, AND TAGGED OUT OF SERVICE BEFORE ANY WORK IS DONE ON THE SERIES CIRCUIT.

4. THE ELECTRICAL RESISTANCE AND INSULATION INTEGRITY OF EACH MODIFIED CIRCUIT SHALL BE TESTED BEFORE THE CIRCUIT IS ENERGIZED.

DEMOLITION NOTES:

1. RESTORE THE DEMOLITION WORK AREAS TO MATCH EXISTING CONDITIONS.

2. LOCATE, IDENTIFY, AND PROTECT EXISTING SERVICES PASSING THROUGH DEMOLITION AREAS AND SERVING OTHER AREAS OUTSIDE THE DEMOLITION LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE DEMOLITION LIMITS, WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.

3. MAINTAIN AND PROTECT EXISTING SERVICES WHICH TRANSIT THE AREAS AFFECTED BY SELECTIVE DEMOLITION.

4. MAINTAIN CIRCUIT CONTINUITY TO ALL EXISTING SYSTEM EQUIPMENT, DEVICES, ETC., TO REMAIN IN USE WHETHER NOTED ON THE PLANS OR NOT. FIELD VERIFY EXISTING ITEMS TO REMAIN IN USE. WIRING FOR EXISTING DEVICES WHICH MUST BE RE-ROUTED OR WHICH ARE PARTIALLY ABANDONED, SHALL BE RECONNECTED TO SERVICE THE REMAINING DEVICES ON THE CIRCUIT.

5. THE INTENTION OF THE ELECTRICAL DEMOLITION IS TO DISCONNECT AND REMOVE ALL ELECTRICAL WORK MADE VOID BY THE SCOPE OF THE CONSTRUCTION AND ALTERATION. FIELD VERIFY EXACT MATERIAL QUANTITIES REQUIRED TO BE REMOVED.

6. ALL REMOVED MATERIALS, OTHER THAN REMOVED MATERIALS TO BE RELOCATED, OR TURNED OVER TO THE OWNER, SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE REMOVED FROM THE PROJECT SITE.

7. COORDINATE ALL DEMOLITION WORK WITH ALL OTHER TRADES.

8. ALL EXISTING ELECTRICAL WORK AND ASSOCIATED RACEWAY AND WIRING WHICH HAS BEEN MADE OBSOLETE BY THE WORK AND / OR IS SHOWN DASHED ON THE ELECTRICAL DEMOLITION DRAWINGS, SHALL BE DISCONNECTED AND REMOVED, UNLESS OTHERWISE NOTED. AN ATTEMPT HAS BEEN MADE TO INDICATE ALL OF THIS WORK, BUT TOTAL ACCOUNT IS NOT GUARANTEED.

9. FOR EXISTING ELECTRICAL EQUIPMENT TO BE REMOVED, DEMOLISH ALL EQUIPMENT, DEVICES, CIRCUITS, CONDUITS, BOXES, AND OTHER APPURTENANCES AS REQUIRED FOR A COMPLETE REMOVAL.

10. CUT OFF BOLT PROTRUSIONS, REMOVE ANCHORS, ETC. AT CEILING, FLOOR, OR WALL SURFACES AS REQUIRED. NO SUPPORT ITEMS SHALL BE LEFT IN PLACE.

11. REMOVE, CAP, AND / OR RELOCATE EQUIPMENT, OUTLETS, CONDUIT, WIRE, ETC., WHETHER INDICATED ON THE DRAWINGS OR NOT, AND AS MAY BECOME NECESSARY BECAUSE OF EXISTING FIELD CONDITIONS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN THE ELECTRICAL SYSTEM IN A WORKING CONDITION UNTIL THE DEMOLITION WORK IS COMPLETED. THE CONTRACTOR SHALL BE HELD TO HAVING VISITED THE SITE AND TAKEN ALL EXISTING CONDITIONS INTO CONSIDERATION.

12. WHERE ELECTRICAL EQUIPMENT, CONDUIT, BOXES, AND SUPPORTING HARDWARE ARE REMOVED, PATCH AND FINISH THE SURFACE (WALL AND CEILING) AS REQUIRED TO MATCH THE EXISTING, UNLESS OTHERWISE NOTED.

13. WHERE BURIED CONDUITS EXTENDING OUT OF A CONCRETE SLAB BECOME ABANDONED, CUT AND GRIND THE CONDUITS OFF FLUSH WITH TOP OF SLAB AND PLUG WITH NON-SHRINK WATERPROOF GROUT FILL.

FILE: L:\2026\07-2600131 - 213 PAPI Replacement\Drawings\2600131-EN001.dwg LAST SAVE: 6/22/2026 9:34 AM PLOTTER USED: AutoCAD PDF (General Documentation).pl PLOT DATE: 6/22/2026 11:37 AM LAST PLOTTED BY: AUCURMAN

FILE: L:\2026\07-2600131 - 213 PAPI Replacement\Drawings\2600131-EN001.dwg LAST SAVE: 6/22/2026 9:34 AM PLOTTER USED: AutoCAD PDF (General Documentation).pl PLOT DATE: 6/22/2026 11:37 AM LAST PLOTTED BY: AUCURMAN





Digitally Signed 05/22/2026

ROUGH RIVER STATE PARK AIRPORT
FALLS OF ROUGH, KENTUCKY
PAPI REPLACEMENT

ELECTRICAL
INSTALLATION PLAN 1


OB NO.: 2600131
ATE: MAY 2026
ESIGNED BY: DLE
RAWN BY: ABC

BAR IS ONE INCH ON ORIGINAL DRAWING

0 1" NOT ONE INCH ON THIS SHEET. ADJUST SCALES ACCORDINGLY.

DRAWING NUMBER

EL101

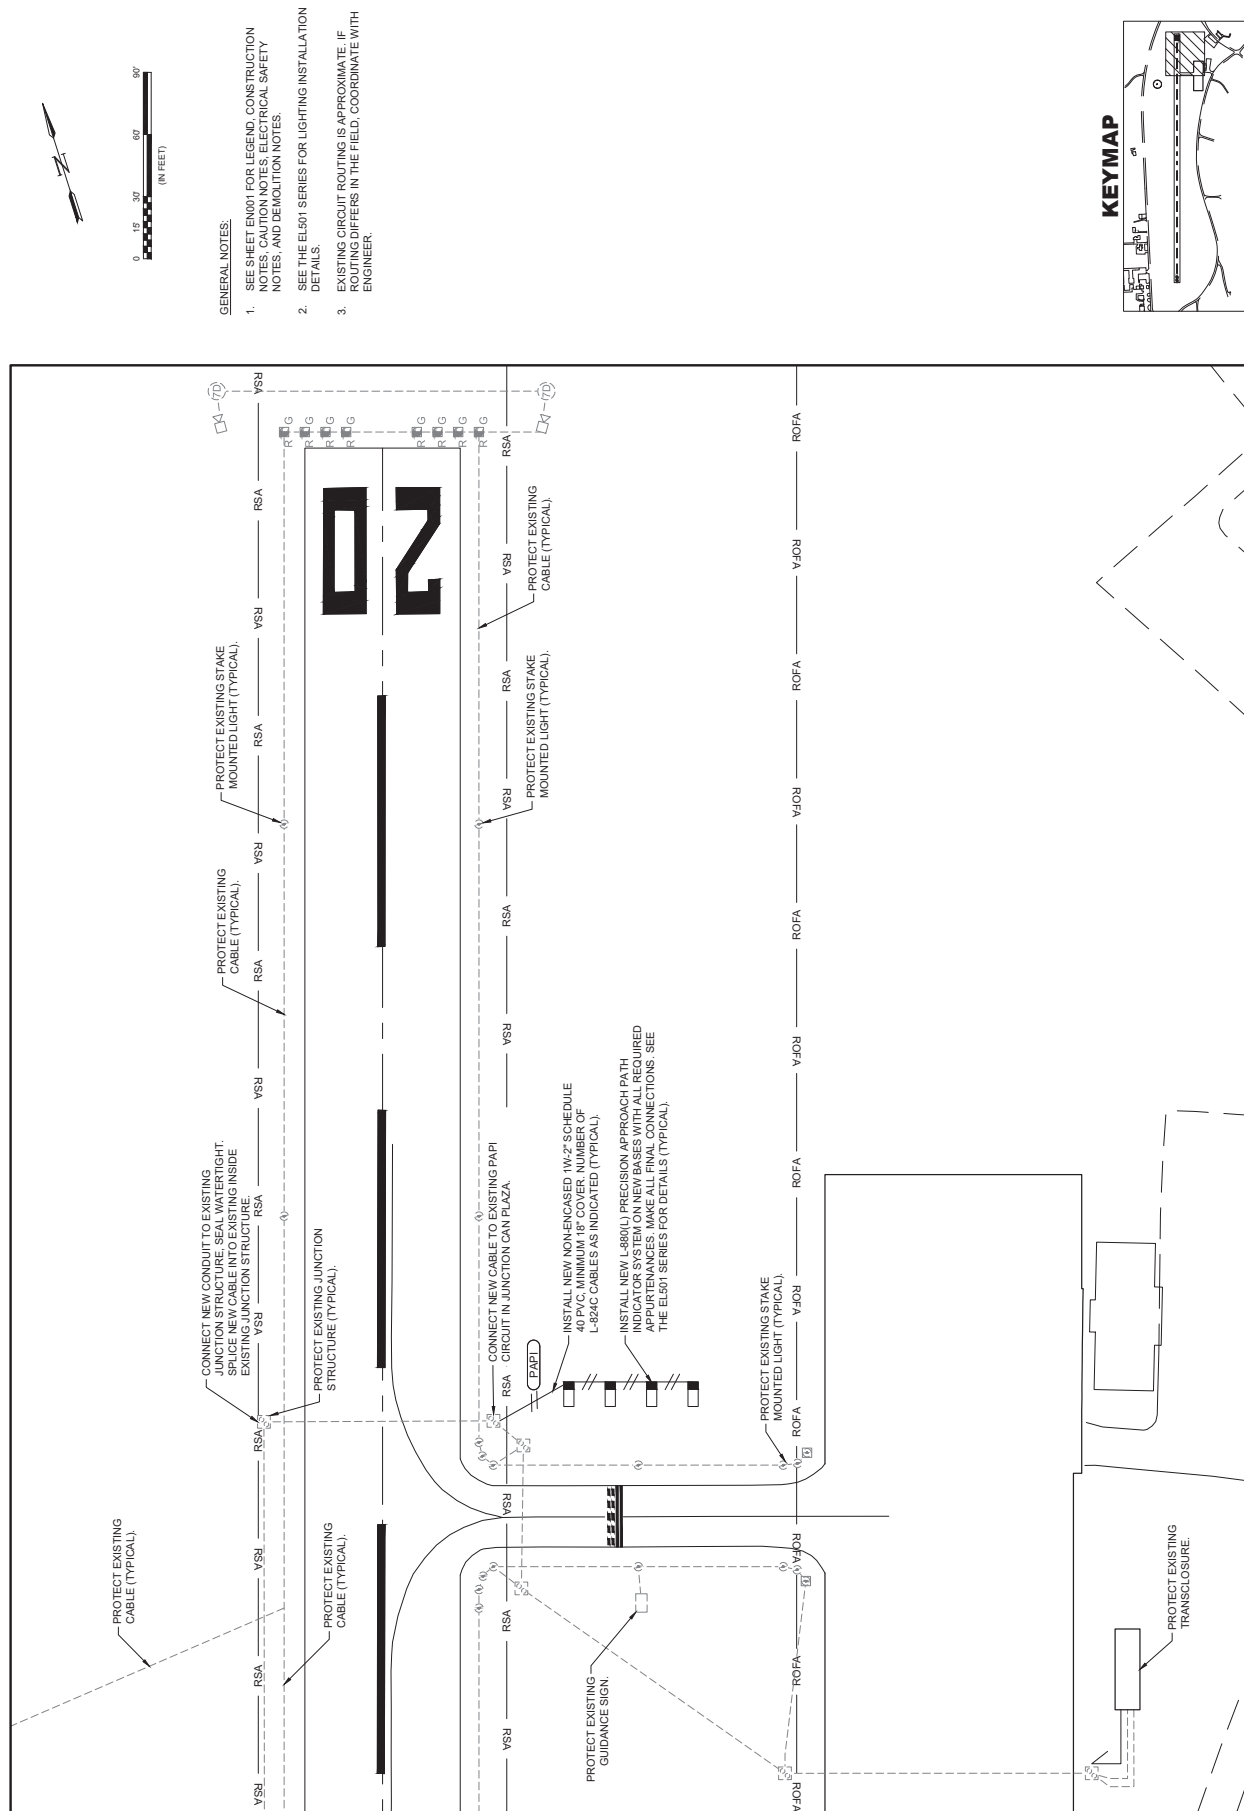

KEYMAP

Garver

Garver Engineering, Inc.

1100 South Main Street, Suite 200
Lexington, KY 40504
(606) 259-0000
www.garver.com

Garver Engineering, Inc.

1100 South Main Street, Suite 200
Lexington, KY 40504
(606) 259-0000
www.garver.com

Garver Engineering, Inc.
1100 South Main Street, Suite 200
Lexington, KY 40504
(606) 259-0000
www.garver.com

One Paragon Center
2525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(606) 219-0659



REV	DATE	DESCRIPTION	BY

KENTUCKY DEPARTMENT OF AVIATION
FALLS OF ROUGH, KENTUCKY
PAPI REPLACEMENT

JOB NO. 7-2000131
DATE: MAY 2026
DESIGNED BY: DLE
DRAWN BY: ABC
DRAWING NUMBER
EL501
SHEET NUMBER 11

1

EL501

TYPICAL GROUND ROD CONNECTION

SCALE: NONE

#6 SOLID BARE SOFT DRAWN COPPER FOR COUNTERPOISE
COPPER FOR EQUIPMENT GROUND

EXOTHERMIC WELDED CONNECTION
(CADWELD OR APPROVED EQUIVALENT)

3/4" X 10'-0" COPPERCLAD STEEL GROUND ROD FOR COUNTERPOISE

3/4" X 10'-0" COPPERCLAD STEEL GROUND ROD FOR LIGHT BASE AND REBAR GROUNDING

1. GROUND RODS SHALL BE INSTALLED NOT MORE THAN 500 FEET APART FOR COUNTERPOISE AND AS SHOWN ON LAYOUT PLAN SHEETS.

2. ONE GROUND ROD SHALL BE INSTALLED AT EACH LIGHT BASE FOR GROUNDING THE LIGHT BASE AND ASSOCIATED STEEL REINFORCEMENT.

2

EL501

NON-ENCASED DUCT BANK

SCALE: NONE

1-WAY

NON-ENCASED NOTES:

1. COUNTERPOISE WIRES SHALL BE INSTALLED ABOVE MULTIPLE CONDUITS / DUCT BANKS FOR AIRFIELD LIGHTING CABLES, WITH THE INTENT BEING TO PROVIDE A COMPLETE CONE OF PROTECTION OVER THE AIRFIELD LIGHTING CABLES.

2. INSTALL 3/4" X 10'-0" COPPERCLAD GROUND RODS AT EACH END OF ELECTRICAL DUCT AND BOND COUNTERPOISES USING EXOTHERMIC WELDS.

3. INSTALL CONDUIT SPACERS WITH LOCKING COLLARS AT 5' O.C. SPACING INTERVALS.


4. INSTALL A COUNTERPOISE 4" ABOVE EACH CONDUIT COLUMN.

5. INSTALL DUCT MARKERS IN ACCORDANCE WITH ADVISORY CIRCULAR 150-5340-30 REQUIREMENTS, INCLUDING AT THE END OF DUCT BANKS.

6. SIMILAR FOR OTHER DUCT SIZES.



1. L-870 BASE SHALL BE LOCATED BEHIND THE UNIT WITHIN REACH OF THE CABLE ASSEMBLY.
2. MANUFACTURER SHALL SUPPLY DIMENSIONS ON SHOP DRAWINGS. CONTRACTOR SHALL VERIFY AND COORDINATE IN ADVANCE PRIOR TO ANY WORK.
3. UTILIZE STAINLESS STEEL MOUNTING HARDWARE ONLY WITH ANTI-SEIZE COMPOUND.
4. COORDINATE EXACT LIGHT BASE AND CONDUIT DRAINING TO THE DESIGN PRIOR TO ANY CONSTRUCTION. CONDUIT PIPING SHALL BE 1/2" DIA. 304 STAINLESS STEEL. INFLUENCE A 1/2" CONDUIT DOWN FROM RUNWAY, INCLUDING A 45 DEGREE DOWN ELBOW INTO MINIMUM 1 CUBIC FOOT OPEN GRADED, DRAINABLE AGGREGATE. TOP OF AGGREGATE MINIMUM 36" BELOW GRADE.
5. SLOPE PAD TO DRAIN AWAY FROM PAPI UNIT AND BASE.
6. BOND LAMP HOUSING AND BOX TO BASE INTERNAL GROUNDING LUG.
7. STEEL VERTICAL AIMING ANGLES ON EACH PAPI UNIT, BLACK NUMERALS 1" MINIMUM HEIGHT.
8. DEDICATED GROUND ROD SHALL NOT BE BONDED TO SEPARATE COUNTERPOISE SYSTEM.
9. VERIFY PAPI FOUNDATION WITH MANUFACTURER MOUNTING REQUIREMENTS PRIOR TO CONSTRUCTION.
10. ALL CONCRETE SHALL HAVE 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI AND SHALL BE PLACED ACCORDING TO THE LATEST EDITIONS OF ACI 301 AND ACI 117.
11. ALL REINFORCING BARS SHALL CONFORM TO ASTM A 615, GRADE 60.
12. ALL CONCRETE SHALL BE AIR-ENTRAINED WITH AN AIR CONTENT OF APPROXIMATELY 5-12 PERCENT AND HAVING A 1/16-INCH NOMINAL MAXIMUM AGGREGATE SIZE.
13. DO NOT ALLOW FLEXIBLE LIQUID-TIGHT CONDUIT TO LAY ON THE GROUND.
14. CAP UNUSED CONDUITS.
15. FOR CURRENT POWERED SYSTEMS, TWO CONDUITS SHALL BE REQUIRED FOR CONNECTING THE LIGHT BASES. ONE FOR POWER AND ONE FOR CONTROL.



1. THE INBOARD LIGHT UNIT MUST NOT BE LESS THAN 50 FEET FROM THE RUNWAY EDGE OR TO OTHER RUNWAYS OR TAXIWAYS.
2. THE PAI LIGHT UNIT MUST HAVE A LATERAL SEPARATION OF 30 FEET FOR L-860 SYSTEMS. NOTE: THE DISTANCE BETWEEN LIGHT UNITS IS MEASURED CENTER TO CENTER.
3. FOR THE L-860, THE DISTANCE BETWEEN LIGHT UNITS MAY NOT VARY BY MORE THAN ± 1 FOOT.
4. EACH LIGHT UNIT MUST BE AIMED OUTWARD INTO THE APPROACH ZONE OF THE INTERSECTING RUNWAY CENTERLINE WITHIN A TOLERANCE OF $\pm 1/2$ DEGREE.
5. THE BEAM CENTERS OF ALL LIGHT UNITS MUST BE WITHIN ± 1 INCH OF A HORIZONTAL PLANE.
6. THE PAI HORIZONTAL PLANE MUST BE WITHIN 1 DEGREE OF THE ELEVATION OF THE INTERSECT POINT OF THE CENTERLINE, THE INTERSECT POINT OF THE VISUAL GUIDE PATH WITH THE RUNWAY.
7. THE FRONT FACE OF EACH LIGHT UNIT IN A BAR MUST BE WITHIN 1 INCH OF THE CENTERLINE OF THE RUNWAY CENTERLINE WITHIN 36 INCHES.



SCALE: NONE

GRAYSON COUNTY

Seal of Grayson County, Kentucky

Garver

Garver Engineering, Inc.

10000 Highway 100, Suite 100
Lexington, KY 40504
(502) 271-0000


One Paragon Center
2525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(502) 219-0659

Seal of the State of Kentucky

DAKOTA L. L. 2025

L-880 PAPI SYSTEM AIMING		
PAPI UNIT	5° VISUAL GLIDE PATH	
1	05° 30'	05.50"
2	05° 10'	05.17"
3	04° 50'	04.83"
4	04° 30'	04.50"

- AIMING NOTES:
- THIS VISUAL GLIDE PATH ANGLE IS THE CENTER OF THE ON-COURSE ZONE AND IS A NORMAL 3 DEGREES WHEN MEASURED FROM THE HORIZONTAL SURFACE OF THE RUNWAY.
 - PAPI OBSTACLE CLEARANCE SURFACE (OCS).
 - THE PAPI OCS PROVIDES THE PILOT WITH A MINIMUM APPROACH CLEARANCE.
 - THE PAPI MUST BE POSITIONED AND AIMED SO NO OBSTACLES PENETRATE ITS SURFACE.
 - PAPI LIGHT SIGNAL CLEARANCE SURFACE (LSCS)
 - THE PAPI LSCS ENSURES THAT OBSTACLES THAT MAY BE PRESENT WHERE THE PAPI LIGHT SIGNAL IS VISIBLE ARE IDENTIFIED AND MITIGATED.
- (1) THE OCS BEGINS 300 FEET IN FRONT OF THE PAPI SYSTEM.
- (2) THE OCS IS PROJECTED INTO THE APPROACH ZONE AT AN ANGLE ONE DEGREE LESS THAN THE AIMING ANGLE OF THE THIRD LIGHT UNIT FROM THE RUNWAY FOR AN L-880 SYSTEM.
- (1) THE LSCS IS PROJECTED INTO THE APPROACH ZONE AT AN ANGLE ONE DEGREE LESS THAN THE AIMING ANGLE OF THE THIRD LIGHT UNIT FROM THE RUNWAY FOR AN L-880 SYSTEM.

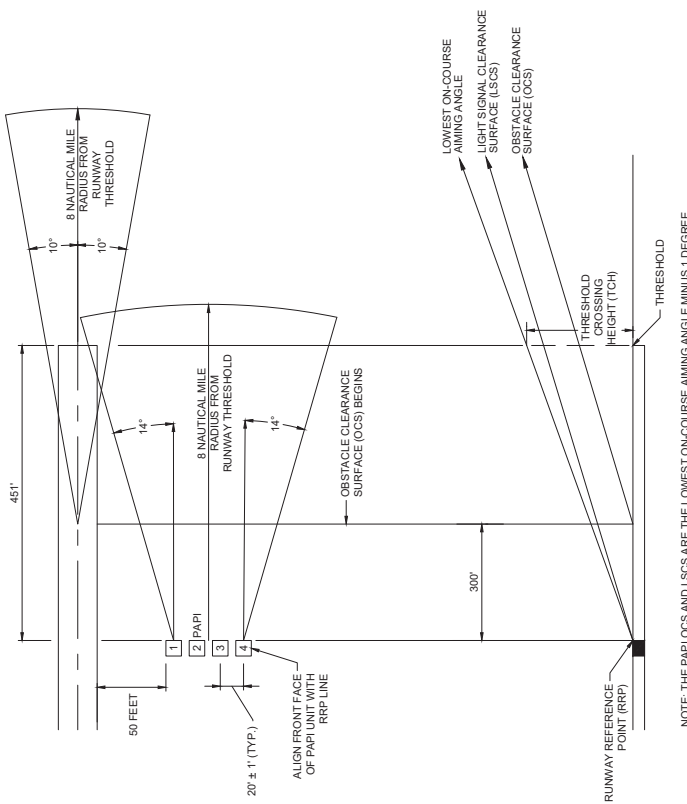

1 L-880 PAPI SYSTEM AIMING DIAGRAM
SCALE: NONE

KENTUCKY DEPARTMENT OF AVIATION
FALLS OF ROUGH, KENTUCKY
PAPI REPLACEMENT

ELECTRICAL DETAILS
4

JOB NO.: 2600131
DATE: MAY 2026
DESIGNED BY: DLE
DRAWN BY: ABC

DRAWING NUMBER
EL504

SHEET NUMBER
14

Garver

Garver Engineering, Inc.
10000 Highway 100, Suite 200
Birmingham, AL 35243
(205) 991-1000
www.garver.com

Garver Engineering, Inc.
10000 Highway 100, Suite 200
Birmingham, AL 35243
(205) 991-1000
www.garver.com


One Paragon Center
2525 Harrodsburg Road
Suite 405
Lexington, KY 40504
(606) 279-0559



REV.	DATE	DESCRIPTION	BY

KENTUCKY DEPARTMENT OF AVIATION
FALLS OF ROUGH, KENTUCKY
PAPI REPLACEMENT
ROUGH RIVER STATE PARK AIRPORT

5	ELECTRICAL DETAILS
JOB NO. 7-2000131	DATE: MAY 2026
DESIGNED BY: DLE	DRAWN BY: ABC
PAPI REPLACEMENT	
DRAWING NUMBER	
SHEET NUMBER	

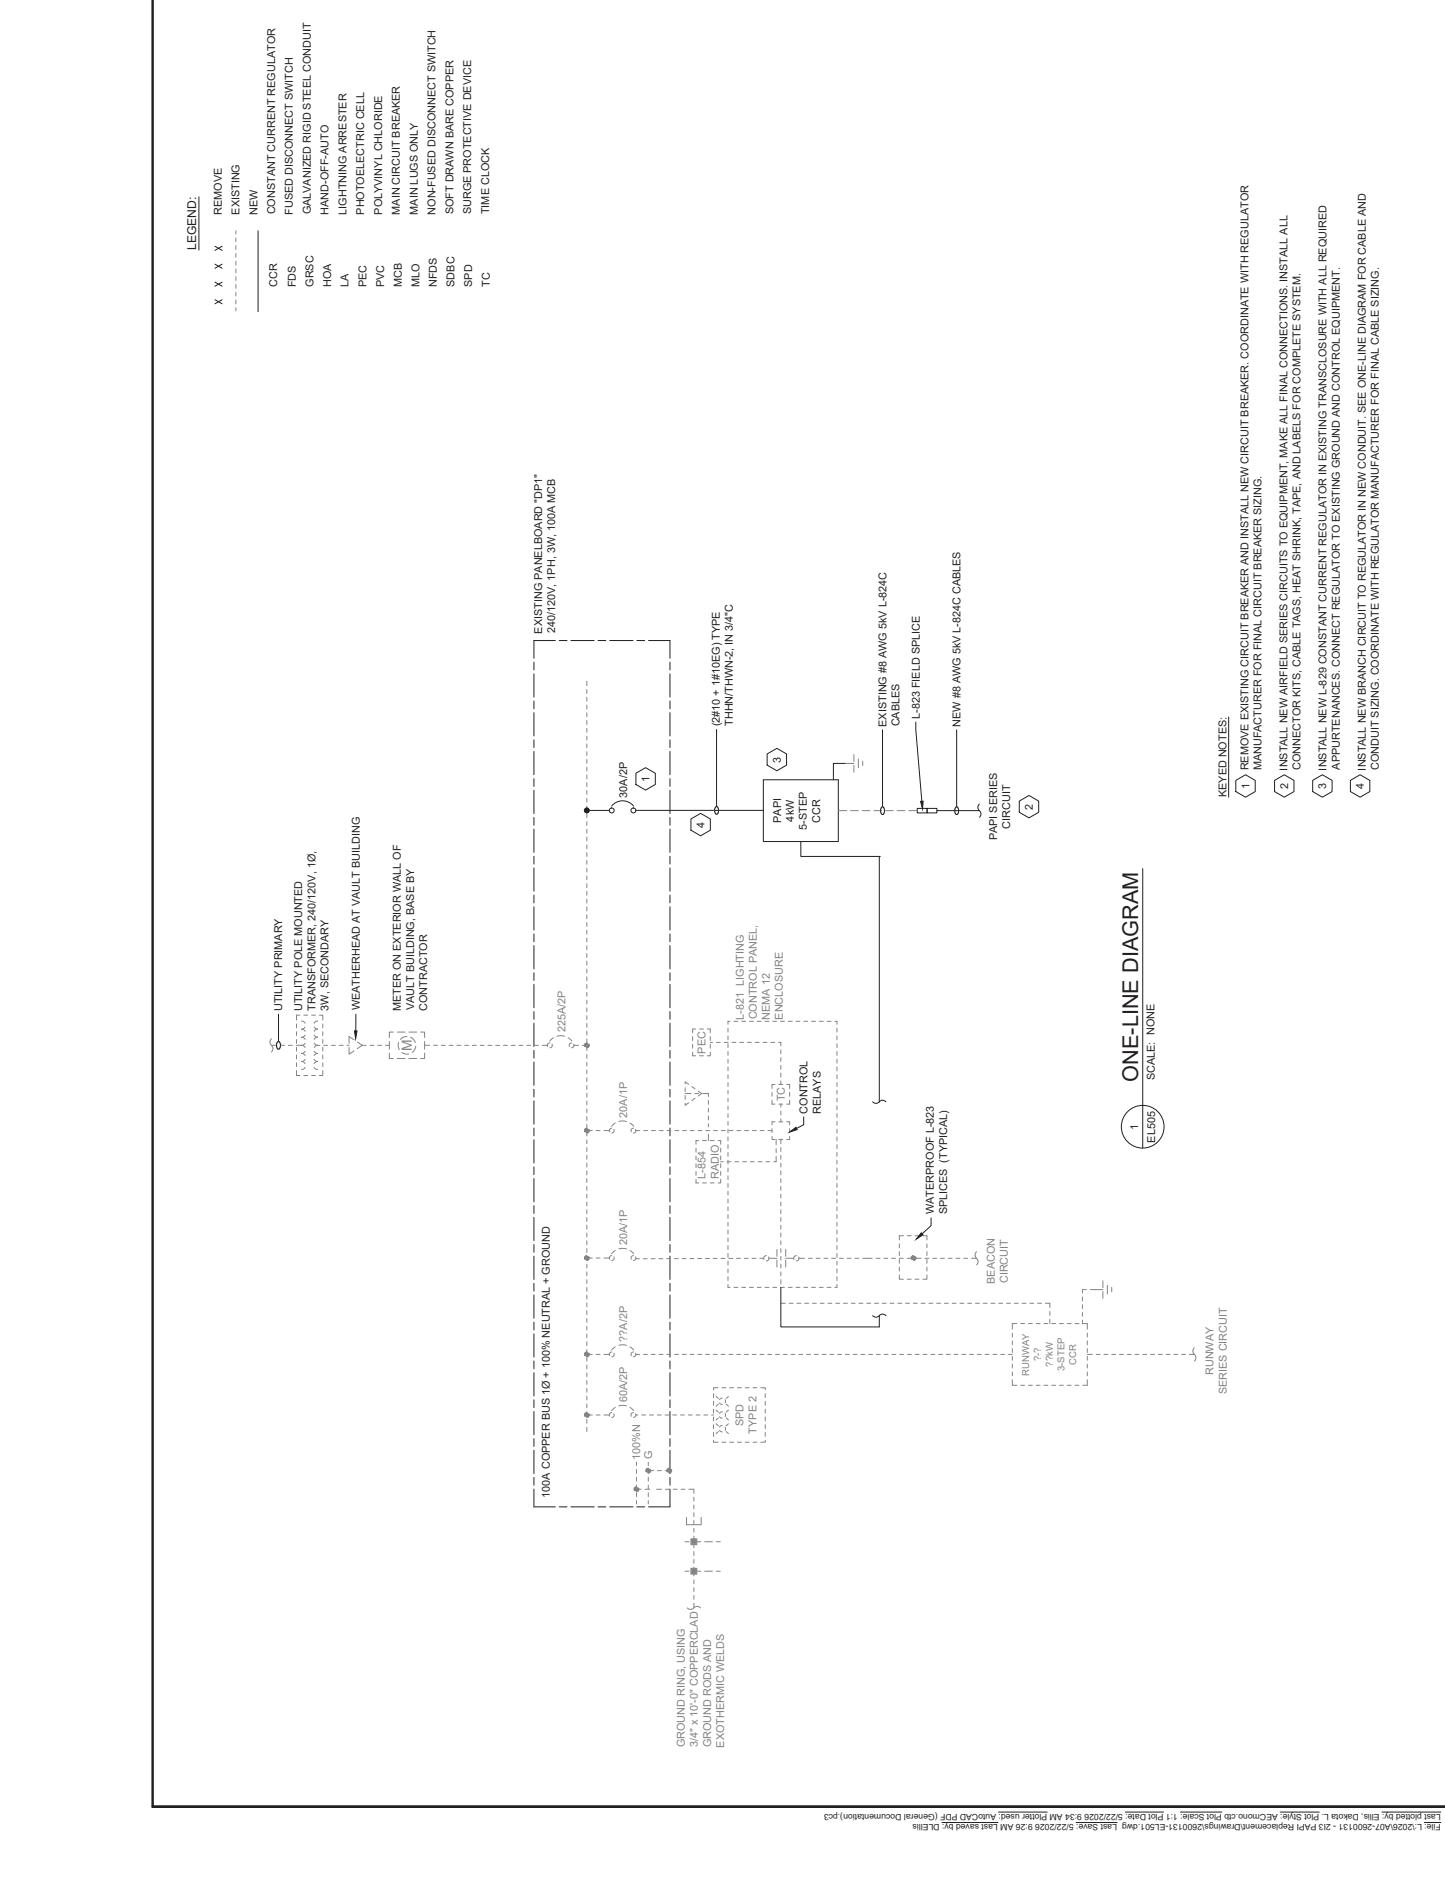

ONE-LINE DIAGRAM

SCALE: NONE

KEYED NOTES:

1

REMOVE EXISTING CIRCUIT BREAKER AND INSTALL NEW CIRCUIT BREAKER. COORDINATE WITH REGULATOR MANUFACTURER FOR FINAL CIRCUIT BREAKER SIZING.

2

INSTALL NEW AIRFIED SERIES CIRCUITS TO EQUIPMENT. MAKE ALL FINAL CONNECTIONS. INSTALL ALL CONNECTOR KITS, CABLE TAPS, HEAT SHRINK, TAPE, AND LABELS FOR COMPLETE SYSTEM.

3

INSTALL NEW L-825 CONSTANT CURRENT REGULATOR IN EXISTING TRANSCLASURE WITH ALL REQUIRED APPURTENANCES. CONNECT REGULATOR TO EXISTING GROUND AND CONTROL EQUIPMENT.

4

INSTALL NEW BRANCH CIRCUIT TO REGULATOR IN NEW CONDUIT. SEE ONE LINE DIAGRAM FOR CABLE AND CONDUIT SIZING. COORDINATE WITH REGULATOR MANUFACTURER FOR FINAL CABLE SIZING.

PART II

SPECIFICATIONS AND STANDARD DRAWINGS

STANDARD SPECIFICATIONS

Any reference in the plans or proposal to previous editions of the *Standard Specifications for Road and Bridge Construction* and *Standard Drawings* are superseded by *Standard Specifications for Road and Bridge Construction, Edition of 2026* and *Standard Drawings, Edition of 2025*.

SUPPLEMENTAL SPECIFICATIONS

The contractor shall use the Supplemental Specifications that are effective at the time of letting. The Supplemental Specifications can be found at the following link:
<http://transportation.ky.gov/Construction/Pages/Kentucky-Standard-Specifications.aspx>

PART III

EMPLOYMENT, WAGE AND RECORD REQUIREMENTS

**TRANSPORTATION CABINET
DEPARTMENT OF HIGHWAYS**

**LABOR AND WAGE REQUIREMENTS
APPLICABLE TO OTHER THAN FEDERAL-AID SYSTEM PROJECTS**

- I. Application
- II. Nondiscrimination of Employees (KRS 344)

I. APPLICATION

1. These contract provisions shall apply to all work performed on the contract by the contractor with his own organization and with the assistance of workmen under his immediate superintendence and to all work performed on the contract by piecework, station work or by subcontract. The contractor's organization shall be construed to include only workmen employed and paid directly by the contractor and equipment owned or rented by him, with or without operators.

2. The contractor shall insert in each of his subcontracts all of the stipulations contained in these Required Provisions and such other stipulations as may be required.

3. A breach of any of the stipulations contained in these Required Provisions may be grounds for termination of the contract.

3. If the contractor is in control of apprenticeship or other training or retraining, including on-the-job training programs, he shall not discriminate against an individual because of his race, color, religion, national origin, sex, disability or age forty (40) and over, in admission to, or employment in any program established to provide apprenticeship or other training.

4. The contractor will send to each labor union or representative of workers with which he has a collective bargaining agreement or other contract or understanding, a notice to be provided advising the said labor union or workers' representative of the contractor's commitments under this section, and shall post copies of the notice in conspicuous places available to employees and applicants for employment. The contractor will take such action with respect to any subcontract or purchase order as the administering agency may direct as a means of enforcing such provisions, including sanctions for non-compliance.

Revised: January 25, 2017

II. NONDISCRIMINATION OF EMPLOYEES

**AN ACT OF THE KENTUCKY
GENERAL ASSEMBLY TO PREVENT
DISCRIMINATION IN EMPLOYMENT
KRS CHAPTER 344
EFFECTIVE JUNE 16, 1972**

The contract on this project, in accordance with KRS Chapter 344, provides that during the performance of this contract, the contractor agrees as follows:

1. The contractor shall not fail or refuse to hire, or shall not discharge any individual, or otherwise discriminate against an individual with respect to his compensation, terms, conditions, or privileges of employment, because of such individual's race, color, religion, national origin, sex, disability or age (forty and above); or limit, segregate, or classify his employees in any way which would deprive or tend to deprive an individual of employment opportunities or otherwise adversely affect his status as an employee, because of such individual's race, color, religion, national origin, sex, disability or age forty (40) and over. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided setting forth the provisions of this nondiscrimination clause.

2. The contractor shall not print or publish or cause to be printed or published a notice or advertisement relating to employment by such an employer or membership in or any classification or referral for employment by the employment agency, indicating any preference, limitation, specification, or discrimination, based on race, color, religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, except that such a notice or advertisement may indicate a preference, limitation, or specification based on religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, when religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, is a bona fide occupational qualification for employment.

EXECUTIVE BRANCH CODE OF ETHICS

The Executive Branch Code of Ethics created by Kentucky Revised Statutes (KRS) Chapter 11A, effective July 14, 1992, establishes the ethical standards that govern the conduct of all executive branch employees. The Executive Branch Code of Ethics, which states, in part:

KRS 11A.040 (7) provides:

A present or former public servant listed in KRS 11A.010(9)(a) to (g) shall not, within one (1) year following termination of his or her office or employment, accept employment, compensation, or other economic benefit from any person or business that contracts or does business with, or is regulated by, the state in matters in which he was directly involved during the last thirty-six (36) months of his tenure. This provision shall not prohibit an individual from returning to the same business, firm, occupation, or profession in which he was involved prior to taking office or beginning his term of employment, or for which he received, prior to his state employment, a professional degree or license, provided that, for a period of one (1) year, he or she personally refrains from working on any matter in which he was directly involved during the last thirty-six (36) months of his or her tenure in state government. This subsection shall not prohibit the performance of ministerial functions, including but not limited to filing tax returns, filing applications for permits or licenses, or filing incorporation papers, nor shall it prohibit the former officer or public servant from receiving public funds disbursed through entitlement programs.

KRS 11A.040 (9) states:

A former public servant shall not represent a person or business before a state agency in a matter in which the former public servant was directly involved during the last thirty-six (36) months of his tenure, for a period of one (1) year after the latter of:

- a) The date of leaving office or termination of employment; or
- b) The date the term of office expires to which the public servant was elected.

This law is intended to promote public confidence in the integrity of state government and to declare as public policy the idea that state employees should view their work as a public trust and not to obtain private benefits.

If you have worked for the executive branch of state government within the past year, you may be subject to the law's prohibitions. The law's applicability may be different if you hold elected office or are contemplating representation of another before a state agency.

Also, if you are affiliated with a firm which does business with the state and which employs former state executive-branch employees, you should be aware that the law may apply to them.

In case of doubt, the law permits you to request an advisory opinion from the Executive Branch Ethics Commission, 1025 Capital Center Drive, Suite 105, Frankfort, Kentucky 40601; telephone (502) 564-7954.

Revised: March 11, 2025

Kentucky Equal Employment Opportunity Act of 1978

The requirements of the Kentucky Equal Employment Opportunity Act of 1978 (KRS 45.560-45.640) shall apply to this Contract. The apparent low Bidder will be required to submit EEO forms to the Division of Construction Procurement, which will then forward to the Finance and Administration Cabinet for review and approval. No award will become effective until all forms are submitted and EEO/CC has certified compliance. The required EEO forms are as follows:

- EEO-1: Employer Information Report
- Affidavit of Intent to Comply
- Employee Data Sheet
- Subcontractor Report

These forms are available on the Finance and Administration's web page under ***Vendor Information, Standard Attachments and General Terms*** at the following address:
<https://www.eProcurement.ky.gov>.

Bidders currently certified as being in compliance by the Finance and Administration Cabinet may submit a copy of their approval letter in lieu of the referenced EEO forms.

For questions or assistance please contact the Finance and Administration Cabinet by email at **finance.contractcompliance@ky.gov** or by phone at 502-564-2874.

EMPLOYEE RIGHTS UNDER THE FAIR LABOR STANDARDS ACT

THE UNITED STATES DEPARTMENT OF LABOR WAGE AND HOUR DIVISION

FEDERAL MINIMUM WAGE

\$7.25 PER HOUR

BEGINNING JULY 24, 2009

- OVERTIME PAY

At least 1½ times your regular rate of pay for all hours worked over 40 in a workweek.
- CHILD LABOR

An employee must be at least **16** years old to work in most non-farm jobs and at least **18** to work in non-farm jobs declared hazardous by the Secretary of Labor.

Youths **14** and **15** years old may work outside school hours in various non-manufacturing, non-mining, non-hazardous jobs under the following conditions:

No more than

 - **3** hours on a school day or **18** hours in a school week;
 - **8** hours on a non-school day or **40** hours in a non-school week.

Also, work may not begin before **7 a.m.** or end after **7 p.m.**, except from June 1 through Labor Day, when evening hours are extended to **9 p.m.** Different rules apply in agricultural employment.
- TIP CREDIT

Employers of “tipped employees” must pay a cash wage of at least \$2.13 per hour if they claim a tip credit against their minimum wage obligation. If an employee’s tips combined with the employer’s cash wage of at least \$2.13 per hour do not equal the minimum hourly wage, the employer must make up the difference. Certain other conditions must also be met.
- ENFORCEMENT

The Department of Labor may recover back wages either administratively or through court action, for the employees that have been underpaid in violation of the law. Violations may result in civil or criminal action.

Employers may be assessed civil money penalties of up to \$1,100 for each willful or repeated violation of the minimum wage or overtime pay provisions of the law and up to \$11,000 for each employee who is the subject of a violation of the Act’s child labor provisions. In addition, a civil money penalty of up to \$50,000 may be assessed for each child labor violation that causes the death or serious injury of any minor employee, and such assessments may be doubled, up to \$100,000, when the violations are determined to be willful or repeated. The law also prohibits discriminating against or discharging workers who file a complaint or participate in any proceeding under the Act.
- ADDITIONAL INFORMATION

- Certain occupations and establishments are exempt from the minimum wage and/or overtime pay provisions.
 - Special provisions apply to workers in American Samoa and the Commonwealth of the Northern Mariana Islands.
 - Some state laws provide greater employee protections; employers must comply with both.
 - The law requires employers to display this poster where employees can readily see it.
 - Employees under 20 years of age may be paid \$4.25 per hour during their first 90 consecutive calendar days of employment with an employer.
 - Certain full-time students, student learners, apprentices, and workers with disabilities may be paid less than the minimum wage under special certificates issued by the Department of Labor.

For additional information:



1-866-4-USWAGE

(1-866-487-9243)

TTY: 1-877-889-5627



WWW.WAGEHOUR.DOL.GOV

PART IV

BID ITEMS

261522

Section: 0001 - LIGHTING

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0010	40000		SITE PREPARATION SAFETY AND SECURITY	1.00	LS		\$	
0020	40003		LOCKOUT-TAGOUT AND CC REGULATOR CAL PRO	1.00	LS		\$	
0030	40054		AWG 5KV CABLE NO.8 L824C-INSTALLED	400.00	LF		\$	
0040	40055		AWG COUNTERPOISE NO.6-INSTALLED	200.00	LF		\$	
0050	40066		ELECTRICAL DEMOLITION REGULATOR REMOVED	1.00	LS		\$	
0060	40118		LIGHTING REGULATOR 4KW CONSTANT CURRENT REGULATOR	1.00	EACH		\$	
0070	40132		PAPI SYSTEM	1.00	EACH		\$	
0080	40150		EX L-880 PAPI SYS-REMOVED	1.00	EACH		\$	
0090	40164		NON-ENC ELEC COND-1W-2-IN C- 18-IN CVER	200.00	LF		\$	
0100	40178		MOBILIZATION FAA FLIGHT CHECK	1.00	LS		\$	

Section: 0002 - DEMOBILIZATION

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0110	02569		DEMOBILIZATION	1.00	LS		\$	