



CALL NO. 310

CONTRACT ID. 221039

OHIO COUNTY

FED/STATE PROJECT NUMBER FD05 092 0062 009-011

DESCRIPTION US-62

WORK TYPE ASPHALT SURFACE WITH GRADE & DRAIN

PRIMARY COMPLETION DATE 6/30/2023

LETTING DATE: July 21,2022

Sealed Bids will be received electronically through the Bid Express bidding service until 10:00 AM EASTERN DAYLIGHT TIME July 21,2022. Bids will be publicly announced at 10:00 AM EASTERN DAYLIGHT TIME.

PLANS AVAILABLE FOR THIS PROJECT.

REQUIRED BID PROPOSAL GUARANTY: Not less than 5% of the total bid.

TABLE OF CONTENTS

PART I	SCOPE OF WORK
	<ul style="list-style-type: none">• PROJECT(S), COMPLETION DATE(S), & LIQUIDATED DAMAGES• CONTRACT NOTES• STATE CONTRACT NOTES• ASPHALT MIXTURE• DGA BASE• DGA BASE FOR SHOULDERS• INCIDENTAL SURFACING• FUEL AND ASPHALT PAY ADJUSTMENT• COMPACTION OPTION A• SPECIAL NOTE(S) APPLICABLE TO PROJECT• PIPELINE INSPECTION• NON-TRACKING TACK COAT• SPRAY APPLIED THERMOPLASTIC PAVEMENT MARKING MATERIALS• RIGHT OF WAY CERTIFICATION• UTILITY IMPACT & RAIL CERTIFICATION NOTES• GENERAL UTILITY NOTES• WATER STANDARD UTILITY BID ITEMS• WATERLINE SPECIFICATIONS• SEWER STANDARD UTILITY BID ITEMS• SEWERLINE SPECS• KPDES STORM WATER PERMIT, BMP AND ENOI
PART II	SPECIFICATIONS AND STANDARD DRAWINGS
	<ul style="list-style-type: none">• SPECIFICATIONS REFERENCE• SUPPLEMENTAL SPECIFICATION• [SN-1I] PORTABLE CHANGEABLE SIGNS• [SN-11M] BARCODE LABEL ON PERMANENT SIGNS• [SN-11N] LONGITUDINAL PAVEMENT JOINT ADHESIVE
PART III	EMPLOYMENT, WAGE AND RECORD REQUIREMENTS
	<ul style="list-style-type: none">• LABOR AND WAGE REQUIREMENTS• EXECUTIVE BRANCH CODE OF ETHICS• KENTUCKY EQUAL EMPLOYMENT OPPORTUNITY ACT OF 1978 LOCALITY / STATE• PROJECT WAGE RATES / STATE FUNDED
PART IV	INSURANCE
PART V	BID ITEMS

PART I
SCOPE OF WORK

ADMINISTRATIVE DISTRICT - 02

CONTRACT ID - 221039

FD05 092 0062 009-011

COUNTY - OHIO

PCN - DE09200622239

FD05 092 0062 009-011

US-62 (MP 9.731) RECONSTRUCTION OF DRAINAGE IMPROVEMENTS, CURB AND GUTTER, AND RESURFACING ON US-62 FROM MP 9.731 TO MP 10.59 IN OHIO COUNTY (MP 10.59), A DISTANCE OF 0.86 MILES.ASPHALT SURFACE WITH GRADE & DRAIN SYP NO. 02-20060.00.

GEOGRAPHIC COORDINATES LATITUDE 37:24:17.00 LONGITUDE 86:52:33.00

ADT

COMPLETION DATE(S):

COMPLETED BY 06/30/2023

APPLIES TO ENTIRE CONTRACT

CONTRACT NOTES

PROPOSAL ADDENDA

All addenda to this proposal must be applied when calculating bid and certified in the bid packet submitted to the Kentucky Department of Highways. Failure to use the correct and most recent addenda may result in the bid being rejected.

BID SUBMITTAL

Bidder must use the Department's electronic bidding software. The Bidder must download the bid file located on the Bid Express website (www.bidx.com) to prepare a bid packet for submission to the Department. The bidder must submit electronically using Bid Express.

JOINT VENTURE BIDDING

Joint venture bidding is permissible. All companies in the joint venture must be prequalified in one of the work types in the Qualifications for Bidders for the project. The bidders must get a vendor ID for the joint venture from the Division of Construction Procurement and register the joint venture as a bidder on the project. Also, the joint venture must obtain a digital ID from Bid Express to submit a bid. A joint bid bond of 5% may be submitted for both companies or each company may submit a separate bond of 5%.

UNDERGROUND FACILITY DAMAGE PROTECTION

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. When prescribed in said directives, the contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom shall be contacted through their individual Protection Notification Center. Non-compliance with these directives can result in the enforcement of penalties.

REGISTRATION WITH THE SECRETARY OF STATE BY A FOREIGN ENTITY

Pursuant to KRS 176.085(1)(b), an agency, department, office, or political subdivision of the Commonwealth of Kentucky shall not award a state contract to a person that is a foreign entity required by [KRS 14A.9-010](#) to obtain a certificate of authority to transact business in the Commonwealth ("certificate") from the Secretary of State under [KRS 14A.9-030](#) unless the person produces the certificate within fourteen (14) days of the bid or proposal opening. If the foreign entity is not required to obtain a certificate as provided in [KRS 14A.9-010](#), the foreign entity should identify the applicable exception. Foreign entity is defined within [KRS 14A.1-070](#).

For all foreign entities required to obtain a certificate of authority to transact business in the Commonwealth, if a copy of the certificate is not received by the contracting agency within the time frame identified above, the foreign entity's solicitation response shall be deemed non-responsive or the awarded contract shall be cancelled.

Businesses can register with the Secretary of State at <https://secure.kentucky.gov/sos/ftbr/welcome.aspx>.

SPECIAL NOTE FOR PROJECT QUESTIONS DURING ADVERTISEMENT

Questions about projects during the advertisement should be submitted in writing to the Division of Construction Procurement. This may be done by fax (502) 564-7299 or email to kytc.projectquestions@ky.gov. The Department will attempt to answer all submitted questions. The Department reserves the right not to answer if the question is not pertinent or does not aid in clarifying the project intent.

The deadline for posting answers will be 3:00 pm Eastern Daylight Time, the day preceding the Letting. Questions may be submitted until this deadline with the understanding that the later a question is submitted, the less likely an answer will be able to be provided.

The questions and answers will be posted for each Letting under the heading "Questions & Answers" on the Construction Procurement website (www.transportation.ky.gov/contract). The answers provided shall be considered part of this Special Note and, in case of a discrepancy, will govern over all other bidding documents.

HARDWOOD REMOVAL RESTRICTIONS

The US Department of Agriculture has imposed a quarantine in Kentucky and several surrounding states, to prevent the spread of an invasive insect, the emerald ash borer. Hardwood cut in conjunction with the project may not be removed from the state. Chipping or burning on site is the preferred method of disposal.

INSTRUCTIONS FOR EXCESS MATERIAL SITES AND BORROW SITES

Identification of excess material sites and borrow sites shall be the responsibility of the Contractor. The Contractor shall be responsible for compliance with all applicable state and federal laws and may wish to consult with the US Fish and Wildlife Service to seek protection under Section 10 of the Endangered Species Act for these activities.

ACCESS TO RECORDS

The contractor, as defined in KRS 45A.030 (9) agrees that the contracting agency, the Finance and Administration Cabinet, the Auditor of Public Accounts, and the Legislative Research Commission, or their duly authorized representatives, shall have access to any books, documents, papers, records, or other evidence, which are directly pertinent to this contract for the purpose of financial audit or program review. Records and other prequalification information confidentially

disclosed as part of the bid process shall not be deemed as directly pertinent to the contract and shall be exempt from disclosure as provided in KRS 61.878(1)(c). The contractor also recognizes that any books, documents, papers, records, or other evidence, received during a financial audit or program review shall be subject to the Kentucky Open Records Act, KRS 61.870 to 61.884.

In the event of a dispute between the contractor and the contracting agency, Attorney General, or the Auditor of Public Accounts over documents that are eligible for production and review, the Finance and Administration Cabinet shall review the dispute and issue a determination, in accordance with Secretary's Order 11-004.

April 30, 2018

SPECIAL NOTE FOR RECIPROCAL PREFERENCE

RECIPROCAL PREFERENCE TO BE GIVEN BY PUBLIC AGENCIES TO RESIDENT BIDDERS

By reference, KRS 45A.490 to 45A.494 are incorporated herein and in compliance regarding the bidders residency. Bidders who want to claim resident bidder status should complete the Affidavit for Claiming Resident Bidder Status along with their bid in the electronic bidding software. Submittal of the Affidavit should be done along the bid in Bid Express.

April 30, 2018

ASPHALT MIXTURE

Unless otherwise noted, the Department estimates the rate of application for all asphalt mixtures to be 110 lbs/sy per inch of depth.

DGA BASE

Unless otherwise noted, the Department estimates the rate of application for DGA Base to be 115 lbs/sy per inch of depth.

DGA BASE FOR SHOULDERS

Unless otherwise noted, the Department estimates the rate of application for DGA Base for Shoulders to be 115 lbs/sy per inch of depth. The Department will not measure necessary grading and/or shaping of existing shoulders prior to placing of DGA Base, but shall be incidental to the Contract unit price per ton for DGA Base.

Accept payment at the Contract unit price per ton as full compensation for all labor, materials, equipment, and incidentals for grading and/or shaping of existing shoulders and furnishing, placing, and compacting the DGA Base.

INCIDENTAL SURFACING

The Department has included in the quantities of asphalt mixtures established in the proposal estimated quantities required for resurfacing or surfacing mailbox turnouts, farm field entrances, residential and commercial entrances, curve widening, ramp gores and tapers, and road and street approaches, as applicable. Pave these areas to the limits as shown on Standard Drawing RPM-110-06 or as directed by the Engineer. In the event signal detectors are present in the intersecting streets or roads, pave the crossroads to the right of way limit or back of the signal detector, whichever is the farthest back of the mainline. Surface or resurface these areas as directed by the Engineer. The Department will not measure placing and compacting for separate payment but shall be incidental to the Contract unit price for the asphalt mixtures.

FUEL AND ASPHALT PAY ADJUSTMENT

The Department has included the Contract items Asphalt Adjustment and Fuel Adjustment for possible future payments at an established Contract unit price of \$1.00. The Department will calculate actual adjustment quantities after work is completed. If existing Contract amount is insufficient to pay all items on the contract with the adjustments, the Department will establish additional monies with a change order.

OPTION A

Be advised that the Department will accept compaction of asphalt mixtures furnished for driving lanes and ramps, at 1 inch (25mm) or greater, on this project according to OPTION A in accordance with Section 402 and Section 403 of the current Standard Specifications. The Department will require joint cores as described in Section 402.03.02 for surface mixtures only. The Department will accept compaction of all other asphalt mixtures according to OPTION B.

Special Note for Modular Concrete Retaining Wall

I. DESCRIPTION

Except as specified herein, perform all work in accordance with the Department's Standard and Supplemental Specifications and Standard and Sepia Drawings, current editions. Article references are to the Standard Specifications. Furnish all equipment, labor, materials, and incidentals for the following work items:

(1) Maintaining and Controlling Traffic; (2) Site preparation; (3) Preparing the design, furnishing the materials, and installing the modular concrete retaining wall to the lines, grades and dimensions shown in this Proposal; and (4) any other work as specified by the Contract.

II. MATERIALS

All materials shall be manufactured in accordance with manufacturer's recommendations and specifications. All materials shall be sampled and tested in accordance with the Department's Sampling Manual and the materials shall be available for sampling a sufficient time in advance of the use of the materials to allow for the necessary time for testing unless otherwise specified in these Notes.

A. Maintain and Control Traffic. See Traffic Control Plan.

B. Erosion Control. See Standard Specifications.

III. CONSTRUCTION METHODS

A. Maintain and Control Traffic. See Traffic Control Plan.

B. Site Preparation. All site preparation shall be as approved or as directed by the Engineer. Be responsible for all site preparation including, but not limited to: clearing and grubbing, staking, excavation, backfill, and removal of obstructions or any other material not covered by other items. Perform all site preparation only as approved or directed by the Engineer.

C. Staking. See Standard Specifications.

D. Modular Block Retaining Wall. Before beginning installation, the Contractor shall furnish to the Engineer drawings prepared by a licensed Professional Engineer in Kentucky for review and approval. The design shall be in accordance with the current editions of the AASHTO LRFD Bridge Design Specifications and the Kentucky Transportation Cabinet Department of Highways Standard Specifications for Road and Bridge Construction. All work shall be performed in accordance with Manufacturer's procedures and recommendations.

E. On-Site Inspection. Each Contractor submitting a bid for this work shall make a thorough inspection of the site prior to submitting his/her bid and shall thoroughly familiarize themselves with the existing conditions so that the work can be expeditiously performed after a contract is awarded. Submission of a bid will be considered evidence of this inspection having been made.

Modular Concrete Retaining Wall
Page 2 of 4

- F. Property Damage.** The Contractor shall be responsible for all damage to public and/or private property resulting from the Contractor's activities. Repair or replace damaged roadway features in like kind materials and design as directed by the Engineer at no additional cost to the Department. Repair or replace damaged private property in like kind materials and design to the satisfaction of the owner and the Engineer at no additional cost to the Department.
- G. Coordination with Utility Companies.** Locate all underground, above ground, and overhead utilities prior to beginning construction. The Contractor shall have the responsibility for contacting and maintaining liaison with all utility companies that have utilities located within the project limits. Do not disturb existing overhead or underground utilities. It is not anticipated that any utility facilities will need to be relocated and/or adjusted; however, in the event that it is discovered that the work does require that utilities be relocated and/or adjusted, the utility companies will work concurrently with the Contractor while relocating their facilities. The Contractor shall be responsible for repairing all utility damage that occurs due to the Contractor's operations.
- H. Right of Way Limits.** The Department has not established exact limits of the Right-of-Way. Unless a consent and release form is obtained from the adjoining property owner, limit work activities to the obvious Right-of-Way and staging areas secured by the Contractor at no additional cost to the Department. In the event that private improvements (i.e. fences, buildings, etc.) encroach upon the Right-of-Way, the contractor shall notify the Engineer and limit work activities in order to NOT disturb the improvements. If they become necessary, the Department will secure consent and releases from property owners through the Engineer. Be responsible for all encroachments onto private lands.
- I. Clean Up, Disposal of Waste.** Clean up the project area as work progresses. Dispose of all removed excess material, debris, and other waste at approved sites off the Right of Way obtained by the Contractor at no additional cost to the Department. See the Special Provision for Waste and Borrow Sites.
- J. Final Dressing, Seeding and Protection.** Grade all disturbed areas to blend with the adjacent roadway features and to provide a suitable seed bed. Apply Class A Final Dressing to all disturbed areas. Sow all disturbed earthen areas with the applicable seed mixture(s) according to Section 212.03.03.
- K. Erosion Control.** See Standard Specifications.
- L. Control.** Perform all work under the absolute control of the Department. Obtain the Engineer's approval of all designs required to be furnished by the Contractor prior to incorporation into the work. The Department reserves the right to have other work performed by other contractors and its own forces, and to permit public utility companies and others to do work during the construction within the limits of, or adjacent to, the project. Conduct operations and cooperate with such other parties so that interference with such other work will be reduced to a minimum. The Department will not honor any claims for money or time extension created by the operations of such other parties.

Should a difference of opinion arise as to the rights of the Contractor and others working within the limits of, or adjacent to, the project, the Engineer will decide as to the respective rights of the various

Modular Concrete Retaining Wall
Page 3 of 4

parties involved in order to assure the completion of the Department’s work in general harmony and in a satisfactory manner, and the Engineer’s decision shall be final and binding upon the Contractor.

IV. GEOTECHNICAL NOTES

- A. The wall shall be designed in accordance with the AASHTO LRFD Bridge Design Specifications, current edition.
- B. Live load surcharges shall be applied in accordance with the AASHTO LRFD Bridge Design Specifications, current edition.
- C. Temporary sheeting, shoring, cofferdams, and/or a dewatering method may be required to facilitate foundation construction.
- D. As noted in Section III, the modular concrete retaining wall supplier shall provide final design calculations for approval. The following parameters shall be utilized for design of the modular concrete retaining wall;

Backfill slope	0°
Unit weight of insitu soil backfill:	120 pcf
Friction angle of insitu soil backfill:	28°
Unit weight of the granular backfill:	110 pcf
Friction angle of granular backfill:	35°
Unit weight of existing foundation soils:	120 pcf
Friction angle of existing foundation soils:	32°

- E. Embedment of the footing must be a minimum of 3.5 feet below the final grade. Solid rock excavation will be required. (1.5’ of the large-block + 2’ leveling pad).
- F. The backfill behind the wall shall consist of non-erodible Granular Embankment under laid with Geotextile Fabric Type IV.
- G. Size the wall footings at the Service Limit State using Factored Nominal Bearing Resistances given below. For checking bearing resistance at Strength and Extreme Limit States, use Resistance Factors of 0.55 and 1.0, respectively, applied to the Nominal Resistances.

Bearing Surface	Factored Nominal Bearing Resistance at Service Limit State	Nominal Bearing Resistance
Existing Soil	5.16 ksf	9.37 ksf

- H. Due to the use of LIDAR survey information and the variability in the rock line the potential for field adjustments should be anticipated.

Modular Concrete Retaining Wall
Page 4 of 4

- I. Rip rap is required at the toe of the retaining wall to minimize the potential for scour. The rip rap shall be placed on a 1:1 slope and shall extend 2 feet above the flowline and for the full length of the wall. The riprap shall be under laid with Geotextile Fabric Type I.
- J. Foundation embankment benches shall be placed in accordance with Standard Drawing RGX-010 along the temporary slope behind the wall and/or as directed by the Engineer.

V. METHOD OF MEASUREMENT

- A. **Maintain and Control Traffic.** See Traffic Control Plan.
- B. **Erosion Control.** See Standard Specifications.
- C. **Staking.** See Standard Specifications.
- D. **Site Preparation.** Other than the bid items listed, site preparation will NOT be measured for payment, but shall be incidental to the project bid items.
- E. **Modular Block Retaining Wall.** The Department will measure the finished in-place area of this item in Linear Feet. Measurement will be made of the exposed face of the wall from the top of the wall to the top of leveling pad for the length of the wall.
- F. **Clean Up, Disposal of Waste, Final Dressing, Seeding and Protection.** The Department will NOT measure for payment the following activities: Clean Up, Disposal of Waste, and Final Dressing. These activities shall be incidental to the project bid items. Seeding and Protection shall be measured according to Section 212.

VI. BASIS OF PAYMENT

- A. **Maintain and Control Traffic.** See Traffic Control Plan.
- B. **Erosion Control.** See Standard Specifications.
- C. **Staking.** See Standard Specifications.
- D. **Modular Concrete Retaining Wall.** The Department will make payment for the completed and accepted quantities under the bid item: Segmental Retaining Wall. Any temporary sheeting, shoring, cofferdams, and/or a dewatering method that may be required to facilitate foundation construction shall be incidental to this bid item. The Department will consider payment full compensation for all work and incidentals necessary to excavate and prepare site/foundation, and install the Modular Block Retaining Wall at the location shown in the proposal or as directed by the Engineer.

SPECIAL NOTE FOR PIPELINE INSPECTION

1.0 DESCRIPTION. The Department will perform visual inspections on all pipe on the project. A video inspection will be required on projects having more than 250 linear feet of storm sewer and/or culvert pipe and on routes with an ADT of greater than 1,000 vehicles. Conduct video inspections on all pipe located under the roadway and 50 percent of the remaining pipe not under the roadway. Storm sewer runs and outfall pipes not under the roadway take precedence over rural entrance pipes. Contractors performing this item of work must be prequalified with the Department in the work type J51 (Video Pipe Inspection and Cleaning). Deflection testing shall be completed using a mandrel in accordance with the procedure outlined below or by physical measurement for pipes greater than 36 inches in diameter. Mandrel testing for deflection must be completed prior to the video inspection testing. Unless otherwise noted, Section references herein are to the Department's Standard Specifications for Road and Bridge Construction, current edition.

2.0 VIDEO INSPECTION. Ensure pipe is clear of water, debris or obstructions. Complete the video inspection and any necessary measurement prior to placing the final surface over any pipe. When paving will not be delayed, take measurements 30 days or more after the completion of earthwork to within 1 foot of the finished subgrade. Notify the Engineer a minimum of 24 hours in advance of inspection and notify the Engineer immediately if distresses or locations of improper installation are logged.

2.1 INSPECTION FOR DEFECTS AND DISTRESSES

A) Begin at the outlet end and proceed through to the inlet at a speed less than or equal to 30 ft/minute. Remove blockages that will prohibit a continuous operation.

B) Document locations of all observed defects and distresses including but not limited to: cracking, spalling, slabbing, exposed reinforcing steel, sags, joint offsets, joint separations, deflections, improper joints/connections, blockages, leaks, rips, tears, buckling, deviation from line and grade, damaged coatings/paved inverts, and other anomalies not consistent with a properly installed pipe.

C) During the video inspection provide a continuous 360 degree pan of every pipe joint.

D) Identify and measure all cracks greater than 0.1" and joint separations greater than 0.5".

E) Video Inspections are conducted from junction to junction which defines a pipe run. A junction is defined as a headwall, drop box inlet, curb box inlet, manhole, buried junction, or other structure that disturbs the continuity of the pipe. Multiple pipe inspections may be conducted from a single set up location, but each pipe run must be on a separate video file and all locations are to be referenced from nearest junction relative to that pipe run.

F) Record and submit all data on the TC 64-765 and TC 64-766 forms.

3.0 MANDREL TESTING. Mandrel testing will be used for deflection testing. For use on Corrugated Metal Pipe, High Density Polyethylene Pipe, and Polyvinyl Chloride Pipe, use a mandrel device with an odd number of legs (9 minimum) having a length not less than the outside diameter of the mandrel. The diameter of the mandrel at any point shall not be less than the diameter specified in Section 3.6. Mandrels can be a fixed size or a variable size.

3.1 Use a proving ring or other method recommended by the mandrel manufacturer to verify mandrel diameter prior to inspection. Provide verification documentation for each size mandrel to the Engineer.

3.2 All deflection measurements are to be based off of the AASHTO Nominal Diameters. Refer to the chart in section 3.6.

3.3 Begin by using a mandrel set to the 5.0% deflection limit. Place the mandrel in the inlet end of the pipe and pull through to the outlet end. If resistance is met prior to completing the entire run, record the maximum distance achieved from the inlet side, then remove the mandrel and continue the inspection from the outlet end of the pipe toward the inlet end. Record the maximum distance achieved from the outlet side.

3.4 If no resistance is met at 5.0% then the inspection is complete. If resistance occurred at 5.0% then repeat 3.1 and 3.2 with the mandrel set to the 10.0% deflection limit. If the deflection of entire pipe run cannot be verified with the mandrel then immediately notify the Engineer.

3.5 Care must be taken when using a mandrel in all pipe material types and lining/coating scenarios. Pipe damaged during the mandrel inspection will be video inspected to determine the extent of the damage. If the damaged pipe was video inspected prior to mandrel inspection then a new video inspection is warranted and supersedes the first video inspection. Immediately notify the Engineer of any damages incurred during the mandrel inspection and submit a revised video inspection report.

3.6 AASHTO Nominal Diameters and Maximum Deflection Limits.

Base Pipe Diameter (inches)	AASHTO Nominal Diameter (inches)	Max. Deflection Limit (inches)	
		5.0%	10.0%
15	14.76	14.02	13.28
18	17.72	16.83	15.95
24	23.62	22.44	21.26
30	29.53	28.05	26.58
36	35.43	33.66	31.89
42	41.34	39.27	37.21
48	47.24	44.88	42.52
54	53.15	50.49	47.84
60	59.06	56.11	53.15

4.0 PHYSICAL MEASUREMENT OF PIPE DEFLECTION. Alternate method for deflection testing when there is available access or the pipe is greater than 36 inches in diameter, as per 4.1. Use a contact or non-contact distance instrument. A leveling device is recommended for establishing or verifying vertical and horizontal control.

4.1 Physical measurements may be taken after installation and compared to the AASHTO Nominal Diameter of the pipe as per Section 3.6. When this method is used, determine the smallest interior diameter of the pipe as measured through the center point of the pipe (D2). All measurements are to be taken from the inside crest of the corrugation. Take the D2 measurements at the most deflected portion of the pipe run in question and at intervals no greater than ten (10) feet through the run. Calculate the deflection as follows:

$$\% \text{ Deflection} = [(AASHTO \text{ Nominal Diameter} - D2) / AASHTO \text{ Nominal Diameter}] \times 100\%$$

Note: The Engineer may require that preset monitoring points be established in the culvert prior to backfilling. For these points the pre-installation measured diameter (D1) is measured and recorded. Deflection may then be calculated from the following formula:

$$\% \text{ Deflection} = [(D1 - D2) / D1] (100\%)$$

4.2 Record and submit all data.

5.0 DEDUCTION SCHEDULE. All pipe deductions shall be handled in accordance with the tables shown below.

FLEXIBLE PIPE DEFLECTION	
Amount of Deflection (%)	Payment
0.0 to 5.0	100% of the Unit Bid Price
5.1 to 9.9	50% of the Unit Bid Price ⁽¹⁾
10 or greater	Remove and Replace ⁽²⁾

⁽¹⁾ Provide Structural Analysis for HDPE and metal pipe. Based on the structural analysis, pipe may be allowed to remain in place at the reduced unit price. ⁽²⁾ The Department may allow the pipe to remain in place with no pay to the Contractor in instances where it is in the best interest to the public and where the structural analysis demonstrates that the pipe should function adequately.

RIGID PIPE REMEDIATION TABLE PIPE	
Crack Width (inches)	Payment
≤ 0.1	100% of the Unit Bid Price
Greater than 0.1	Remediate or Replace ⁽¹⁾

(1) Provide the Department in writing a method for repairing the observed cracking. Do not begin work until the method has been approved.

6.0 PAYMENT. The Department will measure the quantity in linear feet of pipe to inspect. The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
24814EC	Pipeline Inspection	Linear Foot
10065NS	Pipe Deflection Deduction	Dollars

SPECIAL NOTE FOR NON-TRACKING TACK COAT

1. DESCRIPTION AND USEAGE. This specification covers the requirements and practices for applying a non-tracking tack asphalt coating. Place this material on the existing pavement course, prior to placement of a new asphalt pavement layer. Use when expedited paving is necessary or when asphalt tracking would negatively impact the surrounding area. This material is not suitable for other uses. Ensure material can “break” within 15 minutes under conditions listed in 3.2.

2. MATERIALS, EQUIPMENT, AND PERSONNEL.

2.1 Non-Tracking Tack. Provide material conforming to Subsection 2.1.1.

2.1.1 Provide a tack conforming to the following material requirements:

Property	Specification	Test Procedure
Viscosity, SFS, 77 ° F	20 – 100	AASHTO T 72
Sieve, %	0.3 max.	AASHTO T 59
Asphalt Residue ¹ , %	50 min.	AASHTO T 59
Oil Distillate, %	1.0 max.	AASHTO T 59
Residue Penetration, 77 ° F	0 - 30	AASHTO T 49
Original Dynamic Shear (G*/sin δ), 82 ° C	1.0 min.	AASHTO T 315
Softening Point, ° F	149 min.	AASHTO T 53
Solubility, %	97.5 min.	AASHTO T 44

¹ Bring sample to 212 °F over a 10-15 minute period. Maintain 212 °F for 15-20 minutes or until 30-40 mL of water has distilled. Continue distillation as specified in T59.

2.2. Equipment. Provide a distributor truck capable of heating, circulating, and spraying the tack between 170 °F and 180 °F. Do not exceed 180 °F. Circulate the material while heating. Provide the correct nozzles that is recommend by the producer to ensure proper coverage of tack is obtained. Ensure the bar can be raised to between 14” and 18” from the roadway.

2.3. Personnel. Ensure the tack supplier has provided training to the contractor on the installation procedures for this product. Make a technical representative from the supplier available at the request of the Engineer.

3. CONSTRUCTION.

3.1 Surface Preparation. Prior to the application of the non-tracking tack, ensure the pavement surface is thoroughly dry and free from dust or any other debris that would inhibit adhesion. Clean the surface by scraping, sweeping, and the use of compressed air. Ensure this preparation process occurs shortly before application to prevent the return of debris on to the pavement. If rain is expected within one hour after application, do not apply material. Apply material only when the surface is dry, and no precipitation is expected.

- 3.2 Non-tracking Tack Application. Placement of non-tracking tack is not permitted from October 1st to May 15th. When applying material, ensure the roadway temperature is a minimum of 40°F and rising. Prior to application, demonstrate competence in applying the tack according to this note to the satisfaction of the Engineer. Heat the tack in the distributor to between 170 – 180 °F. After the initial heating, between 170 – 180 °F, the material may be sprayed between 165 °F and 180 °F. Do not apply outside this temperature range. Apply material at a minimum rate of 0.70 pounds (0.08 gallons) per square yard. Ensure full coverage of the material on the pavement surface. Full coverage of this material is critical. Increase material application rate if needed to achieve full coverage. Schedule the work so that, at the end of the day's production, all non-tracking tack is covered with the asphalt mixture. If for some reason the non-tracking tack cannot be covered by an asphalt mixture, ensure the non-tracking tack material is clean and reapply the non-tracking tack prior to placing the asphalt mixture. Do not heat material more than twice in one day.
- 3.3 Non-tracking Tack Certification. Furnish the tack certification to the Engineer stating the material conforms to all requirements herein prior to use.
- 3.4 Sampling and Testing. The Department will require a sample of non-tracking tack be taken from the distributor at a rate of one sample per 15,000 tons of mix. Take two 1 gallon samples of the heated material and forward the sample to the Division of Materials for testing within 7 days. Ensure the product temperature is between 170 and 180 °F at the time of sampling.
4. MEASUREMENT. The Department will measure the quantity of non-tracking tack in tons. The Department will not measure for payment any extra materials, labor, methods, equipment, or construction techniques used to satisfy the requirements of this note. The Department will not measure for payment any trial applications of non-tracking tack, the cleaning of the pavement surface, or furnishing and placing the non-tracking tack. The Department will consider all such items incidental to the non-tracking tack.
5. PAYMENT. The Department will pay for the non-tracking tack at the Contract unit bid price and apply an adjustment for each manufacturer's lot of material based on the degree of compliance as defined in the following schedule. Non-tracking tack will not be permitted for use from October 1st to May 15th. During this timeframe, the department will allow the use of an approved asphalt emulsion in lieu of a non-tracking tack product but will not adjust the unit bid price of the material. When a sample fails on two or more tests, the Department may add the deductions, but the total deduction will not exceed 100 percent.

Non-Tracking Tack Price Adjustment Schedule						
Test	Specification	100% Pay	90% Pay	80% Pay	50% Pay	0% Pay
Viscosity, SFS, 77 ° F	20 – 100	19 - 102	17 - 18	15 - 16	14	≤13
			103 - 105	106 - 107	108 - 109	≥ 110
Sieve, %	0.30 max.	≤ 0.40	0.41 - 0.50	0.51 - 0.60	0.61 - 0.70	≥ 0.71
Asphalt Residue, %	50 min.	≥49.0	48.5 – 48.9	48.0 – 48.4	47.5-47.9	≤ 47.4
Oil Distillate, %	1.0 max.	≤1.0	1.1-1.5	1.6 - 1.7	1.8-1.9	>2.0
Residue Penetration, 77 ° F.	30 max.	≤ 31	32 - 33	34 - 35	36 - 37	≥ 38
Original Dynamic Shear (G*/sin δ), 82 ° C	1.0 min.	≥0.95	0.92 – 0.94	0.90 – 0.91	0.85 - 0.89	≤ 0.84
Softening Point, ° F	149 min.	≥145	142 - 144	140 - 141	138 - 139	≤ 137
Solubility, %	97.5 min.	≥ 97.0	96.8 – 96.9	96.6 – 96.7	96.4 – 96.5	≤ 96.3

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
24970EC	Asphalt Material for Tack Non-Tracking	Ton

Revised: May 23, 2022

SPECIAL NOTE FOR SPRAY APPLIED THERMOPLASTIC PAVEMENT MARKING MATERIALS

I. DESCRIPTION

Except as provided herein, all work shall be performed in accordance with the Department’s Standard Specifications, Interim Supplemental Specifications, applicable Standard and Sepia Drawings, applicable Special Provisions and Special Notes, current editions. Article references are to the Standard Specifications. This project shall consist of furnishing all labor, equipment, materials and incidentals for the following:

- (1) Spray applied thermoplastic pavement marking materials with reflectorized glass beads for permanent applications

II. MATERIALS

- A. **DROP ON BEADS.** Use beads that will ensure the pavement marking material will meet retroreflectivity requirements. The Department will evaluate the beads as part of the marking system through retroreflectivity readings.
- B. **APPROVAL.** Select materials that conform to the composition and physical characteristic requirements below when evaluated in accordance with AASHTO T-250 or other test methods as cited. The Department will sample and evaluate for approval each lot of thermoplastic material delivered for use per contract prior to installation of the thermoplastic material. Do not allow the installation of thermoplastic material until it has been approved by the Division of Materials. Allow the Department a minimum of 10 working days to evaluate and approve thermoplastic material from the date sampled.
- C. **Composition.** Use a maleic-modified glycerol ester resin (alkyd binder) to formulate the thermoplastic material. Ensure the pigment, pre-mix beads, and filler are uniformly dispersed in the resin. Use material that is free from all dirt and foreign material. Provide independent analysis data and certification for each formulation stating the total concentration of each heavy metal present, the test method used for each determination, and compliance to 40 CFR 261 for leachable heavy metals content.

COMPOSITION		
(Percentage by Weight)		
Component	White	Yellow
Binder, ⁽¹⁾	26.0 min.	26.0 min.
Glass Beads (Premixed)	30 - 40	30 - 40
Titanium Dioxide (Rutile, Type II)	10.0 min.	—
Calcium Carbonate & Inert Fillers ⁽²⁾	42.0 max.	50.0 max.
Heavy Metals Content	Comply with 40 CFR 261	Comply with 40 CFR 261

⁽¹⁾Use a binder that consists of a mixture of synthetic resins, at least one being solid at room temperature, and high boiling point plasticizers. Ensure that at least one-third of the binder composition is solid maleic-modified glycerol ester resin and is not less than 8 percent by weight of the entire material formulation. Do not use alkyd binder that contains petroleum based hydrocarbon resins.

⁽²⁾The manufacturer may choose the amount of calcium carbonate and inert fillers, providing all other requirements of this section are met.

Spray Applied Thermoplastic
 Page 2 of 3

D. Physical Characteristics. For thermoplastic material heated for 4 hours at 425°F under agitation, conform to the following requirements.

a) **Color.** As determined with a spectrophotometer using D65 illuminant with a 45 degree entrance angle and 0 degree observation angle geometry.

CIELAB Color Coordinates		
	Yellow	White
Daytime Color (CIELAB) Spectrophotometer using illuminant D65 at 45° illumination and 0° viewing with a 2° observer	L* 81.76 a* 19.79 b* 89.89 Maximum allowable variation 6.0ΔE*	L* 93.51 a* -1.01 b* 0.70 Maximum allowable variation 6.0ΔE*
Nighttime Color (CIELAB) Spectrophotometer using illuminant A at 45° illumination and 0° viewing with a 2° observer	L* 86.90 a* 24.80 b* 95.45 Maximum allowable variation 6.0ΔE*	L* 93.45 a* -0.79 b* 0.43 Maximum allowable variation 6.0ΔE*

b) **Set Time.** Use material that, when applied at a temperature range of 375 ± 25 °F and thickness of 60 ± 10 mils, sets to bear traffic in not more than 2 minutes when the air and road surface temperature is approximately ≥ 50 ± 3 °F, and not more than 10 minutes when the air and road surface temperature is approximately < 50 ± 3 °F.

c) **Softening Point.** Ensure that the thermoplastic material has a softening point of 180 ± 15 °F.

d) **Bond Strength.** Ensure that the bond strength of the thermoplastic material to concrete exceeds 180 psi.

e) **Cracking Resistance at Low Temperature.** Ensure that the thermoplastic material shows no cracks when observed from a distance exceeding one foot.

f) **Impact Resistance.** Ensure the impact resistance of the thermoplastic material is a minimum of 50 inch-pounds.

g) **Flash Point.** Use thermoplastic material that has a flash point not less than 475 °F.

E. PACKAGING. Package thermoplastic material in suitable 50 pound containers to which the material shall not adhere during shipment or storage. Include a label stating that the thermoplastic material is to be maintained with a temperature range of 350 – 400°F during application. Provide the thermoplastic material in granular form.

F. SHELF LIFE. Ensure that the thermoplastic material conforms to this section for a period of one year. Replace any thermoplastic material not conforming to the above requirements.

G. MANUFACTURER’S TESTING. Perform testing in accordance with AASHTO T-250 on a minimum of one composite sample per 10,000 pounds, or portion thereof, per lot of thermoplastic produced.

H. CERTIFICATION. Submit manufacturer’s certification stating conformance to the requirements of this section for each lot of extruded thermoplastic delivered for use on projects. Clearly state the manufacture, formulation identification, product name, color, date of manufacturer, total quantity of lot produced, actual quantity of thermoplastic material represented, sampling method utilized to obtain the samples, and required manufacturer’s testing data for each composite sample tested to represent each lot produced.

III. CONSTRUCTION METHODS

- A. **SURFACE PREPARATION.** The contractor will be required to sweep all pavement surfaces prior to striping and maintain the cleaning operation far enough in advance of the striping operation to prevent any dust from the cleaning operation from mixing with the paint. The sweeper must maintain contact with the roadway. When the Engineer determines abnormal amounts of debris or other material have accumulated beyond the capability of the required sweeping unit which will require shoveling or other means to remove, the Engineer will make arrangements, prior to painting, to have the material removed by the Department.
- B. **INSTALLATION.** Install thermoplastic materials in accordance with Section 714, Durable Pavement Striping, and the following exceptions:
 - Install the thermoplastic materials at a minimum thickness of 60 mils.
 - Ensure the material temperature is maintained between 350 and 400°F.
 - Do not allow the material temperature to exceed 400°F.
 - Removal of existing stripe on asphalt surfaces is not required.
- C. **RETROREFLECTIVITY.** The Department will evaluate installed markings in accordance with Section 714.03.06, Proving Period for Durable Markings.

IV. METHOD OF MEASUREMENT

- A. **ACCEPTANCE AND PAYMENT.** The Department will accept spray applied thermoplastic materials based on compliance of the manufacturer’s certification and conformance of test results obtained by the Department to the requirements of this special note.

Contrary to Section 714.03.08, Acceptance of Non-Specification Thermoplastic Markings, the Department will not accept non-specification compliant markings. Remove non-specification compliant markings by water blasting. The Department will perform random thickness tests on applied markings to determine compliance to thickness requirements

IV. BASIS OF PAYMENT

The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
24995EC	PAVE STRIPING-SPRAY THERMO-6 IN W	LF
24996EC	PAVE STRIPING-SPRAY THERMO-6 IN Y	LF

The Department will consider payment as full compensation for furnishing all labor, materials, equipment, and incidentals required to construct spray applied thermoplastic pavement markings.



KENTUCKY TRANSPORTATION CABINET
Department of Highways
DIVISION OF RIGHT OF WAY & UTILITIES

TC 62-226
Rev. 01/2016
Page 1 of 1

RIGHT OF WAY CERTIFICATION

<input checked="" type="checkbox"/>	Original	<input type="checkbox"/>	Re-Certification	RIGHT OF WAY CERTIFICATION
-------------------------------------	-----------------	--------------------------	-------------------------	-----------------------------------

ITEM #	COUNTY	PROJECT # (STATE)	PROJECT # (FEDERAL)
2-20060	Ohio	FD05 092 0062 009-011	N/A

PROJECT DESCRIPTION

Reconstruction of drainage, curb and gutter, and resurfacing on US 62 in Beaver Dam between MP 9.731 and MP 10.59.

No Additional Right of Way Required

Construction will be within the limits of the existing right of way. The right of way was acquired in accordance to FHWA regulations under the Uniform Relocation Assistance and Real Property Acquisitions Policy Act of 1970, as amended. No additional right of way or relocation assistance were required for this project.

Condition # 1 (Additional Right of Way Required and Cleared)

All necessary right of way, including control of access rights when applicable, have been acquired including legal and physical possession. Trial or appeal of cases may be pending in court but legal possession has been obtained. There may be some improvements remaining on the right-of-way, but all occupants have vacated the lands and improvements, and KYTC has physical possession and the rights to remove, salvage, or demolish all improvements and enter on all land. Just Compensation has been paid or deposited with the court. All relocations have been relocated to decent, safe, and sanitary housing or that KYTC has made available to displaced persons adequate replacement housing in accordance with the provisions of the current FHWA directive.

Condition # 2 (Additional Right of Way Required with Exception)

The right of way has not been fully acquired, the right to occupy and to use all rights-of-way required for the proper execution of the project has been acquired. Some parcels may be pending in court and on other parcels full legal possession has not been obtained, but right of entry has been obtained, the occupants of all lands and improvements have vacated, and KYTC has physical possession and right to remove, salvage, or demolish all improvements. Just Compensation has been paid or deposited with the court for most parcels. Just Compensation for all pending parcels will be paid or deposited with the court prior to AWARD of construction contract

Condition # 3 (Additional Right of Way Required with Exception)

The acquisition or right of occupancy and use of a few remaining parcels are not complete and/or some parcels still have occupants. All remaining occupants have had replacement housing made available to them in accordance with 49 CFR 24.204. KYTC is hereby requesting authorization to advertise this project for bids and to proceed with bid letting even though the necessary right of way will not be fully acquired, and/or some occupants will not be relocated, and/or the just compensation will not be paid or deposited with the court for some parcels until after bid letting. KYTC will fully meet all the requirements outlined in 23 CFR 635.309(c)(3) and 49 CFR 24.102(j) and will expedite completion of all acquisitions, relocations, and full payments after bid letting and prior to AWARD of the construction contract or force account construction.

Total Number of Parcels on Project	EXCEPTION (S) Parcel #	ANTICIPATED DATE OF POSSESSION WITH EXPLANATION
Number of Parcels That Have Been Acquired		
Signed Deed		
Condemnation		
Signed ROE		

Notes/ Comments (Text is limited. Use additional sheet if necessary.)

LPA RW Project Manager		Right of Way Supervisor	
Printed Name		Printed Name	
Signature		Signature	
Date		Date	
Right of Way Director		FHWA	
Printed Name		Printed Name	
Signature		Signature	
Date		Date	

UTILITIES AND RAIL CERTIFICATION NOTE

Ohio County
No federal number available
FD05 092 0062 009-011
Mile point: 9.731 TO 10.590
Reconstruction of drainage improvements, curb and gutter, and resurfacing US 62 MP 9.731 to MP 10.59 in Ohio County. (2020BOP)
ITEM NUMBER: 02-20060.00

PROJECT NOTES ON UTILITIES

The contractor should be aware that there is UTILITY WORK INCLUDED IN THIS ROAD CONSTRUCTION CONTRACT. The Contractor shall review the GENERAL UTILITY NOTES AND INSTRUCTIONS which may include KYTC Utility Bid Item Descriptions, utility owner supplied specifications, plans, list of utility owner preapproved subcontractors, and other instructions. Utility contractors may be added via addendum if KYTC is instructed to do so by the utility owner. Potential contractors must seek prequalification from the utility owner. Any revisions must be sent from the utility owner to KYTC a minimum of one week prior to bid opening.

For all projects under 2000 Linear feet which require a normal excavation locate request pursuant to KRS 367.4901-4917, the awarded contractor shall field mark the proposed excavation or construction boundaries of the project (also called white lining) using the procedure set forth in KRS 367.4909(9)(k). For all projects over 2000 linear feet, which are defined as a "Large Project" in KRS 367.4903(18), the awarded contractor shall initially mark the first 2000 linear feet minimally of proposed excavation or construction boundaries of the project to be worked using the procedure set forth in KRS 367.4909(9)(k). This temporary field locating of the project excavation boundary shall take place prior to submitting an excavation location request to the underground utility protection Kentucky Contact Center. For large projects, the awarded contractor shall work with the impacted utilities to determine when additional white lining of the remainder of the project site will take place. This provision shall not alter or relieve the awarded contractor from complying with requirements of KRS 367.4905 to 367.4917 in their entirety.

Please Note: The information presented in this Utility Note is informational in nature and the information contained herein is not guaranteed.

The contractor will be responsible for contacting all utility facility owners on the subject project to coordinate his activities. The contractor will coordinate his activities to minimize and, where possible, avoid conflicts with utility facilities. Due to the nature of the work proposed, it is unlikely to conflict with the existing utilities beyond minor facility adjustments. Where conflicts with utility facilities are unavoidable, the contractor will coordinate any necessary relocation work with the facility owner and Resident Engineer. The Kentucky Transportation Cabinet maintains the right to remove or alter portions of this contract if a utility conflict occurs. The utility facilities as noted have been determined using data

UTILITIES AND RAIL CERTIFICATION NOTE

Ohio County
No federal number available
FD05 092 0062 009-011
Mile point: 9.731 TO 10.590
Reconstruction of drainage improvements, curb and gutter, and resurfacing US 62 MP 9.731 to MP
10.59 in Ohio County. (2020BOP)
ITEM NUMBER: 02-20060.00

garnered by varied means and with varying degrees of accuracy: from the facility owners, a result of S.U.E., field inspections, and/or reviews of record drawings. The facilities defined may not be inclusive of all utilities in the project scope and are not Level A quality, unless specified as such. It is the contractor's responsibility to verify all utilities and their respective locations before excavating.

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. The contractor is instructed to contact KY 811 for the location of existing underground utilities. Contact shall be made a minimum of two (2) and no more than ten (10) business days prior to excavation. The contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY 811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom are to be contacted through their individual Protection Notification Center. It may be necessary for the contractor to contact the County Court Clerk to determine what utility companies have facilities in the area. Non-compliance with these directives can result in the enforcement of penalties.

NOTE: DO NOT DISTURB THE FOLLOWING FACILITIES LOCATED WITHIN THE PROJECT DISTURB LIMITS

City of Beaver Dam Municipal Water & Sewer System – Water and Sanitary Sewer

In addition to the six-inch facility located along the western side of Main Street that is being relocated as a part of the Cabinet's Highway Contract, the City has a six-inch facility located along the eastern side of Main Street, extending from approximately East 3rd Street north to approximately East 5th Street, where it separates from Main Street in an easterly direction. There is a water facility crossing Main Street at approximately East 5th Street, and also at approximately East 3rd Street. The contractor should also anticipate water facility to be located along the adjacent side streets intersecting Main Street.

There is also an existing eight-inch gravity sewer facility located within the right-of-way of 1st Street. It is expected that the depth of this facility results in the facility not being in conflict with the project.

UTILITIES AND RAIL CERTIFICATION NOTE

<p style="text-align: center;">Ohio County No federal number available FD05 092 0062 009-011 Mile point: 9.731 TO 10.590 Reconstruction of drainage improvements, curb and gutter, and resurfacing US 62 MP 9.731 to MP 10.59 in Ohio County. (2020BOP) ITEM NUMBER: 02-20060.00</p>
--

AT&T – Communication

While the Company has numerous facilities within the project area, it appears that the majority of those facilities are aerial and attached to the Kentucky Utilities Company pole route, which KU has determined to not require relocation. However, AT&T has identified an underground facility located along the southern side of West 4th Street and extending along the western side of Main Street to East 3rd Street, where it crosses Main Street, and continues along the southern side of East 3rd Street. The facility is not identified to require relocation. However, the Company has agreed that the Cabinet's Contractor can place a concrete "cap" over the facility's crossing of Main Street, at approximately East 3rd Street, as protection for the facility during highway construction. Preliminary identification of the facility indicates it is a 900-pair air-pressurized copper cable. **Consequently, extreme care should be exercised in the vicinity of the facility, to the extent that HAND-WORK MAY BE REQUIRED.**

Ohio County Regional Wastewater District – Sewer

The Company's facility is an eighteen-inch force main presently located, and shown on the plans, in the intersection of 1st Street and Main Street, a section of which is included for relocation in the Cabinet's Highway contract.

Atmos Energy Corporation - Natural Gas

The Company has identified a section of main located along the eastern side of Main Street, extending from approximately East 3rd Street north to approximately East 5th Street, where it separates from Main Street in an easterly direction. The Company is currently evaluating the necessity of relocating this facility, and has yet to make a final determination.

Kentucky Utilities -- Electric Distribution

The Company has reviewed the plans and does not anticipate the necessity to relocate their facilities. There is some concern at the location of the proposed retaining wall (located along the east side of Main Street, beginning at approximately East 4th Street and extending north approximately 230 feet); however, it is expected that coordination with the local KU personnel will be required.

UTILITIES AND RAIL CERTIFICATION NOTE

<p style="text-align: center;">Ohio County No federal number available FD05 092 0062 009-011 Mile point: 9.731 TO 10.590 Reconstruction of drainage improvements, curb and gutter, and resurfacing US 62 MP 9.731 to MP 10.59 in Ohio County. (2020BOP) ITEM NUMBER: 02-20060.00</p>
--

Charter Communications Holdings, LLC dba Spectrum - CATV

The Company has reviewed the project plans and currently has both coax and fiber optic cable in the area; however, both facilities are aerial, and attached to the power company pole route. Since the power company has determined that their facility does not require relocation, this facility is not expected to require relocation.

The Contractor is fully responsible for protection of all utilities listed above

THE FOLLOWING FACILITY OWNERS ARE RELOCATING/ADJUSTING THEIR FACILITIES WITHIN THE PROJECT LIMITS AND WILL BE COMPLETE PRIOR TO CONSTRUCTION

Not Applicable

THE FOLLOWING FACILITY OWNERS HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE OWNER OR THEIR SUBCONTRACTOR AND IS TO BE COORDINATED WITH THE ROAD CONTRACT

ATMOS Energy

The Company currently has a facility along the east side of Main Street extending north from approximately East 4th Street, through the intersection with East 5th Street, and continuing northeasterly, as Main Street turns in a more northwesterly direction. There are extensions from the main in an easterly direction along both East 4th and East 5th Streets. The Company is currently continuing to evaluate the necessity to relocate the facility, or if it can remain in place as the roadway construction occurs.

UTILITIES AND RAIL CERTIFICATION NOTE

<p style="text-align: center;">Ohio County No federal number available FD05 092 0062 009-011 Mile point: 9.731 TO 10.590 Reconstruction of drainage improvements, curb and gutter, and resurfacing US 62 MP 9.731 to MP 10.59 in Ohio County. (2020BOP) ITEM NUMBER: 02-20060.00</p>
--

THE FOLLOWING FACILITY OWNERS HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE ROAD CONTRACTOR AS INCLUDED IN THIS CONTRACT

City of Beaver Dam Municipal Water and Sewer System – Water facility

The six-inch facility located along the western side of Main Street from approximately West 3rd Street to approximately 250 feet north of East 5th Street. This facility will be relocated to a greater depth to account for the proposed roadway construction.

Ohio County Regional Wastewater District – Force Main facility

The eighteen-inch force main presently located, and shown on the plans, in the intersection of 1st Street and Main Street will be relocated adjacent to the existing; however, at a greater depth to account for the proposed roadway construction. The relocation of this facility will require the use of by-pass pumping to maintain the removal of the waste products being moved to the treatment facility.

RAIL COMPANIES HAVE FACILITIES IN CONJUNCTION WITH THIS PROJECT AS NOTED

No Rail Involvement **Rail Involved** **Rail Adjacent**

UTILITIES AND RAIL CERTIFICATION NOTE

Ohio County
No federal number available
FD05 092 0062 009-011
Mile point: 9.731 TO 10.590
Reconstruction of drainage improvements, curb and gutter, and resurfacing US 62 MP 9.731 to MP 10.59 in Ohio County. (2020BOP)
ITEM NUMBER: 02-20060.00

AREA FACILITY OWNER CONTACT LIST

Facility Owner	Address	Contact Name	Phone	Email
AT&T - Communication	1340 E John Rowan Blvd. Bardstown KY 40004	Scott Roche	5023484528	sr8832@att.com
Atmos Energy Corporation - Natural Gas	3275 Highland Pointe Drive Owensboro KY 42303	Silas Bohlen	2706858020	Silas.Bohlen@atmosenergy.com
Charter Communications Holdings, LLC dba Spectrum - CATV	1900 N Fares Evansville IN 47711	John Wade	8122532767	John.Wade@charter.com
City of Beaver Dam Municipal Water & Sewer System - Water	309 West 2nd Street Beaver Dam KY 42320	Larry Carter	2702747106	lwcarterjr@yahoo.com
Kentucky Utilities - Electric Distribution	195 Hubert Reid Drive, Earlington KY 42410	Hunter Gipson	2703836000	Hunter.Gipson@lge-ku.com
Ohio County Regional Wastewater District - Sewer	234 Miller Road Beaver Dam KY 42320	Kevin Bradley	2702984292	kevin.bradley@ocrwd.com

GENERAL UTILITY NOTES AND INSTRUCTIONS APPLICABLE TO ALL UTILITY WORK MADE A PART OF THE ROAD CONSTRUCTION CONTRACT

The contractor should be aware the following utility notes and KYTC Utility Bid Item Descriptions shall supersede, replace and take precedence over any and all conflicting information that may be contained in utility owner supplied specifications contained in the contract, on plans supplied by the utility owner, or any utility owner specifications or information externally referenced in this contract.

Where information may have been omitted from these notes, bid item descriptions, utility owner supplied specifications or plans; the KYTC Standard Specifications for Road and Bridge Construction shall be referenced.

PROTECTION OF EXISTING UTILITIES

The existing utilities shown on the plans are shown as best known at the time the plans were developed and are to be used as a guide only by the Contractor. The Contractor shall use all means at his disposal to accurately locate all existing utilities, whether shown on the plans or not, prior to excavation. The contractor shall protect these utilities during construction. Any damage to existing utilities during construction that are shown or not shown on the plans shall be repaired at the Contractor's expense.

PREQUALIFIED UTILITY CONTRACTORS

Some utility owners may require contractors that perform relocation work on their respective facilities as a part of the road contract be prequalified or preapproved by the utility owner. **Utility contractors may be added via addendum if KYTC is instructed to do so by the utility owner. Potential contractors must seek prequalification from the utility owner. Any revisions must be sent from the utility owner to KYTC a minimum of one week prior to bid opening.** Those utility owners with a prequalification or preapproval requirement are as follows:

“No contractors are required to be prequalified or preapproved by the utility owner(s) to perform utility relocation work under this contract.”

The bidding contractor needs to review the above list and choose from the list of approved subcontractors at the end of these general notes as identified above before bidding. When the list of approved subcontractors is provided, only subcontractors shown on the following list(s) will be allowed to work on that utility as a part of this contract.

When the list of approved subcontractors for the utility work is not provided in these general notes, the utility work can be completed by the prime contractor. If the prime contractor chooses to subcontract the work, the subcontractor shall be prequalified with the KYTC Division of Construction Procurement in the work type of “Utilities” (I33). Those who would like to become prequalified may contact the Division of Construction Procurement at (502) 564-3500. Please note: it could take up to 30 calendar days for prequalification to be approved. The prequalification does not have to be approved prior to the bid, but must be approved before the subcontract will be approved by KYTC and the work can be performed.

CONTRACT ADMINISTRATION RELATIVE TO UTILITY WORK

All utility work is being performed as a part of a contract administered by KYTC; there is not a direct contract between the utility contractor and utility owner. The KYTC Section Engineer is ultimately responsible for the administration of the road contract and any utility work included in the contract.

SUBMITTALS AND CORRESPONDENCE

All submittals and correspondence of any kind relative to utility work included in the road contract shall be directed to the KYTC Section Engineer, a copy of which may also be supplied to the utility owner by the contractor to expedite handling of items like material approvals and shop drawings. All approvals and correspondence generated by the utility owner shall be directed to the KYTC Section Engineer. The KYTC Section Engineer will relay any approvals or correspondence to the utility contractor as appropriate. At no time shall any direct communication between the utility owner and utility contractor without the communication flowing through the KYTC Section Engineer be considered official and binding under the contract.

ENGINEER

Where the word “Engineer” appears in any utility owner specifications included in this proposal, utility owner specifications included as a part of this contract by reference or on the utility relocation plans, it shall be understood the “Engineer” is the Kentucky Transportation Cabinet (KYTC) Section Engineer or designated representative and the utility owner engineer or designated representative jointly. Both engineers must mutually agree upon all decisions made with regard to the utility construction. The Transportation Cabinet, Section Engineer shall make all final decisions in all disputes.

INSPECTOR OR RESIDENT PROJECT REPRESENTATIVE

Where the word “Inspector” or “Resident Project Representative” appears in the utility specifications included in this proposal, utility owner specifications included as a part of this contract by reference or on the utility relocation plans, it shall be understood the “Inspector” or “Resident Project Representative” is the utility owner inspector and KYTC inspector jointly. The Transportation Cabinet, Section Engineer shall make all final decisions in all disputes.

NOTICE TO UTILITY OWNERS OF THE START OF WORK

One month before construction is to start on a utility, the utility contractor shall make notice to the KYTC Section Engineer and the utility owner of when work on a utility is anticipated to start. The utility contractor shall again make confirmation notice to the KYTC Section Engineer and the utility owner one week before utility work is to actually start.

UTILITY SHUTDOWNS

The Contractor shall not shut down any active and in-service mains, utility lines or services for any reason unless specifically given permission to do so by the utility owner. The opening and closing of valves and operating of other active utility facilities for main, utility line or utility service shut downs are to be performed by the utility owner unless specific permission is given to the contractor by the owner to make shutdowns. If and when the utility owner gives the contractor permission to shutdown mains, utility lines or utility services, the contractor shall do so following the rules, procedures and regulations of the utility owner. Any permission given by the utility owner to the contractor to shutdown active and in-service mains, utility lines or services shall be communicated to the KYTC Section Engineer by the utility owner that such permission has been given.

Notice to customers of utility shut downs is sometimes required to be performed by the utility contractor. The contractor may be required; but, is not limited to, making notice to utility customers in a certain minimum amount of time in advance of the shut down and by whatever means of communication specified by the utility owner. The means of communication to the customer may be; but is not limited to, a door hanger, notice by newspaper ad, telephone contact, or any combination of communication methods deemed necessary, customary and appropriate by the utility owner. The contractor should refer to the utility owner specifications for requirements on customer notice.

Any procedure the utility owner may require the contractor to perform by specification or plan note and any expense the contractor may incur to comply with the utility owner’s shut down procedure and notice to customers shall be considered an incidental expense to the utility construction.

CUSTOMER SERVICE AND LATERAL ABANDONMENTS When temporary or permanent abandonment of customer water, gas, or sewer services or laterals are necessary during relocation of utilities included in the contract, the utility contractor shall perform these abandonments as part of the contract as incidental work. No separate payment will be made for service line and lateral abandonments. The contractor shall provide all labor, equipment and materials to accomplish the temporary or permanent abandonment in accordance with the plans, specifications and/or as directed by the engineer. Abandonment may include, but is not limited to, digging down on a water or gas main at the tap to turn off the tap valve

or corporation stop and/or capping or plugging the tap, digging down on a sewer tap at the main and plugging or capping the tap, digging down on a service line or lateral at a location shown on the plans or agreeable to the engineer and capping or plugging, or performing any other work necessary to abandon the service or lateral to satisfactorily accomplish the final utility relocation.

STATIONS AND DISTANCES

All stations and distances, when indicated for utility placement in utility relocation plans or specifications, are approximate; therefore, some minor adjustment may have to be made during construction to fit actual field conditions. Any changes in excess of 6 inches of plan location shall be reviewed and approved jointly by the KYTC Section Engineer or designated representative and utility owner engineer or designated representative. Changes in location without prior approval shall be remedied by the contractor at his own expense if the unauthorized change creates an unacceptable conflict or condition.

RESTORATION

Temporary and permanent restoration of paved or stone areas due to utility construction shall be considered incidental to the utility work. No separate payment will be made for this work. Temporary restoration shall be as directed by the KYTC Section Engineer. Permanent restoration shall be “in-kind” as existing.

Restoration of seed and sod areas will be measured and paid under the appropriate seeding and sodding bid items established in the contract for roadway work.

BELOW ARE NOTES FOR WHEN “INST” ITEMS ARE IN THE CONTRACT MEANING THE UTILITY COMPANY IS PROVIDING CERTAIN MATERIALS FOR UTILITY RELOCATION

MATERIAL

Contrary to Utility Bid Item Descriptions, those bid items that have the text “**Inst**” at the end of the bid item will have the major components of the bid item provided by the utility owner. No direct payment will be made for the major material component(s) supplied by the utility company. All remaining materials required to construct the bid item as detailed in utility bid item descriptions, in utility specifications and utility plans that are made a part of this contract will be supplied by the contractor. The contractor’s bid price should reflect the difference in cost due to the provided materials.

The following utility owners have elected to provide the following materials for work under this contract:

All materials are to be supplied by the contractor per bid item descriptions, utility specifications and utility plans.”

SECURITY OF SUPPLIED MATERIALS

If any utility materials are to be supplied by the utility owner, it will be the responsibility of the utility contractor to secure all utility owner supplied materials after delivery to the project site. The utility

contractor shall coordinate directly with the utility owner and their suppliers for delivery and security of the supplied materials. Any materials supplied by the utility owner and delivered to the construction site that are subsequently stolen, damaged or vandalized and deemed unusable shall be replaced with like materials at the contractor's expense.

Standard Water Bid Item Descriptions

W AIR RELEASE VALVE This bid item description shall apply to all air release valve installations of every size except those defined as “Special”. This item shall include the air release valve, main to valve connecting line or piping, manhole, vault, structure, access casting or doors, tapping the main, labor, equipment, excavation, proper backfill and restoration required to install the air release valve at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. All air release/vacuum valves on a project shall be paid under one bid item regardless of size. No separate pay items will be established for size variations. Only in the case of the uniqueness of a particular air release valve would a separate bid item be established. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

BOLLARDS This item is for payment for furnishing and installing protective guard posts at above ground utility installations. A bollard may consist of, but not limited to, a steel post set in concrete or any other substantial post material. This item shall include all labor, equipment, and materials needed for complete installation of the bollard as specified by the utility owner specifications and plans. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

NOTE: A bid code for this item has been established in standard roadway bid items and shall be used for payment of this item. The bid code is 2134IND

W CAP EXISTING MAIN This item shall include the specified cap, concrete blocking and/or mechanical anchoring, labor, equipment, excavation, backfill, and restoration required to install the cap at the location shown on the plans or as directed in accordance with the specifications. This item is not to be paid on new main installations. This pay item is only to be paid to cap existing mains. Caps on new mains are incidental to the new main. Any and all caps on existing mains shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W DIRECTIONAL BORE Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of water main under streets, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W ENCASEMENT CONCRETE Includes all labor, equipment, excavation, concrete, reinforcing steel, backfill, restoration, and etc., to construct the concrete encasement of the water main as shown on the plans, and in accordance with the specifications and standard drawings. Payment under this item shall be in addition to the carrier pipe as paid under separate bid items. Carrier pipe is not included in this bid item. Any and all concrete encasement shall be paid under one bid item included in the contract regardless of the size of the carrier pipe or the volume of concrete or steel reinforcement as specified in the plans and specifications. No separate bid items will be established for size variations. Measurement of pay quantity shall be from end of concrete to end of concrete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W ENCASEMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W ENCASEMENT STEEL OPEN CUT This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to open cut and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The size encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W FIRE HYDRANT ADJUST Includes all labor, equipment, excavation, materials, and backfill to adjust the existing fire hydrant using the fire hydrant manufacturer's extension kit for adjustments of 18" or less. Adjustments greater than 18" require anchoring couplings and vertical bends to adjust to grade. The Contractor will supply and install all anchor couplings, bends, fire hydrant extension, concrete blocking, restoration, granular drainage material, etc. needed to adjust the fire hydrant complete and ready for use as shown on the plans, and in accordance with the specifications and standard drawings. This also includes allowing for the utility owner inspector to inspect the existing fire hydrant prior to adjusting, contractor returning unusable fire hydrants to the utility owner warehouse and picking up a replacement hydrant. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete and ready for use.

W FIRE HYDRANT ASSEMBLY Includes all labor, equipment, new fire hydrant, isolating valve and valve box, concrete pad around valve box (when specified in specifications or plans), piping, anchoring tee, anchoring couplings, fire hydrant extension, excavation, concrete blocking, granular drainage material, backfill, and restoration, to install a new fire hydrant assembly as indicated on plans and on standard drawings complete and ready for use. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FIRE HYDRANT RELOCATE This item includes all labor and equipment to remove the existing fire hydrant from its existing location and reinstalling at a new location. This item shall include a new isolating valve and valve box, concrete pad around valve box (when required in specifications or plans), new piping, new anchoring tee, anchoring couplings, fire hydrant extensions, concrete blocking, restoration, granular drainage material, excavation, and backfill as indicated on plans, specifications, and on standard drawings complete and ready for use. This item shall also include allowing for utility owner inspector to inspect the existing fire hydrant prior to reuse, contractor returning unusable fire hydrants to the utility owner warehouse and picking up a replacement hydrant for use, if the existing fire hydrant is determined unfit for reuse. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FIRE HYDRANT REMOVE This bid item includes removal of an abandoned fire hydrant, isolating valve, and valve box to the satisfaction of the engineer. The removed fire hydrant, isolating valve and valve box shall become the property of the contractor for his disposal as salvage or scrap. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FLUSH HYDRANT ASSEMBLY This item shall include the flushing hydrant assembly, service line, tapping the main, labor, equipment, excavation, backfill, and restoration required to install the flush hydrant at the location shown on the plans and in accordance with the specifications and standard drawings, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FLUSHING ASSEMBLY This item shall include the flushing device assembly, service line, meter box and lid, tapping the main, labor, equipment, excavation, backfill, and restoration required to install the

flushing device at the location shown on the plans and in accordance with the specifications and standard drawings, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W LEAK DETECTION METER This item is for payment for installation of a water meter at main valve locations where shown on the plans for detection of water main leaks. The meter shall be of the size and type specified in the plans or specifications. This item shall include all labor, equipment, meter, meter box or vault, connecting pipes between main and meter, main taps, tapping saddles, casting, yoke, and any other associated material needed for installation of a functioning water meter in accordance with the plans and specifications, complete and ready for use. No separate payment will be made under any other contract item for connecting pipe or main taps. Any and all leak detection meters shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete and ready for use.

W LINE MARKER This item is for payment for furnishing and installing a water utility line marker as specified by the utility owner specifications and plans. A line marker may consist of a post or monument of whatever materials specified and shall include markings and/or signage on same as specified by plans or specifications. This item shall include all labor, equipment, and materials needed for complete installation of the marker. This item shall be paid EACH (EA) when complete.

W MAIN POINT RELOCATE This item is intended for payment for horizontal and/or vertical relocation of a short length of an existing main at the locations shown on the plans. This bid item is to be used to relocate an existing water main at point locations such as to clear a conflict at a proposed drainage structure, pipe or any other similar short relocation situation, and where the existing pipe material is to be reused. The contractor shall provide any additional pipe or fitting material needed to complete the work as shown on the plans and specifications. The materials provided shall be of the same type and specification as those that exist. Substitution of alternative materials shall be approved by the engineer in advance on a case by case basis. New polyethylene wrap is to be provided (if wrap exists or is specified in the specifications to be used). If it is necessary that the pipe be disassembled for relay, payment under this item shall also include replacement of joint gaskets as needed. Bedding and backfill shall be provided and performed the same as with any other pipe installation as detailed in the plans and specifications. Payment under this item shall be for each location requiring an existing main to be relocated horizontally or vertically regardless of pipe size or relocation length. No separate pay items will be established for pipe size variations or relocation segment length variations. Water Main Relocate shall not be paid on a linear feet basis; but, shall be Paid EACH (EA) at each location when complete and placed in service. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

W METER This item is for payment for installation of all standard water meters of all sizes 2 inches ID or less as specified on the plans. This item shall include all labor, equipment, meter, meter box, casting, yoke, and any other associated material needed for installation of a functioning water meter in accordance with the plans and specifications, complete and ready for use. This item shall include connections to the new or existing water service line. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER ADJUST This item includes all labor, equipment, excavation, materials, backfill, restoration, and etc., to adjust the meter casting to finished grade (whatever size exists) at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER RELOCATE This item includes all labor, equipment, excavation, additional fittings, disinfection, testing, restoration, and etc., to relocate the existing water meter (whatever size exists), meter yoke, meter box, casting, and etc., from its old location to the location shown on the plans or as directed, in accordance with the specifications and standard drawings complete and ready for use. The new service pipe (if required) will be paid under short side or long side service bid items. Any and all meter relocations of 2 inches or less shall be paid under one bid item included in the contract regardless of size. Each individual relocation shall be paid individually under this item; however, no separate bid items will be established for meter size variations of 2 inches ID or less. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER VAULT SIZE RANGE 1 OR 2 This item is for payment for installation of an underground structure for housing of a larger water meter, fittings, and valves as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or access doors, the specified meter(s) valve(s), all piping, and fitting materials associated with installing a functioning meter and vault in accordance with the plans, standard drawings, and specifications, complete and ready for use. The size shall be the measured internal diameter of the meter and piping to be installed. The size meter vault to be paid under size 1 or 2 shall be as follows:

- Size Range 1 = All meter and piping sizes greater than 2 inches up to and including 6 inches
- Size Range 2 = All meter and piping sizes greater than 6 inches

This item shall be paid EACH (EA) when complete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

W METER/FIRE SERVICE COMBO VAULT This item is for payment for installation of an underground structure for housing of a water meter and fire service piping, fittings, and valves as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or access doors, the specified meter(s), valve(s), all piping, and fitting materials associated with installing a functioning meter and fire service vault in accordance with the plans and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER WITH PRESSURE REDUCING VALVE (PRV) This item is for payment for installation of all standard water meters with pressure reducing valves (PRV) of all sizes 2 inches ID or less as specified on the plans. This item shall include all labor, equipment, meter, PRV, meter box, casting, yoke, and any other associated material needed for installation of a functioning water meter with PRV in accordance with the plans and specifications, complete and ready for use. This item shall include connections to the new or existing water service line. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

This item shall be paid EACH (EA) when complete.

W PIPE This description shall apply to all PVC, ductile iron, and polyethylene/plastic pipe bid items of every size and type to be used as water main, except those bid items defined as “Special”. This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, sanitizing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. **This item shall include all temporary and permanent materials and equipment required to pressure test and sanitize mains including, but not limited to, pressurization pumps, hoses, tubing, gauges, main taps, saddles, temporary main end caps or plugs and blocking, main end taps for flushing, chlorine liquids or tablets for sanitizing, water for testing/sanitizing and flushing (when not supplied by the utility), chlorine neutralization equipment and materials, and any other items needed to accomplish pressure testing and sanitizing the main installation.** This item shall also include pipe anchors, at each end of polyethylene pipe runs when specified to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W PLUG EXISTING MAIN This item shall include the specified plug, concrete blocking and/or anchoring, labor, equipment, excavation, backfill, and restoration required to install the plug in an existing in-service main that is to remain at the location shown on the plans or as directed in accordance with the specifications. Any and all plugs on all existing in-service mains shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

NOTE: This utility bid item is not to be paid on new main installations or abandoned mains. This pay item is to plug existing in-service mains only. Plugs on new mains are incidental to the new main just like all other fittings.

NOTE: Plugging of existing abandon mains shall be performed and paid in accordance with Section 708.03.05 of KYTC Standard Specifications For Road And Bridge Construction and paid using Bid Code 01314 Plug Pipe.

W PRESSURE REDUCING VALVE This description shall apply to all pressure reducing valves (PRV) of every size required in the plans and specifications except those bid items defined as “Special”. Payment under this description is to be for PRVs being installed with new main. This item includes the PRV as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), pit or vault, backfill, restoration, testing, disinfection, and etc., required to install the specified PRV at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, PRVs shall be restrained. PRV restraint shall be considered incidental to the

PRV and adjoining pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W PUMP STATION This item is for payment for installation of pumps and an above or below ground structure for housing of the pumps. This item shall include all pumps, piping, fittings, valves, electrical components, building materials, concrete, any other appurtenances, labor, equipment, excavation, and backfill, to complete the pump station installation as required by the plans, standard drawings, and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LUMP SUM (LS) when complete.

W REMOVE TRANSITE (AC) PIPE This item shall include all labor, equipment, and materials needed for removal and disposal of the pipe as hazardous material. All work shall be performed by trained and certified personnel in accordance with all environmental laws and regulations. Any and all transite AC pipe removed shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W SERVICE LONG SIDE This bid item description shall apply to all service line installations of every size bid up to and including 2 inch inside diameter, except those service bid items defined as "Special". This item includes the specified piping material, main tap, tapping saddle (if required), and corporation stop materials, coupling for connecting the new piping to the surviving existing piping, encasement of 2 inches or less internal diameter (if required by plan or specification), labor, equipment, excavation, backfill, testing, disinfection, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service installations where the ends of the service connection are on opposite sides of the public roadway and the service line crosses the centerline of the public roadway as shown on the plans. The length of the service line is not to be specified. Payment under this item shall not be restricted by a minimum or maximum length. The contractor shall draw his own conclusions as to the length of piping that may be needed. Payment under this item shall include boring, jacking, or excavating across the public roadway for placement. Placement of a service across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for special bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W SERVICE SHORT SIDE This bid item description shall apply to all service line installations of every size up to and including 2 inch internal diameter, except those service bid items defined as "Special". This item includes installation of the specified piping material of the size specified on plans, encasement of 2 inches or less internal diameter (if required by plan or specification), main tap, tapping saddle (if required), corporation stop, coupling for connecting the new piping to the surviving existing piping, labor, equipment, excavation, backfill, testing, disinfection, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and

ready for use. This bid item is to pay for service installations where both ends of the service connection are on the same side of the public roadway, or when an existing service crossing a public roadway will remain and is being extended, reconnected, or relocated with all work on one side of the public roadway centerline as shown on the plans. The length of the service line is not to be specified and shall not be restricted to any minimum or maximum length. Payment shall be made under this item even if the service crosses a private residential or commercial entrance; but, not a public roadway. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. The contractor shall draw his own conclusions as to the length of piping that may be needed. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W SERVICE RELOCATE This item is for the relocation of an existing water service line where a meter is not involved, and where an existing service line can easily be adjusted by excavating alongside and moving the line horizontally and/or vertically a short distance without cutting the service line to avoid conflicts with road construction. This item shall include excavation, labor, equipment, bedding, and backfill to relocate the line in accordance with the plans and specifications complete and ready for use. Payment under this item shall be for each location requiring relocation. Payment shall be made under this item regardless of service size or relocation length. No separate pay items will be established for size or length variation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W STRUCTURE ABANDONMENT This item is to be used to pay for abandonment of larger above or below ground water structures such as meter vaults, fire pits, pump stations, tanks, and etc. Payment under this item shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to water construction, (i.e., abandonment of standard water meters up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted fill or flowable fill for abandonment of the structure in place and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W STRUCTURE REMOVAL This item is to be used to pay for removal of larger above or below ground water structures such as meter vaults, fire pits, pump stations, tanks, and etc. Payment under this item shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to water construction, (i.e., removal of standard water meters up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted backfill for removal of the structure and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W TAPPING SLEVE AND VALVE SIZE 1 OR 2 This item shall include the specified tapping sleeve, valve, valve box, concrete pad around valve box (when required in specifications or plans), labor, and equipment to install the specified tapping sleeve and valve, complete and ready for use in accordance with

the plans and specifications. The size shall be the measured internal diameter of the live pipe to be tapped. The size tapping sleeve and valve to be paid under sizes 1 or 2 shall be as follows:

Size 1 = All live tapped main sizes up to and including 8 inches

Size 2 = All live tapped main sizes greater than 8 inches

Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W TIE-IN This bid description shall be used for all main tie-in bid items of every size except those defined as "Special". This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, disinfection, testing and backfill required to make the water main tie-in as shown on the plans, and in accordance with the specifications complete and ready for use. Pipe for tie-ins shall be paid under separate bid items. This item shall be paid EACH (EA) when complete.

W VALVE This description shall apply to all valves of every size required in the plans and specifications except those bid items defined as "Special". Payment under this description is to be for gate or butterfly valves being installed with new main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by specification), restoration, testing, disinfection, and etc., required to install the specified valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, valves shall be restrained. Valve restraint shall be considered incidental to the valve and adjoining pipe. This description does not apply to cut-in valves. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE ANCHOR EXISTING This bid item is intended to pay for installation of restraint hardware on an existing valve where no restraint exists to hold the valve in place to facilitate tie-ins and other procedures where restraint is prudent. This work shall be performed in accordance with water specifications and plans. This bid item shall include all labor equipment, excavation, materials and backfill to complete restraint of the designated valve, regardless of size, at the location shown on the plans, complete and ready for use. Materials to be provided may include, but is not limited to, retainer glands, lugs, threaded rod, concrete, reinforcing steel or any other material needed to complete the restraint. Should the associated valve box require removal to complete the restraint, the contractor shall reinstall the existing valve box, the cost of which shall be considered incidental to this bid item. No separate bid items are being provided for size variations. All sizes shall be paid under one bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE BOX ADJUST Includes all labor, equipment, valve box and valve stem extensions (if required), excavation, backfill, concrete pad around valve box (when specified in specifications or plans), restoration, and etc., to adjust the top of the box to finished grade complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE CUT-IN This bid description is for new cut-in valve installations of all sizes where installation is accomplished by cutting out a section of existing main. This item shall include cutting the existing pipe, supplying the specified valve, couplings or sleeves, valve box, concrete pad around valve box (when required in specifications or plans), labor, equipment, and materials to install the valve at the locations shown on the plans, or as directed by the engineer, complete and ready for use. Any pipe required for installation shall be cut from that pipe removed or supplied new by the contractor. No separate payment will be made for pipe required for cut-in valve installation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE VAULT This item is for payment for installation of an underground structure for housing of specific valve(s) as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or doors, the specified valve(s), all piping, and fitting materials associated with installing a functioning valve vault in accordance with the plans, standard drawing, and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

WATERLINE RELOCATION PROJECT


BEAVER DAM WATER SYSTEM & MUNICIPAL WATER

Item No. 2-20060.00 FD05 092 0062 009-011

TECHNICAL SPECIFICATIONS

June 2, 2022

Eric F. Hackworth, F. Hackworth, PE, PTOE
PE, PTOE
Date: 2022.06.15
18:44:18 -04'00'

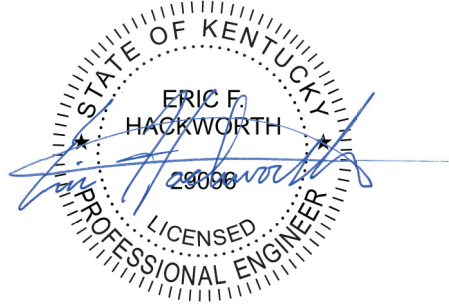

PREPARED BY:

EA Partners, PLLC



CIVIL ENGINEERS • LAND SURVEYORS • LANDSCAPE ARCHITECTS

3111 WALL STREET
LEXINGTON, KENTUCKY 40513
PHONE (859) 296-9889
WWW.EAPARTNERS.COM

TABLE OF CONTENTS
TECHNICAL SPECIFICATIONS

		PAGE
Section A	General Provisions	TS 3
Section B	Water Lines	TS 10
Section C	Valves	TS 23
Section D	Water Service Connections	TS 27

TECHNICAL SPECIFICATIONS

SECTION A – GENERAL PROVISIONS

A.1 KENTUCKY DEPARTMENT OF HIGHWAYS - SPECIFICATIONS

Except as otherwise indicated on the Plans, and in the Contract Documents and Specifications, all items of Work including materials, construction methods, method of measurement and basis of payment shall comply with the current edition of the *Kentucky Department of Highways (KDOH) Standard Specifications for Road and Bridge Construction* and all current revisions.

A.2 ABBREVIATIONS

Abbreviations of standards, codes, and publications used within these Specifications are as follows:

ASTM	American Society of Testing and Materials
ANSI	American National Standard Institute
AWWA	American Water Works Association
KDOH	Kentucky Department of Highways, "Standard Specifications for Road and Bridge Construction", Current Edition

A.3 IDENTIFICATION OF PARTIES

OWNER – Beaver Dam Water System & Municipal Water

ENGINEER – The Registered Professional Engineer designated by KYTC to oversee construction.

CONTRACTOR – The Contractor responsible under contract to KYTC to furnish labor, equipment, etc. to complete the work specified herein.

KENTUCKY TRANSPORTATION CABINET (KYTC) – The entity regulating the roadway and funding the utility relocation.

A.4 SCOPE

It is the intent that the CONTRACTOR, in accordance with the Plans, Contract Documents and Specifications, and other mutually acknowledged informational materials shall perform everything required to be performed and to furnish a complete, fully operating Work, and shall provide and furnish all labor, materials, necessary tools, expendable and non-expendable equipment and all transportation services required for the entire, proper, substantial completion of the Work, the cost of all of which shall be included in his bid.

This Specification sets forth several items of Work or conditions which are required as integral parts of the successful completion of the Project. All items discussed herein under

General Provisions are considered incidental to the overall accomplishment of the Project and no separate payment shall be made therefore unless otherwise noted elsewhere in these specifications.

A.5 CONTRACTOR'S FACILITIES

A.5.1 Sanitary Facilities: The CONTRACTOR shall provide and maintain all necessary sanitary facilities at the site, in accordance with all applicable regulations, and shall properly remove same at completion of the Project.

A.5.2 Utilities: The obtaining of all utilities which may be required for construction shall be the responsibility of the CONTRACTOR.

A.6 CONTRACTOR'S FIELD OFFICE

A CONTRACTOR'S Field Office is not required for this project.

A.7 UTILITIES

The CONTRACTOR is to notify all utility companies prior to beginning construction operations.

It shall be the CONTRACTOR'S responsibility to locate all utilities, make appropriate arrangements regarding relocation, maintain utility service throughout the construction period, and make final relocations at the completion of the Work. The CONTRACTOR shall be responsible for any injury or damage to the existing utilities due to his operations whether shown or not shown in the plans. Where utilities are shown or indicated on the plans, the information given is in accordance with the best information in possession of the OWNER but is approximate only. The data is not warranted to be either complete or correct, and the CONTRACTOR shall assume all risks resulting from the conditions arising from the approximations shown.

The CONTRACTOR shall confer with the utility companies to inform them of the proposed construction schedule, verify the location and elevation of existing utilities and arrange for the relocation and adjustment of any facilities to avoid interference with the proposed construction. All such activities are to be performed under the direction of and with the approval of the ENGINEER.

When the various utility owners find it necessary to make adjustments to their lines where the CONTRACTOR is presently working, the CONTRACTOR is to move his operations to another area of Work so as not to interfere in any way with the utility company's Work.

Any utilities covered up or lost by the construction operations of the CONTRACTOR shall be uncovered and found by the CONTRACTOR and the new construction repaired and/or replaced as directed by the ENGINEER. No additional compensation will be allowed for such Work nor shall any additional payment be allowed for the relocation and adjusting of any utility but shall be considered Incidentals to other Work.

The CONTRACTOR shall make a concerted effort to prevent any disruption of utility services, and if an unintended disruption occurs, the CONTRACTOR shall immediately and safely restore service. If disruption of any of the utility services covered in this section is unavoidable, it will be the responsibility of the CONTRACTOR to notify affected property owners. The CONTRACTOR shall also make every effort to restore said services before quitting Work for the day. In the event this cannot be done, the CONTRACTOR shall provide temporary service to the property owners until permanent service can be restored.

A.8 STAKING AND MARKING

The Contractor will furnish and be responsible for all staking necessary to control and complete the Work, according to the Specifications, to the lines and grades shown on the Plans. The Contractor's staking party shall be under the general supervision of a Licensed Professional Land Surveyor.

A.9 TESTING

From time to time during the progress of the Work, the ENGINEER may require that testing be performed to determine the materials provided meet the specified requirements. The OWNER will select a testing laboratory to perform the testing services. The cost of such services shall be the responsibility of the CONTRACTOR, unless otherwise directed.

A.9.1 Codes and Standards: Testing, when required, will be in accordance with all pertinent codes and regulations and with selected standards of the American Society for Testing and Materials.

A.9.2 Cooperation with the Testing Laboratory: Representatives of the testing laboratory shall have ready access to the Work at all times. The CONTRACTOR shall provide facilities for such access in order that the laboratory may properly perform its functions.

A.10 INSTALLATION REQUIREMENTS

Manufactured articles, materials and equipment shall be applied, installed, connected, erected, used, cleaned, and conditioned as suggested by the respective manufacturers, unless otherwise specified herein or directed by the ENGINEER.

A.11 PROOF OF COMPLIANCE

Whenever the Contract Documents require that a product be in accordance with Federal Specifications, ASTM Designations, ANSI Specifications, or other associations' standards, the CONTRACTOR shall present a certification from the manufacturer that the product complies therewith. When requested or specified, the CONTRACTOR shall submit supporting test data to substantiate compliance.

A.12 REPAIR OF DAMAGE

Any damage done to structures, fills, roadways, or other areas shall be repaired at the CONTRACTOR'S expense before final payment is made.

A.13 PROJECT EXTENT

The CONTRACTOR shall be responsible for satisfying himself as to the construction limits for the Project. The CONTRACTOR shall not establish Work, storage, or staging area outside the Project limits, unless otherwise directed or approved by the ENGINEER.

A.14 WORKING HOURS

Working hours shall be defined by KYTC.

A.15 GUARANTEE

The CONTRACTOR shall assume responsibility for all workmanship and materials for a period of one year from final payment. Any Work found to be defective due to failure to comply with the provision and intent of the Contract Documents, Specifications, and Plans shall be replaced at the CONTRACTOR'S expense.

A.16 PROPERTY CONSIDERATION

Materials having a salvage value shall remain the property of the OWNER. Salvageable material rejected by the OWNER shall become the responsibility of the CONTRACTOR to dispose of in a proper manner subject to the approval of the ENGINEER.

A.17 BLASTING

Blasting is prohibited on this project.

A.18 HAZARDOUS MATERIAL - GAS LINES

The CONTRACTOR is advised to exercise caution in his operations on this project, regardless of whether the plans indicate or do not indicate the presence of any gas or hazardous materials carrying lines.

A.19 DIVERSION OF STORM WATER

Appropriate measures must be taken to sandbag the necessary manholes and to pump drainage around the area under construction. The CONTRACTOR is responsible for developing a plan to divert storm drainage around the construction area with the approval from the ENGINEER. Materials, labor, and all incidentals necessary to accomplish this diversion of storm drainage will be considered incidental to the contract.

A.20 SEWER SERVICE MAINTENANCE

This Work shall consist of maintaining existing sanitary sewer service to residents in the area during construction. Sewage is to be maintained by whatever means necessary. No surcharge of manholes will be allowed. No separate payment will be made for Sewer Service Maintenance. Sewer Service Maintenance shall include all materials, equipment, and labor necessary to maintain sewer service to residents during construction.

A.21 SHOP DRAWINGS

The CONTRACTOR shall submit for the review of the ENGINEER Shop Drawings for all fabricated work and for all manufactured items required to be furnished in the Contract and as specified herein. Shop Drawings shall be submitted in sufficient time to allow at least twenty-one (21) calendar days, after receipt of the Shop Drawings from the CONTRACTOR, for checking and processing by the ENGINEER.

ENGINEER's review of the CONTRACTOR's drawings shall be considered as a gratuitous service, given as assistance to the CONTRACTOR in interpreting the requirements of the Contract, and in no way shall it relieve the CONTRACTOR of any of his responsibilities under the Contract.

Any fabrication, erection, setting, or other Work done in advance of the receipt of Shop Drawings returned by the ENGINEER and noted as "No Exception Taken" or "Make Corrections as Noted" shall be entirely at the CONTRACTOR's risk. The ENGINEER's review will be confined to general arrangement and compliance with the design concept and Specifications only, and will not be for the purpose of checking dimensions, weights, clearances, fitting, tolerances, interferences, coordination of trades, etc.

Unless otherwise stated elsewhere in the Contract Drawings or directed by the Engineer, a total of six (6) copies of all reviewed Shop Drawings shall be furnished to the ENGINEER for his use in accordance with the following sequence of operations:

- A) Initially six copies and one (1) reproducible copy shall be submitted to the Engineer for review. The ENGINEER will return one (1) copy and the reproducible copy to the CONTRACTOR after review.
- B) When Shop Drawings are returned for correction, they shall be immediately corrected and resubmitted for review as described above, and such procedures will not be considered as grounds for delay in completing the Work.
- C) Shop Drawings submitted by subcontractors shall be sent directly to the CONTRACTOR for preliminary checking. The CONTRACTOR shall be responsible for their submission to the ENGINEER at the proper time to prevent delays in delivery of materials.
- D) The CONTRACTOR shall thoroughly check all subcontractor's Shop Drawings regarding measurements, sizes of members, materials, and details to satisfy himself that they conform to the intent of the Specifications. Drawings found to be inaccurate or otherwise in error shall be returned to the subcontractors by the CONTRACTOR for correction before submitting them to the ENGINEER. Before submission, the CONTRACTOR shall mark (stamp) the drawings as being checked and approved by him, dated, and signed. The CONTRACTOR's approval (stamp) shall constitute a representation that all quantities, dimensions, field construction criteria, materials, catalog numbers, performance criteria and similar data have been verified and that, in his opinion, the submittal fully meets the requirements of the Contract Documents and the scope of work involved. Shop Drawings that are not stamped will not be reviewed.
- E) All details on Shop Drawings submitted for review shall clearly show the relation of the various parts and where the Work depends upon field measurements, such

measurements shall be obtained by the CONTRACTOR and noted on the Shop Drawings before being submitted to the ENGINEER for review.

- F) All submissions shall be properly referenced to clearly indicate the specification section, location, service, and function of each particular item. All submissions for one item or group of related items shall be complete. The ENGINEER reserves the right to reject manufacturer's publications in the form of catalogues, pamphlets, or other data sheets when they are submitted in lieu of prepared Shop Drawings. Such submissions shall specifically indicate the item for which approval is requested. Identification of items shall be made in ink, and submissions showing only general information are not acceptable.
- G) If the Shop Drawings contain any departures from the Contract requirements, specific mention thereof shall be made in the CONTRACTOR's letter of transmittal. Where such departures require revisions to layouts or structural changes to the Work, the CONTRACTOR shall, at his own expense, prepare and submit for approval revised layout and structural drawings. Such drawings shall be of the size approved by the ENGINEER.
- H) All shop drawings shall be in English.

A.22 RECORD DRAWINGS

The Record Drawings shall consist of the Contract Drawings (3 mil mylar, updated to 'As Built' conditions) and the approved Shop Drawings in reproducible form (3 mil mylar) and shall be submitted to the ENGINEER at any time upon request during construction, but no later than the Final Inspection.

Contract Drawings and Shop Drawings shall be legibly marked to record actual construction including:

- A) All deviations in location or elevation of any underground installation from that shown on the Contract Drawings.
- B) Any significant changes in above ground installation from approved Shop Drawings or Contract Drawings.
- C) No such deviations from the Contract Drawings or approved Shop Drawings shall be made without approval by the ENGINEER.

Specifications and addenda shall be legibly marked up to record:

- A) Manufacturer, trade name, catalog number, and Supplier of each product and item of equipment actually installed.

- B) Changes made by Change Order or Field Order.
- C) Other matters not originally specified.

- THE END -

SECTION B - WATER LINES

B.1 SCOPE

Furnish all labor, materials, equipment, and incidentals necessary to install and test pipe and fittings as shown on the Drawings and required by the Specifications.

Piping shall be located as shown. The ENGINEER reserves the right to make such modifications in locations as may be found desirable to avoid interference between pipes or for other reasons. Pipe fitting notation is for the CONTRACTOR'S convenience and does not relieve him from laying and jointing different or additional items where required without additional compensation.

Wherever the word pipe or piping is used it shall mean pipe and fittings unless otherwise noted.

B.2 DESCRIPTION OF SYSTEM

Piping shall be installed as shown on the Drawings to form a complete smooth flow path and workable system. The piping and materials specified herein are intended to be standard types of pipe for use in transporting the fluids as indicated on the Drawings. The pipe and fittings shall be designed, constructed, and installed in accordance with the best practices and methods and the manufacturer's recommendations.

B.3 QUALIFICATIONS

All pipe and fittings under this section shall be furnished by manufacturers who are fully experienced, qualified, and regularly engaged in the manufacture of the materials to be furnished.

B.4 SUBMITTALS

Submit to the ENGINEER within 30 days after execution of the Contract a list of materials to be furnished, the names of the suppliers and the approximate date of delivery of materials to the site.

B.5 INSPECTION

The manufacturer shall inspect all pipe joints for out-of-roundness and pipe ends for squareness.

B.6 DUCTILE IRON PIPE

B.6.1 GENERAL

- A. Ductile iron pipe shall be centrifugally cast of ductile iron conforming to ASTM Specification A 746-82. The pipe design conditions shall be as follows:
 - 1. Pressure: Minimum of 200 psi operation plus 100 psi water hammer allowance.

2. Trench Loading: Laying condition Type 4. Trench depth not less than 2' nor more than that shown on the Drawings.
3. Metal Design Strengths:

Bursting Tensile	40,000 psi
Modules of Rupture	90,000 psi
- B. The manufacturing tolerances included in the nominal thickness shall not be less than specified by ANSI/AWWA C151/A21.51-81.
- C. Minimum wall thickness shall be Class 350.
- D. For the bases of design, see ANSI/AWWA C151/A21.51-81.
- E. Pipe may be furnished in 16', 16 1/2', 18' or 20' nominal laying lengths; and the weight of any single pipe shall not be less than the tabulated weight by more than 5 percent for pipe 12" or smaller in diameter, nor by more than 4 percent for pipe larger than 12" in diameter.
- F. The hydrostatic and acceptance tests for the physical characteristics of the pipe shall be as specified in ANSI/AWWA C151/A21.51-81.
- G. Any pipe not meeting the ANSI/AWWA specifications quoted above shall be rejected in accordance with the procedure outlined in the particular specification.
- H. The ENGINEER shall be provided with 3 copies of a certification by the manufacturer that the pipe supplied for this Contract has been tested in accordance with the referenced specifications and is in compliance therewith.
- I. The net weight, class or nominal thickness and sampling period shall be marked on each pipe. The pipe shall also be marked to show that it is ductile iron.

B.6.2 LINING AND COATING DUCTILE IRON PIPE

All buried ductile iron pipe shall have manufacturer's outside coal tar or asphaltic base coating and a cement lining and bituminous seal coat on the inside. Cement mortar lining and bituminous seal coat inside shall conform to ANSI/AWWA C104/A21.4-80.

B.6.3 MECHANICAL JOINT FITTINGS DUCTILE IRON PIPE

- A. Ductile iron mechanical joints shall conform to ANSI/AWWA C111/A21.11-80 for centrifugally ductile iron water pipe.
 1. 3" to 12", All Working Pressures - Fittings shall conform to ANSI/AWWA Specification C110/A21.10-

82 for 250 psi water working pressure plus water hammer.

- 2. Fittings 12" and Over, for 150 psi and Less WWP - Fittings for use on 150 psi WWP pipe shall be AWWA Class D Pattern.
- 3. Fittings 12" and Larger, for 200 psi and Above WWP - Fittings shall be ductile iron or gray iron rated at 250 psi water working pressure plus water hammer. Ductile iron fittings only will be used with ductile iron pipe.

- C. All ductile iron fittings shall be rated at 250 psi water working pressure plus water hammer. Ductile iron fittings shall be ductile cast iron per ASTM Specifications A536-84.
- D. All mechanical joint fittings shall be cement lined and bituminous coated per Federal Specification WW-P-421b.

B.6.4 DUCTILE IRON PIPE AND FITTINGS - SMALLER THAN 3"

- A. Small size ductile iron pipe shall conform to ANSI Specifications A21.12 (AWWA C-112). Fittings shall conform to ANSI Specifications A21.10 (AWWA C-110).
- B. Pipe may be furnished with either mechanical joints or slip-on joints as specified in paragraph 2 hereinbefore. Underground fittings shall be furnished with mechanical joints.

B.6.5 STEEL ENCASUREMENT PIPE

- A. Shall be new, steel, plain end, uncoated and unwrapped, conforming to AWWA specification C-200, latest revision have a minimum yield strength of 35,000 psi and conform to ASTM A252 Grade 2 or ASTM A139 Grade B without hydrostatic tests. The steel pipe shall have continuously welded joints and be furnished in at least 18 foot lengths.

Minimum Wall Thickness

4" or less	0.250
6" – 12"	0.312
14" – 16"	0.375
18" – 20"	0.500
24" and Greater	0.625

B. CASING SPACERS

- 1. Shall be Powerseal Model 4810 or equal.
- 2. Shall have a bolt on shell made in two sections.
- 3. Shall have an elastomeric liner to insulate the shell from the carrier pipe.

4. Shall have runners attached to the shell and shall be designed to provide a minimum of 0.75 inches clearance between the carrier pipe's greatest outside diameter and the casing pipes inside diameter.
5. Materials:
 - a. All metal components shall be type 304 stainless steel.
 - b. The liner shall be Neoprene Rubber for extended service life.
 - c. Chock runners shall be UHMW polyethylene with high abrasion resistance and low friction coefficient.

B. 7 PRESSURE PIPE INSTALLATION - GENERAL

B.7.1 GENERAL

- A. Pipe shall be handled with such care as necessary to prevent damage during installation. The interior of the pipe shall be kept clean, and the pipe shall be installed to the lines and grades shown on the Drawings. Whenever pipe laying is stopped, the end of the pipe shall be securely plugged or capped. Care should be taken to prevent flotation of pipe in the event the trench should flood.
- B. Fittings shall be firmly blocked to original earth or rock to prevent water pressure from springing pipe sideward or upward. Concrete or other blocking material shall be placed such that it does not cover the pipe joints, nuts, and bolts.
- C. Pipes shall be free of all structures other than those planned. Openings and joints to concrete walls shall be constructed as shown on the Drawings.

B.7.2 TRENCH EXCAVATION

- A. All trenching and backfill necessary for installation of all pipelines as planned and specified shall be incidental to the bid items for waterline. Trenching shall include clearing and grubbing of all trash, weeds, briars, trees and stumps encountered in the trenching. The CONTRACTOR shall dispose of such material at no extra cost to the OWNER. Trenching also includes such items as railroad, street, road, sidewalk, pipe, and small creek crossings; cutting, moving or repairing damage to fences, posts, gates, and other surface structures regardless of whether shown on the Drawings.

- B. All existing facilities shall be protected from danger or damage while pipelines are being constructed and backfilled, and from damage due to settlement of the backfill.
- C. In the event any existing structure is damaged, repair and restoration shall be made at once and backfill shall not be replaced until this is done. Restoration and repair shall be such that the damaged structure is equal to or better than its original condition and can serve its purpose as completely as before. All such restoration and repair shall be done to the satisfaction of the ENGINEER without extra cost to KYTC or the OWNER.
- D. Trenches must be dug to lines and grades shown on the Drawings. Hand trenching may be required in areas where machine trenching would result in damage to existing structures and facilities.
- E. Excavation shall be open trenches, except where otherwise shown on the Drawings, for tunneling, boring, or jacking under structures, railroad, sidewalks and roads.
- F. Sheeting and shoring of trenches shall be provided at the expense of the CONTRACTOR where necessary to protect life, property and the new or existing structures from damage or to maintain maximum permissible trench widths at top of pipe. All necessary materials, including but not limited to, sheeting sheet piling, trench jacks, braces, shores and stringers, shall be used to hold trench walls. Sheeting and shoring may be withdrawn as the trenches are being backfilled, after backfill has been tamped over top of the pipe at least 18 inches. If removal before backfill is completed to surface endangers adjacent structures, such as buildings, pipelines, street paving, and sidewalks, then the sheeting and shoring shall be left in place until such danger has passed, and then pulled if practical. Voids caused by sheeting withdrawal shall be backfilled and tamped. If not withdrawn, sheeting shall be cut off at least 18 inches below final surface grade, so there is no obstruction at the ground level.
- G. Where subgrade of trench has insufficient stability to support the pipeline and hold it to its original grade, the ENGINEER may order special stabilization by various means. Exclusion of dewatering normally required for construction, and instability caused by neglect of the CONTRACTOR, the necessary stabilization shall be paid for at unit prices set up in the Contract. In the event no particular bid price is applicable, then the payment for stabilization will be negotiated.
- H. The location of the pipelines and their appurtenances as shown are those intended for the final construction. However, conditions may present themselves before construction of any line is started that would indicate desirable changes in location. The OWNER reserves the right to make reasonable changes in line and structure locations without extra cost, except as may be determined by extra units of materials and construction actually involved. The

OWNER is under no obligation to locate pipelines, so they may be excavated by machine.

- I. Dig trenches to the uniform width required for particular item to be installed, sufficiently wide to provide ample working room. Provide 12" clearance on both sides of pipe or conduit.
 - 1. Excavate trenches to depth indicated or required. Carry depth of trenches for piping to establish indicated flow lines and invert elevations. Beyond building perimeter, keep bottoms of trenches sufficiently below finish grade to avoid freeze-ups.
 - 2. Where rock is encountered, carry excavation 6 inches below required elevation and backfill with a 6-inch layer of crushed stone or gravel prior to installation of pipe.
 - 3. Grade bottoms of trenches as indicated to provide solid bearing for entire body of pipe.
 - 4. Backfill trenches with concrete where trench excavations pass within 18 inches of column or wall footings and which are carried below bottom of such footings, or which pass under wall footings. Place concrete to level of bottom of adjacent footing.
 - 5. Do not backfill trenches until tests and inspections have been made and backfilling authorized by the ENGINEER. Use care in backfilling to avoid damage or displacement of pipe systems.
 - 6. For piping less than 2 feet 6 inches below surface of roadways, provide 6-inch thick concrete base slab support. After installation and testing of piping or conduit, provide minimum 4-inch thick encasement (sides and top) of flowable fill prior to backfilling or placement of roadway subbase.
- J. COLD WEATHER PROTECTIONS: Protect excavation bottoms against freezing when atmospheric temperature is less than 35°F (1°C).

B.7.3 TRENCH BACKFILL

- A. Backfilling shall be accomplished as soon as practical after pipe has been laid and jointing and alignment approved. Packing of crushed rock between joints shall be the usual procedure as the laying progresses. This is to avoid danger of misalignment from slides, flooding or other causes. The ENGINEER shall be given a maximum of 24 hours for inspection before backfilling.

- B. Any special requirements of a Railroad Company or Highway Department in regard to backfilling will take precedence over the following general Specifications.
- C. When the pipe trench crosses a street or roadway, the CONTRACTOR shall be responsible for maintaining the trench surface in a level condition at proper pavement grade at all times.
- D. In all cases walking or working on the completed pipelines except as may be necessary in tamping or backfilling will not be permitted until the trench has been backfilled to a point one foot above the top of the pipe. The filling of the trench and the tamping of the backfill shall be carried on simultaneously on both sides of the pipe in such a manner that the completed pipeline will not be disturbed and injurious side pressures do not occur.
- E. Backfilling in Open Terrain - Backfilling of pipeline trenches in open terrain shall be accomplished in the following manner: In all cases the lower portion of the trench, from the pipe bedding to the springline (centerline) of the pipe shall be backfilled with #9 crushed stone. This stone shall be carefully and thoroughly compacted. The portion of the trench from the springline of the pipe to a point 12 inches above the pipe shall be backfilled in six inch lifts with #9 crushed stone. Each lift shall be hand tamped taking care not to damage the pipe. The portion of the trench from a point 12 inches above the top of the pipe to 8 inches below the ground surface shall be backfilled in six (6) inch lifts with material that is free from ¾" or larger rock. The backfill shall be mechanically tamped in six inch lifts to 95 percent of standard Proctor Density (ASTM D-698). The portion of the trench from a point 8 inches below the ground surface to the ground surface shall be backfilled in four (4) inch lifts with topsoil. The topsoil shall be mechanically tamped in four inch lifts to 95 percent of standard Proctor Density (ASTM D-698).
- F. Backfilling Under Graveled Areas - Backfilling of pipeline trenches under existing and proposed graveled parking lots, driveways, etc. shall be accomplished in the following manner: The pipe bedding and haunching shall be placed and compacted as described in Paragraph B.7.3.E. The lower portion of the trench from the pipe springline to a point 12 inches above the pipe, shall be backfilled and lightly tamped with #9 crushed stone as described in Paragraph B.7.3.E. The portion of the trench from a point 12 inches above the pipe to a point 12 inches below the ground surface shall then be backfilled with #9 crushed stone in six (6) inch lifts. Each lift shall be compacted to 100 percent of Standard Proctor Density (ASTM D698) at a moisture content within two percent of optimum. The final 12 inches of the trench backfill shall be thoroughly compacted dense graded aggregate.

- G. Backfilling Under Paved Areas - Backfilling of pipeline trenches under existing and proposed sidewalks, streets, proposed streets, and driveways shall be accomplished in the following manner: The pipe bedding and haunching shall be placed and compacted as described in Paragraph B.7.3.E. The lower portion of the trench from the pipe springline to a point 12 inches above the pipe, shall be backfilled and lightly tamped with #9 crushed stone as described in Paragraph B.7.3.E. The portion of the trench from a point 12 inches above the pipe to a point 6 inches below the ground surface shall then be backfilled with #9 crushed stone in six inch (6) lifts. Each lift shall be compacted to 100 percent of Standard Proctor Density (ASTM D698) at a moisture content within two percent of optimum. The upper portion of the trench from a point 12 inches below the bottom of the existing or proposed pavement or concrete sub-slab may be backfilled with a base course of dense graded aggregate which shall be maintained flush with the pavement surface for at least 30 days prior to placement of the final surface. The excess dense graded aggregate shall be removed concurrently with the placement of the final pavement surface.
- H. Settlement of Trenches - Wherever pipelines are in, or across, driveways and streets, the CONTRACTOR shall be responsible for any trench settlement which occurs within these rights-of-way within one year from the time of final acceptance of the work. If paving shall require replacement because of trench settlement within this time, it shall be replaced at the CONTRACTOR'S expense. Repair of settlement damage shall meet the approval of the ENGINEER.
- I. The CONTRACTOR shall protect all sewer, gas, electric, telephone, water, and drainpipes or conduits from damage while pipelines are being constructed and backfilled, and from danger due to settlement of trench backfill.
- J. No payment shall be made for backfilling of any kind. Backfilling shall be incidental to the pipeline installation.

B.7.4 PIPE BEDDING

Stone for bedding and backfilling pipe in earth and for bedding on solid rock shall be No. 9 crushed stone.

B.7.5 PRESSURE PIPE LAYING

- A. Pressure pipe shall first be thoroughly cleaned at joints, then joined according to instructions and with tools recommended by the manufacturer. A copy of such instructions shall be available at all times at the site of the work.

- B. All pipes must be forced and held together, or "homed" at the joints, before sealing or bolting. Pipe must be aligned as each joint is placed, so as to obtain straight lines and grades. Curves and changes in grades shall be laid in such a manner that maximum allowable joint deflection is not exceeded.
- C. Trench excavation for pipe laying must be of sufficient width to allow the proper jointing and alignment of the pipe. Trenches in earth or rock shall be dug deep enough to insure 36" minimum cover over top of the pipe, unless otherwise indicated on the Drawings.
- D. Trench line stations shall be set ahead of the trenching at least each 100 feet of pipeline. Trenches shall be dug true to alignment of stakes. Alignment of trenches or pipes in trench must not be changed to pass around obstacles such as poles, fences and other evident obstructions without the approval of the ENGINEER. Lines will be laid out to avoid obstacles as far as possible, consistent with maintenance of alignment necessary to finding the pipeline in the future and avoiding obstruction of future utilities and structures.
- E. Cut pieces of pressure pipe 18" or more in length may be used in fitting to the specials and valves and fitting changes in grade and alignment. Cut ends shall be even enough to make first class joints. Sufficient excavation for bell holes will be required for tightening of bolts. No pipe shall be laid resting on rock, blocking, or other unyielding objects except where laid above ground on piers or in permanent tunnels.

B.7.6 TESTING PRESSURE PIPE

- A. The CONTRACTOR shall furnish all necessary equipment for pressure testing.
- B. All test waters shall be potable water and paid for by the Contractor.
- C. All pipelines shall be given a hydrostatic test to the working pressure of the system under which leakage shall not exceed 1 gallon per 24 hours per inch of diameter per mile of pipe. Loss of water pressure during testing shall not exceed 0 psi in a 4 hour period or 5 psi in 24 hours.
- D. Where practicable, pipelines shall be tested between line valves or plugs in length of not more than 1500 feet.
- E. Pipelines shall be tested before backfilling at joints except where otherwise required by necessity.
- F. The duration of the test shall not be less than 4 hours.

- G. CONTRACTOR shall furnish a recording pressure gage and water meter for measuring water used during the leakage test. Recording pressure charts shall be submitted to the Engineer and the Owner. The pressure recording device shall be suitable for outside service, with a range from 0-200 psi, 24 hour spring wound clock, designed for 9 inch charts, and shall be approved by the ENGINEER.
- H. Where leaks are visible at exposed joints and/or evident on the surface where joints are covered, the joints shall be recaulked, repoured, bolts tightened or relaid and leakage minimized, regardless of total leakage as shown by test.
- I. All pipe, fittings and other materials found to be defective under test shall be removed and replaced.
- J. Lines which fail to meet tests shall be repaired and retested as necessary until test requirements are complied with.
- K. Where nonmetallic joint compounds are used, pipelines should be held under normal operating pressure for at least three days before testing.

B.8 DISINFECTION OF WATER LINES

- B.8.1 Prior to placing into service, all water lines shall be disinfected in strict accordance with 401 KAR 8:150 section 4. All new water distribution systems, including storage distribution tanks and repaired portions of all extensions to existing systems, shall be thoroughly disinfected before being placed in service. Disinfection shall be by the use of chlorine or chlorine compounds in such amounts to ensure a concentration of at least 50 ppm has been obtained throughout the pipe. The chlorinated water solution shall remain in the pipe for 24 hours and have a minimum residual of at least 25 ppm. The disinfection procedure shall be repeated until the minimum residual of 25 ppm has been obtained, then followed by thorough flushing
- B.8.2 Before the pipes are placed in service, bacteriological samples of the water must be taken by the CONTRACTOR and submitted to the required public health agency for testing. No pipes shall be placed in service until the samples have been approved by said agency. The Contractor shall bear all the cost of sampling, testing, and postage.
- B.8.3 Sampling locations shall be approved by the ENGINEER and the public health agency having jurisdiction.
- B.8.4 A satisfactory report for the section(s) under test must be submitted to the OWNER and the ENGINEER before authorizing domestic consumption of water.
- B.8.5 Sterilization procedures shall be continued until approved samples have been obtained.

B.9 DETECTABLE UNDERGROUND UTILITY WARNING TAPES

Detectable underground utility warning tapes which can be located from the surface by a pipe detector shall be installed directly above non-metallic (PVC, polyethylene, concrete) pipe.

The tape shall consist of a minimum thickness 0.35 mils solid aluminum foil encased in a protective inert plastic jacket that is impervious to all know alkalis, acids, chemical reagents and solvents found in the soil.

The minimum overall thickness of the tape shall be 5.5 mils and the width shall not be less than 2" with a minimum unit weight of 2-1/2 pounds/1" x 1000'. The tape shall be color coded and imprinted with the message as follows:

<u>Type of Utility</u>	<u>Color Code</u>	<u>Legends</u>
Water	Safety Precaution Blue	Caution Buried Water Line Below
Gravity Sewer	Safety Green	Caution Buried Sewer Line Below
Force Main	Safety Brown	Caution Buried Sanitary Force Main

Detectable underground tape shall be "Detect Tape" as manufactured by Allen Systems, or equal.

Installation of detectable tapes shall be per manufacturer's recommendations and shall be as close to the grade as is practical for optimum protection and detectability. Allow a minimum of 18" between the tape and the line.

Payment for detectable tapes shall be included in the linear foot price bid of the appropriate bid item(s), unless it is listed as a separate payment item in the bid schedule.

B.10 BLASTING

Blasting is prohibited on this project.

B.11 METHOD OF MEASUREMENT

B.11.1 W ENCASUREMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

Range 3 = All encasement sizes greater than 10 inches to and including 14 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.)

Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

- B.11.2 W PIPE This description shall apply to all PVC, ductile iron, and polyethylene/plastic pipe bid items of every size and type to be used as water main, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, sanitizing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall include all temporary and permanent materials and equipment required to pressure test and sanitize mains including, but not limited to, pressurization pumps, hoses, tubing, gauges, main taps, saddles, temporary main end caps or plugs and blocking, main end taps for flushing, chlorine liquids or tablets for sanitizing, water for testing/sanitizing and flushing (when not supplied by the utility), chlorine neutralization equipment and materials, and any other items needed to accomplish pressure testing and sanitizing the main installation. This item shall also include pipe anchors, at each end of polyethylene pipe runs when specified to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.
- B.11.3 W TIE-IN This bid description shall be used for all main tie-in bid items of every size except those defined as "Special". This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, disinfection, testing and backfill required to make the water main tie-in as shown on the plans, and in accordance with the specifications complete and ready for use. Pipe for tie-ins shall be paid under separate bid items. This item shall be paid EACH (EA) when complete.

B.12 BASIS OF PAYMENT

Payment will be made under:

PAY ITEM	PAY UNIT
14014 W ENCASEMENT STEEL OPEN CUT RANGE 3	LF
14036 W PIPE DUCTILE IRON 06 INCH	LF
14094 W TIE-IN 06 INCH	EA

SECTION C - VALVES

C.1 SUMMARY OF WORK

Furnish labor, materials and equipment required to install valves, fittings, valve boxes, and all other necessary accessories.

C.2 REFERENCES

ANSI/AWWA C500 - Gate Valves, 3 inch through 48 inches, for Water and Sewage Systems

ANSI/AWWA C111 - Rubber Gasket Joints for Ductile Iron and Gray Iron Pressure Pipe and Fittings

ANSI/AWWA C110 - Ductile Iron and Gray Iron Fittings, 3 inch through 48 inch, for Water and other liquids

ANSI/AWWA C153 - Ductile Iron Compact Fittings, 3 inch through 12 inch, for Water and other liquids

ANSI/AWWA C509 - Resilient Seated Gate Valves for Water and Sewage Systems

C.3 SUBMITTALS

Submit product data in accordance with General Conditions.

C.4 QUALITY ASSURANCE

Perform Work in accordance with AWWA standards.

The manufacturers name and pressure rating shall be marked on the body of all valves.

C.5 DELIVERY, STORAGE, AND HANDLING

Deliver and store valves in shipping containers with labeling in place.

C.6 PRODUCTS - GENERAL

All valves shall be furnished with the same joint connection as the supply line or as indicated on the Drawings.

All valves shall be nut operated for underground service, unless otherwise shown on the plans. All nuts shall be located within 2 feet of finished grade and shall be capable of withstanding an overload input torque of 450 ft. lbs. at full-open or closed position without damage to the valve or valve operator.

Valve boxes shall be of cast iron, two or three pieces, slip type consisting of a base, a center section, and a top section with a cover marked water.

The CONTRACTOR shall provide two nut wrenches for the operation of the valves to be installed.

C.7 GATE VALVES

Manufacturers: Subject to compliance with requirements, manufactures offering gate valves which may be incorporated in the Work include, but are not limited to, the following:

- A. M & H Valve Co. - AWWA C509 Resilient Seated Gate Valve
- B. Clow Corp. - AWWA R/W Resilient Seated wedge Valves
- C. Mueller Co. - Super Seal Resilient Valve

All gate valves shall be of the iron body, bronze mounted, resilient seated type.

All resilient seated gate valves shall conform in all respects to ANSI/AWWA C509 with non-rising stems suitable for working pressures of 150 psi.

All valves shall be protected with epoxy coating on all exterior surfaces, applied in accordance with ANSI/AWWA C550.

C.8 FIRE HYDRANT

Fire hydrants shall be Mueller A-425, or approved equal, with 5 1/4" main valve, two way, with 6" shoe and double 4 1/2" pumper nozzles, unless otherwise directed by the OWNER.

C.9 INSTALLATION

Valves shall be installed at locations indicated on Drawings. Where the Drawings do not specifically indicate a valve size, valves shall be same diameter as pipe it serves.

All valves shall be installed with stems vertical.

Valves shall operate freely without binding or sticking in any position from fully open to fully closed.

Valves that are to be for underground service shall be bedded and backfilled according to the requirements of the supply line.

Center and plumb valve boxes over valve. Set box cover flush with finished grade.

Protect valve boxes, not protected by concrete slabs, with a 12" diameter RCP, 18" long sit 2" above finished grade.

C.10 METHOD OF MEASUREMENT

- C.10.1 W FIRE HYDRANT RELOCATE This item includes all labor and equipment to reconnect the existing fire hydrant at its existing location. This item may include a new isolating valve and valve box, concrete pad around valve box (when required in specifications or plans), new piping, new anchoring tee, anchoring

couplings, fire hydrant extensions, concrete blocking, restoration, granular drainage material, excavation, and backfill as indicated on plans, specifications, and on standard drawings compete and ready for use. This item shall also include allowing for utility owner inspector to inspect the existing fire hydrant prior to reuse, contractor returning unusable fire hydrants to the utility owner warehouse and picking up a replacement hydrant for use, if the existing fire hydrant is determined unfit for reuse. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

- C.10.2 W STRUCTURE REMOVAL This item is to be used to pay for removal of larger above or below ground water structures such as meter vaults, fire pits, pump stations, tanks, and etc. Payment under this time shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to water construction, (i.e., removal of standard water meters up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted backfill for removal of the structure and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- C.10.3 W VALVE This description shall apply to all valves of every size required in the plans and specifications except those bid items defined as "Special". Payment under this description is to be for gate or butterfly valves being installed with new main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by specification), restoration, testing, disinfection, and etc., required to install the specified valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, valves shall be restrained. Valve restraint shall be considered incidental to the valve and adjoining pipe. This description does not apply to cut-in valves. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- C.10.4 W VALVE CUT-IN This bid description is for new cut-in valve installations of all sizes where installation is accomplished by cutting out a section of existing main. This item shall include cutting the existing pipe, supplying the specified valve, couplings or sleeves, valve box, concrete pad around valve box (when required in specifications or plans), labor, equipment, and materials to install the valve at the locations shown on the plans, or as directed by the engineer, complete and ready for use. Any pipe required for installation shall be cut from that pipe removed or supplied new by the contractor. No separate payment will be made for pipe required for cut-in valve installation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

C.11 BASIS OF PAYMENT

Payment will be made under:

PAY ITEM	PAY UNIT
14020 W FIRE HYDRANT RELOCATE	EA
14088 W STRUCTURE REMOVAL	EA
14105 W VALVE 06 INCH	EA
14117 W VALVE CUT-IN 06 INCH	EA

SECTION D – WATER SERVICE CONNECTIONS

D.1 SUMMARY OF WORK

Furnish labor, materials and equipment required to install ½ inch through 2 inch water service connections

D.2 SUBMITTALS

Submit product data in accordance with General Conditions.

D.3 QUALITY ASSURANCE

Perform Work in accordance with AWWA standards.

D.4 DELIVERY, STORAGE, AND HANDLING

Deliver and store valves in shipping containers with labeling in place.

D.5 PRODUCTS

- D.5.1 Tapping Saddle: Tapping saddle shall be equal to Ford 202B, brass band type saddles threaded to receive the appropriate diameter AWWA corporation stop.
- D.5.2 Corporation Stop: Corporation Stops shall provide for flared copper connections AWWA C800-84. The stop flared connections shall be appropriate for the service pipe diameter employed.
- D.5.3 Meter Setter: The meter setter shall be equal to the Ford 70 Series copper setter V27-7 with 7 inch rise. If a pressure reducing valve is specified, a tandem copper setter shall be employed.
- D.5.4 Meter Box and Lid: The meter box for copper setters shall be 18” internal diameter High Density Polyethylene Pipe. The meter box and lid shall be equal to the Ford C32 cast iron lid. The meter box for tandem copper setters shall be 20” internal diameter High Density Polyethylene Pipe. The meter box and lid shall be equal to the Ford C3 cast iron lid. If the meter is placed in a paved area the contractor shall supply a traffic rated meter box and lid.
- D.5.5 Meter: The meters shall be specified by the OWNER.

D.6 METHOD OF MEASUREMENT

- D.6.1 W METER RELOCATE This item includes all labor, equipment, excavation, additional fittings, disinfection, testing, restoration, and etc., to relocate the existing water meter (whatever size exists), meter yoke, meter box, casting, and etc., from its old location to the location shown on the plans or as directed, in accordance with the specifications and standard drawings complete and ready for use. The new service pipe (if required) will be paid under short side or long side service bid items. Any and all meter relocations of 2 inches or less shall be paid under one bid item included in the contract regardless of size. Each individual relocation shall be paid individually under this item; however, no separate bid

items will be established for meter size variations of 2 inches ID or less. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

D.6.2 W SERVICE LONG SIDE This bid item description shall apply to all service line installations of every size bid up to and including 2 inch inside diameter, except those service bid items defined as "Special". This item includes the specified piping material, main tap, tapping saddle (if required), and corporation stop materials, coupling for connecting the new piping to the surviving existing piping, encasement of 2 inches or less internal diameter (if required by plan or specification), labor, equipment, excavation, backfill, testing, disinfection, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service installations where the ends of the service connection are on opposite sides of the public roadway and the service line crosses the centerline of the public roadway as shown on the plans. The length of the service line is not to be specified. Payment under this item shall not be restricted by a minimum or maximum length. The contractor shall draw his own conclusions as to the length of piping that may be needed. Payment under this item shall include boring, jacking, or excavating across the public roadway for placement. Placement of a service across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for special bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

D.6.3 W SERVICE SHORT SIDE This bid item description shall apply to all service line installations of every size up to and including 2 inch internal diameter, except those service bid items defined as "Special". This item includes installation of the specified piping material of the size specified on plans, encasement of 2 inches or less internal diameter (if required by plan or specification), main tap, tapping saddle (if required), corporation stop, coupling for connecting the new piping to the surviving existing piping, labor, equipment, excavation, backfill, testing, disinfection, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service installations where both ends of the service connection are on the same side of the public roadway, or when an existing service crossing a public roadway will remain and is being extended, reconnected, or relocated with all work on one side of the public roadway centerline as shown on the plans. The length of the service line is not to be specified and shall not be restricted to any minimum or maximum length. Payment shall be made under this item even if the service crosses a private residential or commercial entrance; but, not a public roadway. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. The contractor shall draw his own conclusions as to the length of piping that may be needed. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for bedding required

in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

D.7 BASIS OF PAYMENT

Payment will be made under:

PAY ITEM	PAY UNIT
14030 W METER RELOCATE	EA
14080 W SERV PE/PLST LONG SIDE 3/4 INCH	EA
14085 W SERV PE/PLST SHORT SIDE 3/4 INCH	EA

Standard Sanitary Sewer Bid Item Descriptions

S BYPASS PUMPING This item shall include all labor, equipment, and materials needed to complete a bypass pumping and/or hauling operation for diversion of sewage during sanitary sewer construction. Examples of such operations when bypass pumping and/or hauling may be necessary is during force main tie-ins, manhole invert reconstruction, insertion of new manholes into existing mains, or other similar construction. There may be more than one bypass pumping/hauling operation on a project. This item shall be paid for each separate bypass pumping/hauling operation occurrence as called out on the plans or directed by the engineer and actually performed. There will be no separate bid items defined for length, duration, or volume of sewage pumped or hauled in each occurrence. If a bypass pumping/hauling operation is called out on the plans; but, conditions are such that the bypass pumping/hauling operation is not needed or utilized, no payment will be made under this item. The contractor shall draw his own conclusions as to what labor, equipment, and materials may be needed for each bypass pumping/hauling occurrence. The contractor should be prepared to handle the maximum volume of the sewer being bypassed, even during a storm event. This item shall not be paid separately, but shall be considered incidental, when bypass pumping and/or hauling is needed during cast-in-place-pipe (CIPP) and/or point repair operations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA).

S CIPP LATERAL SERVICE INVESTIGATION This item shall include all equipment, materials, labor and incidentals necessary to enter the sewer in compliance with all safety/confined space requirements and perform the identification, assessment and pre-measurement of all existing and abandoned laterals for the placement of Cured-In-Place-Pipe lining. This item shall be in payment for all lateral service investigation for all sewer segments to be lined as a part of this contract. This bid item shall include bypass pumping when required. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be LUMP SUM (LS).

S CIPP LATERAL REINSTATEMENT This item is to pay for installing a Cured-In-Place-Pipe liner in service laterals and service/mainline connections to stabilize structural defects and construction inadequacies. This bid item shall include all labor, equipment, materials and incidentals necessary to perform the service lateral reinstatement in accordance with the plans and specifications. Work under this item shall include bypass pumping, sewer flow control, pre-installation cleaning, sealing connections to existing sewer main, pre- and post- construction CCTV inspection and final testing of the CIPP system. This item shall also include the "top hat" required by the specifications. All CIPP lateral reinstatements shall be paid under this item regardless of the size or length of reinstatement. No separate bid items of varying sizes or length of CIPP lateral reinstatement will be provided in the contract. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be EACH (EA) for each CIPP lateral reinstatement complete and ready for use.

S CIPP LINER This bid Item is to pay for rehabilitation of existing sanitary sewers using the Cured-In-Place-Pipe method. This bid item description applies to all CIPP sizes included in the contract.

All CIPP Liner items of all varying sizes shall include all labor, materials, customer notification, testing, necessary permits, ingress and egress procedures, bypass pumping, pre-construction video, sediment and root removal, dewatering, traffic control, erosion and sediment control, excavation pits, removal and replacement of manhole frames and covers as necessary to facilitate the lining work, sealing at manholes and service connections, clearing and grubbing, pipeline cleaning, re-cleaning and video inspection as many times as necessary, debris collection and disposal, root removal, pre- and post-construction video inspection, all digital inspection footage, final report preparation and approval, the cost of potable water from the Owner, required compliance tests, site restoration, site cleanup, sealing of liner at manholes, acceptance testing and all other rehabilitation work and incidentals not included under other pay items necessary to complete the rehabilitation per the plans and specifications. There will be no separate payment for acceptance testing of the lined pipe; but shall be considered incidental to this item. Pay under this item shall be by each size bid in the contract. Pay measurement shall be from center of manhole to center of manhole. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S CIPP PROTRUDING LATERAL REMOVAL This item includes all equipment, materials, labor and incidentals necessary to enter the sewer in compliance with all safety/confined space requirements, remove a sufficient amount of the protruding tap to insure a proper and safe Cured-In-Place-Pipe lining insertion and perform pre-installation CCTV. This bid item shall include bypass pumping when required. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be EACH (EA) for each protruding lateral removed.

S CONCRETE PIPE ANCHOR This item shall be constructed on the sewer pipe at the locations shown on the plans in accordance with sanitary sewer specifications and standard drawings. Payment for concrete anchors will be made at the contract unit price each in place complete and ready for use. Each concrete anchor of sewer pipe or force main shall be paid under one bid item per contract regardless of the sizes of carrier pipe being anchored in the contract. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S DIRECTIONAL BORE Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of force main or gravity sewer under streets, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S ENCASEMENT CONCRETE Includes all labor, equipment, excavation, concrete, reinforcing

steel, backfill, restoration, and etc., to construct the concrete encasement of the sewer or force main as shown on the plans, and in accordance with the specifications and standard drawings. Payment under this item shall be in addition to the carrier pipe as paid under separate bid items. Carrier pipe is not included in this bid item. Any and all concrete encasement shall be paid under one bid item included in the contract regardless of the size of the carrier pipe or the volume of concrete or steel reinforcement as specified in the plans and specifications. No separate bid items will be established for size variations. Measurement of pay quantity shall be from end of concrete to end of concrete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

S ENCASEMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S ENCASEMENT STEEL OPEN CUT This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to open cut install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The size encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S FORCE MAIN This description shall apply to all PVC and ductile iron and polyethylene/plastic pipe bid items of every size and type, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall also include pipe anchors on polyethylene pipe runs as shown on the plans or required by the specifications to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S FORCE MAIN AIR RLS/VAC VLV This bid item description shall apply to all force main air release/vacuum valve installations of every size except those defined as "Special". This item shall include the air release/vacuum valve, main to valve connecting line or piping, manhole/vault/structure, access casting or doors, tapping the main, labor, equipment, excavation, proper backfill and restoration required to install the air release/vacuum valve at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. All air release/vacuum valves on a project shall be paid under one bid item regardless of size. No separate pay items will be established for size variations. Only in the case of the uniqueness of a particular air release/vacuum valve would a separate bid item be established. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN DIRECTIONAL BORE Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of sewer or force main under streets, buildings, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S FORCE MAIN POINT RELOCATE This item is intended for payment for horizontal and/or vertical relocation of a short length of an existing main at the locations shown on the plans. This bid item is to be used to relocate an existing force main at point locations such as to clear a conflict at a

proposed drainage structure, pipe or any other similar short relocation situation, and where the existing pipe material is to be reused. The contractor shall provide any additional pipe or fitting material needed to complete the work as shown on the plans and specifications. The materials provided shall be of the same type and specification as those that exist. Substitution of alternative materials shall be approved by the engineer in advance on a case by case basis. New polyethylene wrap is to be provided (if wrap exists or is specified in the specifications to be used). If it is necessary that the pipe be disassembled for relay, payment under this item shall also include replacement of joint gaskets as needed. Bedding and backfill shall be provided and performed the same as with any other pipe installation as detailed in the plans and specifications. Payment under this item shall be for each location requiring an existing main to be relocated horizontally or vertically regardless of pipe size or relocation length. No separate pay items will be established for pipe size variations or relocation segment length variations. Force Main Relocate shall not be paid on a linear feet basis; but shall be shall be paid EACH (EA) at each location when complete and placed in service. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

S FORCE MAIN TAP SLEVE/VALVE RANGE 1 OR 2 This item shall include the specified tapping sleeve, valve, valve box, concrete pad around valve box (when required in specifications or plans), labor, and equipment to install the specified tapping sleeve and valve, complete and ready for use in accordance with the plans and specifications. The size shall be the measured internal diameter of the live pipe to be tapped. The size tapping sleeve and valve to be paid under sizes 1 or 2 shall be as follows:

- Range 1 = All live tapped main sizes up to and including 8 inches
- Range 2 = All live tapped main sizes greater than 8 inches

Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN TIE-IN This bid description shall be used for all force main tie-in bid items of every size except those defined as "Special". This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, testing and backfill required to make the force main tie-in as shown on the plans and in accordance with the specifications complete and ready for use. This bid item shall include purge and sanitary disposal of any sewage from any abandoned segments of force main. Pipe for tie-ins shall be paid under separate bid items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN VALVE This description shall apply to all force main valves of every size required in the plans and specifications, except those bid items defined as "Special". Payment under this description is to be for gate or butterfly force main valves being installed with new force main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by specification), restoration, testing, and etc., required to install the specified valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, force main valves shall be restrained. Force main valve restraint shall be considered incidental to the force main valve and adjoining pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be

referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN VALVE BOX ADJUST Includes all labor, equipment, valve box and valve stem extensions (if required), excavation, backfill, concrete pad around valve box (when specified in specifications or plans), restoration, and etc., to adjust the top of the force main valve box to finished grade complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LATERAL CLEANOUT This item shall be for payment for installation of a cleanout in a service lateral line. This item shall include furnishing and installation of a tee, vertical pipe of whatever length required, and threaded cap. The cleanout shall extend from the lateral to final grade elevation. The size of the cleanout shall be equivalent to the size of the lateral. The cleanout materials shall meet the same specification as those for the lateral. The cleanout shall be installed at the locations shown on the plans or as directed by the engineer. Only one pay item shall be established for cleanout installation. No separate pay items shall be established for size or height variances. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LATERAL LOCATE This bid item is to pay for all labor, equipment, and materials needed in locating an existing sanitary sewer service lateral for tie-in of the lateral to new mainline sewers and/or for the relocation of a lateral. This bid item shall be inclusive of any and all methods and efforts required to locate the lateral for tie-in or relocation of the lateral. Locating methods to be included under this items shall include, but are not limited to, those efforts employing the use of video cameras from within an existing sanitary sewer main or lateral, electronic locating beacons and/or tracers inserted into the sanitary sewer main or lateral, careful excavation as a separate operation from mainline sewer or lateral excavation, the use of dyes to trace the flow of a lateral, or any combination of methods required to accurately locate the lateral. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA).

S LATERAL LONG SIDE This bid item description shall apply to all service lateral installations of every size up to and including 6 inch internal diameter, except those lateral bid items defined as "Special". This item includes the specified piping material, main tap, bends, clean outs, labor, equipment, excavation, backfill, testing, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service lateral installations where the ends of the lateral connection are on opposite sides of the public roadway. The new lateral must cross the centerline of the public roadway to qualify for payment as a long side lateral. The length of the service lateral is not to be specified. Payment under this item shall not be restricted by a minimum or maximum length. The contractor shall draw his own conclusions as to the length of piping that may be needed. Payment under this item shall include boring, jacking, or excavating across the public roadway for placement. Placement of a service lateral across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LATERAL SHORT SIDE This bid item description shall apply to all service lateral installations of every size up to and including 6 inch, except those lateral bid items defined as “Special”. This item includes the specified piping material, main tap tee, bends, clean outs, labor, equipment, excavation, backfill, testing, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for lateral installations where both ends of the lateral connection are on the same side of the public roadway, or when an existing lateral crossing a public roadway will remain and is being extended, reconnected, or relocated with all work on one side of the public roadway centerline as shown on the plans. The length of the service lateral is not to be specified and shall not be restricted to any minimum or maximum length. Payment shall be made under this item even if the lateral crosses a private residential or commercial entrance; but, not a public roadway. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. The contractor shall draw his own conclusions as to the length of piping that may be needed. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LINE MARKER This item is for payment for furnishing and installing a sewer utility line marker as specified by the utility owner specifications and plans. A line marker may consist of a post or monument of whatever materials specified and shall include markings and/or signage on same as specified by plans or specifications. This item shall include all labor, equipment, and materials needed for complete installation of the marker. This item shall be paid EACH (EA) when complete.

S MANHOLE Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole. Payment for manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Manholes shall include concrete base, barrel sections, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup in accordance with the specifications and standard drawings. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE ABANDON/REMOVE Payment under this item is for the partial removal and/or filling of any sanitary sewer manhole regardless of size or depth that no longer serves any purpose. Payment shall be made regardless of whether the manhole is or is not in conflict with other work. Any manhole requiring partial removal, but not total removal, in order to clear a conflict with other work shall be paid under this item. All manholes partially removed shall be removed to a point at least one foot below final grade, one foot below roadway subgrade, or one foot clear of any other underground infrastructure, whichever is lowest. If partial removal of an abandoned manhole is elected by the contractor, the remaining manhole structure shall be refilled with flowable fill. Payment for disposal of a sanitary sewer manhole will be made under this item only. Please refer to the Utility Company’s

Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE ADJUST TO GRADE Payment under this item is for the adjustment of sanitary sewer casting elevation on all sizes of existing sanitary manholes. This work shall be performed in accordance with the sanitary sewer specifications. Payment shall be made under this bid item regardless of the amount of adjustment necessary to a sanitary sewer manhole casting or diameter of the manhole. Work under this pay item may be as simple as placing a bed of mortar under a casting; but, shall also be inclusive of installation of adjusting rings, and /or addition, removal, or replacement of barrel sections. The existing casting is to be reused unless a new casting is specified on the plans. New casting, when specified, shall be paid as a separate bid item. Anchoring of the casting shall be incidental to this item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE CASTING STANDARD Payment under this bid items is for furnishing of a new standard traffic baring casting for sanitary manholes meeting the requirements of the sanitary sewer specifications and standard drawings. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when installed.

S MANHOLE CASTING WATERTIGHT Payment under this bid item is for furnishing of a new watertight traffic baring casting for sanitary manholes meeting the requirements of the sanitary sewer specifications and standard drawings. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when installed.

S MANHOLE RECONSTRUCT INVERT This bid item is to pay for all labor, equipment, and material for rework of the manhole bench to redirect or eliminate flow, such as when the flow of a pipe or pipes are being removed or redirected. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in elimination or redirect of flow. This item shall also include providing and placement of a rubber seal or boot as required by utility specification, standard drawing or plan. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the specifications, standard drawings, and plans. No payment shall be made under this bid when MANHOLE TAP EXISTING, or MANHOLE TAP EXISTING ADD DROP are being paid at the same location, as this type of work is included in those items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE TAP EXISTING This bid item is to pay for all labor, equipment, and material for coring one opening in an existing manhole base, addition of a rubber seal as specified, and rework of the manhole bench to direct the additional pipe flow. The bid item shall be paid for each core opening added to a single manhole. This bid item shall also include any rework of the existing manhole bench due to the elimination of other existing pipes and flow. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in the addition, elimination, or redirect of flow. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the

specifications, standard drawings, and plans. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE TAP EXISTING ADD DROP This bid item is to pay for all labor, equipment, and material for coring one opening in an existing manhole base, addition of a rubber seal as specified, addition of a vertical drop pipe to the outside of the manhole, placement of reinforcing steel and concrete to encase vertical pipe, and rework of the manhole bench to direct the additional pipe flow. The bid item shall be paid for each drop added to a single manhole. This bid item shall also include any rework of the existing manhole bench due to the elimination of other existing pipes and flow. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in the addition, elimination, or redirect of flow. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the specifications, standard drawings, and plans. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE WITH DROP Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole with drop. Payment for drop manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Drop manholes shall include concrete base, barrel sections, drop materials, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE WITH LINING Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole with corrosion resistant lining. Payment for manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Manholes shall include concrete base, barrel sections, cone section or slab top, steps, lining, excavation, backfilling, air testing, restoration, and cleanup in accordance with the standard drawings. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE WITH TRAP Payment under this item is for the installation of a new manhole with

trap. Payment for trap manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Trap manholes shall include concrete base, manhole structure and trap materials, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup. All materials, except casting, shall be new and unused. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S PIPE This description shall apply to all PVC and ductile iron gravity sewer pipe bid items of every size and type 8 inches internal diameter and larger, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, tap tees and couplings for joining to existing similar or dissimilar pipes), polyethylene wrap (if required by specification), labor, equipment, excavation, bedding, restoration, pressure or vacuum testing, temporary testing materials, video inspection, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. This bid item shall include material and placement of flowable fill under existing and proposed pavement, and wherever specified on the plans or in the specifications. No additional payment will be made for rock excavation. Measurement of quantities under this item shall be through fittings and encasements to a point at the outside face of manhole barrels, or to the point of main termination at dead ends or lamp holes. Carrier pipe placed within an encasement shall be paid under this item and shall include casing spacers and end seals. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S PIPE POINT REPAIR This item is to be used to pay for repair of short lengths of existing sanitary sewer pipe that, through prior video inspection or other means, are known to have pre-existing failure. Pipe Point Repair may be needed in preparation for installation of cured-in-place-pipe (CIPP) lining or other instances where failure is known and repair is prudent. The size of pipe shall not be defined in separate bid items. All diameter sizes of point repair shall be paid under this one item. The materials to be used to make the repair shall be as defined on the plans or in the specifications. This bid item shall include all excavation, pipe materials, joining materials to connect old and new pipe, bedding, and backfill to complete the repair at the locations shown on the plans or as directed by the engineer, complete and ready for use. This bid item shall include bypass pumping when required. Measurement shall be from contact point to contact point of old and new pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S PUMP STATION This item is for payment for installation of sanitary pump stations including above or below ground structure for housing of the pumps. This item shall include all pumps, piping, fittings, valves, electrical components, building materials, concrete, any other appurtenances, labor, equipment, excavation, and backfill, to complete the pump station installation as required by the plans, standard drawings, and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall

be referenced. This item shall be paid LUMP SUM (LS) for each when complete.

S STRUCTURE ABANDON This item is to be used to pay for abandonment of larger above or below ground sewer structures such as air release/vacuum valve vaults, pump stations, tanks, etc. Payment under this time shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to sewer construction, (i.e., abandonment of standard air release/vacuum valves up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted fill or flowable fill for abandonment of the structure in place and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S STRUCTURE REMOVAL This item is to be used to pay for removal of larger above or below ground sewer structures such as air release/vacuum valve vaults, pump stations, tanks, and etc. Payment under this time shall not be limited to size or scope; however, structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to sewer construction, (i.e., removal of standard air release/vacuum valves and their structure up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted backfill for removal of the structure and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

FORCE MAIN RELOCATION PROJECT

OHIO COUNTY REGIONAL
WASTEWATER DISTRICT

Item No. 2-20060.00
FD05 092 0062 009-011

TECHNICAL SPECIFICATIONS

June 2, 2022

Eric F. Hackworth, PE, PTOE
Digitally signed by Eric F. Hackworth, PE, PTOE
Date: 2022.06.21 11:53:09 -04'00'



PREPARED BY:

EA Partners, PLLC



CIVIL ENGINEERS • LAND SURVEYORS • LANDSCAPE ARCHITECTS

3111 WALL STREET
LEXINGTON, KENTUCKY 40513
PHONE (859) 296-9889
WWW.EAPARTNERS.COM

TABLE OF CONTENTS
TECHNICAL SPECIFICATIONS

		PAGE
Section A	General Provisions	TS 3
Section B	Force Mains	TS 10
Section C	Valves	TS 21
Section D	Maintenance of Sanitary Sewer Service	TS 24

TECHNICAL SPECIFICATIONS

SECTION A – GENERAL PROVISIONS

A.1 KENTUCKY DEPARTMENT OF HIGHWAYS - SPECIFICATIONS

Except as otherwise indicated on the Plans, and in the Contract Documents and Specifications, all items of Work including materials, construction methods, method of measurement and basis of payment shall comply with the current edition of the *Kentucky Department of Highways (KDOH) Standard Specifications for Road and Bridge Construction* and all current revisions.

A.2 ABBREVIATIONS

Abbreviations of standards, codes, and publications used within these Specifications are as follows:

ASTM	American Society of Testing and Materials
ANSI	American National Standard Institute
AWWA	American Water Works Association
KDOH	Kentucky Department of Highways, "Standard Specifications for Road and Bridge Construction", Current Edition
KYTC	Kentucky Transportation Cabinet

A.3 IDENTIFICATION OF PARTIES

OWNER – Ohio County Regional Wastewater District

ENGINEER – The Registered Professional Engineer designated by KYTC to oversee construction.

CONTRACTOR – The Contractor responsible under contract to KYTC to furnish labor, equipment, etc. to complete the work specified herein.

KENTUCKY TRANSPORTATION CABINET (KYTC) – The entity regulating the roadway and funding the utility relocation.

A.4 SCOPE

It is the intent that the CONTRACTOR, in accordance with the Plans, Contract Documents and Specifications, and other mutually acknowledged informational materials shall perform everything required to be performed and to furnish a complete, fully operating Work, and shall provide and furnish all labor, materials, necessary tools, expendable and non-expendable equipment and all transportation services required for the entire, proper, substantial completion of the Work, the cost of all of which shall be included in his bid.

This Specification sets forth several items of Work or conditions which are required as integral parts of the successful completion of the Project. All items discussed herein under General Provisions are considered incidental to the overall accomplishment of the Project and no separate payment shall be made therefore unless otherwise noted elsewhere in these specifications.

A.5 CONTRACTOR'S FACILITIES

A.5.1 Sanitary Facilities: The CONTRACTOR shall provide and maintain all necessary sanitary facilities at the site, in accordance with all applicable regulations, and shall properly remove same at completion of the Project.

A.5.2 Utilities: The obtaining of all utilities which may be required for construction shall be the responsibility of the CONTRACTOR.

A.6 CONTRACTOR'S FIELD OFFICE

A CONTRACTOR'S Field Office is not required for this project.

A.7 UTILITIES

The CONTRACTOR is to notify all utility companies prior to beginning construction operations.

It shall be the CONTRACTOR'S responsibility to locate all utilities, make appropriate arrangements regarding relocation, maintain utility service throughout the construction period, and make final relocations at the completion of the Work. The CONTRACTOR shall be responsible for any injury or damage to the existing utilities due to his operations whether shown or not shown in the plans. Where utilities are shown or indicated on the plans, the information given is in accordance with the best information in possession of the OWNER but is approximate only. The data is not warranted to be either complete or correct, and the CONTRACTOR shall assume all risks resulting from the conditions arising from the approximations shown.

The CONTRACTOR shall confer with the utility companies to inform them of the proposed construction schedule, verify the location and elevation of existing utilities and arrange for the relocation and adjustment of any facilities to avoid interference with the proposed construction. All such activities are to be performed under the direction of and with the approval of the ENGINEER.

When the various utility owners find it necessary to make adjustments to their lines where the CONTRACTOR is presently working, the CONTRACTOR is to move his operations to another area of Work so as not to interfere in any way with the utility company's Work.

Any utilities covered up or lost by the construction operations of the CONTRACTOR shall be uncovered and found by the CONTRACTOR and the new construction repaired and/or replaced as directed by the ENGINEER. No additional compensation will be allowed for such Work, nor shall any additional payment be allowed for the relocation and adjusting of any utility but shall be considered Incidentals to other Work.

The CONTRACTOR shall make a concerted effort to prevent any disruption of utility services, and if an unintended disruption occurs, the CONTRACTOR shall immediately and safely restore service. If disruption of any of the utility services covered in this section is unavoidable, it will be the responsibility of the CONTRACTOR to notify affected property owners. The CONTRACTOR shall also make every effort to restore said services before quitting Work for the day. In the event this cannot be done, the CONTRACTOR shall provide temporary service to the property owners until permanent service can be restored.

A.8 STAKING AND MARKING

The Contractor will furnish and be responsible for all staking necessary to control and complete the Work, according to the Specifications, to the lines and grades shown on the Plans. The Contractor's staking party shall be under the general supervision of a Licensed Professional Land Surveyor.

A.9 TESTING

From time to time during the progress of the Work, the ENGINEER may require that testing be performed to determine the materials provided meet the specified requirements. The OWNER will select a testing laboratory to perform the testing services. The cost of such services shall be the responsibility of the CONTRACTOR, unless otherwise directed.

A.9.1 Codes and Standards: Testing, when required, will be in accordance with all pertinent codes and regulations and with selected standards of the American Society for Testing and Materials.

A.9.2 Cooperation with the Testing Laboratory: Representatives of the testing laboratory shall have ready access to the Work at all times. The CONTRACTOR shall provide facilities for such access in order that the laboratory may properly perform its functions.

A.10 INSTALLATION REQUIREMENTS

Manufactured articles, materials and equipment shall be applied, installed, connected, erected, used, cleaned, and conditioned as suggested by the respective manufacturers, unless otherwise specified herein or directed by the ENGINEER.

A.11 PROOF OF COMPLIANCE

Whenever the Contract Documents require that a product be in accordance with Federal Specifications, ASTM Designations, ANSI Specifications, or other associations' standards, the CONTRACTOR shall present a certification from the manufacturer that the product complies therewith. When requested or specified, the CONTRACTOR shall submit supporting test data to substantiate compliance.

A.12 REPAIR OF DAMAGE

Any damage done to structures, fills, roadways, or other areas shall be repaired at the CONTRACTOR'S expense before final payment is made.

A.13 PROJECT EXTENT

The CONTRACTOR shall be responsible for satisfying himself as to the construction limits for the Project. The CONTRACTOR shall not establish Work, storage, or staging area outside the Project limits, unless otherwise directed or approved by the ENGINEER.

A.14 WORKING HOURS

Working hours shall be defined by KYTC.

A.15 GUARANTEE

The CONTRACTOR shall assume responsibility for all workmanship and materials for a period of one year from final payment. Any Work found to be defective due to failure to comply with the provision and intent of the Contract Documents, Specifications, and Plans shall be replaced at the CONTRACTOR'S expense.

A.16 PROPERTY CONSIDERATION

Materials having a salvage value shall remain the property of the OWNER. Salvageable material rejected by the OWNER shall become the responsibility of the CONTRACTOR to dispose of in a proper manner subject to the approval of the ENGINEER.

A.17 BLASTING

Blasting is prohibited on this project.

A.18 HAZARDOUS MATERIAL - GAS LINES

The CONTRACTOR is advised to exercise caution in his operations on this project, regardless of whether the plans indicate or do not indicate the presence of any gas or hazardous materials carrying lines.

A.19 DIVERSION OF STORM WATER

Appropriate measures must be taken to sandbag the necessary manholes and to pump drainage around the area under construction. The CONTRACTOR is responsible for developing a plan to divert storm drainage around the construction area with the approval from the ENGINEER. Materials, labor, and all incidentals necessary to accomplish this diversion of storm drainage will be considered incidental to the contract.

A.20 RESIDENTIAL SEWER SERVICE MAINTENANCE

This Work shall consist of maintaining existing sanitary sewer service to residents in the area during construction. Sewage is to be maintained by whatever means necessary. No surcharge of manholes will be allowed. No separate payment will be made for Sewer Service Maintenance. Sewer Service Maintenance shall include all materials, equipment, and labor necessary to maintain sewer service to residents during construction.

A.21 SHOP DRAWINGS

The CONTRACTOR shall submit for the review of the ENGINEER Shop Drawings for all fabricated work and for all manufactured items required to be furnished in the Contract and as specified herein. Shop Drawings shall be submitted in sufficient time to allow at least

twenty-one (21) calendar days, after receipt of the Shop Drawings from the CONTRACTOR, for checking and processing by the ENGINEER.

ENGINEER's review of the CONTRACTOR's drawings shall be considered as a gratuitous service, given as assistance to the CONTRACTOR in interpreting the requirements of the Contract, and in no way shall it relieve the CONTRACTOR of any of his responsibilities under the Contract.

Any fabrication, erection, setting, or other Work done in advance of the receipt of Shop Drawings returned by the ENGINEER and noted as "No Exception Taken" or "Make Corrections as Noted" shall be entirely at the CONTRACTOR's risk. The ENGINEER's review will be confined to general arrangement and compliance with the design concept and Specifications only, and will not be for the purpose of checking dimensions, weights, clearances, fitting, tolerances, interferences, coordination of trades, etc.

Unless otherwise stated elsewhere in the Contract Drawings or directed by the Engineer, a total of six (6) copies of all reviewed Shop Drawings shall be furnished to the ENGINEER for his use in accordance with the following sequence of operations:

- A) Initially six copies and one (1) reproducible copy shall be submitted to the Engineer for review. The ENGINEER will return one (1) copy and the reproducible copy to the CONTRACTOR after review.
- B) When Shop Drawings are returned for correction, they shall be immediately corrected and resubmitted for review as described above, and such procedures will not be considered as grounds for delay in completing the Work.
- C) Shop Drawings submitted by subcontractors shall be sent directly to the CONTRACTOR for preliminary checking. The CONTRACTOR shall be responsible for their submission to the ENGINEER at the proper time to prevent delays in delivery of materials.
- D) The CONTRACTOR shall thoroughly check all subcontractor's Shop Drawings regarding measurements, sizes of members, materials, and details to satisfy himself that they conform to the intent of the Specifications. Drawings found to be inaccurate or otherwise in error shall be returned to the subcontractors by the CONTRACTOR for correction before submitting them to the ENGINEER. Before submission, the CONTRACTOR shall mark (stamp) the drawings as being checked and approved by him, dated, and signed. The CONTRACTOR's approval (stamp) shall constitute a representation that all quantities, dimensions, field construction criteria, materials, catalog numbers, performance criteria and similar data have been verified and that, in his opinion, the submittal fully meets the requirements of the Contract Documents and the scope of work involved. Shop Drawings that are not stamped will not be reviewed.

- E) All details on Shop Drawings submitted for review shall clearly show the relation of the various parts and where the Work depends upon field measurements, such measurements shall be obtained by the CONTRACTOR and noted on the Shop Drawings before being submitted to the ENGINEER for review.
- F) All submissions shall be properly referenced to clearly indicate the specification section, location, service, and function of each particular item. All submissions for one item or group of related items shall be complete. The ENGINEER reserves the right to reject manufacturer's publications in the form of catalogues, pamphlets, or other data sheets when they are submitted in lieu of prepared Shop Drawings. Such submissions shall specifically indicate the item for which approval is requested. Identification of items shall be made in ink, and submissions showing only general information are not acceptable.
- G) If the Shop Drawings contain any departures from the Contract requirements, specific mention thereof shall be made in the CONTRACTOR's letter of transmittal. Where such departures require revisions to layouts or structural changes to the Work, the CONTRACTOR shall, at his own expense, prepare and submit for approval revised layout and structural drawings. Such drawings shall be of the size approved by the ENGINEER.
- H) All shop drawings shall be in English.

A.22 RECORD DRAWINGS

The Record Drawings shall consist of the Contract Drawings (3 mil mylar, updated to 'As Built' conditions) and the approved Shop Drawings in reproducible form (3 mil mylar) and shall be submitted to the ENGINEER at any time upon request during construction, but no later than the Final Inspection.

Contract Drawings and Shop Drawings shall be legibly marked to record actual construction including:

- A) All deviations in location or elevation of any underground installation from that shown on the Contract Drawings.
- B) Any significant changes in above ground installation from approved Shop Drawings or Contract Drawings.
- C) No such deviations from the Contract Drawings or approved Shop Drawings shall be made without approval by the ENGINEER.

Specifications and addenda shall be legibly marked up to record:

- A) Manufacturer, trade name, catalog number, and Supplier of each product and item of equipment actually installed.
- B) Changes made by Change Order or Field Order.
- C) Other matters not originally specified.

- THE END -

SECTION B – FORCE MAINS

B.1 SCOPE

Furnish all labor, materials, equipment, and incidentals necessary to install and test pipe and fittings as shown on the Drawings and required by the Specifications.

Piping shall be located as shown. The ENGINEER reserves the right to make such modifications in locations as may be found desirable to avoid interference between pipes or for other reasons. Pipe fitting notation is for the CONTRACTOR'S convenience and does not relieve him from laying and jointing different or additional items where required without additional compensation.

Wherever the word pipe or piping is used it shall mean pipe and fittings unless otherwise noted.

B.2 DESCRIPTION OF SYSTEM

Piping shall be installed as shown on the Drawings to form a complete smooth flow path and workable system. The piping and materials specified herein are intended to be standard types of pipe for use in transporting the fluids as indicated on the Drawings. The pipe and fittings shall be designed, constructed, and installed in accordance with the best practices and methods and the manufacturer's recommendations.

B.3 QUALIFICATIONS

All pipe and fittings under this section shall be furnished by manufacturers who are fully experienced, qualified, and regularly engaged in the manufacture of the materials to be furnished.

B.4 SUBMITTALS

Submit to the ENGINEER within 30 days after execution of the Contract a list of materials to be furnished, the names of the suppliers and the approximate date of delivery of materials to the site.

B.5 INSPECTION

The manufacturer shall inspect all pipe joints for out-of-roundness and pipe ends for squareness.

B.6 POLYVINYL CHLORIDE (PVC) PIPE AND FITTINGS (FORCE MAINS)

B.6.1 GENERAL

PVC pipe used for force main applications shall comply with ANSI/AWWA C900 Standard for PVC water transmission pipe, nominal diameters 4" through 12" and ANSI/AWWA C905, Standard for PVC Water Transmission Pipe, Nominal Diameters 14 inch through 36 inch. AWWA C905 pipe shall have a minimum pressure rating of 200 psi (DR 21).

PVC pipe shall be made from Class 12454A or 12454B Virgin Compounds as defined in ASTM D1784, with an established hydrostatic design basis of 4000 psi for water at 73.4°C. Clean rework material generated by the manufacturer's own production may be used if the pipe produced satisfied all requirements of this specification.

Elastomeric gaskets shall comply with the requirements specified in ASTM F477.

The lubricant used for joint assembly shall be a water-soluble lubricating agent which will not support bacterial growth and will not adversely affect the potable qualities of the water to be transported. The lubricant shall not be detrimental to the gasket or the pipe.

The manufacturer shall, upon written request by the purchaser, furnish an affidavit that all basic materials used in pipe production meet the requirements of this recommended standard.

The PVC compound used to manufacture pipe and joints shall contain no ingredient or contaminant that is in an amount that has been demonstrated to migrate into water in quantities considered to be toxic.

The PVC compound used in the pipe shall be tested for chemical extractants and certified as suitable for potable-water applications by an accredited testing agency. Testing shall be performed in accordance with requirements no less restrictive than the applicable chemical extractant requirements specified in the latest edition of NSF Standard No. 14.

Pipe shall be homogenous throughout. It shall be free from voids, cracks, inclusions, and other defects. It shall be uniform as commercially practical in color, density, and other physical properties. Pipe surfaces shall be free from nicks and scratches. Joining surfaces of spigots and joints shall be free from gouges and imperfections that could cause leakage.

Pipe shall be nominal sizes and dimension ratio as shown on the Drawings or specified elsewhere. Pipe outside diameters shall be consistent with cast iron pipe outside diameters.

B.6.2 QUALITY CONTROL RECORDS

The manufacturer shall maintain for a period of not less than two years a record of all quality control tests and shall, if requested, submit the pertinent record to the purchaser.

B.6.3 MARKINGS

Pipe and couplings shall bear identification markings that will remain legible during the normal handling, storage, and installation. Markings shall be applied in a manner that will not

weaken or damage the pipe or coupling. Marking shall be applied at intervals of not more than five (5) feet on the pipe.

Marking on the pipe and coupling shall include the following:

- a. Nominal size and OD base (e.g. 24 CI)
- b. PVC
- c. Dimension ratio and pressure rating (e.g. DR25 PR165)
- d. AWWA C-905 or AWWA C-900
- e. Manufacturer's name or trademark
- f. Manufacturer's production code to include day, month, year, shift, plant, and extruder of manufacture.
- g. Certification seals pertaining to entire documents or specific sections, if desired or requested.

B.6.4 STEEL ENCASUREMENT PIPE

- A. Shall be new, steel, plain end, uncoated and unwrapped, have a minimum yield strength of 35,000 psi and conform to ASTM A139 Class B. The steel pipe shall have continuously welded joints and be furnished in at least 18-foot lengths.

Encasement Pipe Size	Minimum Wall Thickness
30 “	0.500”

B. CASING SPACERS

- 1. Shall be Polyethylene, Raci Spacers or Equivalent.
- 2. End seals shall be EPDM Membrane.

B.6.5 DUCTILE IRON MECHANICAL JOINT FITTINGS

- A. All fittings shall be Ductile Iron mechanical joint, Class 250, meeting ANSI/AWWA C110/A 21.10 and ANSI/AWWA C111/A21.11 standards. Mechanical joint fittings shall have cement-mortar lining and coated with asphaltic material, inside and outside, in accordance with ANSI/AWWA C104/A21.4.

B.6.6 DUCTILE IRON JOINT RESTRAINTS

- A. Mechanical joint restraints shall be Ductile Iron, conforming to ASTM A536, EBAA Iron Series 2000PV Megalug or approved equivalent.

B. 7 PRESSURE PIPE INSTALLATION - GENERAL

B.7.1 GENERAL

- A. Pipe shall be handled with such care as necessary to prevent damage during installation. The interior of the pipe shall be kept clean, and the pipe shall be installed to the lines and grades shown on the Drawings. Whenever pipe laying is stopped, the end of the pipe shall be securely plugged or capped. Care should be taken to prevent flotation of pipe in the event the trench should flood.
- B. Fittings shall be firmly blocked to original earth or rock to prevent water pressure from springing pipe sideward or upward. Concrete or other blocking material shall be placed such that it does not cover the pipe joints, nuts, and bolts.
- C. Pipes shall be free of all structures other than those planned. Openings and joints to concrete walls shall be constructed as shown on the Drawings.

B.7.2 TRENCH EXCAVATION

- A. All trenching and backfill necessary for installation of all pipelines as planned and specified shall be incidental to the bid items for pipeline. Trenching shall include clearing and grubbing of all trash, weeds, briars, trees and stumps encountered in the trenching. The CONTRACTOR shall dispose of such material at no extra cost to the OWNER. Trenching also includes such items as railroad, street, road, sidewalk, pipe, and small creek crossings, cutting, moving, or repairing damage to fences, posts, gates, and other surface structures regardless of whether shown on the Drawings.
- B. All existing facilities shall be protected from danger or damage while pipelines are being constructed and backfilled, and from damage due to settlement of the backfill.
- C. In the event any existing structure is damaged, repair and restoration shall be made at once and backfill shall not be replaced until this is done. Restoration and repair shall be such that the damaged structure is equal to or better than its original condition and can serve its purpose as completely as before. All such restoration and repair shall be done to the satisfaction of the ENGINEER without extra cost to KYTC or the OWNER.
- D. Trenches must be dug to lines and grades shown on the Drawings. Hand trenching may be required in areas where machine trenching would result in damage to existing structures and facilities.
- E. Excavation shall be open trenches, except where otherwise shown on the Drawings, for tunneling, boring, or jacking under structures, railroad, sidewalks and roads.

- F. Sheeting and shoring of trenches shall be provided at the expense of the CONTRACTOR where necessary to protect life, property and the new or existing structures from damage or to maintain maximum permissible trench widths at top of pipe. All necessary materials, including but not limited to, sheeting sheet piling, trench jacks, braces, shores, and stringers, shall be used to hold trench walls. Sheeting and shoring may be withdrawn as the trenches are being backfilled, after backfill has been tamped over top of the pipe at least 18 inches. If removal before backfill is completed to surface endangers adjacent structures, such as buildings, pipelines, street paving, and sidewalks, then the sheeting and shoring shall be left in place until such danger has passed, and then pulled if practical. Voids caused by sheeting withdrawal shall be backfilled and tamped. If not withdrawn, sheeting shall be cut off at least 18 inches below final surface grade, so there is no obstruction at the ground level.
- G. Where subgrade of trench has insufficient stability to support the pipeline and hold it to its original grade, the ENGINEER may order special stabilization by various means. Exclusion of dewatering normally required for construction, and instability caused by neglect of the CONTRACTOR, the necessary stabilization shall be paid for at unit prices set up in the Contract. In the event no particular bid price is applicable, then the payment for stabilization will be negotiated.
- H. The location of the pipelines and their appurtenances as shown are those intended for the final construction. However, conditions may present themselves before construction of any line is started that would indicate desirable changes in location. The OWNER reserves the right to make reasonable changes in line and structure locations without extra cost, except as may be determined by extra units of materials and construction actually involved. The OWNER is under no obligation to locate pipelines, so they may be excavated by machine.
- I. Dig trenches to the uniform width required for particular item to be installed, sufficiently wide to provide ample working room. Provide 6" minimum clearance on both sides of pipe.
1. Excavate trenches to depth indicated or required. Carry depth of trenches for piping to establish indicated flow lines and invert elevations. Beyond building perimeter, keep bottoms of trenches sufficiently below finish grade to avoid freeze-ups.
 2. Where rock is encountered, carry excavation 6 inches below required elevation and backfill with a 6-inch layer of #9 crushed stone prior to installation of pipe.
 3. Grade bottoms of trenches as indicated to provide solid bearing for entire body of pipe.

4. Backfill trenches with concrete where trench excavations pass within 18 inches of column or wall footings and which are carried below bottom of such footings, or which pass under wall footings. Place concrete to level of bottom of adjacent footing.
5. Do not backfill trenches until tests and inspections have been made and backfilling authorized by the ENGINEER. Use care in backfilling to avoid damage or displacement of pipe systems.
6. COLD WEATHER PROTECTIONS: Protect excavation bottoms against freezing when atmospheric temperature is less than 35°F (1°C).

B.7.3 TRENCH BACKFILL

- A. Backfilling shall be accomplished as soon as practical after pipe has been laid and jointing and alignment approved. Packing of crushed rock between joints shall be the usual procedure as the laying progresses. This is to avoid danger of misalignment from slides, flooding, or other causes. The ENGINEER shall be given a maximum of 24 hours for inspection before backfilling.
- B. Any special requirements of a Railroad Company or Highway Department in regard to backfilling will take precedence over the following general Specifications.
- C. When the pipe trench crosses a street or roadway, the CONTRACTOR shall be responsible for maintaining the trench surface in a level condition at proper pavement grade at all times, unless indicated otherwise in the plans.
- D. In all cases walking or working on the completed pipelines except as may be necessary in tamping or backfilling will not be permitted until the trench has been backfilled to a point one foot above the top of the pipe. The filling of the trench and the tamping of the backfill shall be carried on simultaneously on both sides of the pipe in such a manner that the completed pipeline will not be disturbed and injurious side pressures do not occur.
- E. FOR BACKFILL UNDER ROADWAY: After installation and testing of piping, fill trench with flowable fill from the flowline of the trench to the bottom of the existing or proposed roadway pavement elevation. The upper portion of the trench from a point at the bottom of the existing or proposed pavement may be backfilled with a base course of dense graded aggregate which shall be maintained flush with the pavement surface for at least 30 days prior to placement of the final surface. The excess dense graded aggregate shall be removed concurrently with the placement of the final pavement surface.

- F. Settlement of Trenches - Wherever pipelines are in, or across, driveways and streets, the CONTRACTOR shall be responsible for any trench settlement which occurs within these rights-of-way within one year from the time of final acceptance of the work. If paving shall require replacement because of trench settlement within this time, it shall be replaced at the CONTRACTOR'S expense. Repair of settlement damage shall meet the approval of the ENGINEER.
- G. The CONTRACTOR shall protect all sewer, gas, electric, telephone, water, and drainpipes or conduits from damage while pipelines are being constructed and backfilled, and from danger due to settlement of trench backfill.
- H. No payment shall be made for backfilling of any kind. Backfilling shall be incidental to the pipeline installation.

B.7.4 PIPE BEDDING

Stone for bedding and backfilling pipe in earth and for bedding on solid rock shall be No. 9 crushed stone.

B.7.5 PRESSURE PIPE LAYING

- A. Pressure pipe shall first be thoroughly cleaned at joints, then joined according to instructions and with tools recommended by the manufacturer. A copy of such instructions shall be available at all times at the site of the work.
- B. All pipes must be forced and held together, or "homed" at the joints, before sealing or bolting. Pipe must be aligned as each joint is placed, so as to obtain straight lines and grades. Curves and changes in grades shall be laid in such a manner that maximum allowable joint deflection is not exceeded.
- C. Trench excavation for pipe laying must be of sufficient width to allow the proper jointing and alignment of the pipe. Trenches in earth or rock shall be dug deep enough to insure 36" minimum cover over top of the pipe, unless otherwise indicated on the Drawings.
- D. Trench line stations shall be set ahead of the trenching at least each 100 feet of pipeline. Trenches shall be dug true to alignment of stakes. Alignment of trenches or pipes in trench must not be changed to pass around obstacles such as poles, fences and other evident obstructions without the approval of the ENGINEER. Lines will be laid out to avoid obstacles as far as possible, consistent with maintenance of alignment necessary to finding the pipeline in the future and avoiding obstruction of future utilities and structures.

- E. Cut pieces of pressure pipe 18" or more in length may be used in fitting to the specials and valves and fitting changes in grade and alignment. Cut ends shall be even enough to make first class joints. Sufficient excavation for bell holes will be required for tightening of bolts. No pipe shall be laid resting on rock, blocking, or other unyielding objects except where laid above ground on piers or in permanent tunnels.

B.7.6 TESTING PRESSURE PIPE

- A. The CONTRACTOR shall furnish all necessary equipment for pressure testing.
- B. All test waters shall be potable water and paid for by the Contractor.
- C. Relocated force main shall be hydrostatically pressure tested to minimum pressure of 150 psi for a duration of two hours. Pipe will be accepted if pressure does not fall more than 5 psi during the two-hour test period. In conjunction with the hydrostatic test, a leakage test shall be conducted at the same pressure and for the same period of time. Leakage test shall conform to AWWA C600 or C605, as applicable. OCRWD personnel or their representative shall witness all tests.
- G. CONTRACTOR shall furnish a recording pressure gage and water meter for measuring water used during the leakage test. Recording pressure charts shall be submitted to the Engineer and the Owner. The pressure recording device shall be suitable for outside service, with a range from 0-200 psi, 24 hour spring wound clock, designed for 9 inch charts, and shall be approved by the ENGINEER.
- H. Where leaks are visible at exposed joints and/or evident on the surface where joints are covered, the joints shall be recaulked, repoured, bolts tightened or re-laid and leakage minimized, regardless of total leakage as shown by test.
- I. All pipe, fittings and other materials found to be defective under test shall be removed and replaced.
- J. Lines which fail to meet tests shall be repaired and retested as necessary until test requirements are complied with.
- K. Where nonmetallic joint compounds are used, pipelines should be held under normal operating pressure for at least three days before testing.

B.8 DETECTABLE UNDERGROUND UTILITY WARNING TAPES

Detectable underground utility warning tapes which can be located from the surface by a pipe detector shall be installed directly above non-metallic (PVC, polyethylene, concrete) pipe.

The tape shall consist of a minimum thickness 0.35 mils solid aluminum foil encased in a protective inert plastic jacket that is impervious to all know alkalis, acids, chemical reagents, and solvents found in the soil.

The minimum overall thickness of the tape shall be 5.5 mils and the width shall not be less than 2" with a minimum unit weight of 2-1/2 pounds/1" x 1000'. The tape shall be color coded and imprinted with the message as follows:

<u>Type of Utility</u>	<u>Color Code</u>	<u>Legends</u>
Water	Safety Precaution Blue	Caution Buried Water Line Below
Gravity Sewer	Safety Green	Caution Buried Sewer Line Below
Force Main	Safety Brown	Caution Buried Sanitary Force Main

Detectable underground tape shall be "Detect Tape" as manufactured by Allen Systems, or equal.

Installation of detectable tapes shall be per manufacturer's recommendations and shall be as close to the grade as is practical for optimum protection and detectability. Allow a minimum of 18" between the tape and the line.

Payment for detectable tapes shall be included in the linear foot price bid of the appropriate bid item(s) unless it is listed as a separate payment item in the bid schedule.

B.9 BLASTING

Blasting is prohibited on this project.

B.10 METHOD OF MEASUREMENT

B.10.1 S ENCASEMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

B.10.2 S FORCE MAIN This description shall apply to all PVC and ductile iron and polyethylene/plastic pipe bid items of every size and type. This item includes the pipe specified by the plans and specifications, all fittings

(including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall also include pipe anchors on polyethylene pipe runs as shown on the plans or required by the specifications to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

- B.10.3 S FORCE MAIN TIE-IN This bid description shall be used for all force main tie-in bid items of every size. This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, testing and backfill required to make the force main tie-in as shown on the plans and in accordance with the specifications complete and ready for use. This bid item shall include purge and sanitary disposal of any sewage from any abandoned segments of force main. Pipe for tie-ins shall be paid under separate bid items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.
- B.10.4 S STRUCTURE ABANDON This item is to be used to pay for abandonment of larger above or below ground sewer structures such as air release/vacuum valve vaults, pump stations, tanks, etc. Payment under this time shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to sewer construction, (i.e., abandonment of standard air release/vacuum valves up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, compacted fill or flowable fill, and safeloading for abandonment of the structure in place and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

B.11 BASIS OF PAYMENT

Payment will be made under:

PAY ITEM		PAY UNIT
15019	S ENCASEMENT STEEL BORED RANGE 6	LF
15068	S FORCE MAIN SPECIAL (18 IN PVC)	LF
15081	S FORCE MAIN TIE IN SPECIAL (18 IN)	EA
15121	S STRUCTURE ABANDON	EA

SECTION C - VALVES

C.1 SUMMARY OF WORK

Furnish labor, materials and equipment required to install valves, fittings, valve boxes, and all other necessary accessories.

C.2 REFERENCES

ANSI/AWWA C500 - Gate Valves, 3 inch through 48 inches, for Water and Sewage Systems

ANSI/AWWA C111 - Rubber Gasket Joints for Ductile Iron and Gray Iron Pressure Pipe and Fittings

ANSI/AWWA C110 - Ductile Iron and Gray Iron Fittings, 3 inch through 48 inch, for Water and other liquids

ANSI/AWWA C153 - Ductile Iron Compact Fittings, 3 inch through 12 inch, for Water and other liquids

ANSI/AWWA C509 - Resilient Seated Gate Valves for Water and Sewage Systems

C.3 SUBMITTALS

Submit product data in accordance with General Conditions.

C.4 QUALITY ASSURANCE

Perform Work in accordance with AWWA standards.

The manufacturers name and pressure rating shall be marked on the body of all valves.

C.5 DELIVERY, STORAGE, AND HANDLING

Deliver and store valves in shipping containers with labeling in place.

C.6 PRODUCTS - GENERAL

All valves shall be furnished with the same joint connection as the supply line or as indicated on the Drawings.

All valves shall be nut operated for underground service, unless otherwise shown on the plans. All nuts shall be located within 2 feet of finished grade (unless plans indicate otherwise) and shall be capable of withstanding an overload input torque of 450 ft. lbs. at full-open or closed position without damage to the valve or valve operator.

Valve boxes shall be of cast iron, two or three pieces, slip type consisting of a base, a center section, and a top section with a cover marked water.

The CONTRACTOR shall provide two nut wrenches for the operation of the valves to be installed.

C.7 GATE VALVES

Manufacturers: Subject to compliance with requirements, manufactures offering gate valves which may be incorporated in the Work include, but are not limited to, the following:

- A. M & H Valve Co. - AWWA C509 Resilient Seated Gate Valve
- B. Clow Corp. - AWWA R/W Resilient Seated Wedge Valves
- C. Mueller Co. - Super Seal Resilient Valve

All gate valves shall be of the iron body, bronze mounted, resilient seated type.

All resilient seated gate valves shall conform in all respects to ANSI/AWWA C509 with non-rising stems suitable for working pressures of 150 psi.

All valves shall be protected with epoxy coating on all exterior surfaces, applied in accordance with ANSI/AWWA C550.

C.8 SEWAGE AIR RELEASE VALVE

Sewage air release valve and valve box shall be installed at the points in the force main from the pump station as shown and detailed on the Drawings.

The valve shall be a stainless steel, ARI Model D-025 Short Version, with a 4-inch flanged inlet and a 1.5-inch discharge orifice.

A 4-inch manual isolation valve with flagged inlets/outlets is required under air release valves inlet port.

A stainless-steel tapping sleeve with flanged 4-inch outlet shall be used to connect the isolation valve/air release valve to the force main. Tapping Sleeve shall be Romac or approved equal.

C.9 INSTALLATION

Valves shall be installed at locations indicated on Drawings. Where the Drawings do not specifically indicate a valve size, valves shall be same diameter as pipe it serves.

All valves shall be installed with stems vertical unless plan indicate otherwise.

Valves shall operate freely without binding or sticking in any position from fully open to fully closed.

Valves that are to be for underground service shall be bedded and backfilled according to the requirements of the supply line.

Center and plumb valve boxes over valve. Set box cover flush with finished grade.

Protect valve boxes, not protected by concrete slabs, with a 12" diameter RCP, 18" long sit 2" above finished grade.

C.10 METHOD OF MEASUREMENT

C.10.1 S FORCE MAIN AIR RLS/VAC VLV This bid item description shall apply to all force main air release/vacuum valve installations of every. This item shall include the air release/vacuum valve, main to valve connecting sleeve, isolation valve, manhole/vault/structure, access casting or doors, tapping the main, labor, equipment, excavation, proper backfill and restoration required to install the air release/vacuum valve at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. All air release/vacuum valves on a project shall be paid under one bid item regardless of size. No separate pay items will be established for size variations. Only in the case of the uniqueness of a particular air release/vacuum valve would a separate bid item be established. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

C.11 BASIS OF PAYMENT

Payment will be made under:

PAY ITEM	PAY UNIT
15028 S FORCE MAIN AIR PLS/VAC VLV 04 INCH	EA

SECTION D – MAINTENANCE OF SANITARY SEWER SERVICE

D.1 SUMMARY OF WORK

Sanitary sewer service must be maintained at all times. Construction staging / sequence may require temporary bypass measures. Current pumping rates from the Beaver Dam Pump Station are 1,100 to 2,200 gallons per minute (GPM) with a single pump, and 2,700 GPM with two large pumps running. Required bypass pumping rates should be assumed to vary from 1,100 to 2,700 GPM. If possible, OCRWD will pump down Beaver Dam P.S. wet wells prior to CONTRACTOR beginning work. Estimated allowable shutdown time for Beaver Dam P.S. is 3-4 hours depending on wet weather flow and time of day. CONTRACTOR shall provide bypass pumping as necessary until Beaver Dam P.S. is returned to service.

The CONTRACTOR shall submit a detailed maintenance of sanitary sewer service plan that minimizes disruptions to normal operations and receive prior written approval from the ENGINEER and the OWNER before commencing any temporary shutdown, bypass construction, or pumping operation. Payment under the bid item "S BYPASS PUMPING" shall include all labor, equipment, materials, and incidentals needed to complete a shutdown, bypass pumping and/or hauling operation for diversion of sewage during sanitary sewer construction.

The force main relocation plans sheet includes an example bypass based on "hot taps" & line stops. This example is for information only and shall not be treated as an engineered design. If line stopping is performed, the CONTRACTOR shall submit a detailed plan of the line stop fittings/valves and thrust restraints. Thrust block calculations should be submitted based on the flow rate and pressure, to ensure restraints are adequate. The standard thrust block details in this plan are insufficient for line stop applications. The CONTRACTORS plan shall bear the stamp of a professional engineer registered in the state of Kentucky.

Extended by-pass pumping operations should be kept to a minimum. Disruption to the public from the use of mechanical equipment / generators shall be minimized and not exceed the time period agreed to by the CONTRACTOR, the OWNER, and the ENGINEER. The discharge of foreign materials or liquids other than sanitary sewer flows into the owner's sanitary sewer system will not be allowed. The contractor must take all precautions and measures to avoid surface water runoff into the existing sanitary sewer systems. Accidental discharge of foreign material or liquids or surface water runoff shall immediately be reported to the engineer.

D.2 METHOD OF MEASUREMENT

D.2.1 S BYPASS PUMPING This item shall include all labor, equipment, and materials needed to complete a bypass pumping and/or hauling operation for diversion of sewage during sanitary sewer construction. Examples of such operations when bypass pumping and/or hauling may be necessary is during force main tie-ins, manhole invert reconstruction, insertion of new manholes into existing mains, or other similar construction. There may be more than one bypass pumping/hauling operation on a project. This item shall be paid for each separate bypass pumping/hauling operation location as called out on the plans or directed by the engineer and actually performed. There will be no separate bid items defined for length, duration, or volume of sewage pumped or hauled in each occurrence. If a bypass pumping/hauling operation is called out on the plans, but conditions are

such that the bypass pumping/hauling operation is not needed or utilized, no payment will be made under this item. The contractor shall draw his own conclusions as to what labor, equipment, and materials may be needed for each bypass pumping/hauling occurrence. The contractor should be prepared to handle the maximum volume of the sewer being bypassed, even during a storm event. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA).

D.3 BASIS OF PAYMENT

Payment will be made under:

PAY ITEM	PAY UNIT
15000 S BYPASS PUMPING	EA

KyTC BMP Plan for Project CID ## - #####



Kentucky Transportation Cabinet

Highway District 2 (1)

And

_____ (2), Construction

**Kentucky Pollutant Discharge Elimination System
Permit KYR10**

Best Management Practices (BMP) plan

Groundwater protection plan

For Highway Construction Activities

For

**Reconstruction of Drainage Improvements, Curb
and Gutter, and Resurfacing US 62 MP 9.731 to
MP 10.59 in Ohio County (1)**

Project: CID ## - #####

KPDES BMP Plan - Page 1 of 14

Revised 3/4/2016

KyTC BMP Plan for Project CID ## -

Project information

Note – (1) = Design (2) = Construction (3) = Contractor

1. Owner – Kentucky Transportation Cabinet, District 2 (1)
2. Resident Engineer: (2)
3. Contractor name: (2)
Address: (2)

Phone number: (2)
Contact: (2)
Contractors: agent responsible for compliance with the KPDES permit requirements (3):
4. Project Control Number (2)
5. Route (Address) US 62(North Main St.) MP 9.731 to MP 10.59(1)
6. Latitude/Longitude (project mid-point) 37d 24' 17"N, -86d 52'33"W (1)
7. County (project mid-point) Ohio (1)
8. Project start date (date work will begin): (2)
9. Projected completion date: (2)

KyTC BMP Plan for Project CID ## -

A. Site description:

1. Nature of Construction Activity (from letting project description)
RECONSTRUCTION OF DRAINAGE IMPROVEMENTS, CUB AND GUTTER AND RESURFACING US 62 MP 9.731 TO MP 10.59 IN BEAVER DAM, OHIO COUNTY, KY (1)
2. Order of major soil disturbing activities (2) and (3)
3. Projected volume of material to be moved 8,224 CY (1)
4. Estimate of total project area (acres) XXX (1)
5. Estimate of area to be disturbed (acres) XXX (1)
6. Post construction runoff coefficient will be included in the project drainage folder. Persons needing information pertaining to the runoff coefficient will contact the resident engineer to request this information. (1)
7. Data describing existing soil condition (1) & (2) See Geotech report if available. See Roadway Plans.
8. Data describing existing discharge water quality (if any) No existing water quality information available (1) & (2)
9. Receiving water name Threelick Fork (1)
10. TMDLs and Pollutants of Concern in Receiving Waters: (1 DEA)
11. Site map – Project layout sheet plus the erosion control sheets in the project plans that depict Disturbed Drainage Areas (DDAs) and related information. These sheets depict the existing project conditions with areas delineated by DDA (drainage area bounded by watershed breaks and right of way limits), the storm water discharge locations (either as a point discharge or as overland flow) and the areas that drain to each discharge point. These plans define the limits of areas to be disturbed and the location of control measures. Controls will be either site specific as designated by the designer or will be annotated by the contractor and resident engineer before disturbance commences. The project layout sheet shows the surface waters and wetlands.
12. Potential sources of pollutants:

KyTC BMP Plan for Project CID ## -

The primary source of pollutants is solids that are mobilized during storm events. Other sources of pollutants include oil/fuel/grease from servicing and operating construction equipment, concrete washout water, sanitary wastes and trash/debris. (3)

B. Sediment and Erosion Control Measures:

1. Plans for highway construction projects will include erosion control sheets that depict Disturbed Drainage Areas (DDAs) and related information. These plan sheets will show the existing project conditions with areas delineated by DDA within the right of way limits, the discharge points and the areas that drain to each discharge point. Project managers and designers will analyze the DDAs and identify Best Management Practices (BMPs) that are site specific. The balance of the BMPs for the project will be listed in the bid documents for selection and use by the contractor on the project with approval by the resident engineer.

Projects that do not have DDAs annotated on the erosion control sheets will employ the same concepts for development and managing BMP plans.

2. Following award of the contract, the contractor and resident engineer will annotate the erosion control sheets showing location and type of BMPs for each of the DDAs that will be disturbed at the outset of the project. This annotation will be accompanied by an order of work that reflects the order or sequence of major soil moving activities. The remaining DDAs are to be designated as "Do Not Disturb" until the contractor and resident engineer prepare the plan for BMPs to be employed. The initial BMP's shall be for the first phase (generally clearing and grubbing) and shall be modified as needed as the project changes phases. The BMP Plan will be modified to reflect disturbance in additional DDA's as the work progresses. All DDA's will have adequate BMP's in place before being disturbed.
3. As DDAs are prepared for construction, the following will be addressed for the project as a whole or for each DDA as appropriate:
 - Construction Access – This is the first land-disturbing activity. As soon as construction begins, bare areas will be stabilized with gravel and temporary mulch and/or vegetation.
 - At the beginning of the project, all DDAs for the project will be inspected for areas that are a source of storm water pollutants.

KyTC BMP Plan for Project CID ## -

Areas that are a source of pollutants will receive appropriate cover or BMPs to arrest the introduction of pollutants into storm water. Areas that have not been opened by the contractor will be inspected periodically (once per month) to determine if there is a need to employ BMPs to keep pollutants from entering storm water.

- Clearing and Grubbing – The following BMP's will be considered and used where appropriate.
 - Leaving areas undisturbed when possible.
 - Silt basins to provide silt volume for large areas.
 - Silt Traps Type A for small areas.
 - Silt Traps Type C in front of existing and drop inlets which are to be saved
 - Diversion ditches to catch sheet runoff and carry it to basins or traps or to divert it around areas to be disturbed.
 - Brush and/or other barriers to slow and/or divert runoff.
 - Silt fences to catch sheet runoff on short slopes. For longer slopes, multiple rows of silt fence may be considered.
 - Temporary Mulch for areas which are not feasible for the fore mentioned types of protections.
 - Non-standard or innovative methods.
- Cut & Fill and placement of drainage structures - The BMP Plan will be modified to show additional BMP's such as:
 - Silt Traps Type B in ditches and/or drainways as they are completed
 - Silt Traps Type C in front of pipes after they are placed
 - Channel Lining
 - Erosion Control Blanket
 - Temporary mulch and/or seeding for areas where construction activities will be ceased for 21 days or more.
 - Non-standard or innovative methods
- Profile and X-Section in place – The BMP Plan will be modified to show elimination of BMP's which had to be removed and the addition of new BMP's as the roadway was shaped. Probably changes include:
 - Silt Trap Type A, Brush and/or other barriers, Temporary Mulch, and any other BMP which had to be removed for final grading to take place.
 - Additional Silt Traps Type B and Type C to be placed as final drainage patterns are put in place.
 - Additional Channel Lining and/or Erosion Control Blanket.
 - Temporary Mulch for areas where Permanent Seeding and Protection cannot be done within 21 days.
 - Special BMP's such as Karst Policy

KyTC BMP Plan for Project CID ## -

- Finish Work (Paving, Seeding, Protect, etc.) – A final BMP Plan will result from modifications during this phase of construction. Probably changes include:
 - Removal of Silt Traps Type B from ditches and drainways if they are protected with other BMP's which are sufficient to control erosion, i.e. Erosion Control Blanket or Permanent Seeding and Protection on moderate grades.
 - Permanent Seeding and Protection
 - Placing Sod
 - Planting trees and/or shrubs where they are included in the project
- BMP's including Storm Water Management Devices such as velocity dissipation devices and Karst policy BMP's to be installed during construction to control the pollutants in storm water discharges that will occur after construction has been completed are : Seeding and Protection, Erosion Control Blanket. (1)

C. Other Control Measures

1. No solid materials, including building materials, shall be discharged to waters of the commonwealth, except as authorized by a Section 404 permit.
2. Waste Materials

All waste materials that may leach pollutants (paint and paint containers, caulk tubes, oil/grease containers, liquids of any kind, soluble materials, etc.) will be collected and stored in appropriate covered waste containers. Waste containers shall be removed from the project site on a sufficiently frequent basis as to not allow wastes to become a source of pollution. All personnel will be instructed regarding the correct procedure for waste disposal. Wastes will be disposed in accordance with appropriate regulations. Notices stating these practices will be posted in the office.

3. Hazardous Waste

All hazardous waste materials will be managed and disposed of in the manner specified by local or state regulation. The contractor shall notify the Section Engineer if there any hazardous wastes being generated at the project site and how these wastes are being managed. Site personnel will be instructed with regard to proper storage and handling of hazardous wastes when required. The Transportation Cabinet will file for generator, registration when appropriate, with the Division of Waste Management and advise the contractor regarding waste management requirements.

KyTC BMP Plan for Project CID ## -

4. Spill Prevention

The following material management practices will be used to reduce the risk of spills or other exposure of materials and substances to the weather and/or runoff.

➤ **Good Housekeeping:**

The following good housekeeping practices will be followed onsite during the construction project.

- An effort will be made to store only enough product required to do the job
- All materials stored onsite will be stored in a neat, orderly manner in their appropriate containers and, if possible, under a roof or other enclosure
- Products will be kept in their original containers with the original manufacturer's label
- Substances will not be mixed with one another unless recommended by the manufacturer
- Whenever possible, all of the product will be used up before disposing of the container
- Manufacturers' recommendations for proper use and disposal will be followed
- The site contractor will inspect daily to ensure proper use and disposal of materials onsite

➤ **Hazardous Products:**

These practices will be used to reduce the risks associated with any and all hazardous materials.

- Products will be kept in original containers unless they are not resealable.
- Original labels and material safety data sheets (MSDS) will be reviewed and retained
- Contractor will follow procedures recommended by the manufacturer when handling hazardous materials
- If surplus product must be disposed of, manufacturers or state/local recommended methods for proper disposal will be followed

The following product-specific practices will be followed onsite:

➤ **Petroleum Products:**

KyTC BMP Plan for Project CID ## -

Vehicles and equipment that are fueled and maintained on site will be monitored for leaks, and receive regular preventative maintenance to reduce the chance of leakage. Petroleum products onsite will be stored in tightly sealed containers, which are clearly labeled and will be protected from exposure to weather.

The contractor shall prepare an Oil Pollution Spill Prevention Control and Countermeasure plan when the project that involves the storage of petroleum products in 55 gallon or larger containers with a total combined storage capacity of 1,320 gallons. This is a requirement of 40 CFR 112.

This project (will / will not) (3) have over 1,320 gallons of petroleum products with a total capacity, sum of all containers 55 gallon capacity and larger.

➤ **Fertilizers:**

Fertilizers will be applied at rates prescribed by the contract, standard specifications or as directed by the resident engineer. Once applied, fertilizer will be covered with mulch or blankets or worked into the soil to limit exposure to storm water. Storage will be in a covered shed. The contents of any partially used bags of fertilizer will be transferred to a sealable plastic bin to avoid spills.

➤ **Paints:**

All containers will be tightly sealed and stored indoors or under roof when not being used. Excess paint or paint wash water will not be discharged to the drainage or storm sewer system but will be properly disposed of according to manufacturers' instructions or state and local regulations.

➤ **Concrete Truck Washout:**

Concrete truck mixers and chutes will not be washed on pavement, near storm drain inlets, or within 75 feet of any ditch, stream, wetland, lake, or sinkhole. Where possible, excess concrete and wash water will be discharged to areas prepared for pouring new concrete, flat areas to be paved that are away from ditches or drainage system features, or other locations that will not drain off site. Where this approach is not possible, a shallow earthen wash basin will be excavated away from ditches to receive the wash water

➤ **Spill Control Practices**

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices will be followed for spill prevention and cleanup:

KyTC BMP Plan for Project CID ## -

- Manufacturers' recommended methods for spill cleanup will be clearly posted. All personnel will be made aware of procedures and the location of the information and cleanup supplies.
- Materials and equipment necessary for spill cleanup will be kept in the material storage area. Equipment and materials will include as appropriate, brooms, dust pans, mops, rags, gloves, oil absorbents, sand, sawdust, and plastic and metal trash containers.
- All spills will be cleaned up immediately after discovery.
- The spill area will be kept well ventilated and personnel will wear appropriate protective clothing to prevent injury from contact with a hazardous substance.
- Spills of toxic or hazardous material will be reported to the appropriate state/local agency as required by KRS 224 and applicable federal law.
- The spill prevention plan will be adjusted as needed to prevent spills from reoccurring and improve spill response and cleanup.
- Spills of products will be cleaned up promptly. Wastes from spill clean up will be disposed in accordance with appropriate regulations.

D. Other State and Local Plans

This BMP plan shall include any requirements specified in sediment and erosion control plans, storm water management plans or permits that have been approved by other state or local officials. Upon submittal of the NOI, other requirements for surface water protection are incorporated by reference into and are enforceable under this permit (even if they are not specifically included in this BMP plan). This provision does not apply to master or comprehensive plans, non-enforceable guidelines or technical guidance documents that are not identified in a specific plan or permit issued for the construction site by state or local officials. No other local requirements are being added to this project. (1)

E. Maintenance

1. The BMP plan shall include a clear description of the maintenance procedures necessary to keep the control measures in good and effective operating condition.
- Maintenance of BMPs during construction shall be a result of weekly and post rain event inspections with action being taken by the contractor to correct deficiencies.
 - Post Construction maintenance will be a function of normal highway maintenance operations. Following final project acceptance by the cabinet, district highway crews will be responsible for identification and correction of deficiencies regarding ground cover and cleaning of storm water BMPs. The project manager shall identify any BMPs that will be for

KyTC BMP Plan for Project CID ## -

the purpose of post construction storm water management with specific guidance for any non-routine maintenance. No features of this project will require post construction maintenance over and above normal maintenance procedures. (1)

F. Inspections

Inspection and maintenance practices that will be used to maintain erosion and sediment controls:

- All erosion prevention and sediment control measures will be inspected at least once each week and following any rain of one-half inch or more.
- Inspections will be conducted by individuals that have successfully completed the KEPSC-RI course as required by Section 213.02.02 of the Standard Specifications for Road and Bridge Construction, current edition.
- Inspection reports will be written, signed, dated, and kept on file.
- Areas at final grade will be seeded and mulched within 14 days.
- Areas that are not at final grade where construction has ceased for a period of 21 days or longer and soil stock piles shall receive temporary mulch no later than 14 days from the last construction activity in that area.
- All measures will be maintained in good working order; if a repair is necessary, it will be initiated within 24 hours of being reported.
- Built-up sediment will be removed from behind the silt fence before it has reached halfway up the height of the fence.
- Silt fences will be inspected for bypassing, overtopping, undercutting, depth of sediment, tears, and to ensure attachment to secure posts.
- Sediment basins will be inspected for depth of sediment, and built-up sediment will be removed when it reaches 50 percent of the design capacity and at the end of the job.
- Diversion dikes and berms will be inspected and any breaches promptly repaired. Areas that are eroding or scouring will be repaired and re-seeded / mulched as needed.
- Temporary and permanent seeding and mulching will be inspected for bare spots, washouts, and healthy growth. Bare or eroded areas will be repaired as needed.
- All material storage and equipment servicing areas that involve the management of bulk liquids, fuels, and bulk solids will be inspected weekly for conditions that represent a release or possible release of pollutants to the environment.

KyTC BMP Plan for Project CID ## -

G. Non – Storm Water discharges

It is expected that non-storm water discharges may occur from the site during the construction period. Examples of non-storm water discharges include:

- Water from water line flushings.
- Water form cleaning concrete trucks and equipment.
- Pavement wash waters (where no spills or leaks of toxic or hazardous materials have occurred).
- Uncontaminated groundwater and rain water (from dewatering during excavation).

All non-storm water discharges will be directed to the sediment basin or to a filter fence enclosure in a flat vegetated infiltration area or be filtered via another approved commercial product.

H. Groundwater Protection Plan (3)

This plan serves as the groundwater protection plan as required by 401 KAR 5:037.

- Contractors statement: (3)

The following activities, as enumerated by 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan, will or may be may be conducted as part of this construction project:

_____ 2. (e) land treatment or land disposal of a pollutant;

_____ 2. (f) Storing, ..., or related handling of hazardous waste, solid waste or special waste, ..., in tanks, drums, or other containers, or in piles, (This does not include wastes managed in a container placed for collection and removal of municipal solid waste for disposal off site);

_____ 2. (g) Handling of materials in bulk quantities (equal or greater than 55 gallons or 100 pounds net dry weight transported held in an individual container) that, if released to the environment, would be a pollutant;

KyTC BMP Plan for Project CID ## -

_____ 2. (j) Storing or related handling of road oils, dust suppressants,, at a central location;

_____ 2. (k) Application or related handling of road oils, dust suppressants or deicing materials, (does not include use of chloride-based deicing materials applied to roads or parking lots);

_____ 2. (m) Installation, construction, operation, or abandonment of wells, bore holes, or core holes, (this does not include bore holes for the purpose of explosive demolition);

Or, check the following only if there are no qualifying activities

_____ There are no activities for this project as listed in 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan.

The contractor is responsible for the preparation of a plan that addresses the

401 KAR 5:037 Section 3. (3) Elements of site specific groundwater protection plan:

- (a) General information about this project is covered in the Project information;
- (b) Activities that require a groundwater protection plan have been identified above;
- (c) Practices that will protect groundwater from pollution are addressed in section C. Other control measures.
- (d) Implementation schedule – all practices required to prevent pollution of groundwater are to be in place prior to conducting the activity;
- (e) Training is required as a part of the ground water protection plan. All employees of the contractor, sub-contractor and resident engineer personnel will be trained to understand the nature and requirements of this plan as they pertain to their job function(s). Training will be accomplished within one week of employment and annually thereafter. A record of training will be maintained by the contractor with a copy provide to the resident engineer.
- (f) Areas of the project and groundwater plan activities will be inspected as part of the weekly sediment and erosion control inspections
- (g) Certification (see signature page.)

SPECIAL NOTE

Filing of eNOI for KPDES Construction Stormwater Permit


County: Ohio
Item No.: 2-20060.00

Route: US 62
KDOW Submittal ID:
297544

Project Description: Reconstruction of Drainage Improvements, Curb and Gutter, and Resurfacing US 62 MP 9.731 to MP 10.59 in Beaver Dam, Ohio County

A Notice of Intent for obtaining coverage under the Kentucky Pollutant Discharge Elimination System (KPDES) General Permit for Stormwater Discharges Associated with Construction Activities (KYR10) has been drafted, copy of which is attached. Upon award, the Contractor will be identified in Section III of the form as the “Building Contractor” and it will be submitted for approval to the Kentucky Division of Water. The Contractor shall be responsible for advancing the work in a manner that is compliant with all applicable and appropriate KYTC specifications for sediment and erosion control as well as meeting the requirements of the KYR10 permit and the KDOW.

If there are any questions regarding this note, please contact Danny Peake, Director, Division of Environmental Analysis, TCOB, 200 Mero Street, Frankfort, KY 40622, Phone: (502) 564-7250.

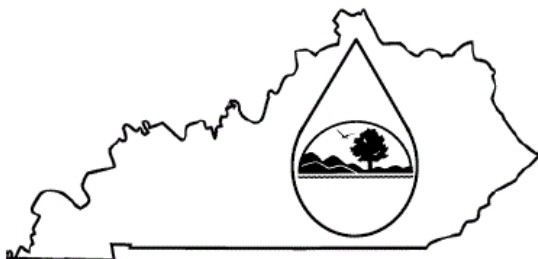

KENTUCKY POLLUTION DISCHARGE ELIMINATION SYSTEM (KPDES)

Notice of Intent (NOI) for coverage of Storm Water Discharge
Associated with Construction Activities Under the KPDES Storm
Water General Permit KYR100000

[Click here for Instructions
\(Controls/KPDES_FormKYR10_Instructions.htm\)](#)

[Click here to obtain information and a copy of the KPDES General Permit.
\(http://dep.ky.gov/formslibrary/Documents/KYR10PermitPage.pdf\)](http://dep.ky.gov/formslibrary/Documents/KYR10PermitPage.pdf)

(*) indicates a required field; (✓) indicates a field may be required based on user input or is an optionally required field

Reason for Submittal:(*)

Application for New Permit Coverage

Agency Interest ID:

Agency Interest ID

Permit Number:(✓)

KPDES Permit Number

If change to existing permit coverage is requested, describe the changes for which modification of coverage is being sought:(✓)

ELIGIBILITY:

Stormwater discharges associated with construction activities disturbing individually one (1) acre or more, including, in the case of a common plan of development, contiguous construction activities that cumulatively equal one (1) acre or more of disturbance.

EXCLUSIONS:

The following are excluded from coverage under this general permit:

- 1) Are conducted at or on properties that have obtained an individual KPDES permit for the discharge of other wastewaters which requires the development and implementation of a Best Management Practices (BMP) plan;
- 2) Any operation that the DOW determines an individual permit would better address the discharges from that operation;
- 3) Any project that discharges to an Impaired Water listed in the most recent Integrated Report, §305(b) as impaired for sediment and for which an approved TMDL has been developed.

SECTION I -- FACILITY OPERATOR INFORMATION (PERMITTEE)

Company Name:(✓)

Kentucky Transportation Cabinet - District 2

First Name:(✓)

Deneatra

M.I.:

MI

Last Name:(✓)

Henderson

Mailing Address:(*)

1840 N. Main St.

City:(*)

Madisonville

State:(*)

Kentucky

Zip:(*)

42431

eMail Address:(*)

Deneatra.Henderson@ky.gov

Business Phone:(*)

270 824 7080

Alternate Phone:

270 791 4396

SECTION II -- GENERAL SITE LOCATION INFORMATION

Project Name:(*)

2-20060.00 - Ohio - US 62 - Drainage Improvements MP 9.731 to MP 10.59

Status of Owner/Operator(*)

State Government

SIC Code(*)

1611 Highway and Street Constr

Company Name:(✓)

Kentucky Transportation Cabinet - District 2

First Name:(✓)

Deneatra

M.I.:

MI

Last Name:(✓)

Henderson

Site Physical Address:(*)

2-20060.00 - Ohio - US 62 - Drainage Improvements MP 9.731 to MP 10.59

City:(*)

Beaver Dam

State:(*)

Kentucky

Zip:(*)

42320

County:(*)

Ohio

Latitude(decimal degrees)(*)DMS to DD Converter
(https://www.fcc.gov/media/radio/dms-decimal)

37.404722

Longitude(decimal degrees)(*)

-86.875833

SECTION III -- SPECIFIC SITE ACTIVITY INFORMATION

Project Description:(*)

2-20060.00 - Ohio - US 62 - Drainage Improvements MP 9.731 to MP 10.59

a. For single projects provide the following information

Total Number of Acres in Project:(✓)

Total Number of Acres Disturbed:(✓)

Anticipated Start Date:(✓)

Anticipated Completion Date:(✓)

b. For common plans of development provide the following information

Total Number of Acres in Project:(✓)

Total Number of Acres Disturbed:(✓)

Number of individual lots in development, if applicable:(✓)

Number of lots in development:(✓)

Total acreage of lots intended to be developed:(✓)

Number of acres intended to be disturbed at any one time:(✓)

Anticipated Start Date:(✓)

Anticipated Completion Date:(✓)

List Building Contractor(s) at the time of Application:(*)

	Company Name	Delete
1		Delete
+		

SECTION IV -- IF THE PERMITTED SITE DISCHARGES TO A WATER BODY THE FOLLOWING INFORMATION IS REQUIRED ?

Discharge Point(s):

	Unnamed Tributary?	Latitude	Longitude	Receiving Water Name	Delete
1	Yes	37.406488	-86.875580	Threelick Fork	Delete
2	Yes	37.402334	-86.875936	Threelick Fork	Delete
+					

SECTION V -- IF THE PERMITTED SITE DISCHARGES TO A MS4 THE FOLLOWING INFORMATION IS REQUIRED ?

Name of MS4:

Date of application/notification to the MS4 for construction site permit coverage:

Discharge Point(s):(*)

	Latitude	Longitude
+		

SECTION VI -- WILL THE PROJECT REQUIRE CONSTRUCTION ACTIVITIES IN A WATER BODY OR THE RIPARIAN ZONE?

Will the project require construction activities in a water body or the riparian zone?:(*)

	No
If Yes, describe scope of activity: (✓)	describe scope of activity
Is a Clean Water Act 404 permit required?:(*)	No
Is a Clean Water Act 401 Water Quality Certification required?:(*)	No

SECTION VII -- NOI PREPARER INFORMATION

First Name:(*) Jean	M.I.: MI	Last Name:(*) Jones	Company Name:(*) KYTC D-02
Mailing Address:(*) 1840 N. Main St.	City:(*) Madisonville	State:(*) Kentucky	Zip:(*) 42431
eMail Address:(*) JeanR.Jones@ky.gov	Business Phone:(*) 270 824 7080	Alternate Phone: Phone	

SECTION VIII -- ATTACHMENTS

Facility Location Map:(*)	<input type="button" value="Upload file"/>
Supplemental Information:	<input type="button" value="Upload file"/>

SECTION IX -- CERTIFICATION

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signature:(*) Deneatra Henderson	Title:(*) Chief District Engineer		
First Name:(*) Deneatra	M.I.: MI	Last Name:(*) Henderson	
eMail Address:(*) Deneatra.Henderson@ky.gov	Business Phone:(*) 270 824 7080	Alternate Phone: 270 791 4396	Signature Date:(*) Date

<input type="button" value="Click to Save Values for Future Retrieval"/>	<input type="button" value="Click to Submit to EEC"/>
--	---

PART II
SPECIFICATIONS AND STANDARD DRAWINGS

SPECIFICATIONS REFERENCE

Any reference in the plans or proposal to previous editions of the *Standard Specifications for Road and Bridge Construction* and *Standard Drawings* are superseded by *Standard Specifications for Road and Bridge Construction, Edition of 2019* and *Standard Drawings, Edition of 2020*.

SUPPLEMENTAL SPECIFICATIONS

The contractor shall use the Supplemental Specifications that are effective at the time of letting.
The Supplemental Specifications can be found at the following link:

<http://transportation.ky.gov/Construction/Pages/Kentucky-Standard-Specifications.aspx>

SPECIAL NOTE FOR PORTABLE CHANGEABLE MESSAGE SIGNS

This Special Note will apply when indicated on the plans or in the proposal.

1.0 DESCRIPTION. Furnish, install, operate, and maintain variable message signs at the locations shown on the plans or designated by the Engineer. Remove and retain possession of variable message signs when they are no longer needed on the project.

2.0 MATERIALS.

2.1 General. Use LED Variable Message Signs Class I, II, or III, as appropriate, from the Department's List of Approved Materials.

Unclassified signs may be submitted for approval by the Engineer. The Engineer may require a daytime and nighttime demonstration. The Engineer will make a final decision within 30 days after all required information is received.

2.2 Sign and Controls. All signs must:

- 1) Provide 3-line messages with each line being 8 characters long and at least 18 inches tall. Each character comprises 35 pixels.
- 2) Provide at least 40 preprogrammed messages available for use at any time. Provide for quick and easy change of the displayed message; editing of the message; and additions of new messages.
- 3) Provide a controller consisting of:
 - a) Keyboard or keypad.
 - b) Readout that mimics the actual sign display. (When LCD or LCD type readout is used, include backlighting and heating or otherwise arrange for viewing in cold temperatures.)
 - c) Non-volatile memory or suitable memory with battery backup for storing pre-programmed messages.
 - d) Logic circuitry to control the sequence of messages and flash rate.
- 4) Provide a serial interface that is capable of supporting complete remote control ability through land line and cellular telephone operation. Include communication software capable of immediately updating the message, providing complete sign status, and allowing message library queries and updates.
- 5) Allow a single person easily to raise the sign to a satisfactory height above the pavement during use, and lower the sign during travel.
- 6) Be Highway Orange on all exterior surfaces of the trailer, supports, and controller cabinet.
- 7) Provide operation in ambient temperatures from -30 to + 120 degrees Fahrenheit during snow, rain and other inclement weather.
- 8) Provide the driver board as part of a module. All modules are interchangeable, and have plug and socket arrangements for disconnection and reconnection. Printed circuit boards associated with driver boards have a conformable coating to protect against moisture.
- 9) Provide a sign case sealed against rain, snow, dust, insects, etc. The lens is UV stabilized clear plastic (polycarbonate, acrylic, or other approved material) angled to prevent glare.
- 10) Provide a flat black UV protected coating on the sign hardware, character PCB, and appropriate lens areas.
- 11) Provide a photocell control to provide automatic dimming.

- 12) Allow an on-off flashing sequence at an adjustable rate.
- 13) Provide a sight to aim the message.
- 14) Provide a LED display color of approximately 590 nm amber.
- 15) Provide a controller that is password protected.
- 16) Provide a security device that prevents unauthorized individuals from accessing the controller.
- 17) Provide the following 3-line messages preprogrammed and available for use when the sign unit begins operation:

/KEEP/RIGHT/=>=>=>/	/MIN/SPEED/**MPH/
/KEEP/LEFT/<=<=</	/ICY/BRIDGE/AHEAD/ /ONE
/LOOSE/GRAVEL/AHEAD/	LANE/BRIDGE/AHEAD/
/RD WORK/NEXT/**MILES/	/ROUGH/ROAD/AHEAD/
/TWO WAY/TRAFFIC/AHEAD/	/MERGING/TRAFFIC/AHEAD/
/PAINT/CREW/AHEAD/	/NEXT/***/MILES/
/REDUCE/SPEED/**MPH/	/HEAVY/TRAFFIC/AHEAD/
/BRIDGE/WORK/***0 FT/	/SPEED/LIMIT/**MPH/
/MAX/SPEED/**MPH/	/BUMP/AHEAD/
/SURVEY/PARTY/AHEAD/	/TWO/WAY/TRAFFIC/

*Insert numerals as directed by the Engineer.
Add other messages during the project when required by the Engineer.

2.3 Power.

- 1) Design solar panels to yield 10 percent or greater additional charge than sign consumption. Provide direct wiring for operation of the sign or arrow board from an external power source to provide energy backup for 21 days without sunlight and an on-board system charger with the ability to recharge completely discharged batteries in 24 hours.

3.0 CONSTRUCTION. Furnish and operate the variable message signs as designated on the plans or by the Engineer. Ensure the bottom of the message panel is a minimum of 7 feet above the roadway in urban areas and 5 feet above in rural areas when operating. Use Class I, II, or III signs on roads with a speed limit less than 55 mph. Use Class I or II signs on roads with speed limits 55 mph or greater.

Maintain the sign in proper working order, including repair of any damage done by others, until completion of the project. When the sign becomes inoperative, immediately repair or replace the sign. Repetitive problems with the same unit will be cause for rejection and replacement.

Use only project related messages and messages directed by the Engineer, unnecessary messages lessen the impact of the sign. Ensure the message is displayed in either one or 2 phases with each phase having no more than 3 lines of text. When no message is needed, but it is necessary to know if the sign is operable, flash only a pixel.

When the sign is not needed, move it outside the clear zone or where the Engineer directs. Variable Message Signs are the property of the Contractor and shall be removed from the project when no longer needed. The Department will not assume ownership of these signs.

4.0 MEASUREMENT. The final quantity of Variable Message Sign will be

11

the actual number of individual signs acceptably furnished and operated during the project. The Department will not measure signs replaced due to damage or rejection.

5.0 PAYMENT. The Department will pay for the Variable Message Signs at the unit price each. The Department will not pay for signs replaced due to damage or rejection. Payment is full compensation for furnishing all materials, labor, equipment, and service necessary to, operate, move, repair, and maintain or replace the variable message signs. The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
02671	Portable Changeable Message Sign	Each

Effective June 15, 2012

SPECIAL NOTE FOR BARCODE LABEL ON PERMANENT SIGNS

1.0 DESCRIPTION. Install barcode label on sheeting signs. Section references herein are to the Department’s Standard Specifications for Road and Bridge Construction, current edition.

2.0 MATERIALS. The Department will provide the Contractor with a 2 inch x 1 inch foil barcode label for each permanent sheeting sign. A unique number will be assigned to each barcode label.

The Contractor shall contact the Operations and Pavement Management Branch in the Division of Maintenance at (502) 564-4556 to obtain the barcode labels.

3.0 CONSTRUCTION. Apply foil barcode label in the lower right quadrant of the sign back. Signs where the bottom edge is not parallel to the ground, the lowest corner of the sign shall serve as the location to place the barcode label. The barcode label shall be placed no less than one-inch and no more than three inches from any edge of the sign. The barcode must be placed so that the sign post does not cover the barcode label.

Barcodes shall be applied in an indoor setting with a minimum air temperature of 50°F or higher. Prior to application of the barcode label, the back of the sign must be clean and free of dust, oil, etc. If the sign is not clean, an alcohol swab shall be used to clean the area. The area must be allowed to dry prior to placement of the barcode label.

Data for each sign shall include the barcode number, MUTCD reference number, sheeting manufacturer, sheeting type, manufacture date, color of primary reflective surface, installation date, latitude and longitude using the North American Datum of 1983 (NAD83) or the State Plane Coordinates using an x and y ordinate of the installed location.

Data should be provided electronically on the TC 71-229 Sign Details Information and TC 71-230 Sign Assembly Information forms. The Contractor may choose to present the data in a different format provided that the information submitted to the Department is equivalent to the information required on the Department TC forms. The forms must be submitted in electronic format regardless of which type of form is used. The Department will not accept PDF or handwritten forms. These completed forms must be submitted to the Department prior to final inspection of the signs. The Department will not issue formal acceptance for the project until the TC 71-229 and TC-230 electronic forms are completed for all signs and sign assemblies on the project.

4.0 MEASUREMENT. The Department will measure all work required for the installation of the barcode label and all work associated with completion and submission of the sign inventory data (TC 71-229 and TC 71-230).


The installation of the permanent sign will be measured in accordance to Section 715.

5.0 PAYMENT. The Department will make payment for the completed and accepted quantities under the following:



<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
24631EC	Barcode Sign Inventory	Each

The Department will not make payment for this item until all barcodes are installed and sign inventory is complete on every permanent sign installed on the project. The Department will make payment for installation of the permanent sign in accordance to Section 715. The Department will consider payment as full compensation for all work required under this special note.





One Sign Post

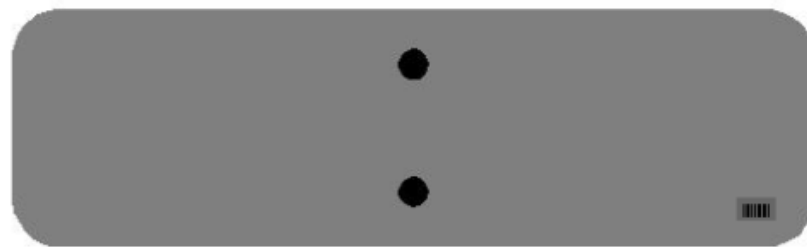



↑
2" Wide Post

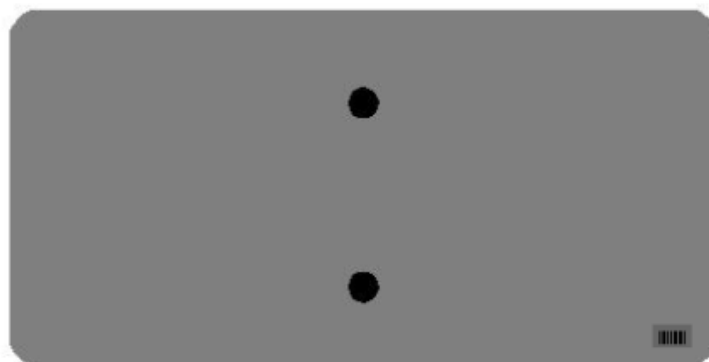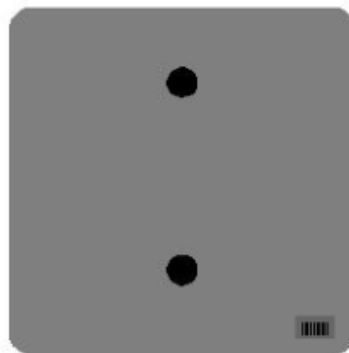


One Sign Post

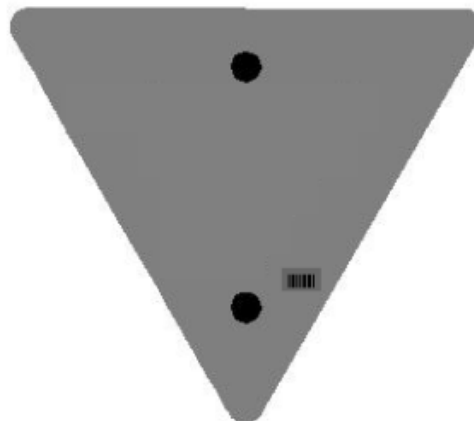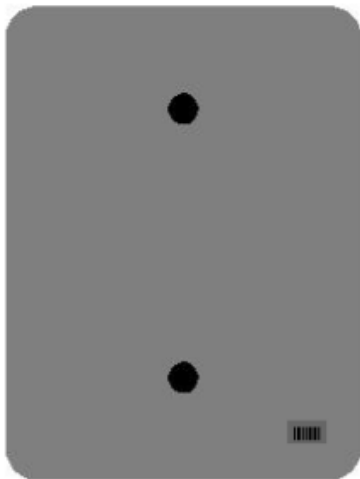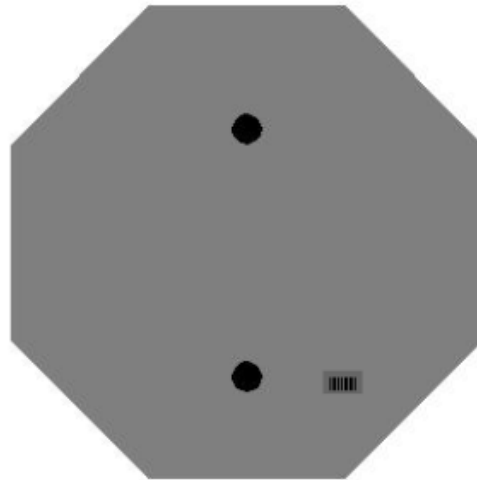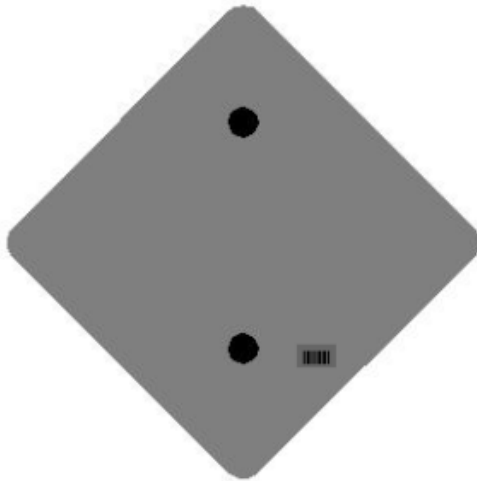


One Sign Post

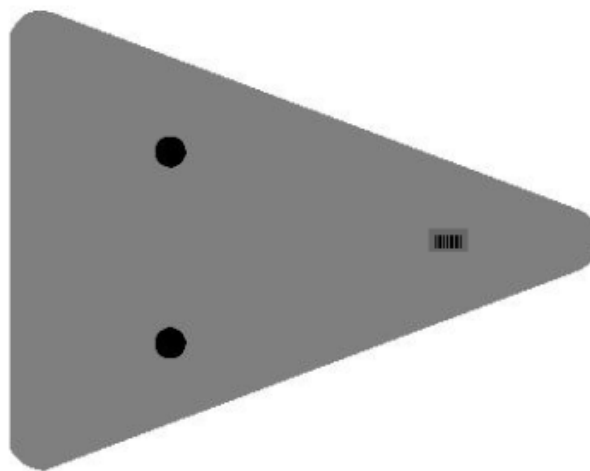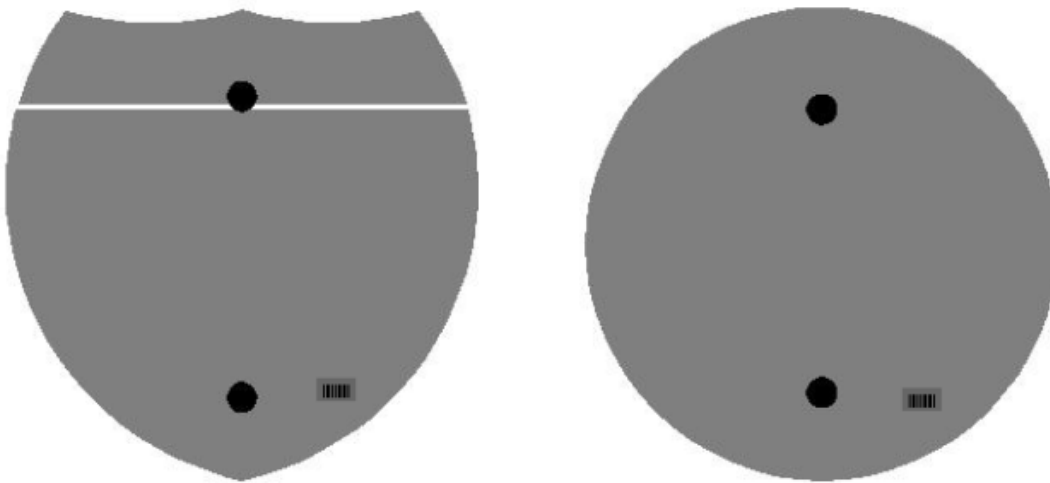

Double Sign Post

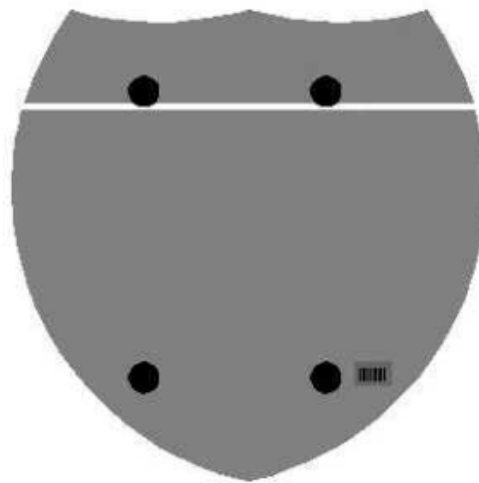

Interstate
Shield

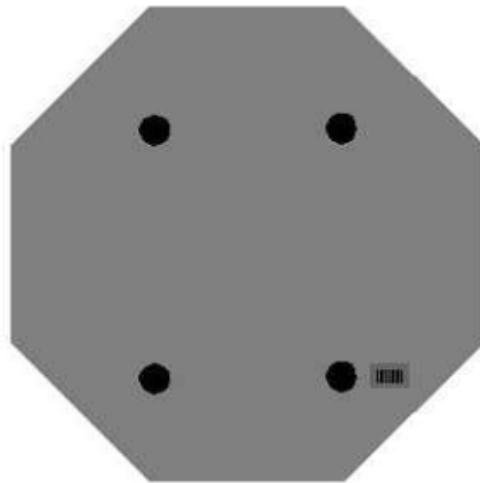


48" Stop

2 Post Signs



↑
2" Wide Post

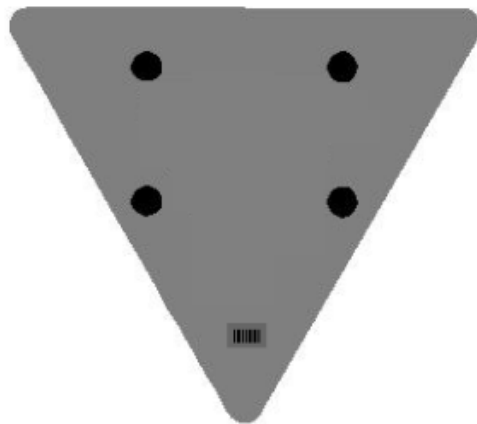

SPECIAL NOTE FOR LONGITUDINAL PAVEMENT JOINT ADHESIVE

1. DESCRIPTION. This specification covers the requirements and practices for applying an asphalt adhesive material to the longitudinal joint of the surface course of an asphalt pavement. Apply the adhesive to the face of longitudinal joint between driving lanes for the first lane paved. Then, place and compact the adjacent lane against the treated face to produce a strong, durable, waterproof longitudinal joint.
2. MATERIALS, EQUIPMENT, AND PERSONNEL.

2.1 Joint Adhesive. Provide material conforming to Subsection 2.1.1.

2.1.1 Provide an adhesive conforming to the following requirements:

Property	Specification	Test Procedure
Viscosity, 400 ° F (Pa·s)	4.0 – 10.0	ASTM D 4402
Cone Penetration, 77 ° F	60 – 100	ASTM D 5329
Flow, 140 ° F (mm)	5.0 max.	ASTM D 5329
Resilience, 77 ° F (%)	30 min.	ASTM D 5329
Ductility, 77 ° F (cm)	30.0 min.	ASTM D 113
Ductility, 39 ° F (cm)	30.0 min.	ASTM D 113
Tensile Adhesion, 77 ° F (%)	500 min.	ASTM D 5329, Type II
Softening Point, ° F	171 min.	AASHTO T 53
Asphalt Compatibility	Pass	ASTM D 5329

Ensure the temperature of the pavement joint adhesive is between 380 and 410 °F when the material is extruded in a 0.125-inch-thick band over the entire face of the longitudinal joint.

2.2. Equipment.

2.2.1 Melter Kettle. Provide an oil-jacketed, double-boiler, melter kettle equipped with any needed agitation and recirculating systems.

2.2.2 Applicator System. Provide a pressure-feed-wand applicator system with an applicator shoe attached.

2.3 Personnel. Ensure a technical representative from the manufacturer of the pavement joint adhesive is present during the initial construction activities and available upon the request of the Engineer.

3. CONSTRUCTION.

3.1 Surface Preparation. Prior to the application of the pavement joint adhesive, ensure the face of the longitudinal joint is thoroughly dry and free from dust or any other debris that would inhibit adhesion. Clean the joint face by the use of compressed air.

Ensure this preparation process occurs shortly before application to prevent the return of debris on the joint face.

3.2 Pavement Joint Adhesive Application. Ensure the ambient temperature is a minimum of 40 ° F during the application of the pavement joint adhesive. Prior to applying the adhesive, demonstrate competence in applying the adhesive according to this note to the satisfaction of the Engineer. Heat the adhesive in the melter kettle to the specified temperature range. Pump the adhesive from the melter kettle through the wand onto the vertical face of the cold joint. Apply the adhesive in a continuous band over the entire face of the longitudinal joint. Do not use excessive material in either thickness or location. Ensure the edge of the extruded adhesive material is flush with the surface of the pavement. Then, place and compact the adjacent lane against the joint face. Remove any excessive material extruded from the joint after compaction (a small line of material may remain).

3.3 Pavement Joint Adhesive Certification. Furnish the joint adhesive's certification to the Engineer stating the material conforms to all requirements herein prior to use.

3.4 Sampling and Testing. The Department will require a random sample of pavement joint adhesive from each manufacturer's lot of material. Extrude two 5 lb. samples of the heated material and forward the sample to the Division of Materials for testing. Reynolds oven bags, turkey size, placed inside small cardboard boxes or cement cylinder molds have been found suitable. Ensure the product temperature is 400°F or below at the time of sampling.

4. MEASUREMENT. The Department will measure the quantity of Pavement Joint Adhesive in linear feet. The Department will not measure for payment any extra materials, labor, methods, equipment, or construction techniques used to satisfy the requirements of this note. The Department will not measure for payment any trial applications of Pavement Joint Adhesive, the cleaning of the joint face, or furnishing and placing the adhesive. The Department will consider all such items incidental to the Pavement Joint Adhesive.
5. PAYMENT. The Department will pay for the Pavement Joint Adhesive at the Contract unit bid price and apply an adjustment for each manufacturer's lot of material based on the degree of compliance as defined in the following schedule. When a sample fails on two or more tests, the Department may add the deductions, but the total deduction will not exceed 100 percent.

11N

Pavement Joint Adhesive Price Adjustment Schedule						
Test	Specification	100% Pay	90% Pay	80% Pay	50% Pay	0% Pay
Joint Adhesive Referenced in Subsection 2.1.1						
Viscosity, 400 ° F (Pa•s) ASTM D 3236	4.0-10.0	3.5-10.5	3.0-3.4 10.6-11.0	2.5-2.9 11.1-11.5	2.0-2.4 11.6-12.0	≤1.9 ≥ 12.1
Cone Penetration, 77 ° F ASTM D 5329	60-100	57-103	54-56 104-106	51-53 107-109	48-50 110-112	≤ 47 ≥ 113
Flow, 140 ° F (mm) ASTM D 5329	≤ 5.0	≤ 5.5	5.6-6.0	6.1-6.5	6.6-7.0	≥ 7.1
Resilience, 77 ° F (%) ASTM D 5329	≥ 30	≥ 28	26-27	24-25	22-23	≤ 21
Tensile Adhesion, 77 ° F (%) ASTM D 5329	≥ 500	≥ 490	480-489	470-479	460-469	≤ 459
Softening Point, ° F AASHTO T 53	≥ 171	≥ 169	166-168	163-165	160-162	≤ 159
Ductility, 77 ° F (cm) ASTM D 113	≥ 30.0	≥ 29.0	28.0-28.9	27.0-27.9	26.0-26.9	≤ 25.9
Ductility, 39 ° F (cm) ASTM D 113	≥ 30.0	≥ 29.0	28.0-28.9	27.0-27.9	26.0-26.9	≤ 25.9

Code
 20071EC

Pay Item
 Joint Adhesive

Pay Unit
 Linear Foot

May 7, 2014

PART III

EMPLOYMENT, WAGE AND RECORD REQUIREMENTS

**TRANSPORTATION CABINET
DEPARTMENT OF HIGHWAYS**

**LABOR AND WAGE REQUIREMENTS
APPLICABLE TO OTHER THAN FEDERAL-AID SYSTEM PROJECTS**

- I. Application
- II. Nondiscrimination of Employees (KRS 344)

I. APPLICATION

1. These contract provisions shall apply to all work performed on the contract by the contractor with his own organization and with the assistance of workmen under his immediate superintendence and to all work performed on the contract by piecework, station work or by subcontract. The contractor's organization shall be construed to include only workmen employed and paid directly by the contractor and equipment owned or rented by him, with or without operators.

2. The contractor shall insert in each of his subcontracts all of the stipulations contained in these Required Provisions and such other stipulations as may be required.

3. A breach of any of the stipulations contained in these Required Provisions may be grounds for termination of the contract.

3. If the contractor is in control of apprenticeship or other training or retraining, including on-the-job training programs, he shall not discriminate against an individual because of his race, color, religion, national origin, sex, disability or age forty (40) and over, in admission to, or employment in any program established to provide apprenticeship or other training.

4. The contractor will send to each labor union or representative of workers with which he has a collective bargaining agreement or other contract or understanding, a notice to be provided advising the said labor union or workers' representative of the contractor's commitments under this section, and shall post copies of the notice in conspicuous places available to employees and applicants for employment. The contractor will take such action with respect to any subcontract or purchase order as the administrating agency may direct as a means of enforcing such provisions, including sanctions for non-compliance.

Revised: January 25, 2017

II. NONDISCRIMINATION OF EMPLOYEES

**AN ACT OF THE KENTUCKY
GENERAL ASSEMBLY TO PREVENT
DISCRIMINATION IN EMPLOYMENT
KRS CHAPTER 344
EFFECTIVE JUNE 16, 1972**

The contract on this project, in accordance with KRS Chapter 344, provides that during the performance of this contract, the contractor agrees as follows:

1. The contractor shall not fail or refuse to hire, or shall not discharge any individual, or otherwise discriminate against an individual with respect to his compensation, terms, conditions, or privileges of employment, because of such individual's race, color, religion, national origin, sex, disability or age (forty and above); or limit, segregate, or classify his employees in any way which would deprive or tend to deprive an individual of employment opportunities or otherwise adversely affect his status as an employee, because of such individual's race, color, religion, national origin, sex, disability or age forty (40) and over. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided setting forth the provisions of this nondiscrimination clause.

2. The contractor shall not print or publish or cause to be printed or published a notice or advertisement relating to employment by such an employer or membership in or any classification or referral for employment by the employment agency, indicating any preference, limitation, specification, or discrimination, based on race, color, religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, except that such a notice or advertisement may indicate a preference, limitation, or specification based on religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, when religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, is a bona fide occupational qualification for employment.

EXECUTIVE BRANCH CODE OF ETHICS

In the 1992 regular legislative session, the General Assembly passed and Governor Brereton Jones signed Senate Bill 63 (codified as KRS 11A), the Executive Branch Code of Ethics, which states, in part:

KRS 11A.040 (7) provides:

No present or former public servant shall, within six (6) months following termination of his office or employment, accept employment, compensation, or other economic benefit from any person or business that contracts or does business with, or is regulated by, the state in matters in which he was directly involved during the last thirty-six (36) months of his tenure. This provision shall not prohibit an individual from returning to the same business, firm, occupation, or profession in which he was involved prior to taking office or beginning his term of employment, or for which he received, prior to his state employment, a professional degree or license, provided that, for a period of six (6) months, he personally refrains from working on any matter in which he was directly involved during the last thirty-six (36) months of his tenure in state government. This subsection shall not prohibit the performance of ministerial functions, including but not limited to filing tax returns, filing applications for permits or licenses, or filing incorporation papers, nor shall it prohibit the former officer or public servant from receiving public funds disbursed through entitlement programs.

KRS 11A.040 (9) states:

A former public servant shall not represent a person or business before a state agency in a matter in which the former public servant was directly involved during the last thirty-six (36) months of his tenure, for a period of one (1) year after the latter of:

- a) The date of leaving office or termination of employment; or
- b) The date the term of office expires to which the public servant was elected.

This law is intended to promote public confidence in the integrity of state government and to declare as public policy the idea that state employees should view their work as a public trust and not as a way to obtain private benefits.

If you have worked for the executive branch of state government within the past six months, you may be subject to the law's prohibitions. The law's applicability may be different if you hold elected office or are contemplating representation of another before a state agency.

Also, if you are affiliated with a firm which does business with the state and which employs former state executive-branch employees, you should be aware that the law may apply to them.

In case of doubt, the law permits you to request an advisory opinion from the Executive Branch Ethics Commission, 1025 Capital Center Drive, Suite 104, Frankfort, Kentucky 40601; telephone (502) 564-7954.

Revised: May 23, 2022

Kentucky Equal Employment Opportunity Act of 1978

The requirements of the Kentucky Equal Employment Opportunity Act of 1978 (KRS 45.560-45.640) shall apply to this Contract. The apparent low Bidder will be required to submit EEO forms to the Division of Construction Procurement, which will then forward to the Finance and Administration Cabinet for review and approval. No award will become effective until all forms are submitted and EEO/CC has certified compliance. The required EEO forms are as follows:

- EEO-1: Employer Information Report
- Affidavit of Intent to Comply
- Employee Data Sheet
- Subcontractor Report

These forms are available on the Finance and Administration's web page under ***Vendor Information, Standard Attachments and General Terms*** at the following address:
<https://www.eProcurement.ky.gov>.

Bidders currently certified as being in compliance by the Finance and Administration Cabinet may submit a copy of their approval letter in lieu of the referenced EEO forms.

For questions or assistance please contact the Finance and Administration Cabinet by email at **finance.contractcompliance@ky.gov** or by phone at 502-564-2874.

EMPLOYEE RIGHTS UNDER THE FAIR LABOR STANDARDS ACT

THE UNITED STATES DEPARTMENT OF LABOR WAGE AND HOUR DIVISION

FEDERAL MINIMUM WAGE

\$7.25

 PER HOUR

BEGINNING JULY 24, 2009

OVERTIME PAY At least 1½ times your regular rate of pay for all hours worked over 40 in a workweek.

CHILD LABOR An employee must be at least **16** years old to work in most non-farm jobs and at least **18** to work in non-farm jobs declared hazardous by the Secretary of Labor.

Youths **14** and **15** years old may work outside school hours in various non-manufacturing, non-mining, non-hazardous jobs under the following conditions:

No more than

- **3** hours on a school day or **18** hours in a school week;
- **8** hours on a non-school day or **40** hours in a non-school week.

Also, work may not begin before **7 a.m.** or end after **7 p.m.**, except from June 1 through Labor Day, when evening hours are extended to **9 p.m.** Different rules apply in agricultural employment.

TIP CREDIT Employers of “tipped employees” must pay a cash wage of at least \$2.13 per hour if they claim a tip credit against their minimum wage obligation. If an employee’s tips combined with the employer’s cash wage of at least \$2.13 per hour do not equal the minimum hourly wage, the employer must make up the difference. Certain other conditions must also be met.

ENFORCEMENT The Department of Labor may recover back wages either administratively or through court action, for the employees that have been underpaid in violation of the law. Violations may result in civil or criminal action.

Employers may be assessed civil money penalties of up to \$1,100 for each willful or repeated violation of the minimum wage or overtime pay provisions of the law and up to \$11,000 for each employee who is the subject of a violation of the Act’s child labor provisions. In addition, a civil money penalty of up to \$50,000 may be assessed for each child labor violation that causes the death or serious injury of any minor employee, and such assessments may be doubled, up to \$100,000, when the violations are determined to be willful or repeated. The law also prohibits discriminating against or discharging workers who file a complaint or participate in any proceeding under the Act.

ADDITIONAL INFORMATION

- Certain occupations and establishments are exempt from the minimum wage and/or overtime pay provisions.
- Special provisions apply to workers in American Samoa and the Commonwealth of the Northern Mariana Islands.
- Some state laws provide greater employee protections; employers must comply with both.
- The law requires employers to display this poster where employees can readily see it.
- Employees under 20 years of age may be paid \$4.25 per hour during their first 90 consecutive calendar days of employment with an employer.
- Certain full-time students, student learners, apprentices, and workers with disabilities may be paid less than the minimum wage under special certificates issued by the Department of Labor.

For additional information:



1-866-4-USWAGE

(1-866-487-9243)

TTY: 1-877-889-5627



WWW.WAGEHOUR.DOL.GOV

PART IV
INSURANCE

Refer to
Kentucky Standard Specifications for Road and Bridge Construction,
current edition

PART V
BID ITEMS

PROPOSAL BID ITEMS

221039

Page 1 of 3

Report Date 6/22/22

Section: 0001 - PAVING

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0010	00001		DGA BASE	194.00	TON		\$	
0020	00003		CRUSHED STONE BASE	3,782.00	TON		\$	
0030	00078		CRUSHED AGGREGATE SIZE NO 2	7,564.00	TON		\$	
0040	00190		LEVELING & WEDGING PG64-22	100.00	TON		\$	
0050	00214		CL3 ASPH BASE 1.00D PG64-22	3,433.00	TON		\$	
0060	00324		CL3 ASPH SURF 0.50B PG64-22	778.00	TON		\$	
0070	02676		MOBILIZATION FOR MILL & TEXT	1.00	LS		\$	
0080	02677		ASPHALT PAVE MILLING & TEXTURING	35.00	TON		\$	
0090	20071EC		JOINT ADHESIVE	7,245.00	LF		\$	
0100	24785EC		FIBER REINFORCEMENT FOR HMA	4,151.00	TON		\$	
0110	24970EC		ASPHALT MATERIAL FOR TACK NON-TRACKING	12.50	TON		\$	

Section: 0002 - ROADWAY

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0120	01000		PERFORATED PIPE-4 IN	3,327.00	LF		\$	
0130	01010		NON-PERFORATED PIPE-4 IN	260.00	LF		\$	
0140	01015		INSPECT & CERTIFY EDGE DRAIN SYSTEM	1.00	LS		\$	
0150	01740		CORED HOLE DRAINAGE BOX CON-4 IN	26.00	EACH		\$	
0160	01810		STANDARD CURB AND GUTTER	2,720.00	LF		\$	
0170	01875		STANDARD HEADER CURB	27.00	LF		\$	
0180	01880		BARRIER HEADER CURB	151.00	LF		\$	
0190	02014		BARRICADE-TYPE III	16.00	EACH		\$	
0200	02101		CEM CONC ENT PAVEMENT-8 IN	626.00	SQYD		\$	
0210	02159		TEMP DITCH	1,005.00	LF		\$	
0220	02160		CLEAN TEMP DITCH	503.00	LF		\$	
0230	02200		ROADWAY EXCAVATION	8,246.00	CUYD		\$	
0240	02242		WATER	477.00	MGAL		\$	
0250	02551		CONCRETE-CLASS A FOR STEPS	2.00	CUYD		\$	
0260	02562		TEMPORARY SIGNS	1,308.00	SQFT		\$	
0270	02585		EDGE KEY	367.00	LF		\$	
0280	02602		FABRIC-GEOTEXTILE CLASS 1	26,286.00	SQYD		\$	
0290	02607		FABRIC-GEOTEXTILE CLASS 2 FOR PIPE	6,764.00	SQYD	\$2.00	\$	\$13,528.00
0300	02611		HANDRAIL-TYPE A-1	70.00	LF		\$	
0310	02650		MAINTAIN & CONTROL TRAFFIC	1.00	LS		\$	
0320	02671		PORTABLE CHANGEABLE MESSAGE SIGN	5.00	EACH		\$	
0330	02701		TEMP SILT FENCE	1,005.00	LF		\$	
0340	02703		SILT TRAP TYPE A	3.00	EACH		\$	
0350	02704		SILT TRAP TYPE B	3.00	EACH		\$	
0360	02705		SILT TRAP TYPE C	3.00	EACH		\$	
0370	02706		CLEAN SILT TRAP TYPE A	3.00	EACH		\$	
0380	02707		CLEAN SILT TRAP TYPE B	3.00	EACH		\$	
0390	02708		CLEAN SILT TRAP TYPE C	3.00	EACH		\$	
0400	02720		SIDEWALK-4 IN CONCRETE	705.00	SQYD		\$	
0410	02721		REMOVE CONCRETE SIDEWALK	44.00	SQYD		\$	

PROPOSAL BID ITEMS

221039

Page 2 of 3

Report Date 6/22/22

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0420	02726		STAKING	1.00	LS		\$	
0430	02775		ARROW PANEL	2.00	EACH		\$	
0440	05952		TEMP MULCH	9,955.00	SQYD		\$	
0450	05953		TEMP SEEDING AND PROTECTION	7,429.00	SQYD		\$	
0460	05963		INITIAL FERTILIZER	.50	TON		\$	
0470	05964		MAINTENANCE FERTILIZER	.80	TON		\$	
0480	05985		SEEDING AND PROTECTION	14,859.00	SQYD		\$	
0490	05990		SODDING	446.00	SQYD		\$	
0500	05992		AGRICULTURAL LIMESTONE	9.20	TON		\$	
0510	05997		TOPSOIL FURNISHED AND PLACED	70.00	CUYD		\$	
0520	06510		PAVE STRIPING-TEMP PAINT-4 IN	32,160.00	LF		\$	
0530	06566		PAVE MARKING-THERMO X-WALK-12 IN	942.00	LF		\$	
0540	06568		PAVE MARKING-THERMO STOP BAR-24IN	130.00	LF		\$	
0550	06569		PAVE MARKING-THERMO CROSS-HATCH	208.00	SQFT		\$	
0560	06573		PAVE MARKING-THERMO STR ARROW	1.00	EACH		\$	
0570	06574		PAVE MARKING-THERMO CURV ARROW	2.00	EACH		\$	
0580	06575		PAVE MARKING-THERMO COMB ARROW	4.00	EACH		\$	
0590	08100		CONCRETE-CLASS A	.50	CUYD		\$	
0600	10020NS		FUEL ADJUSTMENT	9,202.00	DOLL	\$1.00	\$	\$9,202.00
0610	10030NS		ASPHALT ADJUSTMENT	16,280.00	DOLL	\$1.00	\$	\$16,280.00
0620	20550ND		SAWCUT PAVEMENT	752.00	LF		\$	
0630	21134ND		REMOVE-STORE AND REINSTALL SIGN	13.00	EACH		\$	
0640	23158ES505		DETECTABLE WARNINGS	252.00	SQFT		\$	
0650	23402EC		SEGMENTAL RETAINING WALL	70.00	LF		\$	
0660	24814EC		PIPELINE INSPECTION	2,074.00	LF		\$	
0670	24995EC		PAVE STRIPING-SPRAY THERMO-6 IN W	1,006.00	LF		\$	
0680	24996EC		PAVE STRIPING-SPRAY THERMO-6 IN Y	4,534.00	LF		\$	
0690	26119EC		INSTALL RADAR PRESENCE DETECTOR TYPE A	8.00	EACH		\$	

Section: 0003 - DRAINAGE

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0700	00522		STORM SEWER PIPE-18 IN	1,313.00	LF		\$	
0710	00524		STORM SEWER PIPE-24 IN	630.00	LF		\$	
0720	00526		STORM SEWER PIPE-30 IN	127.00	LF		\$	
0730	01310		REMOVE PIPE	44.00	LF		\$	
0740	01480		CURB BOX INLET TYPE B	25.00	EACH		\$	
0750	01644		JUNCTION BOX-30 IN	1.00	EACH		\$	
0760	23610NC		CORED HOLE DRAINAGE BOX CON	1.00	EACH		\$	

Section: 0004 - SEWER

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0770	15000		S BYPASS PUMPING	1.00	EACH		\$	
0780	15019		S ENCASEMENT STEEL BORED RANGE 6	112.00	LF		\$	
0790	15028		S FORCE MAIN AIR RLS/VAC VLV 04 IN	1.00	EACH		\$	

PROPOSAL BID ITEMS

221039

Page 3 of 3

Report Date 6/22/22

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0800	15068		S FORCE MAIN SPECIAL	173.00	LF		\$	
0810	15081		S FORCE MAIN TIE-IN SPECIAL	2.00	EACH		\$	
0820	15121		S STRUCTURE ABANDON	1.00	EACH		\$	

Section: 0005 - WATERLINE

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0830	14014		W ENCASEMENT STEEL OPEN CUT RANGE 3	30.00	LF		\$	
0840	14020		W FIRE HYDRANT RELOCATE	1.00	EACH		\$	
0850	14030		W METER RELOCATE	3.00	EACH		\$	
0860	14036		W PIPE DUCTILE IRON 06 INCH	1,320.00	LF		\$	
0870	14080		W SERV PE/PLST LONG SIDE 3/4 IN	2.00	EACH		\$	
0880	14085		W SERV PE/PLST SHORT SIDE 3/4 IN	7.00	EACH		\$	
0890	14088		W STRUCTURE REMOVAL	2.00	EACH		\$	
0900	14094		W TIE-IN 06 INCH	5.00	EACH		\$	
0910	14105		W VALVE 06 INCH	3.00	EACH		\$	
0920	14117		W VALVE CUT-IN 06 INCH	2.00	EACH		\$	

Section: 0006 - DEMOBILIZATION &/OR MOBILIZATION

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0930	02568		MOBILIZATION	1.00	LS		\$	
0940	02569		DEMOBILIZATION	1.00	LS		\$	