



CALL NO. 319

CONTRACT ID. 251004

MCLEAN COUNTY

FED/STATE PROJECT NUMBER FD04 075 0056 006-007

DESCRIPTION BETHEL GROVE-BETHEL CHURCH ROAD(KY-56)

WORK TYPE WIDENING

PRIMARY COMPLETION DATE 11/15/2025

LETTING DATE: January 23,2025

Sealed Bids will be received electronically through the Bid Express bidding service until 10:00 AM EASTERN STANDARD TIME January 23,2025. Bids will be publicly announced at 10:00 AM EASTERN STANDARD TIME.

PLANS AVAILABLE FOR THIS PROJECT.

REQUIRED BID PROPOSAL GUARANTY: Not less than 5% of the total bid.

TABLE OF CONTENTS

PART I	SCOPE OF WORK <ul style="list-style-type: none">• PROJECT(S), COMPLETION DATE(S), & LIQUIDATED DAMAGES• CONTRACT NOTES• STATE CONTRACT NOTES• ASPHALT MIXTURE• INCIDENTAL SURFACING• ASPHALT PAVEMENT RIDE QUALITY CAT B• COMPACTION OPTION A• TREE REMOVAL• NON-TRACKING TACK COAT• RIGHT OF WAY CERTIFICATION• UTILITY IMPACT & RAIL CERTIFICATION NOTES• WATER STANDARD UTILITY BID ITEMS• WATER SPECIFICATIONS• DEPT OF ARMY - NATIONWIDE PERMIT• KPDES STORM WATER PERMIT, BMP AND ENOI
PART II	SPECIFICATIONS AND STANDARD DRAWINGS <ul style="list-style-type: none">• STANDARD AND SUPPLEMENTAL SPECIFICATIONS• [SN-1I] PORTABLE CHANGEABLE MESSAGE SIGNS• [SN-11N] LONGITUDINAL PAVEMENT JOINT ADHESIVE
PART III	EMPLOYMENT, WAGE AND RECORD REQUIREMENTS <ul style="list-style-type: none">• LABOR AND WAGE REQUIREMENTS• EXECUTIVE BRANCH CODE OF ETHICS• KENTUCKY EQUAL EMPLOYMENT OPPORTUNITY ACT OF 1978 LOCALITY / STATE• PROJECT WAGE RATES / STATE FUNDED
PART IV	BID ITEMS

PART I

SCOPE OF WORK

ADMINISTRATIVE DISTRICT - 02

CONTRACT ID - 251004
FD04 075 0056 006-007
COUNTY - MCLEAN
PCN - DE07500562504
FD04 075 0056 006-007

BETHEL GROVE-BETHEL CHURCH ROAD(KY-56) Midpoint, A DISTANCE OF 0.12 MILES.WIDENING SYP NO.
02-08852.00.
GEOGRAPHIC COORDINATES LATITUDE 37:37:27.00 LONGITUDE 87:23:34.00
ADT

COMPLETION DATE(S):
COMPLETED BY 11/15/2025 APPLIES TO ENTIRE CONTRACT

CONTRACT NOTES

INSURANCE

Refer to Kentucky Standard Specifications for Road and Bridge Construction, current edition.

PROPOSAL ADDENDA

All addenda to this proposal must be applied when calculating bid and certified in the bid packet submitted to the Kentucky Department of Highways. Failure to use the correct and most recent addenda may result in the bid being rejected.

BID SUBMITTAL

Bidder must use the Department's electronic bidding software. The Bidder must download the bid file located on the Bid Express website (www.bidx.com) to prepare a bid packet for submission to the Department. The bidder must submit electronically using Bid Express.

JOINT VENTURE BIDDING

Joint venture bidding is permissible. All companies in the joint venture must be prequalified in one of the work types in the Qualifications for Bidders for the project. The bidders must get a vendor ID for the joint venture from the Division of Construction Procurement and register the joint venture as a bidder on the project. Also, the joint venture must obtain a digital ID from Bid Express to submit a bid. A joint bid bond of 5% may be submitted for both companies or each company may submit a separate bond of 5%.

UNDERGROUND FACILITY DAMAGE PROTECTION

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. When prescribed in said directives, the contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom shall be contacted through their individual Protection Notification Center. Non-compliance with these directives can result in the enforcement of penalties.

REGISTRATION WITH THE SECRETARY OF STATE BY A FOREIGN ENTITY

Pursuant to KRS 176.085(1)(b), an agency, department, office, or political subdivision of the Commonwealth of Kentucky shall not award a state contract to a person that is a foreign entity required by [KRS 14A.9-010](#) to obtain a certificate of authority to transact business in the Commonwealth ("certificate") from the Secretary of State under [KRS 14A.9-030](#) unless the person produces the certificate within fourteen (14) days of the bid or proposal opening. If the

foreign entity is not required to obtain a certificate as provided in [KRS 14A.9-010](#), the foreign entity should identify the applicable exception. Foreign entity is defined within [KRS 14A.1-070](#).

For all foreign entities required to obtain a certificate of authority to transact business in the Commonwealth, if a copy of the certificate is not received by the contracting agency within the time frame identified above, the foreign entity's solicitation response shall be deemed non-responsive or the awarded contract shall be cancelled.

Businesses can register with the Secretary of State at <https://secure.kentucky.gov/sos/ftbr/welcome.aspx>.

SPECIAL NOTE FOR PROJECT QUESTIONS DURING ADVERTISEMENT

Questions about projects during the advertisement should be submitted in writing to the Division of Construction Procurement. This may be done by email to kytc.projectquestions@ky.gov. The Department will attempt to answer all submitted questions. The Department reserves the right not to answer if the question is not pertinent or does not aid in clarifying the project intent.

The deadline for posting answers will be 3:00 pm Eastern Daylight Time, the day preceding the Letting. Questions may be submitted until this deadline with the understanding that the later a question is submitted, the less likely an answer will be able to be provided.

The questions and answers will be posted for each Letting under the heading "Questions & Answers" on the Construction Procurement website (www.transportation.ky.gov/construction-procurement). The answers provided shall be considered part of this Special Note and, in case of a discrepancy, will govern over all other bidding documents.

HARDWOOD REMOVAL RESTRICTIONS

The US Department of Agriculture has imposed a quarantine in Kentucky and several surrounding states, to prevent the spread of an invasive insect, the emerald ash borer. Hardwood cut in conjunction with the project may not be removed from the state. Chipping or burning on site is the preferred method of disposal.

INSTRUCTIONS FOR EXCESS MATERIAL SITES AND BORROW SITES

Identification of excess material sites and borrow sites shall be the responsibility of the Contractor. The Contractor shall be responsible for compliance with all applicable state and federal laws and may wish to consult with the US Fish and Wildlife Service to seek protection under Section 10 of the Endangered Species Act for these activities.

ACCESS TO RECORDS

The state agency certifies that it is in compliance with the provisions of KRS 45A.150, "Access to contractor's books, documents, papers, records, or other evidence directly pertinent to the contract." The Contractor, as defined in KRS 45A.030, agrees that the contracting agency, the

Finance and Administration Cabinet, the Auditor of Public Accounts, and the Legislative Research Commission, or their duly authorized representatives, shall have access to any books, documents, papers, records, or other evidence, which are directly pertinent to this agreement for the purpose of financial audit or program review. The Contractor also recognizes that any books, documents, papers, records, or other evidence, received during a financial audit or program review shall be subject to the Kentucky Open Records Act, KRS 61.870 to 61.884. Records and other prequalification information confidentially disclosed as part of the bid process shall not be deemed as directly pertinent to the agreement and shall be exempt from disclosure as provided in KRS 61.878(1)(c).

BOYCOTT PROVISIONS

If applicable, the contractor represents that, pursuant to [KRS 45A.607](#), they are not currently engaged in, and will not for the duration of the contract engage in, the boycott of a person or an entity based in or doing business with a jurisdiction with which Kentucky can enjoy open trade. **Note:** The term Boycott does not include actions taken for bona fide business or economic reasons, or actions specifically required by federal or state law.

If applicable, the contractor verifies that, pursuant to KRS 41.480, they do not engage in, and will not for the duration of the contract engage in, in energy company boycotts as defined by KRS 41.472.

LOBBYING PROHIBITIONS

The contractor represents that they, and any subcontractor performing work under the contract, have not violated the agency restrictions contained in [KRS 11A.236](#) during the previous ten (10) years, and pledges to abide by the restrictions set forth in such statute for the duration of the contract awarded.

The contractor further represents that, pursuant to [KRS 45A.328](#), they have not procured an original, subsequent, or similar contract while employing an executive agency lobbyist who was convicted of a crime related to the original, subsequent, or similar contract within five (5) years of the conviction of the lobbyist.

Revised: 1/1/2025

1.0 BUY AMERICA REQUIREMENT.

Follow the “Buy America” provisions as required by 23 U.S.C. § 313 and 23 C.F.R. § 635.410. Except as expressly provided herein all manufacturing processes of steel or iron materials including but not limited to structural steel, guardrail materials, corrugated steel, culvert pipe, structural plate, prestressing strands, and steel reinforcing bars shall occur in the United States of America, including the application of:

- Coating,
- Galvanizing,
- Painting, and
- Other coating that protects or enhances the value of steel or iron products.

The following are exempt, unless processed or refined to include substantial amounts of steel or iron material, and may be used regardless of source in the domestic manufacturing process for steel or iron material:

- Pig iron,
- Processed, pelletized, and reduced iron ore material, or
- Processed alloys.

The Contractor shall submit a certification stating that all manufacturing processes involved with the production of steel or iron materials occurred in the United States.

Produce, mill, fabricate, and manufacture in the United States of America all aluminum components of bridges, tunnels, and large sign support systems, for which either shop fabrication, shop inspection, or certified mill test reports are required as the basis of acceptance by the Department.

Use foreign materials only under the following conditions:

- 1) When the materials are not permanently incorporated into the project; or
- 2) When the delivered cost of such materials used does not exceed 0.1 percent of the total Contract amount or \$2,500.00, whichever is greater.

The Contractor shall submit to the Engineer the origin and value of any foreign material used.

2.0 – BUILD AMERICA, BUY AMERICA (BABA)

Contractor shall comply with the Federal Highway Administration (FHWA) Buy America Requirement in 23 C.F.R. § 635.410 and all relevant provisions of the Build America, Buy America Act (BABA), contained within the Infrastructure Investment and Jobs Act, Pub. L. No. 117-58, §§ 70901-52 enacted November 15, 2021. The BABA requires iron, steel, manufactured products, and construction materials used in infrastructure projects funded by federal financial assistance to be produced in the United States. Comply with 2 C.F.R § 184.

BABA permits FHWA participation in the Contract only if domestic steel and iron will be used on the Project. To be considered domestic, all steel and iron used, and all products manufactured from steel and iron must be produced in the United States and all manufacturing processes, including application of a coating, for these materials must occur in the United States. Coating includes all processes that protect or enhance the value of the material to which the coating is applied. This requirement does not preclude a minimal use of foreign steel and iron materials, provided the cost of such materials does not exceed 0.1% of the total contract amount under the Contract or \$2,500.00 whichever is greater.

BABA permits FHWA participation in the Contract only if all “construction materials” as defined in the Act are made in the United States. The Buy America preference applies to the following construction materials

SPECIAL NOTE – BUY AMERICA REQUIREMENTS AND BUILD
AMERICA, BUY AMERICA (BABA) ACT

10/26/2023

incorporated into infrastructure projects: non-ferrous metals; plastic and polymer-based products (including polyvinylchloride, composite building materials, and polymers used in fiber optic cables); glass (including optic glass); Fiber optic cable; optical fiber; lumber; engineered wood; and drywall. Contractor will be required to use construction materials produced in the United States on this Project. The Contractor shall submit a certification stating that all construction materials are certified to be BABA compliant.

Finally, BABA permits the continuation of FHWA's current general applicability waivers for manufactured products, raw materials, and ferryboat parts, but these waivers are subject to reevaluation, specifically the general applicability waiver for manufactured products.

The Contractor has completed and submitted, or shall complete and submit, to the Cabinet a Buy America/Build America, Buy America Certificate prior to the Cabinet issuing the notice to proceed, in the format below. After submittal, the Contractor is bound by its original certification.

A false certification is a criminal act in violation of 18 U.S.C. § 1001. The Contractor has the burden of proof to establish that it is in compliance.

At the Contractor's request, the Cabinet may, but is not obligated to, seek a waiver of Buy America requirements if grounds for the waiver exist under 23 C.F.R. § 635.410(c) or will comply with the applicable Buy America requirements if a waiver of those requirements is not available or not pursued by the Cabinet.

Please refer to the Federal Highway Administration's Buy America webpage for more information.

[Buy America - Construction Program Guide - Contract Administration - Construction - Federal Highway Administration \(dot.gov\)](#)

October 26, 2023 Letting

BUY AMERICA / BUILD AMERICA, BUY AMERICA (ACT) MATERIALS CERTIFICATE OF COMPLIANCE

The Contractor hereby certifies that it will comply with all relevant provisions of the Build America, Buy America Act, contained within the Infrastructure Investment and Jobs Act, Pub. L. NO. 117-58, §§ 70901-52, the requirements of 23 U.S.C. § 313, 23 C.F.R. § 635.410 and 2 C.F.R § 184.

Date Submitted:_____

Contractor:_____

Signature:_____

Printed Name:_____

Title:_____

NOTE: THIS CERTIFICATION IS IN ADDITION TO ANY AND ALL REQUIREMENTS OUTLINED IN THE CURRENT EDITION OF THE STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION AND/OR SPECIAL NOTES CONTAINED IN THE PROJECT PROPOSAL.

SPECIAL NOTE FOR RECIPROCAL PREFERENCE

RECIPROCAL PREFERENCE TO BE GIVEN BY PUBLIC AGENCIES TO RESIDENT BIDDERS

By reference, KRS 45A.490 to 45A.494 are incorporated herein and in compliance regarding the bidders residency. Bidders who want to claim resident bidder status should complete the Affidavit for Claiming Resident Bidder Status along with their bid in the electronic bidding software. Submittal of the Affidavit should be done along the bid in Bid Express.

April 30, 2018

ASPHALT MIXTURE

Unless otherwise noted, the Department estimates the rate of application for all asphalt mixtures to be 110 lbs/sy per inch of depth.

INCIDENTAL SURFACING

The Department has included in the quantities of asphalt mixtures established in the proposal estimated quantities required for resurfacing or surfacing mailbox turnouts, farm field entrances, residential and commercial entrances, curve widening, ramp gores and tapers, and road and street approaches, as applicable. Pave these areas to the limits as shown on Standard Drawing RPM-110-06 or as directed by the Engineer. In the event signal detectors are present in the intersecting streets or roads, pave the crossroads to the right of way limit or back of the signal detector, whichever is the farthest back of the mainline. Surface or resurface these areas as directed by the Engineer. The Department will not measure placing and compacting for separate payment but shall be incidental to the Contract unit price for the asphalt mixtures.

ASPHALT PAVEMENT RIDE QUALITY CATEGORY B

The Department will apply Pavement Rideability Requirements on this project in accordance with Section 410, Category B.

OPTION A

Be advised that the Department will accept compaction of asphalt mixtures furnished for driving lanes and ramps, at 1 inch (25mm) or greater, on this project according to OPTION A in accordance with Section 402 and Section 403 of the current Standard Specifications. The Department will require joint cores as described in Section 402.03.02 for surface mixtures only. The Department will accept compaction of all other asphalt mixtures according to OPTION B.

SPECIAL NOTE

For Tree Removal

**Christian County
ADDRESS CONGESTION AND MOBILITY OF US 68
FROM KY 91 TO KY 1007 IN HOPKINSVILLE
Item No. 2-899**

NO CLEARING OF TREES 5 INCHES OR GREATER (DIAMETER BREAST
HEIGHT) FROM MAY 15 - JULY 31

**If there are any questions regarding this note, please contact Danny Peake, Director,
Division of Environmental Analysis, 200 Mero Street, Frankfort, KY 40601, Phone:
(502) 564-7250.**

SPECIAL NOTE FOR NON-TRACKING TACK COAT

1. DESCRIPTION AND USEAGE. This specification covers the requirements and practices for applying a non-tracking tack asphalt coating. Place this material on the existing pavement course, prior to placement of a new asphalt pavement layer. Use when expedited paving is necessary or when asphalt tracking would negatively impact the surrounding area. This material is not suitable for other uses. Ensure material can “break” within 15 minutes under conditions listed in 3.2.
2. MATERIALS, EQUIPMENT, AND PERSONNEL.

2.1 Non-Tracking Tack. Provide material conforming to Subsection 2.1.1.

2.1.1 Provide a tack conforming to the following material requirements:

Property	Specification	Test Procedure
Viscosity, SFS, 77 ° F	20 – 100	AASHTO T 72
Sieve, %	0.3 max.	AASHTO T 59
Asphalt Residue ¹ , %	50 min.	AASHTO T 59
Oil Distillate, %	1.0 max.	AASHTO T 59
Residue Penetration, 77 ° F	0 - 30	AASHTO T 49
Original Dynamic Shear (G*/sin δ), 82 ° C	1.0 min.	AASHTO T 315
Softening Point, ° F	149 min.	AASHTO T 53
Solubility, %	97.5 min.	AASHTO T 44

¹ Bring sample to 212 °F over a 10-15 minute period. Maintain 212 °F for 15-20 minutes or until 30-40 mL of water has distilled. Continue distillation as specified in T59.

- 2.2. Equipment. Provide a distributor truck capable of heating, circulating, and spraying the tack between 170 °F and 180 °F. Do not exceed 180 °F. Circulate the material while heating. Provide the correct nozzles that is recommend by the producer to ensure proper coverage of tack is obtained. Ensure the bar can be raised to between 14” and 18” from the roadway.
 - 2.3. Personnel. Ensure the tack supplier has provided training to the contractor on the installation procedures for this product. Make a technical representative from the supplier available at the request of the Engineer.
3. CONSTRUCTION.
 - 3.1 Surface Preparation. Prior to the application of the non-tracking tack, ensure the pavement surface is thoroughly dry and free from dust or any other debris that would inhibit adhesion. Clean the surface by scraping, sweeping, and the use of compressed air. Ensure this preparation process occurs shortly before application to prevent the return of debris on to the pavement. If rain is expected within one hour after application, do not apply material. Apply material only when the surface is dry, and no precipitation is expected.

3.2 Non-tracking Tack Application. Placement of non-tracking tack is not permitted from October 1st to May 15th. When applying material, ensure the roadway temperature is a minimum of 40°F and rising. Prior to application, demonstrate competence in applying the tack according to this note to the satisfaction of the Engineer. Heat the tack in the distributor to between 170 – 180 °F. After the initial heating, between 170 – 180 °F, the material may be sprayed between 165 °F and 180 °F. Do not apply outside this temperature range. Apply material at a minimum rate of 0.70 pounds (0.08 gallons) per square yard. Ensure full coverage of the material on the pavement surface. Full coverage of this material is critical. Increase material application rate if needed to achieve full coverage. Schedule the work so that, at the end of the day's production, all non-tracking tack is covered with the asphalt mixture. If for some reason the non-tracking tack cannot be covered by an asphalt mixture, ensure the non-tracking tack material is clean and reapply the non-tracking tack prior to placing the asphalt mixture. Do not heat material more than twice in one day.

3.3 Non-tracking Tack Certification. Furnish the tack certification to the Engineer stating the material conforms to all requirements herein prior to use.

3.4 Sampling and Testing. The Department will require a sample of non-tracking tack be taken from the distributor at a rate of one sample per 15,000 tons of mix. Take two 1 gallon samples of the heated material and forward the sample to the Division of Materials for testing within 7 days. Ensure the product temperature is between 170 and 180 °F at the time of sampling.

4. MEASUREMENT. The Department will measure the quantity of non-tracking tack in tons. The Department will not measure for payment any extra materials, labor, methods, equipment, or construction techniques used to satisfy the requirements of this note. The Department will not measure for payment any trial applications of non-tracking tack, the cleaning of the pavement surface, or furnishing and placing the non-tracking tack. The Department will consider all such items incidental to the non-tracking tack.
5. PAYMENT. The Department will pay for the non-tracking tack at the Contract unit bid price and apply an adjustment for each manufacturer's lot of material based on the degree of compliance as defined in the following schedule. Non-tracking tack will not be permitted for use from October 1st to May 15th. During this timeframe, the department will allow the use of an approved asphalt emulsion in lieu of a non-tracking tack product but will not adjust the unit bid price of the material. When a sample fails on two or more tests, the Department may add the deductions, but the total deduction will not exceed 100 percent.

Non-Tracking Tack Price Adjustment Schedule						
Test	Specification	100% Pay	90% Pay	80% Pay	50% Pay	0% Pay
Viscosity, SFS, 77 ° F	20 – 100	19 - 102	17 - 18	15 - 16	14	≤13
			103 - 105	106 - 107	108 - 109	≥ 110
Sieve, %	0.30 max.	≤ 0.40	0.41 - 0.50	0.51 - 0.60	0.61 - 0.70	≥ 0.71
Asphalt Residue, %	50 min.	≥49.0	48.5 – 48.9	48.0 – 48.4	47.5-47.9	≤ 47.4
Oil Distillate, %	1.0 max.	≤1.0	1.1-1.5	1.6 - 1.7	1.8-1.9	>2.0
Residue Penetration, 77 ° F.	30 max.	≤ 31	32 - 33	34 - 35	36 - 37	≥ 38
Original Dynamic Shear (G*/sin δ), 82 ° C	1.0 min.	≥0.95	0.92 – 0.94	0.90 – 0.91	0.85 - 0.89	≤ 0.84
Softening Point, ° F	149 min.	≥145	142 - 144	140 - 141	138 - 139	≤ 137
Solubility, %	97.5 min.	≥ 97.0	96.8 – 96.9	96.6 – 96.7	96.4 – 96.5	≤ 96.3

Code
24970EC

Pay Item
Asphalt Material for Tack Non-Tracking

Pay Unit
Ton

Revised: May 23, 2022



KENTUCKY TRANSPORTATION CABINET

Department of Highways



DIVISION OF RIGHT OF WAY & UTILITIES

RIGHT OF WAY CERTIFICATION

TC 62-226

Rev. 01/2016

Page 1 of 1

<input checked="" type="checkbox"/>	Original	<input type="checkbox"/>	Re-Certification	RIGHT OF WAY CERTIFICATION	
ITEM #		COUNTY		PROJECT # (STATE)	PROJECT # (FEDERAL)
2-8852.00		McLean		1100 FD04 075 9011801R	N/A
PROJECT DESCRIPTION					
Correct line of sight with intersection of KY 56 and KY 1233					
<input type="checkbox"/>	No Additional Right of Way Required				
Construction will be within the limits of the existing right of way. The right of way was acquired in accordance to FHWA regulations under the Uniform Relocation Assistance and Real Property Acquisitions Policy Act of 1970, as amended. No additional right of way or relocation assistance were required for this project.					
<input checked="" type="checkbox"/>	Condition # 1 (Additional Right of Way Required and Cleared)				
All necessary right of way, including control of access rights when applicable, have been acquired including legal and physical possession. Trial or appeal of cases may be pending in court but legal possession has been obtained. There may be some improvements remaining on the right-of-way, but all occupants have vacated the lands and improvements, and KYTC has physical possession and the rights to remove, salvage, or demolish all improvements and enter on all land. Just Compensation has been paid or deposited with the court. All relocations have been relocated to decent, safe, and sanitary housing or that KYTC has made available to displaced persons adequate replacement housing in accordance with the provisions of the current FHWA directive.					
<input type="checkbox"/>	Condition # 2 (Additional Right of Way Required with Exception)				
The right of way has not been fully acquired, the right to occupy and to use all rights-of-way required for the proper execution of the project has been acquired. Some parcels may be pending in court and on other parcels full legal possession has not been obtained, but right of entry has been obtained, the occupants of all lands and improvements have vacated, and KYTC has physical possession and right to remove, salvage, or demolish all improvements. Just Compensation has been paid or deposited with the court for most parcels. Just Compensation for all pending parcels will be paid or deposited with the court prior to AWARD of construction contract					
<input type="checkbox"/>	Condition # 3 (Additional Right of Way Required with Exception)				
The acquisition or right of occupancy and use of a few remaining parcels are not complete and/or some parcels still have occupants. All remaining occupants have had replacement housing made available to them in accordance with 49 CFR 24.204. KYTC is hereby requesting authorization to advertise this project for bids and to proceed with bid letting even though the necessary right of way will not be fully acquired, and/or some occupants will not be relocated, and/or the just compensation will not be paid or deposited with the court for some parcels until after bid letting. KYTC will fully meet all the requirements outlined in 23 CFR 635.309(c)(3) and 49 CFR 24.102(j) and will expedite completion of all acquisitions, relocations, and full payments after bid letting and prior to AWARD of the construction contract or force account construction.					
Total Number of Parcels on Project		1	EXCEPTION (S) Parcel #	ANTICIPATED DATE OF POSSESSION WITH EXPLANATION	
Number of Parcels That Have Been Acquired					
Signed Deed		1			
Condemnation					
Signed ROE					
Notes/ Comments (Use Additional Sheet if necessary)					
LPA RW Project Manager			Right of Way Supervisor		
Printed Name			Printed Name		
Signature			Signature		
Date			Date		Digitally signed by Jennifer K. Cox Date: 2024.11.22 08:57:43 -06'00'
Right of Way Director			FHWA		
Printed Name			Printed Name		
Signature			Signature		
Date		Digitally signed by Kelly Divine Date: 2024.11.22 09:51:17 -06'00'	Date		

UTILITIES AND RAIL CERTIFICATION NOTE

<p>2-8852.00 Mclean County KY 56 from MP 6.1 to 6.22 Correct line of sight at 56 & 1233 FDO4 075 9011801U</p>
<p>GENERAL PROJECT NOTE ON UTILITY PROTECTION</p>

NOTE: DO NOT DISTURB THE FOLLOWING UTILITIES LOCATED WITHIN THE PROJECT DISTURB LIMITS

N/A

The Contractor is fully responsible for protection of all utilities listed above

THE FOLLOWING COMPANIES ARE RELOCATING/ADJUSTING THEIR UTILITIES WITHIN THE PROJECT LIMITS
AND WILL BE COMPLETE PRIOR TO CONSTRUCTION

THE FOLLOWING COMPANIES HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE COMPANY OR THE
COMPANY’S SUBCONTRACTOR AND IS TO BE COORDINATED WITH THE ROAD CONTRACT

AT&T will be relocated by February

THE FOLLOWING COMPANIES HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE ROAD
CONTRACTOR AS INCLUDED IN THIS CONTRACT

Beech Grove Water

THE FOLLOWING RAIL COMPANIES HAVE FACILITIES IN CONJUNCTION WITH THIS PROJECT AS NOTED

☒ No Rail Involved ☐ Minimal Rail Involved (See Below) ☐ Rail Involved (See Below)

UTILITIES AND RAIL CERTIFICATION NOTE

2-8852.00
McLean County
KY 56 from MP 6.1 to 6.22
Correct line of sight at 56 & 1233
FDO4 075 9011801U

UNDERGROUND FACILITY DAMAGE PROTECTION – BEFORE YOU DIG

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. The contractor is instructed to contact KY 811 for the location of existing underground utilities. Contact shall be made a minimum of two (2) and no more than ten (10) business days prior to excavation.

The contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY 811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom are to be contacted through their individual Protection Notification Center. It may be necessary for the contractor to contact the County Court Clerk to determine what utility companies have facilities in the area. Non-compliance with these directives can result in the enforcement of penalties.

SPECIAL CAUTION NOTE – PROTECTION OF UTILITIES

The contractor will be responsible for contacting all utility facility owners on the subject project to coordinate his activities. The contractor will coordinate his activities to minimize and, where possible, avoid conflicts with utility facilities. Due to the nature of the work proposed, it is unlikely to conflict with the existing utilities beyond minor facility adjustments. Where conflicts with utility facilities are unavoidable, the contractor will coordinate any necessary relocation work with the facility owner and Resident Engineer. The Kentucky Transportation Cabinet maintains the right to remove or alter portions of this contract if a utility conflict occurs.

The utility facilities as noted in the previous section(s) have been determined using data garnered by varied means and with varying degrees of accuracy: from the facility owners, a result of S.U.E., field inspections, and/or reviews of record drawings. The facilities defined may not be inclusive of all utilities in the project scope and are not Level A quality, unless specified as such. It is the contractor's responsibility to verify all utilities and their respective locations before excavating.

Please Note: The information presented in this Utility Note is informational in nature and the information contained herein is not guaranteed.

UTILITIES AND RAIL CERTIFICATION NOTE

2-8852.00
Mclean County
KY 56 from MP 6.1 to 6.22
Correct line of sight at 56 & 1233
FDO4 075 9011801U

AREA UTILITIES CONTACT LIST

NOTE: The Utilities Contact List is provided as informational only, and may not be a complete list of all Utility Companies with facilities in the project area.

Beech Grove Water	Sheila Murphy	(270) 273-5738 beechgrovewater@bellsouth.net
AT&T	Lee Greathouse	(270) 302-7267 Tg2580@att.com

Standard Water Bid Item Descriptions

THESE BID ITEM DESCRIPTIONS SHALL SUPERCEDE ANY BID ITEM DESCRIPTIONS CONTAINED IN UTILITY OWNER SUPPLIED SPECIFICATIONS PROVIDED ELSEWHERE IN THIS PROPOSAL.

W AIR RELEASE VALVE This bid item description shall apply to all air release valve installations of every size except those defined as “Special”. This item shall include the air release valve, main to valve connecting line or piping, manhole, vault, structure, access casting or doors, tapping the main, labor, equipment, excavation, proper backfill, and restoration required to install the air release valve at the location shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready-for-use. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

BOLLARDS This item is for payment for furnishing and installing protective guard posts at above-ground utility installations. A bollard may consist of, but is not limited to, a steel post set in concrete or any other substantial post material. This item shall include all labor, equipment, and materials needed for complete installation of the bollard, as specified by the utility owner specifications and plans. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

NOTE: A bid code for this item has been established in standard roadway bid items and shall be used for payment of this item. The bid code is 2134IND.

W CAP EXISTING MAIN This item shall include the specified cap, concrete blocking and/or mechanical anchoring, labor, equipment, excavation, backfill, and restoration required to install the cap on an existing main to be left in service at the location shown on the plans or as directed, in accordance with the specifications. This item is not to be paid to cap new main installations or mains that are to be abandoned. This pay item is only to be paid to cap existing mains to be left in service. Caps on new mains are to be considered incidental to the new main, as are other fittings, and are not to be paid under this item. All caps on existing mains shall be paid under this one bid item included in the contract, regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

Plugging of existing abandoned mains shall be performed and paid in accordance with Section 708.03.05 of KYTC Standard Specifications for Road and Bridge Construction, using Bid code 01314, Plug Pipe.

W CATHODIC PROTECTION This item is for providing and installing all cathodic protection materials to iron pipe and fittings, as specified in plans and specifications, complete and ready-for-use. Materials to be supplied and installed by the contractor shall include, but are not limited to, anodes, wire, fusion kits, test stations, and/or marker posts. All cathodic protection required for the entire project shall be paid under this one item. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid LUMP SUM (LS) when complete.

W DIRECTIONAL BORE Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized to minimize the impact of open-cut for the installation of water main under streets, creeks, etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore, whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at

each end of the bore, when specified, to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract, regardless of size. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W ENCASEMENT CONCRETE This item shall include all labor, equipment, excavation, concrete, reinforcing steel, backfill, restoration, etc., to construct the concrete encasement of the water main as shown on the plans, and in accordance with the specifications and standard drawings. Payment under this item shall be in addition to the carrier pipe, as paid under separate bid items. Carrier pipe is not included in this bid item. Any and all concrete encasements shall be paid under one bid item included in the contract, regardless of the size of the carrier pipe or the volume of concrete or steel reinforcement, as specified in the plans and specifications. No separate bid items will be established for size variations. Measurement of pay quantity shall be from end of concrete to end of concrete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W ENCASEMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready-for-use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately but shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W ENCASEMENT STEEL OPEN CUT This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to open-cut and install the encasement in accordance with the plans and specifications, complete and ready-for-use. The size shall be the measured internal diameter of the encasement pipe. The size encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately but shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W FIRE HYDRANT ADJUST This item includes all labor, equipment, excavation, materials, and backfill to adjust the existing fire hydrant using the fire hydrant manufacturer's extension kit for adjustments of 18" or less. Adjustments greater than 18" require anchoring couplings and vertical bends to adjust to grade. The Contractor will supply and install all anchor couplings, bends, fire hydrant extension, concrete blocking, restoration, granular drainage material, etc., needed to adjust the fire hydrant, complete and ready-for-use as shown on the plans, and in accordance with the specifications and standard drawings. This also includes allowing for the utility owner inspector to inspect the existing fire hydrant prior to adjusting, contractor returning unusable fire hydrants to the utility owner warehouse and picking up a replacement hydrant. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete and ready for use.

W FIRE HYDRANT ASSEMBLY This item includes all labor, equipment, new fire hydrant, isolating valve and valve box, concrete pad around valve box (when specified in specifications or plans), piping, anchoring tee, anchoring couplings, fire hydrant extension, excavation, concrete blocking, granular drainage material, backfill, and restoration, to install a new fire hydrant assembly as indicated on plans and standard drawings, complete and ready-for-use. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FIRE HYDRANT RELOCATE This item includes all labor and equipment to remove the existing fire hydrant from its existing location and to reinstall at a new location. This item shall include a new isolating valve and valve box, concrete pad around valve box (when required in specifications or plans), new piping, new anchoring tee, anchoring couplings, fire hydrant extensions, concrete blocking, restoration, granular drainage material, excavation, and backfill as indicated on plans, specifications, and standard drawings, complete and ready-for-use. This item shall also include allowing for utility owner inspector to inspect the existing fire hydrant prior to reuse, contractor returning unusable fire hydrants to the utility owner warehouse and picking up a replacement hydrant for use if the existing fire hydrant is determined unfit for reuse. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FIRE HYDRANT REMOVE This item includes removal of an abandoned fire hydrant, isolating valve, and valve box, to the satisfaction of the engineer. The removed fire hydrant, isolating valve, and valve box shall become the property of the contractor for his disposal as salvage or scrap. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FLUSH HYDRANT ASSEMBLY This item shall include the flushing hydrant assembly, service line, tapping the main, labor, equipment, excavation, backfill, and restoration required to install the flush hydrant at the location shown on the plans and in accordance with the specifications and standard drawings, complete and ready-for-use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W FLUSHING ASSEMBLY This item shall include the flushing device assembly, service line, meter box and lid, tapping the main, labor, equipment, excavation, backfill, and restoration required to install the flushing device at the location shown on the plans and in accordance with the specifications and standard drawings, complete and ready-for-use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W LEAK DETECTION METER This item is for payment for installation of a water meter at main valve locations, as shown on the plans, for detection of water main leaks. The meter shall be of the size and type specified in the plans or specifications. This item shall include all labor, equipment, meter, meter box or vault, connecting pipes between main and meter, main taps, tapping saddles, casting, yoke, and any other associated material needed for installation of a functioning water meter in accordance with the plans and specifications, complete and ready-for-use. No separate payment will be made under any other contract item for connecting pipe or main taps. All leak detection meters shall be paid under one bid item included in the contract, regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete and ready for use.

W LINE MARKER This item is for payment for furnishing and installing a water utility line marker as specified by the utility owner specifications and plans. A line marker may consist of a post or monument of whatever materials specified and shall include markings and/or signage on same as specified by plans or specifications. This item shall include all labor, equipment, and materials needed for complete installation of the marker. This item shall be paid EACH (EA) when complete.

W LINE STOP SIZE 1 OR 2 This item shall include the line stop saddle/sleeve, valve, completion plug and any other material, labor, and equipment necessary to complete the line stop as indicated in the plans and/or specifications. This installation shall allow the waterline system to operate as usual without any interruption of service. The size shall be the measured internal diameter of the live pipe to be tapped. The line stop size to be paid under sizes 1 or 2 shall be as follows:

Size 1 = All live tapped main sizes up to and including 8 inches

Size 2 = All live tapped main sizes greater than 8 inches

Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W MAIN POINT RELOCATE This item is intended for payment for horizontal and/or vertical relocation of a short length of an existing main at the location shown on the plans. This bid item is to be used to relocate an existing water main at point locations, such as to clear a conflict at a proposed drainage structure, pipe, or any other similar short relocation situation, and where the existing pipe material is to be reused. The contractor shall provide any additional pipe or fitting material needed to complete the work, as shown on the plans and specifications. The materials provided shall be of the same type and specifications as those that exist. Substitution of alternative materials shall be approved by the engineer in advance on a case-by-case basis. New polyethylene wrap is to be provided (if wrap exists or is specified in the specifications to be used). If it is necessary that the pipe be disassembled for relay, payment under this item shall also include replacement of joint gaskets as needed. Bedding and backfill shall be provided and performed the same as with any other pipe installation as detailed in the plans and specifications. Payment under this item shall be for each location requiring an existing main to be relocated horizontally or vertically, regardless of pipe size or relocation length. No separate pay items will be established for pipe size variations or relocation segment length variations. Water Main Relocate shall not be paid on a linear feet basis but shall be paid EACH (EA) at each location when complete and placed in service. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

W METER This item is for payment for installation of all standard water meters of all sizes 2 inches in diameter or less as specified on the plans. This item shall include all labor, equipment, meter, meter box, casting, yoke, and any other associated materials needed for installation of a functioning water meter, in accordance with the plans and specifications, complete and ready-for-use. This item shall include connections to the new or existing water service line. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER ADJUST This item includes all labor, equipment, excavation, materials, backfill, restoration, etc., to adjust the meter casting to finished grade (whatever size exists) at the location shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready-for-use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER RELOCATE This item includes all labor, equipment, excavation, additional fittings, disinfection, testing, restoration, etc., to relocate the existing water meter (whatever size exists), meter yoke, meter box, casting, etc., from its old location to the location shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready-for-use. The new service pipe (if required) will be paid under the short side or long side service bid item. Any and all meter relocations of 2 inches or less shall be paid under one bid item included in the contract, regardless of size. Each individual relocation shall be paid individually under this item; however, no separate bid items will be established for meter size variations of 2 inches in diameter or less. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER VAULT SIZE RANGE 1 OR 2 This item is for payment for installation of an underground structure for housing of a large water meter, fittings, and valves as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or access doors, the specified meter(s) valve(s), all piping, and fitting materials associated with installing a functioning meter and vault in accordance with the plans, standard drawings, and specifications, complete and ready-for-use. The size shall be the measured internal diameter of the meter and piping to be installed. The size meter vault to be paid under size 1 or 2 shall be as follows:

Size Range 1 = All meter and piping sizes greater than 2 inches up to and including 6 inches
Size Range 2 = All meter and piping sizes greater than 6 inches

This item shall be paid EACH (EA) when complete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

W METER/FIRE SERVICE COMBO VAULT This item is for payment for installation of an underground structure for housing of a water meter and fire service piping, fittings, and valves as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or access doors, the specified meter(s), valve(s), all piping, and fitting materials associated with installing a functioning meter and fire service vault, in accordance with the plans and specifications, complete and ready-for-use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W METER WITH PRESSURE REDUCING VALVE (PRV) This item is for payment for installation of all standard water meters with pressure reducing valves (PRV) of all sizes 2 inches in diameter or less,

as specified on the plans. This item shall include all labor, equipment, meter, PRV, meter box, casting, yoke, and any other associated materials needed for installation of a functioning water meter with PRV, in accordance with the plans and specifications, complete and ready-for-use. This item shall include connections to the new or existing water service line. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W PIPE This item shall apply to all pipe of every size and type material to be used as water main, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specifications), polyethylene wrap (when specified), labor, equipment, excavation, bedding, backfill, restoration, testing, sanitizing, etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings, complete and ready-for-use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall include all temporary and permanent materials, as well as equipment required to pressure test and sanitize mains including, but not limited to, pressurization pumps, hoses, tubing, gauges, main taps, saddles, temporary main end caps or plugs and blocking, main end taps for flushing, chlorine liquids or tablets for sanitizing, water for testing/sanitizing and flushing (when not supplied by the utility), chlorine neutralization equipment and materials, and any other items needed to accomplish pressure testing and sanitizing the main installation. This item shall also include pipe anchors at each end of polyethylene pipe runs, when specified to prevent the creep or contraction of the pipe. When owner specifications require, this bid item shall include contractor preparation of as-built drawings to be provided to the engineer and/or utility owner at the end of construction. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W PLUG EXISTING MAIN This item shall include the specified plug, concrete blocking and/or mechanical anchoring, labor, equipment, excavation, backfill, and restoration required to install the plug on an existing main to be left in service at the location shown on the plans or as directed, in accordance with the specifications. This item is not to be paid to plug new main installations or mains that are to be abandoned. This pay item is only to be paid to plug existing mains that are to be left in service. Plugs on new mains are to be considered incidental to the new main, as are other fittings, and are not to be paid under this item. All plugs on existing mains left in service shall be paid under this one bid item included in the contract, regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

Plugging of existing abandoned mains shall be performed and paid in accordance with Section 708.03.05 of KYTC Standard Specifications for Road and Bridge Construction, using Bid code 01314, Plug Pipe.

W PRESSURE REDUCING VALVE This item shall apply to all pressure reducing valves (PRV) of every size required in the plans and specifications, except those bid items defined as "Special". Payment under this description is to be for PRVs being installed with new main. This item includes the PRV as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), pit or vault, backfill, restoration, testing, disinfection, etc., required to install the specified PRV at the location shown on the plans, in accordance with the specifications and standard

drawings, complete and ready-for-use. If required on the plans and/or proposed adjoining DIP is restrained, PRVs shall be restrained. PRV restraint shall be considered incidental to the PRV and adjoining pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W PUMP STATION This item is for payment for installation of pumps and an above or below ground structure for housing of the pumps. This item shall include all pumps, piping, fittings, valves, electrical components, building materials, concrete, any other appurtenances, labor, equipment, excavation, and backfill, to complete the pump station installation as required by the plans, standard drawings, and specifications, complete and ready-for-use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LUMP SUM (LS) when complete.

W REMOVE TRANSITE (AC) PIPE This item shall include all labor, equipment, and materials needed for removal and disposal of the pipe as hazardous material. All work shall be performed by trained and certified personnel, in accordance with all environmental laws and regulations. Any and all transite AC pipe removed shall be paid under one bid item included in the contract, regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W SERVICE LONG SIDE This item shall apply to all service line installations of every size bid up to and including 2-inch inside diameter, except those service bid items defined as "Special". This item includes the specified piping material, main tap, tapping saddle (if required), corporation stop materials, coupling for connecting the new piping to the surviving existing piping, encasement of 2 inches or less internal diameter (if required by plans or specifications), labor, equipment, excavation, backfill, testing, disinfection, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready-for-use. This bid item is to pay for service installations where the ends of the service connection are on opposite sides of the public roadway and the service line crosses the centerline of the public roadway, as shown on the plans. The length of the service line is not to be specified. Payment under this item shall not be restricted by a minimum or maximum length. The contractor shall draw his own conclusions as to the length of piping that may be needed. Payment under this item shall include boring, jacking, or excavating across the public roadway for placement. Placement of a service across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for special bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W SERVICE SHORT SIDE This item shall apply to all service line installations of every size up to and including 2-inch internal diameter, except those service bid items defined as "Special". This item includes installation of the specified piping material of the size specified on plans, encasement of 2 inches or less internal diameter (if required by plans or specifications), main tap, tapping saddle (if required), corporation stop, coupling for connecting the new piping to the surviving existing piping, labor, equipment, excavation, backfill, testing, disinfection, and restoration at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready-for-use. This bid item is to pay for service installations where both ends of the service connection are on the same side of the public roadway, or when an existing service crossing a public roadway will remain and is being extended, reconnected, or relocated, with all work on one side of the public roadway centerline as shown on the plans. The length of

the service line is not to be specified and shall not be restricted to any minimum or maximum length. Placement of a service lateral across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. The contractor shall draw his own conclusions as to the length of piping that may be needed. This pay item does not include installation or relocation of meters. Meters will be paid separately. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W SERVICE RELOCATE This item is for the relocation of an existing water service line where a meter is not involved, and where an existing service line can easily be adjusted by excavating alongside and moving the line horizontally and/or vertically a short distance without cutting the service line to avoid conflicts with road construction. This item shall include excavation, labor, equipment, bedding, and backfill to relocate the line, in accordance with the plans and specifications, complete and ready-for-use. Payment under this item shall be for each location requiring relocation. Payment shall be made under this item regardless of service size or relocation length. No separate pay items will be established for size or length variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W STRUCTURE ABANDONMENT This item is to be used to pay for abandonment of larger above or below ground water structures such as meter vaults, fire pits, pump stations, tanks, etc. Payment under this item shall not be limited to size or scope; however, structures with connecting pipes of 2 inches or less shall not be paid under this item but shall be considered incidental to water construction (i.e., abandonment of standard water meters up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted fill or flowable fill for abandonment of the structure in-place and complete restoration. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W STRUCTURE REMOVAL This item is to be used to pay for removal of larger above or below ground water structures such as meter vaults, fire pits, pump stations, tanks, etc. Payment under this item shall not be limited to size or scope; however, structures with connecting pipes of 2 inches or less shall not be paid under this item but shall be considered incidental to water construction (i.e., removal of standard water meters up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted backfill for removal of the structure and complete restoration. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W TAPPING SLEEVE AND VALVE SIZE 1 OR 2 This item shall include the specified tapping sleeve, valve, valve box, concrete pad around valve box (when required in specifications or plans), labor, and equipment to install the specified tapping sleeve and valve, complete and ready-for-use, in accordance with the plans and specifications. The size shall be the measured internal diameter of the live pipe to be tapped. The size tapping sleeve and valve to be paid under sizes 1 or 2 shall be as follows:

- Size 1 = All live tapped main sizes up to and including 8 inches
- Size 2 = All live tapped main sizes greater than 8 inches

Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W TIE-IN This item shall be used for all main tie-in bid items of every size, except those defined as “Special”. This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, disinfection, testing, and backfill required to make the water main tie-in as shown on the plans and in accordance with the specifications, complete and ready-for-use. Pipe for tie-ins shall be paid under separate bid items. This item shall be paid EACH (EA) when complete.

Plugging of existing abandoned mains shall be performed and paid in accordance with Section 708.03.05 of KYTC Standard Specifications for Road and Bridge Construction, using Bid code 01314, Plug Pipe.

W VALVE This item shall apply to all valves of every size required in the plans and specifications, except those bid items defined as “Special”. Payment under this description is to be for gate or butterfly valves being installed with new main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specifications), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by specifications), restoration, testing, disinfection, etc., required to install the specified valve at the location shown on the plans, in accordance with the specifications and standard drawings, complete and ready-for-use. If required on plans and/or proposed adjoining DIP is restrained, valves shall be restrained. Valve restraint shall be considered incidental to the valve and adjoining pipe. This description does not apply to cut-in valves. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE ANCHOR EXISTING This item is intended to pay for installation of restraint hardware on an existing valve where no restraint exists, to hold the valve in place to facilitate tie-ins and other procedures where restraint is prudent. This work shall be performed in accordance with water specifications and plans. This bid item shall include all labor, equipment, excavation, materials, and backfill to complete restraint of the designated valve, regardless of size, at the location shown on the plans, complete and ready-for-use. Materials to be provided may include, but are not limited to, retainer glands, lugs, threaded rod, concrete, reinforcing steel, or any other material needed to complete the restraint. Should the associated valve box require removal to complete the restraint, the contractor shall reinstall the existing valve box, the cost of which shall be considered incidental to this bid item. No separate bid items are being provided for size variations. All sizes shall be paid under one bid item. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE BOX ADJUST This item include all labor, equipment, valve box and valve stem extensions (if required), excavation, backfill, concrete pad around valve box (when specified in specifications or plans), restoration, etc., to adjust the top of the box to finished grade, complete and ready-for-use. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE BOX REMOVE This item is in payment for all labor, equipment, restoration materials, disposal, and any other effort for removal of a valve box, leaving the valve in place. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE CUT-IN This item is for new cut-in valve installations of all sizes, where installation is accomplished by cutting out a section of existing main. This item shall include cutting the existing pipe, supplying the specified valve, couplings or sleeves, valve box, concrete pad around valve box (when required in specifications or plans), labor, equipment, and materials to install the valve at the locations

shown on the plans, or as directed by the engineer, complete and ready-for-use. Any pipe required for installation shall be cut from that pipe removed or supplied new by the contractor. No separate payment will be made for pipe required for cut-in valve installation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE REMOVE This item is in payment for all labor, equipment, and restoration materials for cutting of existing pipe and any other effort necessary for total removal of an existing valve and valve box. This bid item shall include disposal of the valve and box, unless plans or specifications state the valve and box are to be salvaged and delivered to the utility owner for reuse. No separate pay items are to be established for size variations. All valve removals, regardless of size, shall be paid under this one pay item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

If plugging of existing abandoned mains is needed after valve removal, the work shall be performed and paid in accordance with Section 708.03.05 of KYTC Standard Specifications for Road and Bridge Construction, using Bid code 01314, Plug Pipe.

W VALVE VAULT This item is for payment for installation of an underground structure for housing of specific valve(s), as required by the plans and specifications. This item shall include all labor, equipment, excavation, concrete, manhole castings or doors, the specified valve(s), all piping, and fitting materials associated with installing a functioning valve vault, in accordance with the plans, standard drawings, and specifications, complete and ready-for-use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

TECHNICAL SPECIFICATIONS

WATER LINE RELOCATIONS – BEECH GROVE WATER SYSTEM

MCLEAN COUNTY, KENTUCKY

GRW Project 5207-01

KYTC ITEM # 2-8852.00, KY 56/1233 INTERSECTION, MCLEAN COUNTY

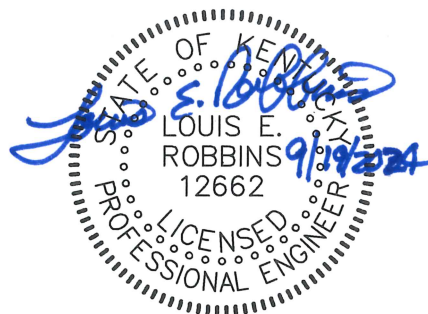


Table of Contents

Section (Document
Page # Page #)

Division 1
General Requirements

00000 – Table of Contents	1	(BGWS-2)
01020 – Quantity Spreadsheet	1	(BGWS-3)
01040 – Project Coordination - Water	1-2	(BGWS-4)
01090 – Definitions of Standards	1-5	(BGWS-6)
01110 – Summary of Work.....	1-2	(BGWS-11)
01120 – General Provisions (Water).....	1-9	(BGWS-13)
01205 – Labor Provisions (KY) - Water.....	1-1	(BGWS-22)
01271 – Basis of Measurement and Payment - Water	1-4	(BGWS-23)
01340 – Submittals	1-5	(BGWS-27)
01400 – Quality Control Services	1-2	(BGWS-32)
01500 – Temporary Facilities and Controls.....	1-2	(BGWS-34)
01631 – Products and Substitutions	1-6	(BGWS-36)
01700 – Project Closeout	1-2	(BGWS-42)
01710 – Cleaning	1-2	(BGWS-44)
01720 – Project Record Documents.....	1-2	(BGWS-46)

Division 2
Site and Utility Work

02225 – Earthwork for Utility Work.....	1-8	(BGWS-48)
02240 - Dewatering.....	1-1	(BGWS-56)
02260 – Excavation Support and Protection	1-3	(BGWS-57)
02371 – Erosion and Sedimentation Control-KPDES Requirements	1-7	(BGWS-60)
02400 – Boring and Jacking	1-3	(BGWS-67)
02410 – Directional Drilling	1-9	(BGWS-70)
02510 – Water Distribution Piping	1-7	(BGWS-79)
02515 – Valves – Utility Service	1-4	(BGWS-96)
02517 - Hydrants.....	1-3	(BGWS-100)
02920 – Lawns and Grasses.....	1-1	(BGWS-103)

Division 3
Concrete

03300 – Cast-in-Place Concrete.....	1-12	(BGWS-104)
-------------------------------------	------	------------

BEECH GROVE WATER SYSTEM UTILITY QUANTITIES SPREADSHEET							
PROJECT NUMBER 2-8852.00, BEECH GROVE>BETHEL CHURCH FD04 075 005 6 006-007, McLEAN COUNTY							
ITEM CODE	ITEM	UNIT	SHEET U3	SHEET U4	SHEET U5		PROJECT TOTALS
14059	W PIPE PVC 06 IN	LF	457	508	190		1155
14057	W PIPE PVC 03 IN	LF	0	0	15		15
14066	W PIPE PVC SPECIAL (6 IN RESTRAINED JOINT PVC)	LF	0	100	0		100
14506	W ENCASEMENT STEEL BORED RANGE 3	LF	33	0	45		78
14004	W DIRECTIONAL BORE	LF	0	100	0		100
14105	W VALVE 06 INCH	EA	4	0	4		8
14103	W VALVE 03 INCH	EA	0	0	1		1
14094	W TIE-IN 06 INCH	EA	2	0	1		3
14092	W TIE-IN 03 INCH	EA	0	0	1		1
14000	W AIR RELEASE VALVE 1 INCH	EA	1	0	0		1
14022	W FLUSH HYDRANT ASSEMBLY	EA	1	0	1		2
14177	W VALVE BOX REMOVE	EA	3	0	2		5
14003	W CAP EXISTING MAIN	EA	2	0	1		3
02690	SAFELOADING	CUYD	0.5	0.75	0		1.25

SECTION 01040 - PROJECT COORDINATION - WATER

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

Drawings and general provisions of Contract, including General and Supplementary Conditions and other Division 1 Specification sections, apply to work of this section.

1.02 DESCRIPTION OF WORK

Minimum administrative and supervisory requirements necessary for coordination of work on the project include but are not necessarily limited to the following:

- Coordination and meetings.
- Limitations for use of site.
- Coordination of crafts, trades and subcontractors.
- General installation provisions.
- Cleaning and protection.
- Conservation and salvage.

1.03 COORDINATION AND MEETINGS

If required, general project coordination meetings will be held at regularly scheduled times convenient for all parties involved. These meetings are in addition to specific meetings held for other purposes, such as regular project meetings and special pre-installation meetings. Request representation at each meeting by every party currently involved in coordination or planning for the work of the entire project. Conduct meetings in a manner which will resolve coordination problems. Record results of the meeting and distribute copies to everyone in attendance and to others affected by decisions or actions resulting from each meeting.

1.04 LIMITATIONS ON USE OF THE SITE

Limitations on site usage as well as specific requirements that impact site utilization are indicated on the drawings and by other contract documents. In addition to these limitations and requirements administer allocation of available space equitably among entities needing both access and space so as to produce the best overall efficiency in performance of the total work of the project. Schedule deliveries so as to minimize space and time requirements for storage of materials and equipment on site. The Contractor shall limit the area to be cleared to the construction site itself as far as practical. No extra clearing shall be allowed for convenience or for storage. If the Contractor requires additional space to that indicated to be available on the Drawings, the Contractor shall be responsible for making the necessary arrangements or agreements.

1.05 COORDINATION OF CRAFTS, TRADES AND SUBCONTRACTORS

- A. The Contractor shall coordinate the work of all the crafts, trades and subcontractors engaged on the work, and he/she shall have final responsibility as regards the schedule, workmanship and completeness of each and all parts of the work.
- B. All crafts, trades and subcontractors shall be made to cooperate with each other and with

others as they may be involved in the installation of work which adjoins, incorporates, precedes or follows the work of another. It shall be the Contractor's responsibility to point out areas of cooperation prior to the execution of subcontract agreements and the assignment of parts of the work. Each craft, trade and subcontractor shall be made responsible to the Owner, for furnishing embedded items and giving directions, for doing all cutting and fitting and making all provisions for accommodating the work, and for protecting, patching, repairing and cleaning as required to satisfactorily perform the work.

- C. The Contractor shall be responsible for all cutting, digging and other action of his/her subcontractors and workmen. Where such action impairs the safety or function of any structure or component of the project, the Contractor shall make such repairs, alterations and additions as will, in the opinion of the Engineer, bring said structure or component back to its original design condition at no additional cost to the Owner.
- D. Each subcontractor is expected to be familiar with the General Requirements and all sections of the detailed Specifications for all other trades and to study all Drawings applicable to his/her work, to the end that complete coordination between trades will be affected. Consult with the Engineer if conflicts exist on the Drawings.

PART 2 - PRODUCTS (Not Applicable).

PART 3 - EXECUTION (Not Applicable).

END OF SECTION

SECTION 01090 - DEFINITIONS AND STANDARDS

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

Drawings and general provisions of Contract, including General and Supplementary Conditions and other Division 1 Specification sections, apply to work of this section.

1.02 DESCRIPTION OF REQUIREMENTS

- A. **General:** This section specifies procedural and administrative requirements for compliance with governing regulations and codes and standards imposed upon the Work. These requirements include obtaining permits, licenses, inspections, releases and similar documentation, as well as payments, statements and similar requirements associated with regulations, codes and standards.
1. The term, "Regulations", is defined to include laws, statutes, ordinances and lawful orders issued by governing authorities, as well as those rules, conventions and agreements within the construction industry which effectively control the performance of the work regardless of whether they are lawfully imposed by governing authority or not.

1.03 DEFINITIONS

- A. **General Explanation:** A substantial amount of specification language consists of definitions of terms found in other contract documents, including drawings. (Drawings are recognized as being diagrammatic in nature and not completely descriptive of the requirements indicated thereon). Certain terms used in contract documents are defined in this article. Definitions and explanations contained in this section are not necessarily either complete or inclusive but are general for the Work to the extent that they are not stated more explicitly in another element of the contract documents.
- B. **General Requirements:** The provisions or requirements of other Division 1 sections apply to entire work of the Contract and, where so indicated, to other elements which are included in the project.
- C. **Indicated:** The term, "indicated", is a cross-reference to graphic representations, notes or schedules on the drawings, to other paragraphs or schedules in the specifications, and to similar means of recording requirements in contract documents. Where terms such as "shown", "noted", "scheduled", and "specified" are used in lieu of "indicated", it is for the purpose of helping the reader locate the cross-reference, and no limitation of location is intended except as specifically noted.
- D. **Directed, Requested, Etc.:** Where not otherwise explained, terms such as "directed", "requested", "authorized", "selected", "approved", "required", "accepted", and "permitted" mean "directed by the Architect/ Engineer", "requested by the Architect/Engineer", and similar phrases. However, no such implied meaning will be interpreted to extend the Architect's/Engineer's responsibility into the Contractor's area of construction supervision.
- E. **Approve:** Where used in conjunction with the Architect's/Engineer's response to submittals, requests, applications, inquiries, reports and claims by the Contractor, the meaning of the term "approved" will be held to limitations of the Architect's/Engineer's responsibilities and duties as specified in General and Supplementary Conditions. In no case will the

(BGWS-7)

Architect/Engineer's approval be interpreted as a release of the Contractor from responsibilities to fulfill requirements of contract documents.

- F. **Project Site:** The term, "project site", is defined as the space available to the Contractor for performance of the Work, either exclusively or in conjunction with others performing other work as part of the project. The extent of the project site is shown on the drawings and may or may not be identical with the description of the land upon which the project is to be built.
- G. **Furnish:** Except as otherwise defined in greater detail, the term "furnish" is used to mean "supply and deliver to the project site, ready for unloading, unpacking, assembly, installation, and similar operations" as applicable in each instance.
- H. **Install:** Except as otherwise defined in greater detail, the term "install" is used to describe operations at project site including the actual "unloading, unpacking, assembly, erection, placing, anchoring, applying, working to dimension, finishing, curing protecting, cleaning and similar operations", as applicable in each instance.
- I. **Provide:** Except as otherwise defined in greater detail, the term "provide" means "to furnish and install, complete and ready for intended use", as applicable in each instance.
- J. **Installer:** The term "installer" is defined as "the entity" (person or firm) engaged by the Contractor, its subcontractor or sub- subcontractor for performance of a particular unit of work at the project site, including installation, erection, application and similar required operations. It is a requirement that installers are experienced in the operations they are engaged to perform.
- K. **Testing Laboratories:** The term "testing laboratory" is defined as an independent entity engaged to perform specific inspections or tests of the work, either at the project site or elsewhere, and to report, and (if required) interpret results of those inspections or tests.

1.04 INDUSTRY STANDARDS

- A. **Applicability of Standards:** Except where more explicit or more stringent requirements are written into the contract documents, applicable construction industry standards have the same force and effect as if bound into or copied directly into the contract documents. Such industry standards are made a part of the contract documents by reference. Individual specification sections indicate which codes and standards the Contractor must keep available at the project site for reference.
 - 1. Referenced standards (standards referenced directly in the contract documents) take precedence over non-referenced standards that are recognized in the industry for applicability to the Work.
 - 2. Non-referenced standards are defined as not being applicable to the Work, except as a general requirement of whether the Work complies with recognized construction industry standards.
- B. **Publication Dates:** Except as otherwise indicated, where compliance with an industry standard is required, comply with standard in effect as of date of contract documents.
- C. **Conflicting Requirements:** Where compliance with two or more standards is specified, and where these standards establish different or conflicting requirements for minimum quantities or quality levels, the most stringent requirement will be enforced, unless the contract documents specifically indicate a less stringent requirement. Refer requirements that are different, but apparently equal, and uncertainties as to which quality level is more stringent

to the Architect/Engineer for a decision before proceeding.

- 1. **Minimum Quantities or Quality Levels:** In every instance the quantity or quality level shown or specified is intended to be the minimum for the work to be provided or performed. Unless otherwise indicated, the actual work may either comply exactly, within specified tolerances, with the minimum quantity or quality specified, or may exceed that minimum within reasonable limits. In complying with these requirements, the indicated numeric values are either minimum or maximum values, as noted, or as appropriate for the context of the requirements. Refer instances of uncertainty to the Architect/Engineer for decision before proceeding.

- D. **Copies of Standards:** The contract documents require that each entity performing work be experienced in that part of the work being performed. Each entity is also required to be familiar with industry standards applicable to that part of the work. Copies of applicable standards are not bound with the contract documents.

Where copies of standards are needed for proper performance of the Work, the Contractor is required to obtain such copies directly from the publication source.

Although certain copies of standards needed for enforcement of the requirements may be required submittals, the Architect/ Engineer reserves the right to require the Contractor to submit additional copies of these standards as necessary for enforcement of the requirements.

- E. **Abbreviations and Names:** Trade association names and title of general standards are frequently abbreviated. The following acronyms or abbreviations as referenced in contract documents are defined to mean the associated names. Both names and addresses are subject to change, and are believed to be, but are not assured to be, accurate as of date of contract documents. Any acronyms found but not defined shall be referred to the Engineer for clarification as necessary.

AASHTO	American Association of State Highway and Transportation Officials 444 North Capitol Street, Suite 225 Washington, DC 20005	(202) 624-5800
ACI	American Concrete Institute P.O. Box 19150 Detroit, MI 48219	(313) 532-2600
AIA	American Institute of Architects 1735 New York Ave., NW Washington, DC 20006	(202) 626-7300
AISC	American Institute of Steel Construction 400 N. Michigan Ave., 8th Floor Chicago, IL 60611	(312) 670-2400
AISI	American Iron and Steel Institute 1000 Sixteenth Street, NW Washington, DC 20036	(202) 452-7100
ANSI	American National Standards Institute 655 Fifteenth Street, NW, Suite 300 Washington, DC 20015	(202) 639-4090

(BGWS-9)

ASTM	American Society of Testing & Materials 1916 Race Street Philadelphia, PA 19103	(215) 299-5400
AWS	American Welding Society P.O. Box 351040 550 Le Jeune Road, NW Miami, FL 33135	(305) 443-9353
AWWA	American Water Works Association 6666 W. Quincy Ave. Denver, CO 80235	(303) 794-7711
CRSI	Concrete Reinforcing Steel Institute 933 Plum Grove Road Schaumburg, IL 60195	(312) 490-1700
NCMA	National Cement Masonry Association P.O. Box 781 Herndon, VA 22070	(703) 435-4900
NEC	National Electric Code (by NFPA)	
NEMA	National Electrical Manufacturers Association 2101 L Street, NW; Suite 300 Washington, DC 20037	(202) 457-8400
NFPA	National Fire Protection Association Batterymarch Park Quincy, MA 02269	(617) 770-3000
NSF	National Sanitation Foundation P.O. Box 1468; 3475 Plymouth Road Ann Arbor, MI 48106	(313) 769-8010
PCI	Prestressed Concrete Institute 201 N. Wells Street Chicago, IL 60606	(312) 346-4071
UL	Underwriters Laboratories 333 Pfingsten Road Northbrook, IL 60062	(312) 272-8800

F. Federal Government Agencies: The names and titles of federal government standard or specification producing agencies are frequently abbreviated. The following acronyms or abbreviations as referenced in the contract documents indicate the names of standard or specification producing agencies of the federal government. Names and addresses are subject to change but are believed to be, but are not assured to be, accurate and up-to-date as of the date of the contract documents.

COE	Corps of Engineers (US Department of the Army) Chief of Engineers-Referral Washington, DC 20314	(202) 693-6456
CFR	Code of Federal Regulations	

Available from the Government Printing Office
North Capitol Street
between G and H Streets, NW
Washington, DC 20402 (202) 783-3238
(Material is usually first published
in the Federal Register)

CPSC Consumer Product Safety Commission
1111 Eighteenth Street, NW
Washington, DC 20207 (202) 634-7700

DOT Department of Transportation
400 Seventh Street, SW
Washington, DC 20590 (202) 426-4000

EPA Environmental Protection Agency
401 M Street, SW
Washington, DC 20460 (202) 829-3535

OSHA Occupational Safety and Health Administration
(U.S. Department of Labor)
Government Printing Office
Washington, DC 20402

1.05 SUBMITTALS

- A. **Permits, Licenses, and Certificates:** For the Owner's records, submit copies of permits, licenses, certifications, inspection reports, releases, jurisdictional settlements, notices, receipts for fee payments, and similar documents, correspondence and records established in conjunction with compliance with standards and regulations bearing upon performance of the work.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

SECTION 01110 - SUMMARY OF WORK

PART 1 - GENERAL

1.01 SCOPE OF WORK PERFORMED UNDER THIS CONTRACT

- A. The scope of work generally consists of the construction of approximately 1,360 L.F. of 6” water line in the Hwy 56/1233 area of the Beech Grove Water System in McLean County, Kentucky to accommodate the Kentucky Department of Highways intersection improvements project. Appurtenant work includes valves, approximately 78 L.F. of steel casing pipe, a 100 LF directional bore, etc. The detailed sections of these Specifications and the Drawings should be relied upon for detailed requirements.
- B. The Contractor for this contract shall furnish all labor, equipment, materials and appurtenances necessary to construct the water line utilities on the relocation portion of the project as specified and as shown on the Drawings, complete in place and fully operational.
- C. It is intended that the work covered by these contracts be done so as to cause the minimum interference with the normal operation of the existing distribution system of the Beech Grove Water System. The Contractor will be required to organize and schedule the work to keep the existing facilities in full operation during the construction period insofar as is consistent with the nature of the construction work to be performed.
- D. The manner in which shutdowns will be made, and the Contractor's work schedule will be subject to the approval of the Beech Grove Water System and the Engineer; although every effort will be made to cause the minimum amount of interference with the Contractor's work, the interest of the Owner in regard to the existing facilities must always take precedence over the construction work. Therefore, the right is reserved by the Owner to put any water lines that may be shut down for the construction work back into service when an emergency arises.
- E. The Contractor must have sufficient materials, equipment, labor, and supervision available to accomplish the work required in the time allocated for any shutdown.

1.02 ENUMERATION OF DRAWINGS & SPECIFICATIONS

Following are the Drawings and Specifications, which form the Contract Documents as set forth in Section 1.1 of the General Conditions:

<u>Drawings</u>	<u>Sheet Number</u>
See Beech Grove Water System Drawings for the Water Utility Work	U1 thru U8
<u>Specifications</u>	

See Table of Contents for Beech Grove Water System Work along with the general requirements of KTC DOH specifications.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

SECTION 01120 - GENERAL PROVISIONS - WATER

PART 1 - GENERAL

1.01 DESIGNATION OF PARTIES

- A. All references in these Utility Specifications, Contract Documents and Drawings to "Owner" shall mean Beech Grove Water System; all references to "Engineer" shall mean GRW Engineers, Inc., 404 BNA Drive, Suite 201, Nashville, Tennessee 37217; all references to "Agency" shall mean Kentucky Department of Highways.

1.02 PRE-CONSTRUCTION CONFERENCE

- A. The Contractor, Engineer, Agency and Owner, or their duly appointed representatives, shall meet in a preconstruction conference prior to the initiation of construction to organize, schedule and determine responsibilities for the work as it pertains to each party of the Contract.

1.03 CONSTRUCTION SCHEDULE CHART

- A. Prior to the start of any construction, the Contractor shall furnish three (3) copies of a suitable construction schedule or progress chart for construction of the water lines. The schedule or chart shall be subject to the approval of the Engineer and Agency and be of sufficient detail to show the chronological relationship of all activities of the project, the order in which the Contractor proposes to carry on the work, estimated starting and completion dates of major features, procurement of materials, and scheduling of equipment. The schedule shall be in a form suitable for appropriately indicating the percentage of work scheduled for completion at any time. The schedule shall be kept current and shall reflect completion of all work under the Contract within the specified time and in accordance with these Specifications. The schedule shall be coordinated with the KDOH General/Grading Contractor(s).
- B. If the Contractor fails to submit a schedule or chart within the time prescribed, the Agency/Owner/Engineer may withhold approval of progress payments until the Contractor submits the required schedule or chart.

1.04 CONSTRUCTION PROGRESS MEETINGS

If required, construction progress meetings shall be held at a designated location established by the Owner or Agency. The Contractor, appropriate Sub-Contractors, Agency, Engineer and the Owner shall meet to review construction progress, equipment or material submittals, construction schedules, etc.

1.05 TAXES

Proposals shall be made to include any applicable taxes on payrolls, materials, equipment, vehicles, utilities, etc., including State sales taxes (if required) and shall include compensation for such taxes on all work under this Contract.

1.06 LINES AND GRADES

- A. The Contractor shall be responsible for all lines and grades required for the construction of structures and piping. The Contractor shall set line and grade stakes for all gravity pipes,

(BGWS-14)

offset from the centerline of the trench or the axes of the pipelines as required to facilitate accurate construction.

- B. When water lines, force main and other such buried pressure pipelines are involved, the Owner will assist the Contractor in the location of these lines; however, any detailed layout requiring surveying, or excavation including that required for establishing the grade of the pipeline, shall be accomplished by the Contractor. Contractor shall coordinate with the KDOH for required surveying to establish ROW, ditching, etc., allowing for accurate placement of the water lines in relation to proposed highway related construction activities.
- C. The Contractor shall furnish all materials, stakes and grade boards that are required for layout by the Contractor's forces. In addition, the Contractor shall furnish any necessary survey personnel to mark the location of the various facilities on the ground, establishing bench levels and determining as-built conditions after work is completed. The Contractor's personnel engaged in the layout work described herein and the aides furnished to the Engineer shall be fully capable of performing the duties set out herein and shall be fully qualified as required. Contractor shall be responsible for verifying all profiles and elevations prior to construction and for coordinating with the KDOH on the proposed ROW and design features for the Hwy. 259 South improvements project.
- D. Any discrepancy between elevations shown on the Drawings and elevations taken in the field shall be reported to the Engineer/Agency immediately.

1.07 BLASTING

- A. All blasting operations shall be conducted in strict accordance with the Kentucky Regulations, which shall be deemed to be included in these Specifications the same as though herein written in full. The Contractor shall also comply with applicable municipal ordinances, Federal Safety Regulations and Section 9 of the Manual of Accident Prevention in Construction, published by the Associated General Contractor's of America, Inc. All explosives shall be stored in conformity with said ordinances, laws and safety regulations. No blasting shall be done within five feet of any water mains, telephone, electric or other underground utility lines or ten feet of any gas mains except with light charges of explosives. Any damage done by blasting is the responsibility of the Contractor and shall be promptly and satisfactorily repaired by him. All blast events shall be designed in accordance with state laws.
- B. Shot rock, which is excavated, shall be disposed of offsite by the Contractor. No rock larger than two inches will be permitted in the backfill.
- C. Compliance with laws, ordinances, and regulations shall be the Contractor's responsibility and he shall save the Owner and Engineer harmless from any and all claims of any type or nature arising from blasting or storage of explosives.

1.08 COMPLIANCE WITH SAFETY REGULATIONS

- A. The equipment items furnished shall comply with all governing federal and state laws regarding safety, including all current requirements of the Occupational Safety and Health Act (OSHA). Contractor shall be solely responsible for job safety in accordance with all laws, regulations, methods, etc. of OSHA and the state.
- B. All work under this Contract shall be done in strict compliance with the Occupational Safety and Health Act of 1970 (PL 91-596) and under Section 107 of the Contract Work Hours and Safety Standards Act. (PL 91-54).

- C. It is not the intention of these specifications to conflict with the Act in any way, and where conflicts may arise, the Act shall govern.

1.09 OBSTRUCTIONS

- A. In cases where storm sewers, sanitary sewers, gas lines, water lines, telephone lines, electric lines or other overhead and underground structures are encountered, they shall not be displaced or molested unless necessary, in which case they shall be replaced in as good a condition as found and as quickly as possible.
- B. The Contractor is responsible for notifying the appropriate utility companies and coordinating for the protection of the utility. All such lines or underground structures damaged or molested in the construction shall be replaced at the Contractor's expense, unless in the opinion of the Utility, such damage was caused through no fault of the Contractor.
- C. With particular respect to existing underground utilities, all available information concerning their location has been shown on the Highway Plans. While it is believed that the locations shown are reasonable correct, neither the Engineer, Owner, nor the Agency can guarantee the accuracy or adequacy of this information.
- E. It is suggested that the Contractor locate all unknown metallic hazards, namely buried pipe, metals, etc., by using a pipe locator. The pipe locator should immediately precede the trench ditching and all hazards located and marked with a pointed stake in such manner as to notify the ditcher operator of such hazard. The Engineer may require this procedure. Available for assistance to the Contractor is BUD, a service to aid in underground utility location. BUD telephone 1-800-752-6007.
- F. It is expected that the Contractor will be diligent in his efforts and use every possible means to locate existing utilities. Any claims for unavoidable damage, based on improper or unknown locations will be thoroughly examined considering the Contractor's efforts to locate the said utilities or obstructions prior to beginning construction.

1.10 STORAGE FACILITIES

- A. The Contractor shall be responsible for proper and adequate storage of all materials and equipment used on the site. Any additional off-site space required for construction purposes shall be the Contractor's responsibility to obtain.
- B. Upon completion of the work, the Contractor shall remove all storage facilities, surplus materials and equipment and restore the site to its original condition, or to the finished condition as required by the Contract.

1.11 STANDARDS OF WORKMANSHIP

Work of all crafts and trades shall be laid out to lines and elevations as established by the Contractor from the Drawings or from instructions by the Engineer. Unless otherwise shown, all work shall be plumb and level, in straight lines and true planes, parallel or square to the established lines and levels. The work shall be accurately measured and fitted to tolerance as established by the best practices of the crafts and trades involved and shall be as required to fit all parts of the work carefully and neatly together. All work shall be coordinated with the proposed highway construction project.

1.12 GUARANTY

- A. Except as otherwise specified herein, the Contractor shall guarantee all work from latent defects in materials, equipment and workmanship for one (1) year from the date of final completion of the Work. The date of final completion shall be the date upon which the final estimate is approved by the Owner or the date of substantial completion as defined in Section 01770 of the technical Specifications. In case any date but the date of final completion is established to govern the time of the Guaranty, such date shall be duly recorded together with the terms and conditions of such agreement.
- B. The Contractor agrees that he will obtain from the manufacturers of equipment and materials furnished under this Contract, guarantees against defective materials and workmanship, and if those guarantees furnished by the manufacturer do not extend for the term of one (1) year from and after the date upon which the final estimate is formally approved by the Owner or other established date as set forth hereinbefore, he shall make the necessary arrangements and assume all cost for extending this guarantee for the required period.
- C. The Contractor shall promptly make such repairs or replacement as may be required under the above specified guarantee, and, when the repairs or replacements involve one or more items of installed equipment, shall provide the services of qualified factory-trained servicemen in the employ of the equipment manufacturers to perform or supervise the repairs or replacements.
- D. When the Engineer or the Owner deems it necessary, and so orders, such replacements or repairs under this section shall be undertaken by the Contractor within twenty-four (24) hours after service of notice. If the Contractor unnecessarily delays or fails to make the ordered replacements or repairs within the time specified, or if any replacements or repairs are of such nature as not to admit of the delay incident to the service of a notice, then the Owner shall have the right to make such replacements or repairs, and the expense thereof shall be paid by the Contractor or deducted from any moneys due the Contractor.
- E. All warranties and guarantees remaining in effect at and beyond the Guaranty expiration date shall be relinquished and transferred to the Owner. Copies of such warranty/guaranty shall be submitted to the Engineer prior to the date of the start of the guaranty period.

1.13 TRAFFIC CONTROL AND MAINTENANCE

- A. Traffic shall be maintained on all highways and streets at all times during construction of water lines across or along side said highways and streets. Access to all existing subdivisions and private residences shall also be kept open. Work shall be performed in accordance with applicable City, County, and state Department of Highways guidelines. Traffic control shall include proper signing and flagging per these guidelines.
- B. Traffic shall be maintained in accordance with the Manual on Uniform Traffic Control Devices. Work shall include all labor and materials necessary for construction and maintenance of traffic control devices and markings.
- C. Traffic control shall also include all flag persons and traffic control devices such as, but not limited to, flashers, signs, barricades and vertical panels, plastic drums (steel drums will not be permitted) and cones necessary for the control and protection of vehicular and pedestrian traffic as specified by the Manual on Uniform Traffic Control Devices.

- D. Any temporary traffic control items, devices, materials, and incidentals shall remain the property of the Contractor.
- E. The Contractor shall maintain a two-lane traveled way with a minimum lane width of 10 feet; however, during working hours, one-way traffic may be allowed at the discretion of the Owner, provided permission is obtained from the KDOH and adequate signing and flagpersons are at the location.
- F. The Contractor shall fully cover with plywood any signs, either existing, permanent or temporary, which do not properly apply to the current traffic phasing and shall maintain the covering until the signs are applicable or are removed.
- G. In general, all traffic control devices shall be placed starting and proceeding in the direction of the flow of traffic and removed starting and proceeding in the direction opposite to the flow of traffic.
- H. If traffic should be stopped due to construction operations and an emergency vehicle on an official emergency run arrives on the scene, the Contractor shall make provisions for the passage of that vehicle immediately.

1.14 CONSTRUCTION ALONG OR ACROSS A STREAM

- A. All excavations along or across a stream shall be done in such a manner as to prevent degradation of the waters. Spoil material shall not be allowed to enter the flowing portion of the stream.
- B. Effective erosion and sedimentation measures must be employed at all times during the project to prevent degradation of the waters.
- C. Site grading and reseeded shall be accomplished within 14 days after disturbance, regardless of the season.
- D. The Contractor shall refer to Section 02371 of these Detailed Specifications for a more detailed description of requirements of the Construction Stormwater Permit and the Kentucky Water Quality Standards Water Quality Certification. Contractor shall comply with the requirements of any project permits and the project SWPPP for the project.

1.15 EXECUTION AND COORDINATION OF THE WORK

A. GENERAL

- 1. It is intended that the work covered by this contract be done to cause the minimum interference with the normal operation of the existing distribution system of the Beech Grove Water System. The Contractor will be required to organize and schedule his work to keep the existing facilities in full operation during the construction period insofar as is consistent with the nature of the construction work to be performed.
- 2. The manner in which shutdowns will be made, and the Contractor's work schedule will be subject to the approval of the Owner and the Engineer; and although every effort will be made to cause the minimum amount of interference with the Contractor's work, the interest of the Owner in regard to the existing facilities must always take precedence over the construction work. Therefore, the right is reserved by the Owner to put any

lines or other facilities that may be shut down for the construction work back into service when an emergency arises.

3. The Contractor must have sufficient materials, equipment, labor, and supervision available to accomplish the work required in the time allocated for any shutdown.

1.16 ORDER OF WORK

- A. Work on the contract shall be prosecuted in a timely manner. The nature of the work will require that portions of the work be constructed and be placed into service as soon as possible to allow other portions to be taken out of service.

1.17 RESTORATION OF DISTURBED AREAS/WORK ON PRIVATE PROPERTY

- A. In connection with work performed on or adjacent to private property, the Contractor shall take all reasonable care to avoid damage to the property owner's buildings, grounds and facilities and shall be completely responsible for the repair or damage to same. Fences, hedges, shrubs, etc., within the construction limits shall be carefully removed, preserved, and replaced when the construction is completed. Grassed areas shall be graded, fertilized, and seeded when construction is completed in accordance with the requirements set out in these Detailed Specifications. It is intended that when construction is completed the Owner's facilities and grounds shall be restored to as good as or better than its original condition. Foundations adjacent to an excavation which is to be carried below the bottom of the foundation shall be supported by shoring, bracing, or underpinning and the Contractor shall be held strictly responsible for any damage to said foundation.
- B. Work on the rights-of-way of the State or County Highway Departments shall be considered work on private property. It shall be the Contractor's responsibility to obtain any necessary work permits and to meet all requirements for signs, warning lights, flagmen, etc.
- C. Reasonable care shall be taken during construction to avoid damage to vegetation. Ornamental shrubbery and tree branches shall be temporarily tied back, where appropriate, to minimize damage. Trees, which receive damage to branches, shall be trimmed of those branches to improve the appearance of the tree. Tree trunks receiving damage from equipment shall be treated with a tree dressing.

1.18 BASIS OF PAYMENT

- A. The Contractor shall furnish all necessary labor, machinery, tools, apparatus, materials, equipment, service and other necessary supplies and perform all work at the unit or lump sum prices for the items listed in the BID.
- B. Items listed in the BID constitute all of the pay items for the water utilities on this project; any other items of work listed in the Specifications shown on the Drawings or required to construct an operable facility shall be considered incidental to those items.
- B. The Contractor shall refer to Section 01020 for the Basis of Payment requirements.

1.19 SHOP DRAWINGS

The Contractor shall submit shop drawings for all materials to be installed. Shop drawings shall be submitted in accordance with Section 01340. Rejection of the same drawings on three separate occasions will constitute grounds for total rejection of the proposed equipment manufacturer or supplier as being unable to meet the Specifications.

Shop drawings shall be checked by the Contractor and evidence of such checking shall be indicated thereon. The Contractor shall be completely responsible for accuracy, completeness, compliance with Plans and Specifications, and compatibility, the Engineer's approval notwithstanding.

1.20 SUPERVISION OF INSTALLATION

All special equipment or materials shall be installed under the supervision of qualified personnel representing the Contractor.

1.21 CONNECTING TO EXISTING LINES

Connections of new lines to existing lines shall be as shown on the Drawings and/or directed by the Engineer. The Contractor shall verify materials of construction and size of existing lines before ordering tapping sleeves, couplings, etc.

1.22 FINAL INSPECTION

Final inspection will be held when Contractor notifies the Engineer that work is complete and ready for inspection. The Engineer shall contact concerned parties and set a date for the inspection to be held.

1.23 PERMITS CODES, AGREEMENTS AND/OR CONTRACTS WITH PRIVATE UTILITIES

The Contractor shall make application for, obtain, and pay for all licenses, permits, agreements, and/or contracts with private utility companies and shall pay all fees and charges in connection therewith. The Contractor shall be responsible for all expenses and fees associated with the above.

1.24 UTILITIES REQUIRED BY CONTRACTOR

All electric current and/or any utility service required by the Contractor shall be furnished at his own expense except as otherwise noted in these specifications

1.25 WATER AND UPLIFT

The Contractor shall by the use of well points, pumps, or other approved methods, prevent the accumulation of water in excavated areas. Should water accumulate, it shall be promptly removed. The Contractor shall also provide for dewatering areas adjacent to structures or lines to prevent uplift during construction operations. The Contractor will be held responsible for any damage due to uplift of such structures or lines and to existing structures during construction operations.

1.26 SUBSURFACE CONDITIONS

Neither the Owner nor the Engineer will be held responsible for subsurface conditions. The Contractor should make his own determination concerning the quantities of rock and ground water prior to bidding.

1.27 NOISE AND ODOR CONTROL

Some of the work hereunder is to be performed adjacent to or near private residences. The Contractor shall be responsible for noise and odor abatement procedures and shall not commence work in these areas before 7:00 a.m. local prevailing time.

1.28 CHEMICAL REQUIREMENTS

All chemicals used during project construction or furnished for project operation, whether herbicide, pesticide, disinfectant, reactant or of other classifications, must show approval of either EPA or USDA. Use of all such chemicals and disposal of residues shall be in strict conformance with instructions.

1.29 FIELD REPRESENTATIVE

The Contractor shall have available a responsible on-site representative who can officially receive instructions from the Engineer. The Contractor shall have one complete up-to-date set of plans and specifications available at all times. The Contractor's failure to comply with this requirement shall cause the Contractor to work at his own risk. The jobsite superintendent shall, as a minimum, be provided a pager and mobile telephone with voice mail capabilities.

1.30 EASEMENTS AND WORK ON OR ADJACENT TO PRIVATE PROPERTY

In connection with work performed on or adjacent to private property, the Contractor shall take all reasonable care to avoid damage to the property owner's grounds and facilities and shall be completely responsible for the repair of damage to same. It is intended that when construction is completed, the private property owner's facilities and grounds shall be restored to as good as or better than their original condition.

1.31 ENGINEER'S AUTHORITY

The Engineer does not have the authority to stop work, order work done or to direct or supervise any of the Contractor's forces.

1.32 EROSION AND SEDIMENT CONTROL

- A. The Contractor shall maintain all areas where excavation and backfill operations are being performed or have been performed in order that siltation and bank erosion will be kept to a minimum during construction. This requirement includes construction of temporary or permanent erosion barriers and use of special methods to control erosion.
- B. If required, the Contractor shall make application for a Storm Water Discharge permit. Coordination with the KDOH/General Highway Contractor and the project permit/SWPPP will be required.

- C. A Kentucky Water Quality Certification should be obtained by the Contractor for each blue line stream crossing. The Contractor will be required to abide by all requirements of the permit. The Contractor shall not work within the streambed or tributaries thereof without the Water Quality Certification Permit.
- D. The Contractor shall refer to Section 02371 of these Detailed Specifications for a more detailed description of requirements of the KPDES Construction Stormwater Permit and the Kentucky Water Quality Standards Water Quality Certification.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

SECTION 01205 - LABOR PROVISIONS (KY) - WATER

PART 1 - GENERAL

1.01 HOURS OF WORK

- A. The Contractor shall comply in every respect to all provisions of the Kentucky Revised Statutes 337.505 to 337.550.
- B. Hours of work shall be as set out in KRS 337.550; that is, not more than eight (8) hours in one calendar day, nor more than forty (40) hours in one week, except in case of emergency caused by fire, flood or damage to life or property.
- C. The provisions included under KRS 337.540 concerning a 10-hour workday may be allowed if Owner is in agreement.
- D. Any laborer, workman, mechanic, helper, assistant or apprentice working in excess of forty (40) hours in one week shall be paid not less than 1-1/2 times the base rate.

1.02 PREVAILING WAGE REQUIREMENT

- A. In accordance with Kentucky Revised Statutes 337.510 Prevailing Wage Rates shall be in effect and shall apply to all contracts of this project. The Utility Contractor shall coordinate with the KDOH for the applicable wage rates.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

(BGWS-23)

SECTION 01271 - BASIS OF MEASUREMENT AND PAYMENT – WATER UTILITIES

PART 1 - GENERAL

1.01 DESCRIPTION OF REQUIREMENTS

- A. The Contractor shall furnish all necessary labor, machinery, tools, apparatus, equipment, materials, service and other necessary supplies and perform all Water Utility Work shown on the Drawings and/or described in the Specifications and Contract Documents at the unit prices as indicated by the Bidder in the Bid.
- B. The Bidder declares that he has examined the site of the Work and informed himself fully in regard to all conditions pertaining to the place where the Work is to be done; that he has examined the Drawings, Specification and Contract Documents for the Work, and has read all special provisions furnished prior to the opening of bids; and that he has further satisfied himself relative to the Work to be performed. The Bidder further declares that he understands that unit quantities for Water Utilities are approximately only, are subject to increase or decrease, and that, should the quantities of any of the items be decreased, the Bidder will make no claim for the anticipated profits. In addition, the Owner also reserves the right to adjust quantities, either by addition or deletion and as-BID unit price shall remain in effect for these quantity adjustments.
- C. The Bidder declares that he understands the Utility Work must be coordinated with the overall Work shown on the KDOH Drawings on the project and that all General Conditions, etc., shall apply, including any AIS requirements.

1.02 PAY ITEMS

The items listed hereinafter (standard KYTC descriptions) refer to and are the same items listed in the BID hereinbefore and constitute all the pay items in the Water Utility portion of the Contract. Only the items shown on the Utilities General Summary Spreadsheet are pay items; any other items of Work listed in the Specifications or shown on the Utility Drawings shall be considered incidental to the listed items on the General Summary sheet.

Standard Water Bid Descriptions (KYTC Descriptions)

W CAP EXISTING MAIN This item shall include the specified cap, concrete blocking and/or mechanical anchoring, labor, equipment, excavation, backfill, and restoration required to install the cap at the location shown on the plans or as directed in accordance with the specifications. This item is not to be paid on new main installations. This pay item is only to be paid to cap existing mains. Caps on new mains are incidental to the new main. Any and all caps on existing mains shall be paid under one bid item included in the contract regardless of size. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W ENCASEMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

Range 1 = All encasement sizes greater than 2 inches to and including 6 inches

Range 2 = All encasement sizes greater than 6 inches to and including 10 inches

(BGWS-24)

Range 3 = All encasement sizes greater than 10 inches to and including 14 inches

Range 4 = All encasement sizes greater than 14 inches to and including 18 inches

Range 5 = All encasement sizes greater than 18 inches to and including 24 inches

Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W FLUSH HYDRANT ASSEMBLY This item shall include the flushing hydrant assembly, service line, tapping the main, labor, equipment, excavation, backfill, and restoration required to install the flush hydrant at the location shown on the plans and in accordance with the specifications and standard drawings, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W PIPE This description shall apply to all PVC, ductile iron, and polyethylene/plastic pipe bid items of every size and type to be used as water main, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, sanitizing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall include all temporary and permanent materials and equipment required to pressure test and sanitize mains including, but not limited to, pressurization pumps, hoses, tubing, gauges, main taps, saddles, temporary main end caps or plugs and blocking, main end taps for flushing, chlorine liquids or tablets for sanitizing, water for testing/sanitizing and flushing (when not supplied by the utility), chlorine neutralization equipment and materials, and any other items needed to accomplish pressure testing and sanitizing the main installation. This item shall also include pipe anchors, at each end of polyethylene pipe runs when specified to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements. Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W PIPE PVC SPECIAL (6" RESTRAINED JOINT PVC) This description shall apply to the pipe installed in the directional bore to be used as water main. This item includes the pipe specified by the plans and specifications, tracing wire, labor, equipment, excavation, bedding, restoration, testing, sanitizing, backfill, and etc., required to install the specified new pipe in the directional bore at the location shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This item shall include all temporary and permanent materials and equipment required to pressure test and sanitize mains including, but not limited to, pressurization pumps, hoses, tubing, gauges, main taps, saddles, temporary main end caps or plugs and blocking, main end taps for flushing, chlorine liquids or tablets for sanitizing, water for testing/sanitizing and flushing (when not supplied by the utility), chlorine neutralization equipment and materials, and any other items needed to accomplish pressure testing and sanitizing the main installation. Measurement of quantities under this item shall be to the point of connection to the connection point to the W PIPE pay items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications

(BGWS-25)

shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W DIRECTIONAL BORE This description shall apply to directional bores for the pipe sizes shown on the Drawings. This item includes labor, equipment, excavation, restoration, backfill, and etc., required to install the specified new pipe and at the location shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. The W PIPE PVC SPECIAL (6" restrained joint PVC) installed in the direction bore is a separate pay item. Measurement of quantities under this item shall be from end to end of the bore as defined by the length of restrained joint pipe installed therein. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

W VALVE This description shall apply to all valves of every size required in the plans and specifications except those bid items defined as "Special". Payment under this description is to be for gate or butterfly valves being installed with new main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by specification), restoration, testing, disinfection, and etc., required to install the specified valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, valves shall be restrained. Valve restraint shall be considered incidental to the valve and adjoining pipe. This description does not apply to cut-in valves. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W TIE-IN This description shall apply to all tie-ins of every size required in the plans and specifications. Payment under this description is to be for the tie-ins required to connect the existing main to the new main. This item includes the labor, equipment, excavation, anchoring, backfill, restoration, testing, disinfection, and etc., required to make the connections at the locations shown on the plans in accordance with the specifications and standard drawings complete and ready for use. This pay item also includes capping of the existing mains adjacent to the tie-in which are to be abandoned. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W AIR RELEASE VALVE 1INCH This description shall apply to the 1" air release valve required in the plans and specifications. Payment under this description is to be for air release valves being installed with new main. This item includes the valve as specified in the plans and specifications, labor, equipment, excavation, valve box, backfill, restoration, testing, disinfection, and etc., required to install the specified air release valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W VALVE BOX REMOVE This description shall apply to the removal of existing valve boxes required in the plans and specifications. Payment under this description is to be for removal of existing valve boxes on existing water main to be abandoned. This item includes labor, equipment, excavation, backfill, restoration, and etc., required to remove the specified valve boxes at the location shown on the plans in accordance with the specifications and standard drawings. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

W SAFELOADING This description shall apply to the filling of all abandoned water pipes under travelled roadway surfaces indicated to be abandoned and filled with flowable fill or grout to prevent later collapse or undermining of the roadway. This item shall be paid CUBIC YARD (CY) when

(BGWS-26)

complete.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

SECTION 01340 – SUBMITTALS - WATER

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

Drawings and general provisions of Contract, including KTC DOH General and Supplementary Conditions and other Specification sections, apply to work of this section.

1.02 DESCRIPTION OF REQUIREMENTS

A. General

This section specifies procedural requirements for non-administrative submittals including shop drawings, product data, samples (when samples are specifically requested) and other miscellaneous work-related submittals. Shop drawings, product data, samples and other work-related submittals are required to amplify, expand and coordinate the information contained in the Contract Documents.

All submittals shall be submitted in electronic format through the Engineer's submittal process and shall be checked and reviewed by the Contractor before submission to the Engineer. The review of the submittals by the Engineer shall not be construed as a complete check but will indicate only that the general method of construction and detailing is satisfactory. Review of such submittals will not relieve the Contractor of the responsibility for any errors, which may exist, as the Contractor shall be responsible for the dimensions and design of adequate connections, details, and satisfactory construction of all work.

1.03 DEFINITIONS

A. Shop drawings are technical drawings and data that have been specially prepared for this project, including but not limited to the following items:

1. Fabrication and installation drawings.
2. Setting diagrams.
3. Shop work manufacturing instructions.
4. Coordination drawings (for use on-site).
5. Schedules.
6. Design mix formulas.
7. Contractor's engineering calculations.

Standard information prepared without specific reference to a project is not considered to be shop drawings.

B. Product data includes standard printed information on manufactured products that has not been specially prepared for this project, including but not limited to the following items:

1. Manufacturer's product specifications and installation instructions.
2. Catalog cuts.
3. Roughing-in diagram and templates.
4. Standard wiring diagrams.
5. Printed performance curves.

6. Operational range diagrams.
 7. Mill reports.
 8. Standard product operating and maintenance manuals.
- C. Miscellaneous submittals are work related, non-administrative submittals that do not fit in the three previous categories, including, but not limited to the following:
1. Specially-prepared and standard printed warranties.
 2. Maintenance agreements.
 3. Workmanship bonds.
 4. Survey data and reports.
 5. Testing and certification reports.
 6. Record drawings.
 7. Field measurement data.
 8. Operating and maintenance manual.
 9. Certificate of Suitability

1.04 SUBMITTAL PROCEDURES

A. General

Refer to the General Conditions and Paragraph 1.02.A hereinbefore for basic procedures for submittal handling.

B. Coordination

Coordinate the preparation and processing of submittals with the performance of the work. Coordinate each separate submittal with other submittals and related activities such as testing, purchasing, fabrication, delivery and similar activities that require sequential activity.

Coordinate the submittals of different units of interrelated work so that one submittal will not be delayed by the Engineer's need to review a related submittal. The Engineer reserves the right to withhold action on any submittal requiring coordination with other submittals until related submittals are forthcoming.

C. Coordination of Submittal Times

Prepare and transmit each submittal to the Engineer sufficiently in advance of the scheduled performance of related work and other applicable activities. Transmit different kinds of submittals for the same units of work so that processing will not be delayed by the Engineer's need to review submittals concurrently for coordination.

D. Review Time

Allow sufficient time so that the installation will not be delayed as a result of the time required to properly process submittals, including time for resubmittal, if necessary. Advise the Engineer on each submittal, as to whether processing time is critical to the progress of the work and if the work would be expedited if processing time could be shortened.

1. Allow three weeks for the Engineer's initial processing of each submittal. Allow a longer time period where processing must be delayed for coordination with subsequent submittals. The Engineer will advise the Contractor promptly when it is determined that a submittal being processed must be delayed for coordination.

2. Allow two weeks for re-processing each submittal.
 3. No extension of time will be authorized because of the Contractor's failure to transmit submittals to the Engineer sufficiently in advance of the work.
- E. Submittal Preparation: Mark each submittal with a permanent label for identification. Number each submittal consecutively beginning with the Numeral 1. If, for any reason, a submittal must be returned to the Contractor for resubmittal, then its submittal number would be the same as the first with the letter "A" following the number. Second resubmittals would be "B" and so on. Provide the following information on the label for proper processing and recording of action taken.
1. Submittal number.
 2. Project name.
 3. Date.
 4. Name and address of Architect/Engineer.
 5. Name and address of Contractor.
 6. Name and address of subcontractor.
 7. Name and address of supplier.
 8. Name of manufacturer.
 9. Number and title of appropriate specification section.
 10. Drawing number and detail references, as appropriate.

F. **Submittal Transmittal**

All submittals shall be submitted in electronic format through the Engineer's submittal process. Transmit each submittal from the Contractor to the Engineer, and to other destinations as indicated, by use of a transmittal form. Submittals received from sources other than the Contractor will be returned to the sender "without action".

1.05 SPECIFIC SUBMITTAL REQUIREMENTS

A. **Shop Drawings**

Shop drawings shall be prepared by a qualified detailer. Details shall be identified by reference to sheet and detail numbers shown on Contract Drawings. Where applicable, show fabrication, layout, setting and erection details.

B. **Project Data**

Project data shall include manufacturer's standard schematic drawings modified to delete information, which is not applicable to the project, and shall be supplemented to provide additional information applicable to the project. Each copy of descriptive literature shall be clearly marked to identify pertinent information as it applies to the project.

C. **Samples**

Where samples are required, they shall be adequate to illustrate materials, equipment or workmanship, and to establish standards by which completed work is judged. Provide sufficient size and quantity to clearly illustrate functional characteristics of product and material, with integrally related parts and attachment devices, along with a full range of color samples.

D. Review of Submittals

The Contractor shall review and check submittals and shall indicate his review by initials and date.

E. Deviations

If the submittals deviate from the Contract Drawings and/or Specifications, the Contractor shall advise the Engineer, in writing of the deviation and any reasons therefore.

F. Modifications

In the event the Engineer does not specifically reject the use of material or equipment at variance to that which is shown on the Drawings or specified, the Contractor shall, at no additional expense to the Owner, and using methods reviewed by the Engineer, make any changes to structures, piping, controls, electrical work, mechanical work, etc., that may be necessary to accommodate this equipment or material. Should equipment other than that on which design drawings are based be accepted by the Engineer, shop drawings shall be submitted detailing all modification work and equipment changes made necessary by the substituted item.

G. Submittals for All Electrically Operated Items

Submittals for all electrically operated items (including instrumentation and controls) shall include complete size, color-coding, all terminations and connections, and coordination with related equipment.

H. Equipment Shop Drawings

Equipment shop drawings shall indicate all factory or shop paint coatings applied by suppliers, manufacturers and fabricators; the Contractor shall be responsible for insuring the compatibility of such coatings with the field-applied paint products and systems.

I. Fasteners

Fastener specifications of manufacturer shall be indicated on equipment shop drawings.

J. No material shall be fabricated or shipped unless the applicable drawings or submittals have been reviewed by the Engineer and returned to the Contractor.

K. All bulletins, brochures, instructions, parts lists, and warranties packaged with and accompanying materials and products delivered to and installed in the project shall be saved and transmitted to the Owner through the Engineer

1.06 CONTRACTOR RESPONSIBILITIES

A. Verify field measurements, field construction criteria, catalog numbers, and similar data.

B. Coordinate each submittal with requirements of work and of Contract Documents.

C. Notify Engineer, in writing at time of submission, of deviations in submittals from requirements of Contract Documents.

(BGWS-31)

- D. Begin no work, and have no material or products fabricated or shipped which requires submittals until return of submittals with Engineer's stamp and initials or signature indicating review.

PART 2 - PRODUCTS (Not Applicable).

PART 3 - EXECUTION (Not Applicable).

END OF SECTION

SECTION 01400 - QUALITY CONTROL SERVICES

(BGWS-32)

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

Drawings and general provisions of Contract, including General and Supplementary Conditions and other Division 1 Specification sections, apply to work of this section.

1.02 DESCRIPTION OF REQUIREMENTS

General: Required inspection and testing services are intended to assist in the determination of probable compliance of the work with requirements specified or indicated. These required services do not relieve the Contractor of responsibility for compliance with these requirements or for compliance with requirements of the contract documents.

Tests, inspections and certifications of materials, equipment, subcontractors or completed work, as required by the various sections of the Specifications shall be obtained by the Contractor and all costs shall be included in the contract price.

The Contractor shall submit to the Engineer the name of any testing laboratory to be used.

Contractor shall deliver written notice to the Engineer at least 24-hours in advance of any inspections or tests to be made at the project site. All inspections or tests to be conducted at the field shall be done in the presence of the Engineer or his representative.

Certifications by independent testing laboratories may be by copy of the attest and shall give scientific procedures and results of tests. Certifications by persons having interest in the matter shall be by original attest properly sworn to and notarized.

Inspections, tests and related actions specified in this section and elsewhere in the contract documents are not intended to limit the Contractor's own quality control procedures which facilitate overall compliance with requirements of the contract documents.

1.03 RESPONSIBILITIES

- A. Contractor Responsibilities: Except where they are specifically indicated as being the Owner's responsibility, or where they are to be provided by another identified entity, inspections, tests and similar quality control services are the Contractor's responsibility; these services also include those specified to be performed by an independent agency and not directly by the Contractor. Costs for these services shall be included in the Contract Sum. The Contractor shall employ and pay an independent agency, testing laboratory or other qualified firm to perform quality control services specified.
- B. Retest Responsibility: Where results of required inspections, tests or similar services prove unsatisfactory and do not indicate compliance of related work with the requirements of the contract documents, then retests are the responsibility of the Contractor, regardless of whether the original test was the Contractor's responsibility. Retesting of work revised or replaced by the Contractor is the Contractor's responsibility, where required tests were performed on original work.
- C. Responsibility for Associated Services: The Contractor is required to cooperate with the independent performing required inspections, tests and similar services. Provide such auxiliary services as are reasonably requested. Notify the testing agency sufficiently in

(BGWS-33)
advance of operations to permit assignment of personnel. These auxiliary services include but are not necessarily limited to the following:

- Providing access to the work.
- Taking samples or assistance with taking samples.
- Delivery of Samples to test laboratories.
- Delivery and protection of samples and test equipment at the project site.

- D. Coordination: The Contractor and each independent agency engaged to perform inspections, tests and similar services for the project shall coordinate the sequence of their activities so as to accommodate required services with a minimum of delay in the progress of the work. In addition, the Contractor and each independent testing agency shall coordinate their work so as to avoid the necessity of removing and replacing work to accommodate inspections and tests. The Contractor is responsible for scheduling times for inspections, tests, taking of samples and similar activities.

1.04 SUBMITTALS

- A. General: Refer to Division-1 section on "Submittals" for the general requirements on submittals. Submit a certified written report of each inspection, test or similar service, directly to the Architect/Engineer.
- B. Report Data: Written reports of each inspection, test or similar service shall include, but not be limited to the name of testing agency or test laboratory; dates and locations of samples and tests or inspections; names of individuals making the inspection or test; designation of the work and test method; complete inspection or test data and test results; interpretations of test results; notation of significant ambient conditions at the time of sample taking and testing; comments or professional opinion as to whether inspected or tested work complies with requirements of the contract documents; recommendations on retesting, if applicable.

PART 2 - PRODUCTS (Not Applicable).

PART 3 - EXECUTION

3.01 REPAIR AND PROTECTION

Upon completion of inspection, testing, sample taking and similar services performed on the work, repair damaged work and restore substrates and finishes to eliminate deficiencies, including deficiencies in the visual qualities of exposed finishes. Comply with the contract document requirements for "Cutting and Patching". Protect work exposed by or for quality control service activities and protect repaired work. Repair and protection is the Contractor's responsibility, regardless of the assignment of responsibility for inspection, testing or similar services.

END OF SECTION

SECTION 01500 - TEMPORARY FACILITIES AND CONTROLS

PART 1 - GENERAL

1.01 CONTROL

Maintain strict supervision of use of temporary utility services.

1. Enforce compliance with applicable standards.
2. Enforce safety practices.
3. Prevent abuse of services.

1.02 REQUIREMENTS OF REGULATORY AGENCIES

- A. Obtain and pay for all permits as required by governing authorities. This shall include (but not be limited to) a building permit.
- B. Obtain and pay for temporary easements required across property other than that of Owner.
- C. Comply with applicable codes.

1.03 REMOVAL

- A. Completely remove temporary materials, equipment, and offices upon completion of construction.
- B. Repair damage caused by installation, and restore to specified or original condition.

1.04 TEMPORARY WATER

- A. Contractor shall meter and pay for all potable water provided by the Owner.
- B. Contractor shall pay costs of the furnishing, maintaining and removing all temporary water service equipment, fixtures, hose, piping, etc.

1.05 PROTECTION AND SECURITY

- A. Provide barricades, lanterns and other such signs and signals as may be necessary to warn of the dangers in connection with open excavation and obstructions.
- B. Provide an adequate and approved system to secure the project area at all times, especially during non-construction periods; General Contractor shall be solely responsible for taking proper security measures.
- C. Contractor shall pay all costs for protection and security systems.

1.06 SANITARY FACILITIES

The Contractor shall furnish, install and maintain ample sanitary facilities for the workmen. As the needs arise, enclosed temporary toilets, in sufficient number, shall be placed as directed by the

Engineer. Drinking water shall be provided from a proven safe source so piped or transported as to be kept clean and fresh and served from single service containers of satisfactory types.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

SECTION 01631 - PRODUCTS AND SUBSTITUTIONS

PART 1 - GENERAL

1.01 RELATED DOCUMENTS

Drawings and general provisions of Contract, including General and Supplementary Conditions and other Division 1 Specification sections, apply to work of this section.

1.02 DESCRIPTION OF REQUIREMENTS

A. General

Substitution of materials and/or equipment is defined more fully hereinafter.

B. Definitions

Definitions used in this paragraph are not intended to negate the meaning of other terms used in the contract documents including such terms as "specialties", "systems", "structure", "finishes", "accessories", "furnishings", "special construction" and similar terms. Such terms are self-explanatory and have recognized meanings in the construction industry.

1. "Products" are items purchased for incorporation in the Work, regardless of whether they were specifically purchased for the project or taken from the Contractor's previously purchased stock. The term "product" as used herein includes the terms "material", "equipment", "system" and other terms of similar intent.
2. "Named Products" are products identified by use of the manufacturer's name for a product, including such items as a make or model designation, as recorded in published product literature, of the latest issue as of the date of the contract documents.
3. "Materials" are products that must be substantially cut, shaped, worked, mixed, finished, refined or otherwise fabricated, processed, or installed to form units of work.
4. "Equipment" is defined as a product with operational parts, regardless of whether motorized or manually operated, and in particular, a product that requires service connections such as wiring or piping.

C. Substitutions

The Contractor's requests for changes in the products, materials, equipment and methods of construction required by the contract documents are considered requests for "substitutions" and are subject to the requirements specified herein. The following are not considered as substitutions:

1. Revisions to the contract documents, where requested by the Owner, Architect or Engineer are considered as "changes" not substitutions.

2. Substitutions requested during the bidding period, which have been accepted prior to the Contract Date, are included in the contract documents and are not subject to the requirements for substitutions as herein specified.
3. Specified Contractor options on products and construction methods included in the contract documents are choices available to the Contractor and are not subject to the requirements for substitutions as herein specified.
4. Except as otherwise provided in the contract documents, the Contractor's determination of and compliance with governing regulations and orders as issued by governing authorities do not constitute "substitutions" and do not constitute a basis for change orders.

1.03 QUALITY ASSURANCE

A. Source Limitations

To the fullest extent possible, provide products of the same generic kind, from a single source, for each unit of work.

B. Compatibility of Options

Compatibility of products is a basic requirement of product selection. When the Contractor is given the option of selecting between two or more products for use on the project, the product selected must be compatible with other products previously selected, even if the products previously selected were also Contractor options. The complete compatibility between the various choices available to the Contractor is not assured by the various requirements of the Contract documents but must be provided by the Contractor.

1.04 SUBMITTALS

The information required to be furnished for evaluation of product substitution will be as follows:

- A. Performance capabilities, and materials and construction details will be evaluated based upon conformance with the Specifications. Products that do not conform with the Specifications will not be accepted.
- B. Manufacturer's production and service capabilities, and evidence of proven reliability will be acceptable if the following is furnished.
 1. Written evidence that the manufacturer has not less than (3) years experience in the design and manufacture of the substitute product.
 2. Written evidence of at least one application of a type and size similar to the proposed substitute product, in successful operation in a water treatment plant for a period of at least one year.
 3. In lieu of furnishing evidence of a manufacturer's experience and successful operation of an application of the product to be substituted, the Contractor has the option of furnishing a cash deposit or bond which will guarantee replacement if the product the furnished does not satisfy the other requirements specified in this

section. The amount of each deposit or bond will be subject to the approval of the A/E.

- C. Specific reference to characteristics either superior or inferior to specified requirements will be evaluated based on their net effect on the project. Products with any characteristics inferior to those specified will not be acceptable unless offset by characteristics that, in the opinion of the Engineer, will cause the overall effect of the product on the project to be at least equal to that of those specified.
- D. The detailed estimate of operating and maintenance costs will be evaluated based on comparison with similar data on the specified products. Proposed substitute products, which have an operating, and maintenance cost that, in the opinion of the Engineer, exceeds that of the specified products will not be considered equal and will not be acceptable.

1.05 PRODUCT DELIVERY, STORAGE, AND HANDLING

A. General

Deliver, store, and handle products in accordance with manufacturer's recommendations, using means and methods that will prevent damage, deterioration and loss, including theft. Control delivery schedules to minimize long-term storage at the site and to prevent overcrowding of construction spaces. Coordinate delivery and installation to ensure minimum holding or storage times for items known or recognized to be flammable, hazardous, easily damaged, or sensitive to deterioration, theft and other sources of loss.

- 1. Deliver products to the site in the manufacturer's sealed container or other packaging system, complete with labels and instructions for handling, storing, unpacking, protecting and installing.
- 2. Store products at the site in a manner that will facilitate inspection and measurement of quantity or counting of units.
- 3. Store heavy materials away from the project structure in a manner that will not endanger the supporting construction.
- 4. Products not stored in strict accordance with these provisions are not eligible for partial payment for products stored on site.

PART 2 - PRODUCTS

2.01 GENERAL PRODUCT COMPLIANCE

A. General

Requirements for individual products are indicated in the contract documents; compliance with these requirements is a contract requirement. These requirements may be specified in any one of several different specifying methods, or in any combination of these methods. These methods include the following:

- Proprietary.
- Descriptive.

Performance.
Compliance with Reference Standards.

Compliance with codes, compliance with graphic details, allowances, and similar provisions of the contract documents also have a bearing on the selection process.

B. Procedures for Selecting Products

Contractor's options in selecting products are limited by requirements of the contract documents and governing regulations. They are not controlled by industry traditions or procedures experienced by the Contractor on previous construction projects.

2.02 SUBSTITUTIONS

A. Conditions

Contractor's request for substitution will be received and considered when extensive revisions to the contract documents are not required, when the proposed changes are in keeping with the general intent of the contract documents, when the requests are timely, fully documented and properly submitted, and when one or more of the following conditions is satisfied, all as judged by the Engineer; otherwise, the requests will be returned without action except to record non-compliance with these requirements.

1. The Engineer will consider a request for substitution where the request is directly related to an "or equal" clause or similar language in the contract documents.
2. The Engineer will consider a request for substitution where the specified product or method cannot be provided within the Contract Time. However, the request will not be considered if the product or method cannot be provided as a result of the Contractor's failure to pursue the work promptly or to coordinate the various activities properly.
3. The Engineer will consider a request for substitution where the specified product or method cannot receive necessary approval by a governing authority, and the requested substitution can be approved.
4. The Engineer will consider a request for a substitution where a substantial advantage is offered the Owner, in terms of cost, time, energy conservation or other considerations of merit, after deducting offsetting responsibilities the Owner may be required to bear. These additional responsibilities may include such considerations as additional compensation to the Engineer for redesign and evaluation services, the increased cost of other work by the Owner or separate contractors, and similar considerations.
5. The Engineer will consider a request for substitution when the specified product or method cannot be provided in a manner, which is compatible with other materials of the work, and where the Contractor certifies that the substitution will overcome the incompatibility.
6. The Engineer will consider a request for substitution when the specified product or method cannot be properly coordinated with other materials in the work, and where

the Contractor certifies that the proposed substitution can be properly coordinated.

7. The Engineer will consider a request for substitution when the specified product or method cannot receive a warranty as required by the contract documents and where the contractor certifies that the proposed substitution receives the required warranty.
8. The Contractor shall reimburse the Owner any costs for review by the Engineer of proposed product substitutions which require major design changes, as determined by the Owner, to related adjacent work made necessary by the proposed substitutions.

B. Work-Related Submittals

Contractor's submittal of and the Engineer's acceptance of shop drawings, product data or samples which relate to work not complying with requirements of the contract documents, does not constitute an acceptable or valid request for a substitution, nor approval thereof.

2.03 GENERAL PRODUCT REQUIREMENTS

A. General

Provide products that comply with the requirements of the contract documents and that are undamaged and, unless otherwise indicated, unused at the time of installation. Provide products that are complete with all accessories, trim, finish, safety guards and other devices and details needed for a complete installation and for the intended use and effect.

1. Standard Products

Where they are available, provide standard products of types that have been produced and used successfully in similar situations on other projects.

2. Continued Availability

Where, because of the nature of its application, the Owner is likely to need replacement parts or additional amounts of a product at a later date, either for maintenance and repair or replacement, provide standard, domestically produced products for which the manufacturer has published assurances that the products and its parts are likely to be available to the Owner at a later date.

B. Nameplates

Except as otherwise indicated for required labels and operating data, do not permanently attach or imprint manufacturer's or producer's nameplates or trademarks on exposed surfaces of products which will be exposed to view either in occupied spaces or on the exterior of the completed project.

1. Labels: Locate required product labels and stamps on a concealed surface or, where required for observation after installation, on an accessible surface which, in occupied spaces, is not conspicuous.

2. Equipment Nameplates: Provide permanent nameplate on each item of service-connected or power operated equipment. Locate the nameplate on an easily accessible surface, which is inconspicuous in occupied spaces. The nameplate shall contain the following information and other essential operating data.
 - a. Name of manufacturer
 - b. Name of product
 - c. Model number
 - d. Serial number
 - e. Capacity
 - f. Speed
 - g. Ratings

PART 3 - EXECUTION

3.01 INSTALLATION OF PRODUCTS

A. General

Except as otherwise indicated in individual sections of these specifications, comply with the manufacturer's instructions and recommendations for installation of the products in the applications indicated. Anchor each product securely in place, accurately located and aligned with other work. Clean exposed surfaces and protect surfaces as necessary to ensure freedom from damage and deterioration at time of acceptance.

END OF SECTION

SECTION 01700 - PROJECT CLOSEOUT

PART 1 - GENERAL

1.01 RELATED REQUIREMENTS SPECIFIED ELSEWHERE

- A. Liquidated Damages: See KDOH requirements and conditions.
- B. Cleaning: Section 01710.
- C. Project Record Documents: Section 01720.

1.02 SUBSTANTIAL COMPLETION

A. Contractor

- 1. Submit written certification to Engineer that project is substantially complete.
- 2. Submit list of major items to be completed or corrected.

- B. Engineer will make an inspection within seven (7) days after receipt of certification, together with Owner's Representative.

- C. Should Engineer consider that work is substantially complete:

- 1. Contractor shall prepare, and submit to Engineer, a list of items to be completed or corrected, as determined by the inspection.
- 2. Engineer will prepare and issue a Certificate of Substantial Completion, containing:
 - a. Date of Substantial Completion.
 - b. Contractor's list of items to be completed or corrected, verified and amended by Engineer.
 - c. The time within which Contractor shall complete or correct work of listed items.
 - d. Time and date Owner will assume possession of work or designated portion thereof.
- 3. Owner occupancy of Project or Designated Portion of Project:
 - a. Contractor shall:
 - (1) Obtain certificate of occupancy.
 - (2) Perform final cleaning in accordance with Section 01710.
 - b. Owner will occupy Project, under provisions stated in Certificate of Substantial Completion.
- 4. Contractor: Complete work listed for completion or correction, within designated time.

- D. Should Engineer consider that work is not substantially complete:

- 1. He shall immediately notify Contractor, in writing, stating reasons.

(BGWS-43)

2. Contractor: Complete work, and send second written notice to Engineer certifying that Project, or designated portion of Project, is substantially complete.
3. Engineer will reinspect work.

1.03 FINAL INSPECTION

- A. Contractor shall submit written certification that:
 1. Contract Documents have been reviewed.
 2. Project has been inspected for compliance with Contract Documents.
 3. Work has been completed in accordance with Contract Documents.
 4. Equipment and systems have been tested in presence of the Owner and the Engineer or his Representative and are operational.
 5. Project is completed, and ready for final inspection.
- B. Engineer and Owner will make final inspection in the presence of the Contractor within seven (7) days after receipt of certification.
- C. Should Engineer consider that work is finally complete in accordance with requirements of Contract Documents, he shall request Contractor to make Project Closeout submittals.
- D. Should Engineer consider that work is not finally complete:
 1. He shall notify Contractor, in writing, stating reasons.
 2. Contractor shall take immediate steps to remedy the stated deficiencies, and send second written notice to Engineer certifying that work is complete.
 3. Engineer will reinspect work.
- E. Should Engineer consider that work is still not finally complete:
 1. He shall notify Contractor, in writing, stating reasons.
 2. Contractor shall take immediate steps to remedy the stated deficiencies, and send third written notice to the Engineer certifying that the work is complete.
 3. Engineer and Owner will reinspect work at Contractor's expense.

1.04 CLOSEOUT SUBMITTALS

- A. Project Record Documents: To requirements of Section 01720.
- B. Operation and Maintenance Data: To requirements of particular technical specifications.
- C. Guarantees, Warranties and Bonds: To requirements of particular technical specifications.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

SECTION 01710 - CLEANING

PART 1 - GENERAL

1.01 DESCRIPTION

- A. Related requirements specified elsewhere:
 - 1. Project Closeout: Section 01700.
 - 2. Cleaning for Specific Products or Work: Specification section for that work.
- B. Maintain premises free from accumulations of waste, debris, and rubbish, caused by operations.
- C. At completion of work, remove waste materials, rubbish, tools, equipment, machinery and surplus materials, and clean all sight-exposed surfaces; leave project area clean and ready for use.

1.02 SAFETY REQUIREMENTS

- A. Hazards Control
 - 1. Store volatile wastes in covered metal containers and remove from premises daily.
 - 2. Prevent accumulation of wastes, which create hazardous conditions.
 - 3. Provide adequate ventilation during use of volatile or noxious substances.
- B. Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
 - 1. Do not burn or bury rubbish and waste materials on project site.
 - 2. Do not dispose of volatile wastes such as mineral spirits, oil, or paint thinner in storm or sanitary drains.
 - 3. Do not dispose of wastes into streams or waterways.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Use only cleaning materials recommended by manufacturer of surface to be cleaned.
- B. Use cleaning materials only on surfaces recommended by cleaning material manufacturer.

PART 3 - EXECUTION

3.01 DURING CONSTRUCTION

- A. Execute cleaning to ensure that building, grounds, and public properties are maintained free from accumulations of waste materials and rubbish.

- B. Wet down dry materials and rubbish to lay dust and prevent blowing dust.
- C. At reasonable intervals during progress of work, clean site and public properties, and dispose of waste materials, debris and rubbish.
- D. Provide on-site containers for collection of waste materials, debris and rubbish.
- E. Remove waste materials, debris and rubbish from site and legally dispose of at public or private dumping areas off Owner's property.
- F. Handle materials in a controlled manner with as few handlings as possible; do not drop or throw materials from heights.
- G. Schedule cleaning operations so that dust and other contaminants resulting from cleaning process will not fall on wet, newly painted surfaces.

3.02 FINAL CLEANING

- A. The work will not be considered as completed and final payment made until all final cleaning has been done by the Contractor in a manner satisfactory to the Engineer.
- B. Employ experienced workmen, or professional cleaners, for final cleaning.
- C. In preparation for substantial completion or occupancy, conduct final inspection of sight-exposed interior and exterior surfaces, and of concealed spaces.
- D. Remove grease, dust, dirt, stains, labels, fingerprints, and other foreign materials, from sight-exposed interior or exterior finished surfaces; polish surfaces so designated to shine finish.
- E. Repair, patch and touch up marred surfaces to specified finish, to match adjacent surfaces.
- F. Broom clean paved surfaces; rake clean other surfaces of grounds.
- G. Maintain cleaning until project, or portion thereof, is occupied by Owner.

END OF SECTION

SECTION 01720 - PROJECT RECORD DOCUMENTS

PART 1 - GENERAL

1.01 RELATED REQUIREMENTS

- A. Submittals: Section 01340.

1.02 MAINTENANCE OF DOCUMENTS

- A. Maintain at job site, one copy of:
 - 1. Contract Drawings
 - 2. Specifications
 - 3. Addenda
 - 4. Reviewed Shop Drawings
 - 5. Change Orders
 - 6. Other Modifications to Contract
- B. Store documents in approved location, apart from documents used for construction.
- C. Maintain documents in clean, dry, legible condition.
- D. Do not use record documents for construction purposes.
- E. Make documents available at all times for inspection by Engineer and Owner.

1.03 MARKING DEVICES

Provide colored pencil or felt-tip marking pen for all marking.

1.04 RECORDING

- A. Label each document "PROJECT RECORD".
- B. Keep record documents current.
- C. Do not permanently conceal any work until required information has been recorded.
- D. Contract Drawings: Legibly mark to record actual construction.
 - 1. Horizontal and vertical location of underground utilities and appurtenances referenced to permanent surface improvements.
 - 2. Location of internal utilities and appurtenances concealed in construction referenced to visible and accessible features of structure.
 - 3. Field changes of dimension and detail.
 - 4. Changes made by Change Order or Field Order.
 - 5. Details not on original contract drawings.
- E. Specifications and Addenda: Legibly mark each Section to record:

1. Manufacturer, trade name, catalog number, and Supplier of each product and item of equipment actually installed.
 2. Changes made by Change Order or Field Order.
 3. Other matters not originally specified.
- F. Shop Drawings: Maintain as record documents; legibly annotate shop drawings to record changes made after review.

1.05 SUBMITTAL

- A. At completion of project, deliver record documents to Engineer.
- B. Accompany submittal with transmittal letter, in duplicate, containing:
1. Date.
 2. Project Title and Number.
 3. Contractor's Name and Address.
 4. Title and Number of each Record Document.
 5. Certification that each Document as Submitted is Complete and Accurate.
 6. Signature of Contractor or his authorized Representative.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION (Not Applicable)

END OF SECTION

SECTION 02225 - EARTHWORK FOR UTILITY WORK

PART 1 GENERAL

1.01 DEFINITIONS

- A. Rock: Stratified material in place which rings under the flow of a hammer; boulders having a volume of one-half (1/2) cubic yard or more. Shale, slate, soapstone, and chert will not be classified as rock.
- B. Utility: Any buried pipe, conduit, or cable.

1.02 REFERENCES

- A. ASTM C33 - Concrete Aggregates.
- B. ASTM C94 - Ready-Mixed Concrete.
- C. ASTM C150 - Portland Cement.

1.03 SUBMITTALS

Submit two copies of following test reports:

- A. Test reports on borrow material.

1.04 QUALITY ASSURANCE

- A. Codes and Standards: Perform work in compliance with requirements of governing authorities having jurisdiction.
- B. Inspection and Testing: Provide inspection and testing under provisions of Section 01400.
- C. Excavator: Engage an excavator with not less than 5 years of experience in excavating, rock removal, sheeting, bracing, soil stabilization, dewatering, well pointing, backfilling, and similar operations commonly encountered in major excavation projects.

1.05 JOB CONDITIONS

- A. Existing Utilities: Locate existing underground utilities in areas of work. Protect utilities indicated to remain in place. If uncharted or mis-charted utilities are encountered, immediately notify Engineer and Utility Owner. Keep services and facilities in operation under direction of Utility Owner.
- B. Repair damaged utilities to satisfaction of Utility Owner.
- C. Owner will not be responsible for mis-charted utilities.
- D. Do not interrupt existing utilities that are in use without written permission of Owner and then only after temporary services have been provided.

1.06 EXPLOSIVES

Do not bring explosives on-site or use in work without written permission from authorities having jurisdiction. Contractor is solely responsible for handling, storage and use of explosives.

1.07 PROTECTION OF PERSONS AND PROPERTY

- A. Barricade open excavations occurring as part of this work and post warning lights. Operate warning lights as recommended by authorities having jurisdiction.
- B. Protect structures, utilities, sidewalks, pavements, and other facilities indicated to remain in place from damage caused from possible settlement, lateral movement, undermining, washout and other hazards created by excavation.
- C. Protect plant growth and trees scheduled to remain. Do not excavate or store material within drip line of trees.
- D. Restore property to a condition similar or equal to that existing before construction.

1.08 COORDINATION

- A. Coordinate the Work.
- B. Verify work associated with lower elevation utilities are complete before placing higher elevation utilities.
- C. Where excavation and backfill for utility work passes through or occurs in a landscaped area, repair or replace the landscape work to match original condition and quality of work.
- D. Where excavation and backfill for utility work passes through or occurs in an area of paving, restore construction and finish of paving to match original condition and quality of work.
- E. Coordinate excavations with weather conditions, to minimize the possibility of washouts, settlements and other damages and hazards.
- F. Coordinate with utility owner for shutdown of service. Provide minimum 48-hour notice to Owner and receive written notice to proceed before interrupting any utility.

1.09 SCHEDULING AND SEQUENCING

- A. Do not excavate for utility work until the work is ready to proceed without delay, so that the total time lapse from excavation to completion of backfilling will be minimal.
- B. At street and road crossings, excavate only 1/2 of crossings before placing temporary bridges over side excavated, for convenience of traveling public.

1.10 MAINTENANCE

- A. Where subsidence is measurable or observable at utility work excavations during warranty period, remove surface (pavement, lawn or other finish), add backfill material, compact, and replace surface treatment.

- B. Restore appearance, quality, and conditions of surface or finish to match adjacent work and eliminate evidence of restoration to greatest extent possible.

PART 2 - PRODUCTS

2.01 FILL

- A. Earth Fill: Soil free of roots and organic material, debris and other material considered deleterious by Engineer. Soil selected shall consist of residual clay occurring within designated borrow areas, or which occurs within on-site areas which are to be excavated. Soil shall be free of rock fragments greater than 2 inches in maximum dimension.
- B. Bedding and Backfill Material: Department of Transportation specification Grade E Crusher Run Gradation or as specified for specific utilities.
- C. Finely-Graded Bedding Material: Well graded sand, gravel, crushed stone or crushed slag, with 100% passing a 3/8 inch sieve.

2.02 ACCESSORIES

- A. Topsoil: Natural, fertile, agricultural soil capable of sustaining plant growth; free of subsoil, slag, rocks, clay, sticks, and roots.
- B. Lean Concrete: Provide concrete in accordance with the following:
 - 1. Cement: ASTM C150 normal - Type 1 Portland.
 - 2. Fine and Coarse Aggregates: ASTM C33.
 - 3. Water: Clean and not detrimental to concrete.
 - 4. Mix concrete in accordance with ASTM C94 with a compressive strength (28 days) of 3,000 psi and a 4 inch slump.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Examine areas to be excavated, and conditions under which work is to be performed, and notify Engineer in writing of conditions detrimental to the proper completion of the Work.
- B. Do not proceed with excavating until unsatisfactory conditions have been corrected in an acceptable manner.

3.02 PREPARATION

- A. Identify required lines, levels, contours, and datum.
- B. Strip topsoil and stockpile on site for re-spreading. Do not pile over 8 feet and protect from erosion.
- C. In cases where gas, sewer, or other pipe is encountered, pipe shall not be displaced nor disturbed unless necessary, in which case replace it in good condition as soon as possible.

3.03 EXCAVATION

- A. Excavate for piping with clearance on both sides of pipe as shown, except where otherwise shown or required for proper installation of pipe joints, fittings, valves and other work. Excavate for other utility work to provide minimum practical but adequate working clearances.
- B. Hand trim for bell and spigot pipe joints. For sanitary sewer lines shape bedding to fit shape of bottom half pipe, for uniform continuous support.
- C. Depth for Direct Support: For work to be supported directly on undisturbed soil, do not excavate beyond indicated depths, and hand-excavate the bottom cut to accurate elevations. Support the following work on undisturbed soil at the bottom of the excavations:
 - 1. Piping of 5 inch diameter and less.
 - 2. Cast-in-place concrete.
- D. Depth for Bedding Support: For large piping (6 inch pipe size and larger), tanks and where indicated for other utility work, excavate for installation of bedding material in the depth indicated or, if not otherwise indicated, 6 inches below bottom of work to be supported.
- E. Depth for Unsatisfactory Soil Conditions: Where unsatisfactory soil conditions at bottom of indicated excavation are encountered, excavate additional depth to reach satisfactory soil-bearing condition. Backfill with bedding material and compact to indicated excavation depth.
- F. Depth for Exterior Piping: Excavate for exterior water-bearing piping (water, steam, condensate, and drainage) so that top of piping will not be less than 36" in open fields and 48" in roadways vertical distance below finished grade.
- G. When excavating within drip line of large trees, perform the work by hand, and protect the root system from damage or dryout to the greatest extent possible. Maintain moist condition for root system and cover exposed roots with burlap. Paint root cuts of one inch diameter and larger with asphaltic tree paint.
- H. Correct areas over excavated. Correct unauthorized rock removal with lean concrete fill.
- I. Previous Excavations: Where piping crosses over an area more than 5'-0" wide which has been previously excavated to a greater depth than required for piping installation, provide suitable subsidence-proof support for piping.
- J. Comply with the details shown. Where not otherwise shown, excavate to undisturbed soil, in a width equal to pipe diameter plus 18". Install 6 inch courses of bedding material, each compacted to 95% of maximum density, as required to fill excavation and support piping.
- K. Excavation is unclassified, and includes excavation to subgrade elevations indicated, regardless of character of materials and obstructions encountered. Same price shall be considered for excavation whether it be earth or rock.
- L. Unauthorized Excavation: Removal of material beyond indicated elevations or dimensions without direction of Engineer. Unauthorized excavation, as well as remedial work directed by

Engineer, shall be at Contractor's expense. Backfill and compact unauthorized excavations as specified for authorized excavations of same classification, unless otherwise directed by Engineer.

- M. Stability of Excavations: Slope sides of excavations to comply with applicable codes. Shore and brace where sloping is not possible. Maintain sides and slopes in safe condition until completion of backfilling.
- N. Shoring and Bracing: Comply with applicable code requirements for shoring and bracing. Provide materials that are in good serviceable condition. Carry down shoring and bracing as excavation progresses and maintain in place as long as excavations are open.

Where removal of shoring may permit lateral movement of soil under adjacent structures, provide steel or pressure treated wood sheet piling to be cut off and left in place.

- O. Material Storage: Stockpile satisfactory material where directed until required for backfill or fill. Place, grade, and shape stockpiles for proper drainage. Do not stockpile material at edge of excavation. Dispose of excess soil and waste material. Do not store under trees within the drip line.

3.04 COMPACTION

- A. Before compacting and filling, proof roll area. Remove soft spots, fill and compact to required density.
- B. Control soil compaction during construction providing minimum percentage of density specified for each area classification indicated below.
- C. Percentage of Maximum Density Requirements: Compact soil to not less than the listed percentages of dry density for soils which exhibit a well-defined moisture density relationship determined in accordance with ASTM D698 (Standard Proctor); and not less than listed percentages of relative density, determined in accordance with ASTM D4253, for soils which will not exhibit a well-defined moisture-density relationship.
 - 1. Pavements: Compact top 12 inches of subgrade and each layer of backfill or fill material at 98% maximum dry density or 90% relative dry density for cohesive soil material.
 - 2. Roadways: 90% for cohesive soils; 95% for cohesionless soils.
 - 3. Lawn or Unpaved Areas: Compact top 6 inches of subgrade and each layer of backfill or fill material at 90% maximum dry density.
 - 4. Walkways: Compact top 6 inches of subgrade and each layer of backfill or fill material at 95% maximum dry density.
- D. Moisture Control: Where subgrade or layer soil material must be moisture conditioned before compaction, uniformly apply water to surface of subgrade, or layer of soil material, to prevent free water appearing on surface during or subsequent to compaction operations.
- E. Remove and replace, or scarify and air dry, soil material that is too wet to permit compaction to specified density. Soil material that has been removed because it is too wet to permit compaction may be stockpiled or spread and allowed to dry. Assist drying by discing, harrowing or pulverizing until moisture content is reduced to a satisfactory value. Reuse stockpiled material only after dried to proper moisture content.

3.05 BACKFILL AND FILL

- A. Backfill trenches to contours and elevations with unfrozen materials. Systematically backfill trenches to allow maximum time for natural settlement. Do not backfill over porous, wet, frozen or spongy subgrade surfaces.

Provide finely-graded-bedding material for wrapped, coated and plastic pipe and tanks. (Excavated dirt free of rock will be suitable.)

- B. Place acceptable fill in layers to required subgrade elevations, for each area classification listed below.
- C. Place and mechanically compact aggregate fill materials in continuous layers not exceeding 6 inches compacted depth each.
1. Place aggregate fill over top of pipe in landscaped areas to depth as shown.
 2. In areas of asphaltic concrete paving, fill trench as shown on Standard Drawings.

- D. Place and mechanically compact earth fill material in continuous layers not exceeding 8 inches compacted depth from top of aggregate fill to finish grade.

For site filling, in excavations, under grassed areas, under walks or pavements, use satisfactory excavated or borrow material.

- E. Backfill excavations as soon as work permits, but not until acceptance by Architect/Engineer of the following:
1. Below grade construction.
 2. Inspection, testing, approval and recording locations of underground utilities.
 3. Removal of formwork and shoring and bracing.
 4. Removal of trash and debris.

- F. Employ a placement method that does not disturb or damage or create injurious side pressures on pipe in trench.

- G. Topsoil Spreading: Re-spread topsoil stockpiled on site to a minimum depth of 6 inches. If amount of topsoil is inadequate, provide approved borrowed material at no additional expense to Owner.

3.06 GRADING

- A. Uniformly grade areas within limits of grading under this Section, including adjacent transition areas. Smooth finished surface within specified tolerances, compact with uniform levels or slopes between points where elevations are indicated, or between such points and existing grades.
- B. Grading Outside Building Lines: Slope grade away from buildings to drain away water and prevent ponding.
- C. Grading Tolerances: Finish surfaces free from irregular surface changes and to following

tolerances above or below required subgrade elevations.

1. Lawns and Unpaved Areas: Finish areas to receive topsoil to within not more than 0.10 foot above or below required subgrade elevations.
 2. Walks: Shape surface of areas under walks to line, grade and cross-section, with finish surface not more than 0.10 foot above or below required subgrade elevations.
 3. Pavements: Shape surface of areas under pavement to line, grade and cross-section, with finish surface not more than 1/2 inch above or below required subgrade elevations when tested with a 10 foot straight edge.
- D. Compaction: After grading, compact subgrade surfaces to depth and percentage of maximum density for each area classification.

3.07 TOLERANCES

- A. Top Surface of Backfilling Under Paved Areas: Plus or minus 1 inch 0.08 feet from required elevations.
- B. Top Surface of General Backfilling: Plus or minus 1 inch 0.08 feet from required elevations.

3.08 FIELD QUALITY CONTROL

- A. Field inspection and testing will be performed under provisions of Section 01410.
- B. Testing During Construction: Testing agency to inspect and approve subgrades and fill layers before continuing with construction.
1. Perform testing in accordance with ASTM D1556 (sand cone method) or D2167 (rubber balloon method).
- C. If compacted subgrade or fills, which have been placed, do not meet specified densities provide additional compaction and testing at no expense to Owner.

3.09 MAINTENANCE

- A. Protection of Graded Areas: Protect newly graded areas from traffic and erosion. Keep free of trash and debris.
- B. Repair and re-establish grades in settled, eroded, and rutted areas to specified tolerances.
- C. Reconditioning Compacted Areas: Where completed compacted areas are disturbed by subsequent construction operations or adverse weather, scarify surface, re-shape, and compact to required density prior to further construction.

3.10 DISPOSAL OF EXCESS AND WASTE MATERIALS

- A. Remove excess excavated material, trash, debris and waste materials and dispose of it off Owner's property.
- B. Materials excavated shall be disposed of so as to interfere as little as possible with public travel and, in all cases, the disposition of excavated material shall be satisfactory to the Engineer.

3.11 PROTECTION OF FINISHED WORK

- A. Protect finished Work under provisions of Section 01500.
 - 1. Do not walk on or work on top of finished piping until trench has been backfilled.
- B. Reshape and re-compact fills subjected to vehicular traffic during construction period. Add mineral aggregate base course as required to maintain trenches in asphaltic concrete areas in a safe and passable condition.

END OF SECTION

SECTION 02240 - DEWATERING

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor and equipment required to dewater all excavations.
- B. Dewatering of all excavations shall be the responsibility of the Contractor, and no additional compensation will be allowed for same.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Earthwork for Utility Work is included in Section 02225.
- B. Erosion and sedimentation control is included in Section 02371.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.01 GENERAL

- A. Dewatering equipment shall be of adequate size and quantity to assure maintaining proper conditions for installing pipe, concrete, backfill or other material or structure in the excavation.
- B. Dewatering shall include proper removal of any and all liquid, regardless of its source, from the excavation and the use of all practical means available to prevent surface runoff from entering any excavation.
- C. The site shall be kept free of standing surface water at all times. The Contractor shall install drainage ditches, dikes and shall perform all pumping and other work necessary to divert or remove rainfall and all other accumulations of surface water from the excavations. The diversion and removal of surface water shall be performed in a manner that will prevent flooding and/or damage to other locations within the construction area where it may be detrimental. The Contractor shall provide, install and operate sufficient trenches, sumps, pumps, hose piping, well points, deep wells, etc., necessary.

END OF SECTION

SECTION 02260 - EXCAVATION SUPPORT AND PROTECTION

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. This Section includes, but is not limited to, the following:
 - 1. Shoring and bracing necessary to protect existing buildings, streets, walkways, utilities, and other improvements and excavation against loss of ground or caving embankments.
 - 2. Maintenance of shoring and bracing.
 - 3. Removal of shoring and bracing, as required.
- B. Types of shoring and bracing systems include, but are not limited to, the following:
 - 1. Steel H-section (soldier) piles.
 - 2. Timber lagging.
 - 3. Steel sheet piles.

1.02 RELATED DOCUMENTS

Drawings and general provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.03 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Section 01340.
- B. Layout drawings for excavation support system and other data prepared by, or under the supervision of, a qualified professional engineer. System design and calculations must be acceptable to local authorities having jurisdiction.

1.04 QUALITY ASSURANCE

- A. Engineer Qualifications: A professional engineer legally authorized to practice in jurisdiction where Project is located and experienced in providing successful engineering services for excavation support systems similar in extent required for this Project.
- B. Supervision: Engage and assign supervision of excavation support system to a qualified professional engineer foundation consultant.
 - 1. Submit name of engaged consultant and qualifying technical experience.
- C. Regulations: Comply with codes and ordinances of governing authorities having jurisdiction.

1.05 JOB CONDITIONS

- A. Before starting work, verify governing dimensions and elevations. Verify condition of adjoining properties. Take photographs to record any existing settlement or cracking of structures, pavements, and other improvements. Prepare a list of such damages, verified by dated photographs, and signed by Contractor and others conducting investigation.
- B. Survey adjacent structures and improvements, employing qualified professional engineer, establishing exact elevations at fixed points to act as benchmarks. Clearly identify benchmarks and record existing elevations.
- C. During excavation, resurvey benchmarks maintaining accurate log of surveyed elevations for comparison with original elevations. Promptly notify Engineer if changes in elevations occur or if cracks, sags, or other damage is evident.

1.06 EXISTING UTILITIES

- A. Protect existing active sewer, water, gas, electricity and other utility services and structures.
- B. Notify municipal agencies and service utility companies having jurisdiction. Comply with requirements of governing authorities and agencies for protection, relocation, removal, and discontinuing of services.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. General: Provide adequate shoring and bracing materials, which will support loads imposed. Materials need not be new but should be in serviceable condition.
- B. Structural Steel: ASTM A-36.
- C. Steel Sheet Piles: ASTM A-328.
- D. Timber:

Lagging: Any species, rough-cut, mixed hardwood, nominal 3 inches thick, unless otherwise indicated.

Sheeting, Bracing, Struts: No timber sheeting less than two inches in thickness and timber bracing, cross bracing or struts less than six inches in thickness will be acceptable.

PART 3 - EXECUTION

3.01 GENERAL

- A. Where unstable materials are encountered or as required by law or Government regulations, such as OSHA, the sides of the trench or excavation shall be supported by substantial sheeting, bracing, and shoring, or the sides sloped to the angle of repose. Adequate and proper shoring of all excavations shall be the entire responsibility of the Contractor.

- B. Foundations, adjacent to where the excavation is to be made below the depth of the foundation, shall be supported by shoring, bracing or underpinning of a temporary or a permanent nature as may be required to assure the integrity of the structure. The Contractor will be held strictly responsible for any damage to adjoining foundations or structures.
- C. All sheeting, planking, timbering, bracing and bridging shall be placed, renewed and maintained as long as necessary. Unless directed by the Engineer, any sheeting left in place is not a separate pay item.
- D. Solid sheeting will be required for wet or unstable material. It shall consist of continuous vertical sheet piling of timber two inches thick or of steel with suitable shores and braces. All sheeting to be left in place shall be two-inch thick timber.
- E. Care shall be taken to avoid excessive backfill loads on the completed pipelines and the requirements that the width of the ditch at the level of the crown of the pipe exceed that specified in section 2510: "Water Distribution Piping".
- F. Trench sheeting shall not be removed until sufficient backfill has been placed to protect the pipe.

3.01 SHORING

- A. Wherever shoring is required, locate the system to clear permanent construction and to permit forming and finishing of concrete surfaces. Provide shoring system adequately anchored and braced to resist earth and hydrostatic pressures.
- B. Shoring systems retaining earth on which the support or stability of existing structures is dependent must be left in place at completion of work.

3.02 BRACING

- A. Locate bracing to clear columns, floor framing construction, and other permanent work. If necessary to move a brace, install new bracing prior to removal of original brace.
- B. Do not place bracing where it will be cast into or included in permanent concrete work, except as otherwise acceptable to Engineer.
- C. Install internal bracing, if required, to prevent spreading or distortion of braced frames.
- D. Maintain bracing until structural elements are supported by other bracing or until permanent construction is able to withstand lateral earth and hydrostatic pressures.
- E. Remove sheeting, shoring, and bracing in stages to avoid disturbance to underlying soils and damage to structures, pavements, facilities, and utilities.
- F. Repair or replace, as acceptable to Engineer, adjacent work damaged or displaced through installation or removal of shoring and bracing work.

END OF SECTION

SECTION 02371 - EROSION AND SEDIMENTATION CONTROL-KPDES REQUIREMENTS

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Coordinate with the KYTC general/grading contractor for the furnishing of all labor, materials, and equipment required for erecting, maintaining and removing temporary erosion and sedimentation controls as required and/or recommended by state and local regulatory agencies to conform with the Erosion and Sedimentation Control provisions of the SWPPP for the project.
- B. Temporary erosion controls include, but are not limited to grassing, mulching, seeding, providing erosion control and turf reinforcement mats on all disturbed surfaces including waste area surfaces and stockpile and borrow area surfaces; scheduling work to minimize erosion and providing interceptor ditches at those locations which will ensure that erosion during construction will be either eliminated or maintained within acceptable limits.
- C. Temporary sedimentation controls include, but are not limited to, silt dams, traps, barriers, and appurtenances on sloped surfaces which will ensure that sedimentation pollution will be either eliminated or maintained within acceptable limits.
- D. Coordinate as to the responsibility for providing and maintaining effective temporary erosion and sediment control measures prior to and during construction or until final controls become effective.
- E. The Utility Contractor shall be responsible for placement of erosion and sedimentation controls required for the Utility Work. Prior to construction, the Contractor shall coordinate with the General Contractor for conformance to the project erosion control requirements, documents, etc.
- F. Bare soil areas must be seeded, mulched, or covered after 14 days if no work will be done in the area within the next 7 days. If areas are to be left bare for more than 14 days, erosion controls and sediment barriers are required to be installed.
- G. Erosion Control prevention measures shall be installed prior to removal of vegetation and/or stripping of topsoil.

1.02 PERMIT AND NOTIFICATION REQUIREMENTS

- A. The Contractor shall comply with all requirements of the State and Local regulatory agencies.

PART 2 – PRODUCTS

2.01 SEED

- A. The seed mixture to be sown shall match existing grasses in lawns or, where mixed or of unknown variety, shall be in the following proportions:

(BGWS-61)

Common Name	Proportion By Weight	% Of Purity	% Of Germination
Kentucky 31 Tall Fescue	75	90	85
Italian Rye Grass	10	90	85
Red Top	10	90	85
White Clover	5	95	90

- B. All seed shall be fresh and clean and shall be delivered mixed, in unopened packages, bearing a guaranteed analysis of the seed mixture.
- C. Seed for temporary stabilization shall be annual rye grass, oats or wheat.

2.02 FERTILIZER

- A. If required to establish ground cover, just prior to the planting of turf, evenly broadcast 15 pounds per thousand square feet of fertilizer, 10-10-10 (nitrogen, phosphorus, potassium). Disc or harrow fertilizer 1 to 4 inches into the soil.
- B. Fertilizer shall be delivered to the site in the original unopened container bearing the manufacturer's guarantee analysis. Any fertilizer that becomes caked or damaged making it unsuitable for use, will not be accepted.

2.03 MULCH

- A. Mulch for seeded areas shall be Conwed Hydro Mulch, Silva-Fiber, or equal. It shall be suitable for use in a water slurry or for application with hydraulic equipment. The moisture content shall be 9-15%, and mulch shall have an organic matter content of minimum 98%.
- B. Clean straw is acceptable as mulch. It shall be spread at the rate of one (1) bale per 1,000 feet (approximately 1" loose depth).
- C. Mulch on slopes greater than 3:1 shall be held in place with erosion control netting.
- D. Mulch on areas subject to surface water run-off or in drainage ditches shall be held in place with erosion control netting.

2.04 EROSION CONTROL BLANKETS

- A. Erosion Control Blanket shall be made up of biodegradable and/or photodegradable products such as jute, wood fiber, coconut fiber, straw and degradable plastic netting. They shall degrade at a rate of approximately 6 months to 24 months.
- B. Erosion Control Blanket shall be installed on slopes greater than 3:1 and in all ditches and drainage channels, and where otherwise indicated on the Contract Drawings or directed by regulatory agencies.

2.05 SILT FENCE

- A. Temporary Silt Fence shall consist of woven geotextile fabric attached to 2" X 2" X 48" tall hardwood stakes.

1.

Fabric shall be 48” tall, with top being even with top of stakes. Bottom 12” shall be buried in trench as shown on the Detail Drawings.
2.

Stakes shall be at 6’ centers unless stated otherwise on Contract Documents.
- B.

Temporary Reinforced Silt Fence

1.

For areas of steep slopes and high flows, where indicated on the Contract Drawings, or as directed by state or local regulations, Reinforced Silt Fence shall be installed.

2.

Fabric shall be woven monofilament geotextile attached to 11 gauge steel fencing of 2” X 4” grid.

3.

Stakes shall be 5” tall steel and shall be installed on 4’ centers.

4.

Fabric and fencing shall be buried in trench as shown on the Detail Drawings.
- C.

Spacing of Silt Fences on slopes shall be according to the following table, or as directed by state or local regulatory agencies:

	Soil Type		
Slope Angle	Silty	Clays	Sandy
Very Steep (1:1)	50 ft.	75 ft.	100 ft.
Steep (2:1)	75 ft.	100 ft.	125 ft.
Moderate (4:1)	100 ft.	125 ft.	150 ft.
Slight (10:1)	125 ft.	150 ft.	200 ft.

- D.

If runoff flows along the uphill side of the silt fence, Contractor shall install “J-hooks” every 40 to 80 feet. These are curved sections of silt fence above the continuous fence that serve as small dams to stop and hold the flow to allow sediment to settle.

2.06 FIBER ROLLS

- A.

On long slopes less than 10:1, and where indicated on the Contract Drawings or recommended by the regulatory agency, Fiber Rolls shall be installed.
- B.

Fiber Rolls shall be made of wood shavings, coconut fiber or other similar material encased in heavy duty netting.
- C.

Wooden stakes at 4’-0” on center shall be used to anchor the Fiber Rolls along the contours of the slope.

2.07 AGGREGATE SILT CHECKS

- A.

Where needed to slow flow velocity, to cause ponding or to protect storm water inlet structures, Aggregate Silt Checks shall be installed.
- B.

Aggregate Silt Checks shall consist of rock of various sizes ranging from 2” to 6” contained in or placed on geotextile filter fabric. Pea-stone or gravel-filled bags are acceptable for temporary silt checks in low-flow conditions.

2.08 RIP RAP

- A. Rip Rap shall be installed at the outlets of storm drains and on channel banks as noted on the Contract Drawings and/or recommended by state and local regulatory agencies.
- B. Rip Rap shall have no less than 80%, by volume, of individual stones that range in size from 0.0247 to 1.483 cubic feet.

PART 3 - EXECUTION

3.01 GENERAL

- A. Erosion and sediment control practices shall be consistent with the requirements of the state and local regulatory agencies and in any case shall be adequate to prevent erosion of disturbed and/or regraded areas.
- B. Water lines that cross streams shall be constructed by methods that maintain normal stream flow and allow for a dry excavation. Water pumped from the excavation shall be contained and allowed to settle prior to reentering the stream. Excavation equipment and vehicles shall operate outside of the flowing portion of the stream. Spoil material from the line excavation shall not be allowed to enter the flowing portion of the stream. The provisions of this condition shall apply to all types of utility line stream crossings.

Removal of riparian vegetation in the utility line right-of-way shall be limited to that necessary for equipment access. Effective erosion and sedimentation control measures must be employed at all times during the project to prevent degradation of waters of the Commonwealth. Site regrading and reseeding will be accomplished with 14 days after disturbance.

3.02 TEMPORARY AND PERMANENT STABILIZATION REQUIREMENTS

- A. Temporary Stabilization is required for all disturbed areas where active work is not being performed and shall be coordinated with the General/Grading Contractor on the project. The Contractor shall follow the guidelines contained in the SWPPP for the project and/or as indicated in the table below:

Temporary Stabilization Table

Area requiring temporary stabilization	Time frame to apply erosion controls
Any disturbed areas within 50 feet of a stream and not at final grade	Within two days of the most recent disturbance if the area will remain idle for more than 21 days
For all construction activities, any disturbed areas that will be dormant for more than 21 days but less than one year, and not within 50 feet of a stream	Within seven days of the most recent disturbance within the area
Disturbed areas that will be idle over winter	Prior to the onset of winter weather

- B. Permanent control measures to minimize erosion and sedimentation shall be

accomplished through the stabilization of soil as soon as possible with perennial vegetation. The Contractor shall follow the guidelines for Permanent Stabilization as specified in the table below.

Permanent Stabilization Table

Area requiring permanent stabilization	Time frame to apply erosion controls
Any areas that will lie dormant for one year or more	Within seven days of the most recent disturbance
Any areas within 50 feet of a stream and at final grade	Within two days of reaching final grade
Any other areas at final grade	Within seven days of reaching final grade within that area

If permanent seeding is not practical due to the time of year, the disturbed area shall be seeded immediately with an annual rye grass at a rate of 3 lb. per 1,000 sq. feet and mulched with straw at a rate of 2.5 tons per acre. Mulch shall be anchored at 6 to 12-inch intervals across the slope by crimping into soil.

3.03 SEEDING

- A. This item shall consist of seeding a cover of grass, on areas disturbed as a result of construction.
- B. The seed mixture to be sown shall closely match the existing grass in lawns or shall be as previously specified.
- C. All seed shall be fresh and clean and shall be delivered mixed, in unopened packages, bearing a guaranteed analysis of the seed mixture.
- D. Germination must be certified to conform to the following minimums:

Purity	90%
Germination	85%
- E. Pre-fertilization (if required to establish ground cover) :
 - 1. Just prior to the planting of turf, evenly broadcast fertilizer as previously specified.
- F. Method:
 - 1. This work consists of furnishing all labor, equipment and materials and in performing all operations in connection with the fertilizing and seeding of all the finished graded areas not specified to be sodded or occupied by structures, roads, concrete slabs, sidewalks, walls, etc., and including grassed areas destroyed or

damaged by the Contractor.

2. The areas to be seeded shall be thoroughly tilled by discing, harrowing, or other approved methods until the condition of the soil is acceptable for sowing. After harrowing or discing, the seedbed shall be dragged and/or hand raked to finish grade.
3. Apply fertilizer uniformly over the seed bed, and lightly harrow, rake or otherwise incorporate them into the soil for a depth of approximately 1-inch. Fertilizer shall be as previously specified. The incorporation of the fertilizer may be a part of the tillage operation.
4. Seed shall be broadcast either by hand or approved sowing equipment at the rate of ninety (90) pounds per acre (two pounds per 1,000 square feet), uniformly distributed over the area. Broadcasting seeding during high winds will not be permitted. The seed shall be drilled or raked into a depth of approximately ½ inch and the seeded areas shall be lightly raked to cover the seed and rolled. Drilling seeding shall be done with approved equipment with drills not more than 3 inches apart. All ridges shall be smoothed out, and all furrows and wheel tracks likely to develop into washes, shall be removed.
5. Seed may be sown during the following periods:

February 1 to April 15

August 15 to October 15
6. After the seed has been sown, the areas so seeded shall be mulched with clean straw as previously specified.
7. Areas seeded shall be protected until a uniform stand develops, when it will be accepted and the Contractor relieved of further responsibility for maintenance. Displaced mulch shall be replaced or any damage to the seeded area shall be repaired promptly, both in a manner to cause minimum disturbance to the existing stand of grass. If necessary to obtain a uniform stand, the Contractor shall refertilize, reseed and remulch as needed.
8. The Engineer/Owner shall inspect the seeding within sixty (60) days after planting and determine if it is acceptable. An area is considered acceptable if it is represented by a minimum of 100 seedlings per square foot (uniform over the entire area) of the permanent species of grass representative of the seed mixture. If an acceptable growth is not obtained on the first planting, reseeding and remulching will be required.
9. Payment for seeding and mulching shall be included in the Contractor's bid.

3.04 INSTALLATION OF EROSION AND SEDIMENT CONTROL DEVICES

- A. All erosion and sediment control products and materials shall be installed per manufacturer's recommendations and in accordance with the Kentucky Erosion Prevention and Sediment Control Field Guide.

- B. Contractor shall pay special attention to the trenching-in of the bottoms of silt fence, the staking of sediment barriers, and the stapling of erosion control blankets. Coordinate with the general/grading contractor for the SWPPP requirements.

3.05 MAINTENANCE OF EROSION AND SEDIMENT CONTROL DEVICES

- A. Erosion and sedimentation controls shall be inspected weekly and after rain events of 0.5 inch or greater. Replace silt fencing as needed, filter stone which is dislodged, erosion control blanket which is damaged, and make other necessary repairs.
- B. Remove sediment from fences and barriers when it accumulates to half the height of the barrier, or more often as needed.

3.06 CLEAN UP

- A. Upon completion of the project and/or establishment of satisfactory turf, vegetation or permanent erosion control structures, Contractor shall remove all temporary devices and properly dispose of such.

3.07 KPDES GENERAL PERMIT FOR STORM WATER DISCHARGES FROM CONSTRUCTION ACTIVITIES

All subcontractors are required to comply with the requirements of the Permit and the Stormwater Pollution Prevention Plan (SWPPP).

END OF SECTION

SECTION 02400 - BORING AND JACKING

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Provide all labor, materials, equipment and services required to furnish and install all bored and jacked carrier pipes in encasement pipes under railroad, highway, road, and other paved surfaces as shown on the Drawings and/or specified herein.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Earthwork for Utility Work: Section 02225
- B. Piping: Division 2

1.03 SUBMITTALS

- A. Descriptive literature, catalog cuts, and dimensional prints clearly indicating all dimensions and materials of construction, shall be submitted on all items specified herein to the Engineer for review before ordering.
- B. At the time of submission, the Contractor shall, in writing, call the Engineer's attention to any deviations that the submittals may have from the requirements of the Contract Drawings and Specifications.
- C. Comply with all requirements of Section 01340.

PART 2 - PRODUCTS

2.01 CARRIER PIPE

- A. Carrier pipe shall be restrained joint ductile iron pipe as specified in the applicable Division 2 section, unless otherwise noted.

2.02 CASING PIPE

- A. Casing pipe shall be steel, plain end, have a minimum yield point strength of 35,000 psi and conform to ASTM A 252 Grade 2 or ASTM A 139 Grade B without hydrostatic tests. The casing pipe shall meet the latest approved "Specifications for Pipelines for Carrying Flammable and Non-flammable Substances". The steel pipe shall have welded joints and be in at least 18 foot lengths. The casing pipe exterior shall be coal tar epoxy coated. Field butt welds shall be fully welded the entire circumference of the casing with full weld penetration of the steel. Steel casing pipe shall meet the KTC DOH's Buy American requirements.
- B. The diameter of the casing pipe shall be as shown on the Drawings.
- C. The wall thickness of the casing pipe shall be as shown on the Drawings or a minimum of 0.365 inches if not shown.

2.03 CASING SPACERS

- A. Stainless Steel Casing Spacers: Stainless steel casing spacers shall be bolt-on style with a shell made in two (2) sections of heavy T-304 stainless steel. Connecting flanges shall be ribbed for extra strength. The shell shall be lined with a PVC liner .090" thick with 85-90 durometer. All nuts and bolts are to be 18-8 stainless steel. Runners shall be made of ultra high molecular weight polymer with inherent high abrasion resistance and a low coefficient of friction. Runners shall be supported by risers made of heavy T-304 stainless steel. The supports shall be mig welded to the shell and all welds shall be fully passivated. Stainless steel casing spacers shall be made by Cascade Waterworks Mfg. Co. or approved equal.
- B. Solid Polyethylene Casing Spacers: Solid polyethylene casing spacers shall be bolt-on style with a shell made in two (2) sections. Carrier pipe shall be wrapped with rubber strap inside casing space to prevent slippage. All nuts and bolts are to be 18-8 stainless steel. Solid polyethylene casing spacers shall be made by Calpico Inc., PSI, or approved equal.

2.04 CASING END SEALS

- A. Wrap-around end seals: Wrap-around end seals shall be made of a waterproof flexible coal tar membrane reinforced with fiberglass. The two exposed edges of the wrap-around seal shall be adhesively bonded forming a watertight seal. The ends of the wrap shall be sealed on the casing and carrier pipe by stainless steel bands. Wrap-around end seals shall be made by Calpico Inc. or approved equal.

PART 3 - EXECUTION

3.01 CROSSINGS - GENERAL

- A. Where designated on the drawings, crossings beneath roadways, driveways or other paved surfaces not to be disturbed shall be accomplished by boring and jacking a casing pipe.
- B. Steel casing pipe for crossings shall be bored and/or jacked into place to the elevations shown on the drawings. All joints between lengths shall be solidly butt-welded with a smooth non-obstructing joint inside. The casing pipe shall be installed without bends. The carrier pipe shall be installed after the casing pipe is in place and shall extend a minimum of two (2) feet beyond each end of the casing to facilitate making joint connections. The carrier shall be braced and centered with casing spacers within the casing pipe to preclude possible flotation. Casing spacers shall be installed as shown on the Plans. The height of the supports and runners combined shall be sufficient to keep the carrier pipe at least 0.75" from the casing pipe wall at all times. Spacer skids shall be sized and trimmed to maintain a maximum clearance of 0.5" between the skid and casing pipe.
- C. At each end of the casing pipe, the carrier pipe shall be sealed with casing end seals. The end seals shall extend a minimum of 12 inches in each direction from the end of the casing pipe.

3.02 BORING AND JACKING

- A. The Contractor shall excavate his own pits, as he/she may deem necessary, and will set his/her own line and grade stakes which shall be checked by the Engineer. Permits shall be in the Contractor's hands before any excavating is commenced.
- B. The boring method shall consist of pushing the pipe into the earth with a boring auger rotating within the pipe to remove the spoil.

(BGWS-69)

1. The boring operation shall be progressed on a 24-hour basis without stoppage (except for adding lengths of pipe) until the leading edge of the pipe has reached the receiving pit.
 2. The front of the pipe shall be provided with mechanical arrangements or devices that will positively prevent the auger from leading the pipe so that there will be no unsupported excavation ahead of the pipe.
 3. The auger and cutting head arrangement shall be removable from within the pipe in the event an obstruction is encountered. If the obstruction cannot be removed without excavation in advance of the pipe, the pipe shall be abandoned in place and immediately filled with grout.
 4. The over-cut by the cutting head shall not exceed the outside diameter of the pipe by more than 2 inches. If voids should develop or if the bored hole diameter is greater than the outside diameter of the pipe by more than approximately 1 inch, grouting or other approved methods must be used to fill such voids.
 5. The face of the cutting head shall be arranged to provide a reasonable obstruction to the free flow of soft or poor material.
 6. Contractor's boring arrangement plans and methods must be submitted to, and approved by, the Engineer.
- C. Insurance to be furnished by the Contractor to cover this type of work shall be adequate to meet the requirements of the Railroad and/or State or County Highway Departments. Insurance shall consist of comprehensive general liability and automobile liability insurance.
- D. Before award of the contract, the Contractor shall furnish a statement of his/her experience of such work, or if inexperienced, shall advise the Owner as to whom he/she will sublet the work and give a statement of the experience of the subcontractor, which shall be satisfactory to the Owner.
- E. Disposal of the excavated materials shall be provided by an approved manner.

3.03 CONTRACTOR'S RESPONSIBILITIES

- A. Obtain a copy of the Railroad Crossing Permit and/or Highway Encroachment Permit before beginning construction.
- B. Attend a preconstruction meeting at the construction site with the City Inspector, Railroad Inspector, Highway Inspector, Engineer, and Contractor being present.

END OF SECTION

SECTION 02410 – DIRECTIONAL DRILLING

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Furnish all labor, materials and equipment required to install potable water main, service lines, service line casings, or force main pipe using directional drilling method of installation, all in accordance with the requirements of the Contract Documents. The pipe size, type and length shall be as specified herein and as shown on the Drawings. Work shall include and not be limited to proper installation, testing, restoration of underground utilities and environmental protection and restoration.
- B. The directional drill shall be accomplished by first drilling a pilot hole to design standards, and then enlarging the pilot hole no larger than 1.5 times larger than the outer diameter of the casing pipe, to accommodate the pull back of the pipe through the enlarged hole.
- C. Soil borings, if required for certain subsurface soil conditions, shall be accomplished by the Directional Drilling Contractor as required for the field conditions to insure a proper installation.

1.02 RELATED WORK SPECIFIED ELSEWHERE

Piping: Division 2

1.03 SUBMITTALS

- A. Descriptive literature, catalog cuts, and dimensional prints clearly indicating all dimensions and materials of construction, shall be submitted on all items specified herein to the Engineer for review before ordering.
- B. At the time of submission, the Contractor shall, in writing, call the Engineer's attention to any deviations that the submittals may have from the requirements of the Contract Drawings and Specifications.
- C. Comply with all requirements of Section 01340.

PART 2 - PRODUCTS

2.01 RESTRAINED JOINT PVC PIPE

- A. Restrained joint PVC pipe in sizes 2" through 12" shall meet the requirements of the ASTM D2241 standard with a minimum dimension ratio of SDR17 (Class 250). The pipe shall be joined using couplings with beveled edges, built in sealing gaskets and restraining grooves or shall be integral bell pipe with built in sealing gaskets and restraining grooves. The restraining splines shall be round or square and made from Nylon 101. Couplings shall be beveled on the leading edges to minimize soil friction.

(BGWS-71)

- B. Contractor shall adhere to the pipe manufacturer’s most current calculations regarding tensile load limitations for trenchless application. This calculation shall be part of the required submittal.
- C. Contractor shall adhere to the pipe manufacturers most current calculations regarding deflection and radius of curvature for restrained joint PVC pipe used for trenchless application. This calculation of each bore shall be part of the required submittal prior to work.

Pipe Diameter	Minimum Radius of Curvature	Tightest Permissible Bend % Per 10’
2”	60’	16.8%
3”	90’	11.2%
4”	100’	10.0%
6”	150’	6.7%
8”	200’	5.0%
10”	250’	4.0%
12”	300’	3.3%
16”	450’	2.2%

- D. Restrained joint PVC pipe shall be Certa-Lok Yelomine as manufactured by CertainTeed Corporation or equal.
- E. The Contractor shall furnish and install any transition couplings and/or mechanical restraint system to secure the transition between the restrained joint PVC piping and the standard bell joint PVC piping.

2.02 HIGH DENSITY POLYETHYLENE PIPE

- A. General: High density polyethylene pipe shall be "Driscopipe" as manufactured by Phillips Product Company, Inc., PLEXCO as manufactured by Chevron, POLYPIPE, or Engineer approved equivalent.
- B. Materials for Polyethylene Pipe:
 - 1. The polyethylene pipe and fittings shall be made of polyethylene resins classified in ASTM D 1248 as Type III, Category 5, Grade P34 (pipe designation PE 3408 defined per ASTM D 3035), having specific base resin densities of 0.941 g/cc minimum and 0.955 g/cc maximum respectively; and having melt index less than 0.15 grams/10 min.
 - 2. Pipe made from these resins must have a long-term strength rating of 1,600 psi or more.
 - 3. The polyethylene resin shall contain antioxidants and shall be stabilized with carbon black against ultra-violet degradation to provide protection during processing and subsequent weather exposure.
 - 4. The polyethylene resin compound shall have a resistance to environmental stress cracking as determined by the procedure detailed in ASTM D 1693, Condition B with sample preparation by procedure C of not less than 200 hours.

(BGWS-72)

5. Polyethylene shall have cell classification of 345434C as defined by ASTM 3350-84.

C. Polyethylene Pipe and Fittings:

1. The pipe shall be designed for a normal internal working pressure and earth cover over top of the pipe to suit the conditions of proposed use.
2. Each length of pipe shall be marked, at no more than 10-foot intervals, with the following information:

Nominal Pipe Size

Type Plastic Material - PE3408

Pipe Pressure Rating

Manufacturer's Name, Trademark and Code

3. All pipe shall be made from virgin material. No rework compound.
4. Pipe shall be homogenous throughout, and be free of visible cracks, holes, foreign material, blisters, or other deleterious faults.

D. Pipe Jointing:

1. Pipe to be joined by leak proof, thermal, butt fusion joints. All fusion joints must be done by personnel trained by the pipe supplier using tools approved by the pipe supplier.
2. The fusion machine shall have hydraulic pressure control for fusing 2 pipe ends together; it shall include pressure fusion indicating gauges to correctly monitor fusion pressures. The machines correctly monitor fusion pressures. The machines shall be equipped with an electric or gasoline engine powered facing unit to trim irregularities from the pipe ends. The heating plate on the fusion machine shall be electrically heated and thermostatically controlled and shall contain a temperature gauge for monitoring temperature.
3. Joint strength must be equal to that of adjacent pipe as demonstrated by tensile test. In addition, results of tensile impact testing of joint should indicate a ductile rather than a brittle fracture. External appearance of fusion bead should be smooth without significant juncture groove.
4. Threaded or solvent cement joints and connections are not permitted.

E. Tools and Procedures:

1. Fusion jointing and other procedures necessary for correct assembly of the polyethylene pipe and fittings will be done only by personnel trained in those skills by the pipe supplier.

(BGWS-73)

2. Only those tools designed for aforementioned procedures and approved by the pipe supplier shall be used for assembly of pipe and fittings to insure proper installation.

F. Standard Dimension Ratio (SDR) for Pipe:

All HDPE pipe for service casing directional drilling applications shall be ductile iron pipe size, minimum SDR 13.5.

2.03 DIRECTIONAL DRILLING OPERATIONS

A. Quality Assurance

1. All directional drilling operations shall be accomplished by a qualified directional drilling CONTRACTOR with at least two (2) years experience involving work of a similar nature to the work required for this project.
2. Notify ENGINEER and OWNER a minimum of three (3) days in advance of the start of work.
3. All work shall be performed in the presence of the OWNER or ENGINEER.

B. Directional Drilling Equipment Requirements

1. General: The directional drilling equipment shall consist of a directional drilling rig of sufficient capacity to perform the bore and pull back the pipe, a drilling fluid mixing, delivery and recovery system of sufficient capacity to successfully complete the installation, a drilling fluid recycling system to remove solids from the drilling fluid so that the fluid can be reused (if required), a magnetic guidance system or walk-over system to accurately guide boring operations, a vacuum truck of sufficient capacity to handle the drilling fluid volume, and trained and competent personnel to operate the system. All equipment shall be in good, safe condition with sufficient supplies, materials and spare parts on hand to maintain the system in good working order for the duration of this project.
2. Drilling Rig: The directional drilling machine shall consist of a hydraulically powered system to rotate and push hollow drilling pipe into the ground at a variable angle while delivering a pressurized fluid mixture to a guidable drill (bore) head. The machine shall be anchored to the ground to withstand the pulling, pushing and rotating pressure required to complete the installation. The hydraulic power system shall be self-contained with sufficient pressure and volume to power drilling operations. Hydraulic system shall be free of leaks. Rig shall have a system to monitor and record maximum pull-back pressure during pull-back operations. There shall be a system to detect electrical current from the drill string and an audible alarm, which automatically sounds when a electrical current is detected.

3. Drill Head: The drill head shall be steerable by changing its rotation, and shall provide necessary cutting surfaces and drilling fluid jets.
4. Mud Motors (if required): Mud motors shall be of adequate power to turn the required drilling tools.
5. Drill Pipe: Shall be constructed of high quality 4130 seamless tubing, grade D or better, with threaded box and pins. Tools joints should be hardened to 32-36 RC.

C. Guidance System

1. General: An electronic walkover tracking system or a Magnetic Guidance System (MGS) probe or proven gyroscopic probe and interface shall be used to provide a continuous and accurate determination of the location of the drill head during the drilling operation. The guidance shall be capable of tracking at all depths up to fifty feet and in any soil condition, including hard rock. It shall enable the driller to guide the drill head by providing immediate information on the tool face, azimuth (horizontal direction), and inclination (vertical direction). The guidance system shall be accurate and calibrated to manufacturer's specifications of the vertical depth of the borehole at sensing position at depths up to fifty feet and accurate to 2-feet horizontally.
2. Components: The CONTRACTOR shall supply all components and materials to install, operate, and maintain the guidance system.
3. The guidance system shall be of a proven type and shall be set up and operated by personnel trained and experienced with the system. The operator shall be aware of any geo-magnetic anomalies and shall consider such influences in the operation of the guidance system.

D. Drilling Fluid (Mud) System

1. Mixing System: A self-contained, closed, drilling fluid mixing system shall be of sufficient size to mix and deliver drilling fluid composed of bentonite clay, potable water, and appropriate additives. Mixing system shall be able to molecularly shear individual bentonite particles from the dry powder to avoid clumping and ensure thorough mixing. Mixing system shall continually agitate the drilling fluid during drilling operations.

2. Drilling Fluids: Drilling fluid shall be composed of clean water and bentonite clay. No additional material may be used in drilling fluid without prior approval from ENGINEER.

The viscosities of the drilling fluids may be varied to best fit the soil conditions encountered as determined by the operator.

3. Delivery System: The mud pumping system shall have a minimum capacity of 35-500 GPM and the capability of delivering the drilling fluid at a constant minimum pressure of 1200 psi. The delivery system shall have filters in-line to prevent solids from being pumped into drill

(BGWS-75)

pipe. Used drilling fluid and drilling fluid spilled during operations shall be contained and conveyed to the drilling fluid recycling system or shall be removed by vacuum trucks or other methods acceptable to the ENGINEER. A berm, minimum of 12-inches high, shall be maintained around drill rigs drilling fluid mixing system, entry and exit pits and drilling fluid recycling system to prevent spills into the surrounding environment. Pumps and or vacuum truck(s) of sufficient size shall be in place to convey drilling fluid from containment areas to storage and recycling facilities for disposal. No discharge into a stream or ditch shall be allowed.

E. Other Equipment

1. Pipe Rollers: Pipe rollers shall be used for pipe assembly during final product pull back.
2. Restrictions: Other devices or utility placement systems for providing horizontal thrust other than those previously defined in the preceding sections shall not be used unless approved by the ENGINEER prior to commencement of the work. Consideration for approval will be made on an individual basis for each specified location. The proposed device or system shall maintain line and grade within the tolerances prescribed by the particular conditions of the project.

F. Personnel Requirements

1. All personnel shall be fully trained in their respective duties as part of the directional drilling crew and in safety. Each person must have at least two years directional drilling experience.
2. A competent and experienced supervisor representing the CONTRACTOR and Drilling Subcontractor shall be present at all times during the actual drilling operations. A responsible representative who is thoroughly familiar with the equipment and type of work to be performed must be in direct charge and control of the operation at all times. In all cases, the supervisor must be continually present at the job site during the actual Directional Bore operation. The CONTRACTOR and Subcontractor shall have a sufficient number of competent workers on the job at all times to insure the Directional Bore is made in a timely and satisfactory manner.

PART 3 - EXECUTION

3.01 GENERAL REQUIREMENTS

- A. The ENGINEER must be notified 3 days in advance of starting work. The Directional Bore shall not begin until the ENGINEER is present at the job site and agrees that proper preparations for the operation have been made. The ENGINEER'S approval for beginning the installation shall in no way relieve the CONTRACTOR of the ultimate responsibility for the satisfactory completion of the work as authorized under the Contract.

- B. All equipment used by the CONTRACTOR on Owner's property and rights-of-way may be inspected by the OWNER or the Owner's Representatives and shall not be used if considered unsatisfactory by OWNER or Owner's Representatives.
- C. The Contractor shall be fully responsible for all damages arising from his failure to comply with the regulations and the requirements of these Specifications.

3.02 DIRECTIONAL DRILLING OPERATION

- A. The CONTRACTOR shall provide all material, equipment, and facilities required for directional drilling. Proper alignment and elevation of the bore hole shall be consistently maintained throughout the directional drilling operation. The method used to complete the directional drill shall conform to the requirements of all applicable permits.
- B. The entire drill path shall be accurately surveyed with entry and exit stakes placed in the appropriate locations within the areas indicated on drawings. If CONTRACTOR is using a magnetic guidance system, drill path will be surveyed for any surface geo-magnetic variations or anomalies.
- C. CONTRACTOR shall place silt fence between all drilling operations and any drainage, well-fields, wetland, waterway or other area appropriate for such protection. Additional environmental protection necessary to contain any hydraulic or drilling fluid spills shall be put in place, including berms, liners, turbidity curtains and other measures. CONTRACTOR shall adhere to all applicable environmental regulations. Fuel may not be stored in bulk containers within 200 feet of any water body or wetland.
- D. Readings shall be recorded after advancement of each successive drill pipe (no more than 10') and the readings plotted on a scaled drawing, both vertical and horizontal. Access to all recorded readings and plan and profile information shall be made available to the ENGINEER, or his representative, at all times. At no time shall the deflection radius of the drill pipe exceed the deflection limits of the carrier pipe as specified herein.
- E. A complete list of all drilling fluid additives and mixtures to be used in the directional operation shall be submitted to the ENGINEER, along with their respective Material Safety Data Sheets. All drilling fluids and loose cuttings shall be contained in pits or holding tanks for recycling or disposal, no fluids shall be allowed to enter any unapproved areas or natural waterways. Upon completion of the directional drill project, the drilling mud and cuttings shall be disposed of by the CONTRACTOR at an approved site.
- F. The pilot hole shall be drilled on bore path with no deviations greater than 5% of depth over a length of 100-feet. In the event that pilot does deviate from the bore path more than 2-feet of depth in 100-feet, CONTRACTOR will notify ENGINEER and ENGINEER may require CONTRACTOR to pull-back and re-drill from the location along bore path before the deviation. In the event that a drilling fluid fracture, inadvertent returns or returns loss occurs during pilot hole drilling operations, CONTRACTOR shall cease drilling, wait at least 30 minutes, inject a quantity of drilling fluid with a viscosity exceeding 120 seconds as measured by a Marsh funnel and wait another 30 minutes. If mud fracture or returns loss continues, CONTRACTOR shall discuss additional options with the Engineer and work shall then proceed accordingly.

- G. Upon completion of pilot hole phase of the operation, a complete set of “as-built” records shall be submitted in duplicate to the Engineer. These records shall include copies of the plan and profile drawing, as well as directional survey reports as recorded during the drilling operation.
- H. Upon approval of the pilot hole location, the hole opening or enlarging phase of the installation shall begin. The bore hole diameter shall be increased to accommodate the pullback operation of the required size of pipe. The type of hole opener or back reamer to be utilized in this phase shall be determined by the types of subsurface soil conditions that have been encountered during the pilot hole drilling operation. The reamer type shall be at the CONTRACTOR’S discretion with the final hole opening being a maximum of 1.5 times larger than the outside diameter of the pipe to be installed in the bore hole.
- I. The open bore hole may be stabilized by means of bentonite drilling slurry pumped through the inside diameter of the drill rod and through openings in the reamer. The drilling slurry must be in a homogenous / flowable state serving as an agent to carry the loose cuttings to the surface through the annulus of the borehole. The volume of bentonite mud required for each pullback shall be calculated based on soil conditions, largest diameter of the pipe couplings, capacity of the bentonite mud pump, and the speed of pullback as recommended by the bentonite drilling fluid manufacture. The bentonite slurry is to be contained at the exit or entry side of the directional bore in pits or holding tanks. The slurry may be recycled at this time for reuse in the hole opening operation or shall be hauled by the CONTRACTOR to an approved dump site for proper disposal.
- J. The pipe shall be joined together according to manufacturer’s specifications. The ends of pipe must be inspected and cleaned with a wet cloth prior to each joint assembly so they are free of any dirt or sand. The ends of pipe must be free of any chips, scratches, or scrapes before pipe is assembled. A pulling eye will be attached to pulling head on the lead stick of pipe, which in turn shall be attached to a swivel on the end of the drill pipe. The procedure shall allow for a straight, smooth pull of the product pipe as it enters and passes through the borehole toward the drill rig and original entrance hole of the directional bore. The product pipe shall be elevated to the approximate angle of entry and supported by means of a side boom with roller arm, or similar equipment, to allow for the “free stress” situation as the pipe is pulled into the exit hole toward the drill rig. The product pullback phase of the directional operation shall be carried out in a continuous manner until the pipe reaches the original entry side of the bore.

3.03 PIPE HANDLING

- A. Care shall be taken during transportation of the pipe such that it will not be cut, kinked or otherwise damaged.
- B. Ropes, fabrics or rubber protected slings and straps shall be used when handling pipes. Chains, cables or hooks inserted into the pipe ends shall not be used. Two slings spread apart shall be used for lifting each length of pipe. Pipe or fittings shall not be dropped into rocky or unprepared ground.
- C. Pipes shall be stored on level ground, preferably turf or sand, free of sharp objects, which could damage the pipe. Where necessary due to ground

conditions, the pipe shall be stored on wooden sleepers, spaced suitably and of such width as not to allow deformation of the pipe at the point of contact with the sleeper or between supports.

- D. The handling of the joined pipeline shall be in such a manner that the pipe is not damaged by dragging it over sharp and cutting objects. Slings for handling the pipeline shall not be positioned at pipe joints. Sections of the pipes with deep cuts and gouges shall be removed and the ends of the pipeline rejoined.

3.04 TESTING PIPE

- A. Cleaning and flushing shall be accomplished by the CONTRACTOR in accordance with the requirements of the contract.
- B. Directional drilling pipe shall be tested by CONTRACTOR after pullback. The average pressure shall be maintained at 200 psi for two hours. The test pump and water supply shall be arranged to allow accurate measurements of the water required to maintain the test pressure. Any material showing seepage or the slightest leakage shall be replaced as directed by the OWNER at no additional expense to the OWNER. Note: Pressure testing will not be required for pipe used as casing for service lines.
- C. The manufacturer's recommendations on bend radius and tensile strength shall be observed.
- D. Pipeline shall be tested end to end.

3.05 SITE RESTORATION

- A. Following drilling operations, CONTRACTOR shall de-mobilize equipment and restore the work site to the original conditions or better. All excavations shall be backfilled and compacted according to the specifications.
- B. Surface restoration shall be completed in accordance with the requirements of the contract, to a condition as good as or better than existed prior to construction.

3.06 RECORD KEEPING AND AS-BUILTS

CONTRACTOR shall maintain a daily project log of drilling operations and a guidance system log with a copy given to the ENGINEER at completion of project.

END OF SECTION

SECTION 02510 - WATER DISTRIBUTION PIPING

PART 1 - GENERAL

1.01 SCOPE OF WORK

Provide all labor, materials, equipment and services required for furnishing and installing all piping and appurtenances specified herein.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Valves - Utility Services: Section 02515
- B. Hydrants: Section 02517

1.03 SUBMITTALS

- A. A notarized certification shall be furnished for all pipe and fittings that verifies compliance with all applicable specifications.
- B. The requirement for this certification does not eliminate the need for shop drawings submittals in compliance with Section 01340.

1.04 EXISTING CONDITIONS

- A. The existing piping shown on the Contract Drawings is based on the best available information. The Engineer makes no guarantee as to the accuracy of the locations or type of piping depicted. All new piping, which ties into existing lines, must be made compatible with that piping and be rated for working pressure experienced.
- B. So that piping conflicts may be avoided, Contractor shall open up his trench well ahead of the pipe laying operation to confirm exact locations of existing piping before installing any new piping.
- C. Contractor shall provide all fittings and adapters necessary to complete all connections to existing piping.

1.05 UTILITY LINE ACTIVITIES COVERED UNDER NATIONWIDE PERMIT # 12

- A. All activities involving utility line construction covered under the US Army Corps of Engineers NATIONWIDE PERMIT # 12 shall meet the following conditions:
 - 1. Utility Line Activities. Activities required for the construction, maintenance, repair, and removal of utility lines and associated facilities in waters of the United States, provided the activity does not result in the loss of greater than 1/2-acre of waters of the United States for each single and complete project. Utility lines: This NWP authorizes the construction, maintenance, or repair of utility lines, including outfall and intake structures, and the associated excavation, backfill, or bedding for the utility lines, in all waters of the United States, provided there is no change in pre-construction contours. This NWP also authorizes temporary structures, fills, and work necessary to conduct the utility line activity.
 - 2. Appropriate measures must be taken to maintain normal downstream flows and minimize flooding to the maximum extent practicable, when temporary structures, work, and discharges, including cofferdams, are necessary for construction activities, access fills, or dewatering of construction sites. Temporary fills must

(BGWS-80)

consist of materials, and be placed in a manner, that will not be eroded by expected high flows. Temporary fills must be removed in their entirety and the affected areas returned to pre-construction elevations. The areas affected by temporary fills must be revegetated, as appropriate.

3. Notification: The permittee must submit a pre-construction notification to the US Army Corps district engineer prior to commencing the activity if any of the following criteria are met: (1) The activity involves mechanized land clearing in a forested wetland for the utility line right-of-way; (2) a section 10 permit is required; (3) the utility line in waters of the United States, excluding overhead lines, exceeds 500 feet; (4) the utility line is placed within a jurisdictional area (i.e., water of the United States), and it runs parallel to or along a stream bed that is within that jurisdictional area; (5) discharges that result in the loss of greater than 1/10-acre of waters of the United States; (6) permanent access roads are constructed above grade in waters of the United States for a distance of more than 500 feet; or (7) permanent access roads are constructed in waters of the United States with impervious materials.

- B. All activities involving utility line construction covered under KENTUCKY GENERAL CERTIFICATION of Nationwide Permit # 12 shall meet the following conditions:

The general Water Quality Certification applies to surface waters of the Commonwealth as defined in 401KAR10:001 Chapter 10, Section 1(80): Surface waters means those waters having well-defined banks and beds, either constantly or intermittently flowing, lakes and impounded waters; marshes and wetlands; and any subterranean waters flowing in well-defined channels and having a demonstrable hydrologic connection with the surface.

1. The activity will not occur within surface waters of the Commonwealth identified by the Kentucky Division of Water as Outstanding State or National Resource Water, Cold Water Aquatic Habitat, or Exceptional Waters.
2. The activity will not occur within surface waters of the Commonwealth identified as perpetually-protected (e.g. deed restriction, conservation easement) mitigation sites.
3. This general water quality certification does not authorize the installation of utility lines in a linear manner within the stream channel or below the top of the stream bank.
4. For a single crossing, impacts from the construction and maintenance corridor in surface waters shall not exceed 50 feet of bank disturbance.
5. This general certification shall not apply to nationwide permits issued for individual crossings which are part of a larger utility line project where the total cumulative impacts from a single and complete linear project exceed ½ acre of wetlands or 300 linear feet of surface waters. Cumulative impacts include utility line crossings, permanent or temporary access roads, headwalls, associated bank stabilization areas, substations, pole or tower foundations, maintenance corridor, and staging areas.
6. Stream impacts under Conditions 4 and 5 of this certification are defined as the length of bank disturbed. For the utility line crossing and roads, only one bank length is used in calculation of the totals.
7. Stream impacts covered under this General Water Quality Certification and undertaken by those persons defined as an agricultural operation under the Agricultural Water Quality Act must be completed in compliance with the Kentucky Agricultural Water Quality Plan (KWQP).

(BGWS-81)

8. The Kentucky Division of Water may require submission of a formal application for an individual certification for any project if the project has been determined to likely have a significant adverse effect upon water quality or degrade the waters of the Commonwealth so that existing uses of the water body or downstream waters are precluded.
9. Activities that do not meet the conditions of this General Water Quality Certification require an Individual Section 401 Water Quality Certification.
10. Blasting of stream channels, even under dry conditions, is not allowed under this general water quality certification.
11. Utility lines placed parallel to the stream shall be located at least 50 feet from an intermittent or perennial stream, measured from the top of the stream bank. The cabinet may allow construction within the 50 foot buffer if avoidance and minimization efforts are shown and adequate methods are utilized to prevent soil from entering the stream.
12. Utility line stream crossings shall be constructed by methods that maintain flow and allow for a dry excavation. Water pumped from the excavation shall be contained and allowed to settle prior to re-entering the stream. Excavation equipment and vehicles shall operate outside of the flowing portion of the stream. Spoil material from the excavation shall not be allowed to enter the flowing portion of the stream.
13. The activities shall not result in any permanent changes in pre-construction elevation contours in surface waters or wetlands or stream dimension, pattern or profile.
14. Utility line activities which impact wetlands shall not result in conversion of the area to non-wetland status. Mechanized land clearing of forested wetlands for the installation or maintenance of utility lines is not authorized under this certification.
15. Activities qualifying for coverage under this General Water Quality Certification are subject to the following conditions:

Erosion and sedimentation pollution control plans and Best Management Practices must be designed, installed, and maintained in effective operating condition at all times during construction activities so that violations of state water quality standards do not occur.

Sediment and erosion control measures, such as check-dams constructed of any material, silt fencing, hay bales, etc., shall not be placed within surface waters of the Commonwealth, either temporarily or permanently, without prior approval by the Kentucky Division of Water's Water Quality Certification Section. If placement of sediment and erosion control measures in surface waters is unavoidable, design and placement of temporary erosion control measures shall not be conducted in such a manner that may result in instability of streams that are adjacent to, upstream, or downstream of the structures. All sediment and erosion control devices shall be removed and the natural grade restored within the completion timeline of the activities.

Measures shall be taken to prevent or control spills of fuels, lubricants, or other toxic materials used in construction from entering the watercourse.

Removal of riparian vegetation shall be limited to that necessary for equipment access.

(BGWS-82)

To the maximum extent practicable, all in-stream work under this certification shall be performed under low-flow conditions.

Heavy equipment, e.g. bulldozers, backhoes, draglines, etc., if required for this project, should not be used or operated within the stream channel. In those instances in which such in-stream work is unavoidable, then it shall be performed in such a manner and duration as to minimize turbidity and disturbance to substrates and bank or riparian vegetation.

Any fill shall be of such composition that it will not adversely affect the biological, chemical, or physical properties of the receiving waters and/or cause violations of water quality standards. If rip-rap is utilized, it should be of such weight and size that bank stress or slump conditions will not be created because of its placement.

If there are water supply intakes located downstream that may be affected by increased turbidity and suspended solids, the permittee shall notify the operator when such work will be done.

Should evidence of stream pollution or jurisdictional wetland impairment and/or violations of water quality standards occur as a result of this activity (either from a spill or other forms of water pollution), the Kentucky Division of Water shall be notified immediately by calling (800) 928-2380.

16. Non-compliance with the conditions of this general certification or violation of Kentucky state water quality standards may result in civil penalties.

1.06 CONSTRUCTION IN A FLOODPLAIN

- A. No material shall be placed in the stream or in the flood plain to form construction pads, coffer dams, access roads, etc. unless prior approval has been obtained from the Environmental and Public Protection Cabinet.
- B. The trench shall be backfilled as closely as possible to the original contour. All excess material from construction of the trench shall be disposed of outside the flood plain unless the applicant has received prior approval from the Cabinet to fill within the flood plain.

PART 2 - PRODUCTS

2.01 DUCTILE IRON PIPE AND FITTINGS

- A. Ductile iron pipe shall conform to ANSI/AWWA C151/A21.51, latest revision, with push-on joints incorporating a single molded gasket unless otherwise noted on Drawings. Pipe sizes 3-inch through 12-inch shall be pressure class 350 and sizes 14-inch and larger shall be pressure class 350, unless otherwise noted. Pipe shall be manufactured in the USA and be certified to meet the AIS requirements.
- B. The interior of the pipe shall be cement-mortar lined with seal coat in accordance with ANSI/AWWA C104/A21.4, latest revision. Thickness of the lining shall be as set forth in the ANSI/AWWA C104/A21.4 specification unless otherwise directed by the Engineer. The exterior of all pipe, unless otherwise specified, shall receive either coal tar or asphalt base coating a minimum of 1 mil thick. Interior lining system shall be NSF approved.

(BGWS-83)

- C. Each piece of pipe shall bear the manufacturer's name or trademark, the year in which it was produced and the letters "DI" or the word "DUCTILE". Pipe manufacturer shall furnish notarized certificate of compliance to the above AWWA or ANSI specifications.
- D. Fittings shall be ductile iron and have mechanical-joints or push-on joints in accordance with ANSI/AWWA C110/A21.10, latest revision, unless otherwise specified. Fittings shall be rated for a minimum of 250 psi working pressure. Fittings shall conform to the details and dimensions shown therein. Fittings shall have interior cement-mortar lining as specified hereinbefore for the pipe. Compact ductile iron fittings meeting the requirements of ANSI/AWWA C153/A21.53, latest revision, will also be acceptable. Each fitting shall be certified by the manufacturer to have been tested and to have met the requirements of the governing standard specifications. All fittings shall be installed with Megalug type restraining glands compatible with the pipe being furnished. Fittings and restraint glands shall be certified to meet the AIS requirements. All fittings and glands shall be certified to meet the KDOH's AIS requirements.
- E. Joints for ductile iron pipe and fittings, as described hereinbefore, shall be rubber-gasket joints and be in accordance with ANSI/AWWA C111/A21.11, latest revision. Joints shall have the same pressure rating as the pipe or fitting of which they are a part. Joints shall be installed per the manufacturer's recommendations.
- F. Provide ANSI/AWWA C110/A21.10 mechanical joint plugs and locked or restrained pipe joints where indicated on Drawings. Fittings under structures shall be mechanical joint with retainer glands, unless indicated otherwise.

2.02 RESTRAINED JOINT DUCTILE IRON PIPE

- A. Restrained joint ductile iron pipe shall conform to ANSI/AWWA C151/A21.51, latest revision, with locking gasket type push-on joints unless otherwise noted on Drawings. Pipe size 3-inch through 12-inch shall be pressure class 350 and sizes 14-inch and larger shall be pressure class 350, unless otherwise noted.
- B. The interior of the pipe shall be cement-mortar lined with seal coat in accordance with ANSI/AWWA C104/A21.4, latest revision. Thickness of the lining shall be set forth in the aforementioned specification unless otherwise directed by the Engineer. The exterior of all pipe, unless otherwise specified, shall receive either coal tar or asphalt base coating a minimum of 1 mil thick. Interior lining system shall be NSF approved.
- C. Each piece of pipe shall bear the manufacturer's name or trademark, the year in which it was produced and the letters "DI" or the word "DUCTILE". Pipe manufacturer shall furnish notarized certificate of compliance to the above AWWA or ANSI specifications. Pipe shall be certified to meet the AIS requirements.
- D. Fittings shall be ductile iron and have locking gasket type push-on joints in accordance with ANSI/AWWA C110/A21.10, latest revision with the exception of the manufacturer's proprietary design dimensions. Fittings shall be rated for a minimum of 250-psi working pressure. Fittings shall have interior cement-mortar lining as specified hereinbefore for the pipe. Compact ductile iron fittings meeting the requirements of ANSI/AWWA C153/A21.53, latest revision, will also be acceptable. Each fitting shall be certified by the manufacturer to have been tested and to have met the requirements of the governing standard specifications and shall be certified to meet the AIS requirements.
- E. Joints for ductile iron pipe and fittings, as described hereinbefore, shall be rubber-gasket joints and be in accordance with ANSI/AWWA C111/A21.11, latest revision. Joints shall have a working pressure rating of 250 psi minimum. Joints shall be installed per the manufacturer's recommendations.

(BGWS-84)

- F. Fittings shown on the Plans are intended to convey the general configuration but the Contractor shall furnish all fittings required. When fittings are used, refer to the table on the Plans for associated required restrained joint lengths. Pipe at ends left for future connections shall also have restrained push-on joints.
- G. Restrained joint pipe and fittings shall be Fast-Grip Restrained Joint as manufactured by American Ductile Iron Pipe or approved equal. Restrained joint pipe and fittings shall be designed for a working pressure of at least 250 psi.
- H. Restrained push-on joint pipe and fittings shall be capable of being deflected after assembly.
- I. Where spigot end of restrained joint pipe connects with valves or other items that have mechanical-joint ends, connection shall be made with a restrained mechanical-joint gland. Restrained mechanical-joint connection shall be as specified in this Section of the Specifications.

2.03 POLYVINYL CHLORIDE PLASTIC (PVC) PIPE

- A. ASTM D2241 (Outside Diameter compatible with Iron Pipe O.D.)
 - 1. 1-inch through 16-inch - PVC plastic pipe shall conform to ASTM Specification - D2241 (latest edition); Product Standards PS-22-70 NBS; Standard Dimension Ratio SDR 21 (200 psi) or SDR 17 (250 psi); Maximum Length - 20 feet; Pressure Rating - 200 psi at 73.4° F. (SDR-21) or 250 psi (SDR 17). Elastomeric gasket shall conform with the requirements of ASTM F-477. The seal of the National Sanitation Foundation Testing Laboratory must appear on each pipe.
 - a. Fittings, adaptors or specials shall be furnished, as required, to connect the plastic pipe to the cast or ductile iron mechanical joint valves, fittings, and pipe.
- B. Fittings for PVC Pipe shall be mechanical joint ductile iron and be designed for a working pressure of 250 psi. The fittings shall conform to the latest revision of ANSI Specification A21.10, latest revision. Compact ductile iron fittings meeting the requirements of ANSI/AWWA C153/A21.53, latest revision, will also be acceptable. All fittings shall be installed with Megalug type restraining glands compatible with the pipe being furnished. All fittings and glands shall be certified to meet the KDOH's AIS requirements.
- C. The basis of acceptance of PVC plastic water main pipe will be a written, notarized certification, accompanied by a copy of test results, that the pipe and pipe material has been sampled, tested and inspected in accordance with the designated standard specifications. These certifications shall be obtained from the manufacturer and delivered to the Engineer's or Owner's representative on the project site. A sufficient number of tests and certifications shall be made so as to be representative of the complete project. Copies of the test results shall be kept on file by the manufacturer and shall be available for review by the Engineer or Owner upon request.
- D. Pipe shall be visually inspected on the project site for proper markings which shall include manufacturer's name or trademark, nominal pipe size, pressure rating for water at 73.4 degrees F., plastic pipe material designation code (e.g. PVC 1120), dimension ratio, AWWA or ASTM designation and pressure class with which the pipe complies, and the National Sanitation Foundation NSF 14 Seal of Approval for drinking water.

(BGWS-85)

2.04 **RESTRAINED JOINT PVC PIPE**

- A. Restrained joint PVC pipe in sizes 2” through 12” shall meet the requirements of the ASTM D2241 standard with a minimum dimension ratio of SDR17. The pipe shall be joined using couplings with beveled edges, built in sealing gaskets and restraining grooves or shall be integral bell pipe with built in sealing gaskets and restraining grooves. The restraining splines shall be round or square and made from Nylon 101. Couplings shall be beveled on the leading edges to minimize soil friction.
- B. Contractor shall adhere to the pipe manufacturer’s most current calculations regarding tensile load limitations for trenchless application. This calculation shall be part of the required submittal.
- C. Contractor shall adhere to the pipe manufacturers most current calculations regarding deflection and radius of curvature for restrained joint PVC pipe used for trenchless application. This calculation of each bore shall be part of the required submittal prior to work.

Pipe Diameter	Minimum Radius of Curvature	Tightest Permissible Bend % Per 10’
2”	60’	16.8%
3”	90’	11.2%
4”	100’	10.0%
6”	150’	6.7%
8”	200’	5.0%
10”	250’	4.0%
12”	300’	3.3%
16”	450’	2.2%

- D. Restrained joint PVC pipe shall be Certa-Lok Yelomine as manufactured by CertainTeed Corporation or equal.
- E. The Contractor shall furnish and install any transition couplings and/or mechanical restraint system to secure the transition between the restrained joint PVC piping and the standard bell joint PVC piping.

2.05 **COUPLING AND ADAPTORS**

- A. Flexible couplings shall be of the sleeve type with a middle ring, two wedge shaped resilient gaskets at each end, two follower rings, and a set of steel trackhead bolts. The middle ring shall be flared at each end to receive the wedge portion of the gaskets. The follower rings shall confine the outer ends of the gaskets, and tightening of the bolts shall cause the follower rings to compress the gaskets against the pipe surface, forming a leak-proof seal. Flexible couplings shall be steel with minimum wall thickness of the middle ring or sleeve installed on pipe being 5/16-inch for pipe smaller than 10 inches, 3/8-inch for pipe 10 inches or larger. The minimum length of the middle ring shall be 5-inches for pipe sizes up to 10 inches and 7 inches for pipe 10 inches to 30 inches. The pipe stop shall be removed. Gaskets shall be suitable for 250 psi working pressure rating or at rated working pressure of the connecting pipe. Couplings shall be harnessed and be designed for 250 psi working pressure.

2.06 **CONCRETE PIPE ANCHORS, THRUST BLOCKS, CRADLE OR ENCASEMENT**

- A. Unless otherwise indicated on the Drawings or directed by the Engineer, concrete pipe anchors, thrust blocks, cradles or encasements shall be installed at all pipe fittings, valves, etc.

(BGWS-86)

- B. Concrete used for anchors, thrust blocks, cradle or encasement shall be Class "B" and have a minimum 28-day compressive strength of 3000 psi.

2.07 CONNECTION OF NEW WATER MAINS TO EXISTING SYSTEM

- A. The Contractor shall connect the new water main to existing water main where shown on the Drawings or directed by the Engineer, and shall furnish all necessary equipment and materials required to complete the connection. Connections shall be made and restrained to accept a 200 psi working pressure.

2.08 MECHANICAL JOINT RESTRAINT

- A. Mechanical joint restraint shall be furnished and installed where shown on the Plans. The restraining mechanism shall consist of individually actuated wedges that increase their resistance to pull-out as pressure or external forces increase. The device shall be capable of full mechanical joint deflection during assembly and the flexibility of the joint shall be maintained after burial. The joint restraint ring and its wedging components shall be made of grade 60-42-10 ductile iron conforming to ASTM A536 latest revision. The wedges shall be ductile iron heat-treated to a minimum hardness of 370 BHN. Dimensions of the gland shall be such that it can be used with the standardized mechanical joint bell conforming to ANSI/AWWA C111/A21.11 and ANSI/AWWA C153/A21.53 of the latest revision. Torque limiting twist-off nuts shall be used to insure proper actuation of the restraining wedges. The mechanical joint restraint shall be rated for a minimum working pressure of 250 psi.
- B. The mechanical joint restraint shall be compatible with the pipe being installed. The restraint glands shall be certified to meet the AIS requirements.

2.09 LOCATOR WIRE

- A. All water lines shall be laid with No. 12 coated copper wire. The wire shall have a minimum cover as specified for the bottom of the pipe and be laid approximately 6" to the right side of the pipe (as facing away from the water supply source). Wire shall be continuous with ends connected to metal valve boxes or concrete rings (with connectors), etc. Waterproof connectors shall be used where splices and connections are required/installed. The wire shall be laid in a manner to prevent allowing it to touch the water pipe.
- B. After completion of the line installation, the Contractor shall test the locator wire to confirm continuity of the installation. The Owner will utilize their locator equipment and will witness the test along with the Contractor.

PART 3 - EXECUTION

3.01 EXCAVATION FOR PIPELINE TRENCHES

- A. Unless otherwise indicated by the Drawings, trenches in which pipes are to be laid shall be excavated in open cut to the depths required by field conditions or as specified by the Engineer. In general, this shall be interpreted to mean that machine excavation in earth shall not extend below an elevation permitting the pipe to be properly bedded. Installation shall be in accordance with ANSI/AWWA C600 for ductile iron and Cast Iron O.D. (AWWA) PVC pipe or ASTM F-645 for Iron Pipe O.D. (ASTM) PVC pipe except as modified herein.
- B. If the foundation is good firm earth and the machine excavation has been accomplished as set out hereinbefore, the remainder of the material shall be excavated by hand, then the earth pared or molded to give full support to the lower quadrant of the barrel of each pipe. Where bell and spigot is involved, bell holes shall be excavated during this latter operation to prevent the bells from being supported on undisturbed earth. If for any reason the machine

(BGWS-87)

excavation in earth is carried below an excavation that will permit the type of bedding specified above, then a layer of granular material shall be placed so that the lower quadrant of the pipe will be securely bedded in compact granular fill.

- C. Excavation may be undercut to a depth below the required invert elevation that will permit laying the pipe in a bed of granular material to provide continuous support for the bottom quadrant of the pipe. When this method is used, the bedding shall be as set out in Paragraph 3.02 hereinafter.
- D. Trenches shall be of sufficient width to provide free working space on each side of the pipe and to permit proper backfilling around the pipe, but unless specifically authorized by the Engineer, trenches shall in no case be excavated or permitted to become wider than 1'-6" plus the nominal diameter of the pipe at the level of or below the crown of the pipe. If the trench does become wider than 1'-6" at the level of or below the crown of the pipe, special precaution may be necessary, such as providing compacted, granular fill up to top of the pipe or providing pipe with additional crushing strength as determined by the Engineer after taking into account the actual trench loads that may result and the strength of the pipe being used. The Contractor shall bear the cost of such special precautions as are necessary.
- E. All excavated materials shall be placed a minimum of two feet (2') back from the edge of the trench.
- F. Before laying the pipe, the trench shall be opened far enough ahead to reveal obstructions that may necessitate changing the line or grade of the pipeline. Unless specifically directed otherwise by the Engineer or where required to uncover or determine the presence of underground obstructions, not more than three hundred (300) feet of trench shall be opened ahead of the pipe laying, and not more than two (200) feet of open ditch shall be left behind the pipe laying.
- G. The requirements of the County and State Highway Departments regarding the length of open trench left overnight shall also apply to water line laid along the rights-of-way for all roads and streets.
- H. The trench shall be straight and uniform so as to permit laying pipe to lines and grades given by the Engineer. It shall be kept free of water during the laying of the pipe and until the pipeline has been backfilled. Removal of trench water shall be at the Contractor's expense. Dry conditions shall be maintained in the excavations until the backfill has been placed. During the excavation, the grade shall be maintained so that it will freely drain and prevent surface water from entering the excavation at all times. When directed by Owner, temporary drainage ditches shall be installed to intercept or direct surface water, which may affect work. All water shall be pumped or drained from the excavation and disposed of in a suitable manner without damage to adjacent property or to other work.
- I. Unless otherwise indicated on the Plans, or directed by the Engineer, all pipelines shall have at least 36" of cover. Any line within the State Highway ROW shall have a minimum depth of cover of 48" and any line, including bores, within the traveled shoulder or pavement of the State Highway or other road/parking areas (including existing and proposed traffic areas) shall have a minimum depth of cover of 48". All depths of cover are measured to the top of pipe. No departure from this policy shall be made except at the order of the Engineer.
- J. All barricades, lanterns, watchmen, and other such signs and signals as may be necessary to warn the public of the dangers in connection with open trenches, excavations and other obstructions shall be provided by and at the expense of the Contractor. All excavation shall be accomplished in accordance with applicable safety laws and regulations; the Engineer, as previously stated, does not assume responsibility of any degree or sort for acts of the Contractor.

(BGWS-88)

- K. Unless otherwise directed by the Engineer, lines and grades shall be set to conform to those shown on the Plans. Field setting of lines and grades shall be the responsibility of the Contractor.

3.02 PIPE BEDDING

- A. The pipe shall be uniformly and continuously supported throughout the entire length on a firm, stable material. All pipe shall be supported on a bed of granular material, unless the trench has been prepared in accordance with Paragraph 3.01B. In no case shall pipe be supported directly on rock. Bedding shall not be a separate pay item unless otherwise set out in the Detailed Specifications. Bedding shall be provided in earth bottom trenches, as well as rock bottom trenches. Bedding material shall be free from rock, foreign material, frozen earth, and shall be acceptable to the Engineer. Bedding shall be a minimum of 6" below pipe barrel when rock is encountered. When rock is encountered, backfill the space below grade for pipelines with crushed stone or other approved material, and tamp to the proper grade and make ready for construction.
- B. In all cases the foundation for pipes shall be prepared so that the entire load of the backfill on top of the pipe will be carried on the barrel of the pipe so that none of the load will be carried on the bells.
- C. Where flexible pipe is used, the bedding shall be placed up to at least 12 inches above the top of the pipe. The bedding material and procedures shall conform to ASTM D 2321 and any Technical Specifications set out hereinafter. Granular bedding shall be Size #9-m or ASTM C 33; Size #7 crushed stone, fine gravel, or sand, and is not a separate pay item.
- D. Where undercutting and granular bedding is involved, it shall be of such depth that the bottom of the bells of the pipe will be at least three inches above the bottom of the trench as excavated. Undercutting is not a separate pay item unless approved by the Engineer.
- E. In wet, yielding mucky locations where pipe is in danger of sinking below grade or floating out of line or grade, or where backfill materials are of such a fluid nature that such movements of the pipe might take place during the placing of the backfill, the pipe must be weighted or secured permanently in place by such means as will prove effective. When ordered by the Engineer, yielding and mucky materials in subgrades shall be removed below ordinary trench depth in order to prepare a proper bed for the pipe. In such cases, the trench bottom shall be brought back up to proper grade with bedding material. Crushed stone or other such granular material, if necessary, as determined by the Engineer to replace poor subgrade material, shall be a separate pay item and classified as "Special Pipe Bedding". Removal of poor material is not a separate pay item.
- F. Installation shall be in accordance with ASTM D 2321 except as modified hereinafter.

3.03 SPECIAL PIPE BEDDING

Granular material for "Special Pipe Bedding" where required shall be Department of Transportation crushed limestone, Size #9.

3.04 LAYING PIPE

- A. The laying of pipe in finished trenches shall be commenced at the lowest point so the spigot ends point in the direction of flow. The pipe shall be laid in a straight line and grade without kinks or sags and shall be laid in a workmanlike manner.

(BGWS-89)

- B. All pipes shall be laid with ends abutting and true to line and grade as given by the Engineer. Supporting of pipes shall be as set out hereinbefore under "Pipe Bedding" and in no case shall the supporting of pipes on blocks be permitted.
- C. The trench shall be excavated to the required depth and width; bell holes and/or jointing holes shall be dug in advance of pipe laying. Bell holes and/or jointing holes shall be large enough so that the bell or hub will clear the ground and leave ample room for making and inspecting the joints.
- D. Before each piece of pipe is lowered into the trench, it shall be thoroughly swabbed out and inspected to ensure that it is clean. Each piece of pipe shall be lowered separately unless the Engineer gives special permission otherwise.
- E. Care shall be taken to prevent injury to the pipe coating both inside and out. No piece of pipe or fitting which is known to be defective shall be laid or placed in the lines. If any defective pipe or fitting shall be discovered after the pipe is laid, it shall be removed and replaced with a satisfactory pipe or fitting without additional charge. In case a length of pipe is cut to fit in a line it shall be so cut as to leave a smooth end at right angles to the longitudinal axis of the pipe as per latest revision of AWWA Specification C600.
- F. Pipe shall not be laid on solid rock. A pad of granular material as specified in Paragraph 3.02 "Pipe Bedding", shall be used as a pipe bedding. Pipe bedding is not a separate pay item. Irregularities in subgrade in an earth trench shall be corrected by use of granular material.
- G. When ordered by the Engineer, unsuitable materials in subgrades shall be removed below ordinary trench depth in order to prepare a proper bed for the pipe.
- H. Open ends of unfinished pipelines shall be securely plugged or closed at the end of each day's work or when the line is left temporarily at any other time, so as to exclude earth or other material, and precautions taken to prevent flotation of pipe by runoff into trench.
- I. No backfilling (except for securing pipe in place) over pipe will be allowed until the Engineer has had an opportunity to examine the joints, alignment and grade, in the section laid.
- J. Wherever pipe must be deflected from a straight line (in either the vertical or horizontal plane) in order to avoid obstructions, or wherever long radius curves are permitted, the amount of deflection shall not exceed that necessary for the joint to be satisfactorily made, nor that recommended by the pipe manufacturer, and shall be approved by the Engineer.

3.05 BACKFILLING PIPELINE TRENCHES

- A. Backfilling shall begin after line construction is completed, inspected, and approved by the Engineer. Backfilling of pipeline trenches shall be accomplished as shown on the Drawings and with details set forth hereinafter. Before final acceptance, the Contractor will be required to level off all trenches or to bring the trench up to grade. The Contractor shall also remove from roadways, rights-of-way and/or private property all excess earth or other materials resulting from construction. If pavement is not placed immediately following trench backfilling in paved areas, the Contractor shall be responsible for maintaining the trench surface in a level condition at proper pavement grade at all times. Under pavement, roads or driveways, all trench backfill shall be in accordance with Method C. All other trench backfill shall be in accordance with Method A or B.

(BGWS-90)

B. Method "A" - Backfilling in Open Terrain:

Backfilling of pipeline trenches in open terrain shall be accomplished in the following manner:

1. The lower portion of the trench, from the pipe bedding to a point 12" above the top of the pipe, shall be backfilled with materials acceptable to the Engineer such as fine loose earth, sandy soil or loam, or granular material, free from clods, vegetable matter, debris, stone and/or other objectionable materials. This material shall be placed in even layers simultaneously on each side of the pipe in a manner approved by the Engineer and shall be carefully compacted to avoid displacement of the pipe. Layers shall not exceed 6" depth (before compaction). Each layer shall be thoroughly and completely tamped into place before placing the succeeding layer. Compaction shall be accomplished by hand-tamping or by approved mechanical methods. Do not use power operated tampers to tamp that portion of the backfill around the pipe within 1' above the pipe.
2. The upper portion of the trench above the compacted portion shall be backfilled with material, which is free from large rock. Individual stones shall not exceed 1" in maximum dimension. Backfilling this portion of the trench may be accomplished by any means approved by the Engineer. Sufficient earth material shall be incorporated in such backfill to completely fill all voids. The trench backfill shall be heaped over or leveled as directed by the Engineer.

C. Method "B" - Backfilling Under Dirt Entrances:

Backfilling of pipeline trenches under dirt entrances shall be accomplished in the following manner.

1. The lower portion of the trench, from the pipe bedding to a point 12 inches above the top of the pipe, shall be backfilled with materials acceptable to the Engineer such as fine loose earth, sandy soil or loam, or granular material, free from clods, vegetable matter, debris, stone and/or other objectionable materials. This material shall be placed in even layers simultaneously on each side of the pipe in a manner approved by the Engineer and shall be carefully compacted to avoid displacement of the pipe. Layers shall not exceed 6" depth (before compaction). Each layer shall be thoroughly and completely tamped into place before placing the succeeding layer. Compaction shall be accomplished by hand-tamping or by approved mechanical methods. Do not use power operated tampers to tamp that portion of the backfill around the pipe within 1' above the pipe.
2. The middle portion of the trench, from a point 12" above the top of the pipe to a point 6" below the grade line, shall be backfilled with material free from rock and/or acceptable to the Engineer. This material shall be placed and compacted in layers of approximately 6 inches. Water (puddling) may be used as required to obtain maximum compaction.

Upon approval of the Engineer, the Contractor may backfill the middle portion of the trench with crushed stone, fine gravel, or sand in lieu of materials, which require compaction.

D. Method "C" - Backfilling Under Streets, Roads, and Driveways:

Backfilling of pipeline trenches under streets, roads and driveways shall be accomplished in the following manner:

1. The lower portion of the trench from the pipe bedding to a point 6" below the bottom of the pavement or concrete sub-slab, shall be backfilled with No. 57 stone, firmly compacted into place.
 2. The upper portion of the trench, from a point 6" below the bottom of the pavement or concrete sub-slab to grade, shall be backfilled with No. 57 stone, firmly compacted into place. At such time that pavement replacement is accomplished, the excess base course shall be removed as required.
- E. Trenches outside existing sidewalks, driveways, streets, and highways shall be backfilled in accordance with Method "A". Trenches within the limits of dirt entrances shall be backfilled in accordance with Method "B". Trenches within the paving limits of existing streets, highways and driveways shall be backfilled in accordance with Method "C". When directed by the Engineer, the Contractor shall wet backfill material to assure maximum compaction.

Before final acceptance, the Contractor will be required to level off all trenches or to bring the trench up to grade. The Contractor shall also remove from roadways, rights-of-ways and/or private property all excess earth or other materials resulting from construction.

In the event that pavement is not placed immediately following trench backfilling in streets, highways, and driveways the Contractor shall be responsible for maintaining the trench surface in a level condition at proper pavement grade at all times.

Wherever excavation has been made within easements across private property, the top 6" of backfill material shall consist of fine loose earth free from large clods, vegetable matter, debris, stone, and/or other objectionable materials.

3.06 SETTLEMENT OF TRENCHES

- A. Whenever lines are in, or cross, driveways and streets, the Contractor shall be responsible for any trench settlement which occurs within these rights-of-way within one (1) year from the time of final acceptance of the work. If paving shall require replacement because of trench settlement within this time, the Contractor at no extra cost to the Owner shall replace it. Repair of settlement damage shall meet the approval of the Owner.

3.07 INSPECTION OF LINES DURING CONSTRUCTION

- A. The Contractor shall notify the Engineer when pipe will be received on the job so that arrangements may be made for inspecting the unloading and stringing, as well as inspecting the pipe proper and examining for the stamp of the independent laboratory. In order to avoid damage to pipe, it is recommended that the pipe be delivered in bundles and kept bundled until it is needed. No pipe (or other materials or equipment) shall be stored on private property without the permission of the property owner.
- B. Before the Contractor backfills any of the lines, they shall be first inspected by the Engineer; and the Engineer shall give the Contractor permission to proceed with the backfilling. If any joints, pipes, or other workmanship or materials are found to be defective, they shall be removed and replaced by the Contractor without any extra compensation.

3.08 CONCRETE THRUST BLOCKS, CRADLE, ANCHORS OR ENCASEMENT

- A. Concrete thrust blocks, cradle, anchors or encasement shall be placed where shown on the Drawings, required by the Specifications, or as directed by the Engineer. All fittings, valves, etc., require thrust blocks.
- B. For cradle and encasement, concrete shall be 3000 psi and shall be mixed sufficiently wet to permit it to flow under the pipe to form a continuous bed.

(BGWS-92)

- C. The cost of thrust blocks shall be included in the price bid for pipe.
- D. For thrust blocks and anchors, concrete shall be 3000 psi, and shall be formed or be sufficiently stiff to maintain the forms indicated on the Details.
- E. In tamping concrete, care shall be taken not to disturb the grade or line of the pipe or injure the joints.
- F. Water mains shall have concrete thrust or “kicker” blocks at all pipe intersections and changes of direction or at any other point as recommended by the pipe manufacturer and /or as indicated by the Engineer to resist forces acting on the pipeline. All reducers (increasers) shall be anchored.
- G. Concrete placed outside the specified limits or without written authorization from the Engineer will not be subject to payment.

3.09 BITUMINOUS CONCRETE HIGHWAY, STREET AND DRIVEWAY REPLACEMENT

- A. The Contractor shall replace those sections of existing roads, streets and driveways required to be removed to install the pipelines under this contract. He shall construct same to the original lines and grades and in such manner as to leave all such surfaces in fully as good or better condition than that which existed prior to the operations.
- B. Prior to trenching, the pavement shall be scored or cut to straight edges at least twelve (12) inches outside each edge of the proposed trench to avoid unnecessary damage to the remainder of the paving. Edges of the existing pavement shall be re-cut and trimmed to square, straight edges after the pipeline has been installed and prior to placing the new base and pavement.
- C. Backfilling of the trench shall be in accordance with Method "C" as described hereinbefore. Base course for the paving shall be dense graded crushed limestone furnished and placed in accordance with the current requirements of the Standard Specifications for Road and Bridge Construction of the Department of Transportation, to a depth of six (6) inches in roads and streets and four (4) inches in driveways.

3.10 UNPAVED DRIVEWAY (CRUSHED STONE) SURFACE REPLACEMENT

- A. The Contractor shall replace those sections of existing driveways and parking areas required to be removed to install the pipelines under this contract. He shall construct same to the original lines and grades and in such manner as to leave all such surfaces in fully as good or better condition than that which existed prior to the operations.
- B. Material for backfilling of the pipeline trench shall be dense-graded aggregate in accordance with Method “C” as described hereinbefore.

3.11 REMOVING AND REPLACING CONCRETE CURB AND GUTTER OR SIDEWALK

- A. The Contractor shall remove the curb and gutter or sidewalk when encountered when required for laying the pipe. Only that portion of the curb and gutter or sidewalk needed to lay the pipe shall be removed.
- B. Where concrete curb and gutter or sidewalk is removed or disturbed during the construction work, it shall be replaced, using 3000 psi concrete, in fully as good or better condition than that which existed prior to the Contractor's operation.

3.12 REPLACEMENT OF EXISTING MAIL BOXES, CULVERTS, CLOTHES LINE POSTS, FENCES AND OTHER SUCH FACILITIES

- A. Existing mail boxes, drainage culverts, clothes line posts, fences and the like shall not be damaged or disturbed unless necessary, in which case, they shall be replaced in as good condition as found as quickly as possible. Existing materials shall be reused in replacing such facilities when materials have not been damaged by the Contractor's operations. Existing facilities damaged by Contractor's operation shall be replaced with new materials of the same type at the Contractor's expense. Work in this category is not a pay item.
- B. Replacement of paved drainage ditches within highway right-of-way shall be accomplished in accordance with Department of Transportation specifications.

3.13 PORTLAND CEMENT CONCRETE DRIVEWAY REPLACEMENT

- A. Wherever Portland cement concrete driveways are removed, they shall be reconstructed to the original lines and grades and in such manner as to leave all such surfaces in fully as good or better condition than existed prior to the operation.
- B. The existing concrete paving shall be sawed or cut to straight edges 12-inches outside the edges of the trench or broken out to an existing joint, as directed by the Engineer. The concrete pavement shall be equal to the existing pavement thickness but not less than 6-inches in thickness for driveways.
- C. Pavement shall be reinforced with 6 x 6 #10-10 wire mesh meeting the AIS requirements and shall be constructed with 3000 psi concrete.

3.14 RIP-RAP STREAM BANK SLOPE PROTECTION

- A. The Contractor shall install rip-rap stream bank slope protection at locations directed by the Engineer. Rip-rap slope protection shall be 12-inches thick and shall meet State D.O.T. Standard Specifications.

3.15 TESTING

- A. All pressure piping shall be given a hydrostatic test. Testing of lines shall comply with the provisions listed below, or similar approved procedures, which will insure equal or better results. Pipe lines of whatever material shall be tested at 1.5 times the anticipated working pressure but no less than the pressure as shown below as a minimum; the allowable leakage shall not exceed the requirements of the following table (which are approximately 1/4th of the AWWA formula allowance):

<u>Pipe Size</u>	<u>Test Pressure</u>	<u>Allowable Leakage per 1000 Feet</u>
24-inch	150 psig	0.60 gallons per hour
16-inch	150 psig	0.40 gallons per hour
12-inch	150 psig	0.30 gallons per hour
8-inch	150 psig	0.20 gallons per hour
6-inch	150 psig	0.15 gallons per hour
4-inch	150 psig	0.10 gallons per hour

- B. Contractor shall furnish all recording gauges, recording pressure charts, pumps, meters, and other equipment required for measuring water used during leakage test and maintain said equipment in condition for accurate testing as determined by the Engineer. Recording pressure charts shall be required throughout the duration of the test and shall be turned over to the Engineer at conclusion of tests. The pressure recording device shall be suitable for outside service, of a range sufficient for the line pressure tested, 24- hour spring wound clock, designed for 9-inch or 12-inch charts, and shall be approved by the Engineer.
- C. Duration of test shall be not less than four (4) hours. If the pressure drop is 5 psi or greater, the line shall be retested regardless of the leakage rate.
- D. Where leaks are visible at exposed joints and/or evident on the surface where joints are covered, the pipe shall be rejoined and leakage must be minimized, regardless of total leakage as shown by test.
- E. All pipe, fittings, valves, and other materials found to be defective under test shall be removed and replaced at no additional expense to the Owner.
- F. Lines, which fail to meet tests, shall be repaired and retested as necessary until test requirements are complied with.
- G. Where nonmetallic joint compounds are used, pipelines should be held under normal operating pressure for at least three days before testing.
- H. The Owner will provide initial water for testing the pressure piping. Should the first test fail to pass, all additional water required for subsequent tests shall be furnished at the Contractor's expense.
- I. The cost of testing of pressure piping is incidental and is to be included in the Contractor's unit Contract Price.

3.16 CLEAN UP

- A. Upon completion of installation of the piping and appurtenances, the Contractor shall remove all debris and surplus construction materials resulting from the Work. The Contractor shall grade the ground along each side of pipe trenches in a uniform and neat manner leaving the construction area in a shape as near as possible to the original ground line.

3.17 DISINFECTION OF POTABLE WATER LINES

- A. The new potable waterlines shall not be placed in service, either temporarily or permanently, until they have been thoroughly disinfected in accordance with the following requirements and to the satisfaction of the Engineer.
- B. After testing, a solution of hypochlorite using HTH or equal shall be introduced into the section of the line being disinfected sufficient to insure a chlorine dosage of at least 50 ppm in the main. While the solution is being applied, the water should be allowed to escape at the ends of the line until tests indicate that a dosage of at least 50 ppm has been obtained throughout the pipe. Open and close all valves and cocks while chlorinating agent is in the piping system. The chlorinated water shall be allowed to remain in the pipe for 24 hours, after which a residual of at least 25 ppm shall be obtained. The disinfection shall be repeated until 25 ppm is obtained after which time the main shall be thoroughly flushed until the residual chlorine content is not greater than 2.0 ppm, and then may be connected to the system. Also, no additional payment will be allowed for providing taps for chlorine injection

and/or flushing, if necessary. The Contractor is responsible for the disposal of highly chlorinated water flushed from the main. (b)(6)(b)(7)(C)

- C. The Contractor shall be responsible for having a private laboratory perform all required bacteriological testing to meet State regulatory standards. A minimum of two samples shall be tested for each line up to 0.5 mile in length; for line lengths over 0.5 mile, an additional sample shall be collected and tested for each additional mile of line. The laboratory must be acceptable to the Owner and the Engineer. If negative samples are obtained the line shall be thoroughly flushed and then may be connected to the system. If a positive sample is obtained, the disinfection procedure must be repeated until negative samples are obtained. The cost of the bacteriological testing will be borne by the Contractor. Disinfection is not a pay item. The Owner will pay for the water required for the initial filling of the lines and for the first refill after flushing, but the Contractor shall pay for any other water required.

END OF SECTION

SECTION 02515 – VALVES

(BGWS-96)

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Provide all labor, materials, equipment and services required to furnish and install all valves shown on the Drawings and/or specified herein. Valves shall meet the current AIS requirements with certification being furnished with the submittal.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification sections, apply to work of this Section.

1.03 SUBMITTALS

- A. Descriptive literature, catalog cuts, and dimensional prints clearly indicating all dimensions and materials of construction, shall be submitted on all items specified herein to the Engineer for review before ordering. Comply with provisions of Section 01340.
- B. At the time of submission, the Contractor shall, in writing, call Engineer's attention to any deviations that the submittals may have from the requirements of the Engineer's Contract Drawings and Specifications. AIS certifications shall be submitted along with shop drawings.

PART 2 - PRODUCTS

2.01 GATE VALVES

- A. Gate valves shall conform with AWWA C-509 or AWWA C-515 standard, and shall be of the resilient seat type, iron body, fully bronze mounted, non-rising stem and have a design working pressure of 250 psi. All assembly bolts shall be stainless steel. Valves shall be of standard manufacturer and of the highest quality both as to materials and workmanship. Valves shall meet the current AIS requirements with certification being furnished with the submittal.
- B. All gate valves shall be furnished with mechanical joint connections, unless otherwise shown on the Drawings or specified hereinafter. Megalug type joint restraints shall be installed on all valves; the end-connections and restraints furnished shall be suitable for connection to the pipe being installed.
- C. An epoxy coating conforming to AWWA C-550 shall be applied to the interior and exterior ferrous surfaces of the valve except for finished or seating surfaces.
- D. All gate valves shall have the name or monogram of the manufacturer, the year the valve casting was made, the size of the valve, and the working water pressure cast on the body of the valve.
- E. Each gate valve shall be installed in a vertical position with a roadway type valve box. Gate valves set with valve boxes shall be provided with a 2-inch square operating nut and shall be opened by turning to the left (counter-clockwise). Contractor must use extension stems, if necessary, to raise operator nut within 24" of final grade.

2.02 VALVE BOXES

- A. Valve boxes shall be 5-1/4 inch cast iron, two piece, screw type with drop cover marked "WATER". Valve boxes shall meet the current AIS requirements.

Valve boxes shall be accurately centered over valve operating nut, and backfill thoroughly tamped about them. Valve box bases shall not rest on the valves but shall be supported on crushed stone fill. They shall be set vertically and properly cut and/or adjusted so that the tops of boxes will be at grade in any paving, walk or road surface, and 1 and 2 inches above ground in grass plots, fields, woods or other open terrain. For ease of location and identification, a concrete pad and marker for valves outside the roadway shall be furnished as shown on the Drawings.

Contractor shall also furnish and install at each valve a two piece HDPE valve box alignment device (BOXLOK) as manufactured by EMMA Sales or approved equal.

- B. Valve boxes shall be set at valve locations shown on the drawings or designated by the Engineer.
- C. Nut operator extensions for all valves buried deeper than 3 feet shall be provided with stem extensions sufficient to raise operator nut to within 2 feet of finished grade.

2.03 VALVE MARKERS

Water valve markers shall be furnished and installed for each "out of road" valve. The valve marker shall be as detailed on the Drawings.

2.04 TAPPING SLEEVES AND VALVES

- A. Tapping sleeves for connections to existing water lines shall be of the mechanical joint type suitable for working pressures of 200 psi. All sleeves shall meet the current AIS requirements with certifications furnished.
- B. Tapping valves shall be of the flange/mechanical joint type suitable for minimum working pressures of 200 psi. All valves shall meet the current AIS requirements with certifications furnished.
- C. All existing water mains to be tapped under this contract shall be exposed in order to verify line sizes prior to ordering tapping sleeves and valves. The Contractor shall verify in the field the type of existing pipe that the tapping sleeve will be used in connection with.

2.05 SERVICE CONNECTIONS

A. Service Assemblies

- 1. Service assemblies shall be suitable for use under the working pressure of the lines on which installed, which shall be a maximum of 250 psi.
- 2. The main shall be tapped in the upper half of the pipe at a 45 degree angle. Size of pipe taps shall not exceed that recommended by the pipe manufacturer for the pipe size involved. Service clamps shall be used for all taps on polyvinyl chloride pipe. Brass tapped couplings with AWWA threads shall be used in place of a direct main tap. The tap shall be in the upper half of the coupling at a 45 degree angle.

B. Service Connection Fittings

- 1. Manufacturers' names and catalog numbers are used to establish the type and quality. Substitution will not be allowed. The following fittings shall be a part of the service assembly:
 - a. Corporation Stops shall be made of brass, shall have AWWA tapered threads, outlet be compression joint connection for copper tubing size service pipe, shall be as manufactured by Ford Meter Box Company, F1000,

or approved equal.

(BGWS-98)

- b. Service saddles shall be made of certified brass and machined to rigid specifications. The upper and lower castings shall be permanently hinged together with silicon bronze pin, and the silicon bronze bolt shall have a retainer on it to prevent loss during shipment or during installation. The lower casting must be tapped to accept the screw so that no nuts are required, must be designed to form a hydraulic seal before the brass saddle halves bottom out, shall have AWWA tapered threads, shall be for PVC pipe, and must be as manufactured by Ford Meter Box Company (S70-203, S70-204, S70-303, S70-304, S70-403, S70-404, S70-603, S70-604, S70-803, S70-804) or approved equal.
- c. Inserts shall be quality stainless steel and shall be for 3/4" copper tubing size PE pipe, and shall be as manufactured by Ford Meter Box Co. (#51) or approved equal.
- d. Meter setters shall be flexible copper material having horizontal inlet and outlet compression joint connections for "copper tubing size" service tubing, shall have an angle ball valve and with lock wings, a dual check valve and be for 5/8" x 3/4" meters, as manufactured by Ford Meter Box Company (VBHH72-7W-44-33) or approved equal.
- e. Meter Washers shall be made of rubber for meter size 5/8" x 3/4" and shall be 1-5/32" outside diameter, 3/4" inside diameter, and 1/8" thick, and shall be as manufactured by Ford Meter Box Company #GT-114, or approved equal.
- f. Flow Control Couplings shall be constructed of PVC with compression ends for copper tubing size service pipe.
- g. Couplings (Service Line) shall be constructed of brass with both ends compression joints connection for 3/4" copper tubing size service pipe, shall be as manufactured by Ford Meter Box (C44-33) or approved equal.

C. Service Pipe

Water service piping shall meet the following requirements: Polyethylene Plastic Service Piping shall conform to the requirements of Type III, Grade 3, Class C material as described in Standard Specifications for Polyethylene Plastic Tubing (200 PSI) ASTM D-2737 (Copper-Tubing Size). The PE service piping shall carry the NSF seal of approval.

D. Steel Casing Pipe (for Services)

Casing pipe shall be black steel pipe, 21 feet joints, have male iron pipe threads on each end, with coupling(s) as required and shall be 1-1/2" in diameter. Steel casing pipe shall meet the current AIS requirements with certifications furnished.

E. Water Meters

Water meters for new settings shall be furnished and installed by the Owner.

F. Water Meter Boxes

(BGWS-99)

Meter boxes shall be 24" high standard rectangular Poly Plastic with fabricated notches for service piping, shall have a cast iron meter reading lid, shall be as manufactured by Poly Plastic Water Meter Boxes or approved equal. Tensile strength shall be 3100-5500 psi and shall be chemical resistant. Cast iron lids shall be certified to meet the AIS requirements.

2.06 INSERTION VALVES (WHEN REQUIRED)

- A. Insertion valves for inserting into existing water lines shall be of the mechanical joint type suitable for working pressures of 250 psi and shall be TEAM Industrial Services, or approved equal.
- B. The inserted valve shall meet ANSI/AWWA C515 material standards and shall be a fully functioning, resilient wedge gate valve with MJ end connections. The wedge gate shall seal/seat on the valve body, not on the host pipe. The insertion valve shall be installed under full line pressure to avoid interruption of service.
- C. All existing water mains to be tapped under this contract shall be exposed in order to verify line sizes and material type prior to ordering insertion valves.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. All valves shall be installed in accordance with details on the Contract Drawings and with the manufacturer's recommendations.
- B. All valves shall be installed with Mega-Lug type restraints suitable for the pipe being installed and anchored in accordance with the details on the Contract Drawings. The restraining lugs shall be certified to meet the AIS requirements.

END OF SECTION

SECTION 02517 - HYDRANTS

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Provide all labor, materials, equipment and services required for furnishing and installing all hydrants and appurtenances specified herein. Hydrants shall be certified to meet the AIS requirements.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Water Distribution Piping: Section 02510
- B. Valves - Utilities Services: Section 02515

1.03 SUBMITTALS

- A. Submit shop drawings and product data in accordance with Section 01340 of this specification.
- B. Descriptive literature, catalog cuts, and dimensional prints clearly indicating all dimensions and materials of construction, shall be submitted on all items specified herein to the Engineer for review before ordering. AIS certifications shall be included with the submittal.
- C. At the time of submission, the Contractor shall, in writing, call the Engineer's attention to any deviations that the submittals may have from the requirements of the Engineer's Contract Drawings and Specifications.

PART 2 - PRODUCTS

2.01 FIRE HYDRANTS

- A. The Contractor shall furnish and install fire hydrants and auxiliary gate valves where shown on the Drawings or directed by the Engineer. Hydrants shall conform in all respects to the most recent requirements of AWWA C502. Hydrant barrel shall have safety breakage feature above the ground line. All fire hydrants shall have 6-inch mechanical joint shoe connection, two (2) 2-1/2-inch discharge nozzles, and one (1) 4 1/2-inch pumper nozzle with rubber gasketed caps fitted with cap chains. Cap nuts are to be five (5) sided. Connection threads shall be National Standard Thread. Main valve shall have 5-1/4-inch full opening and be of the compression type opening against water pressure so that valve remains closed should barrel be broken off.
- B. Hydrants shall be fully bronze mounted. Main valve shall have a threaded bronze seat ring assembly of such design that it is easily removable by unscrewing from a threaded bronze drain ring. Bronze drain ring shall have multiple ports providing positive automatic drainage as the main valve is opened or closed. Drainage waterways shall be completely bronze to prevent rust and corrosion.
- C. The operating nut shall be five (5) sided bronze or bronze with a five (5) sided ductile iron cap and mounted so that a counterclockwise motion will open the valve. There must be cast on top an arrow and the word "Open" indicating the direction of turn to open the hydrant.

(BGWS-101)

- D. Operating stem shall be equipped with anti-friction thrust bearing to reduce operating torque and assure easy opening. Stop shall be provided to limit stem travel. Stem threads shall be enclosed in a permanently sealed lubricant reservoir protected from weather and the waterway with O-ring seals.
- E. Hydrants shall be shop tested to 300 psi pressure with main valve both opened and closed. Under test the valve shall not leak, the automatic drain shall function and there shall be no leakage into the bonnet.
- F. Type of shoe connection shall be mechanical joint and size shall be six inches (6").
- G. Hydrants shall be given two (2) coats of enamel high visibility paint with color to be selected by the Owner.
- H. Hydrants shall be certified to meet the AIS requirements.

PART 3 - EXECUTION

3.01 SETTING OF HYDRANTS

A. Location:

- 1. Hydrants shall be located as shown or as directed to provide complete accessibility and minimize the possibility of damage from vehicles or injury to pedestrians.
- 2. When placed behind the curb, the hydrant barrel shall be set so that the pumper or hose nozzle cap will be a minimum of five feet (5') from the back of curb.
- 3. When set in the lawn space between the curb and the sidewalk or between the sidewalk and the property line, no portion of the hydrant or nozzle cap shall be within six inches (6") of the sidewalk.

B. Position:

All hydrants shall be set plumb with not less than two (2) cubic feet of crushed stone and shall have their nozzles parallel with the roadway, with the pumper nozzle facing toward the roadway. Hydrants shall be set to the established grade, with nozzles at least eighteen inches (18") above the ground, as shown or as directed by the Engineer.

C. Connection to Main:

Each fire hydrant shall be connected to the main with a six-inch (6") restrained joint ductile iron branch controlled by an independent six -inch (6") gate valve, unless otherwise specified. Post hydrants shall be connected with 3" branch and valve.

D. Hydrant Drainage in Pervious Soil:

Whenever a hydrant is set in soil that is pervious, drainage shall be provided at the base of the hydrant by placing uncrushed course aggregate (AAHSTO M-43) No. 57 from the bottom of the trench to at least six inches (6") above the drain opening in the hydrant and to a distance of one foot (1') around the elbow. No drainage system shall be connected to a sewer.

E. Hydrant Drainage in Impervious Soil:

(BGWS-102)

Whenever a hydrant is set in clay or impervious soil, a drainage pit two feet (2') in diameter and three feet (3') deep shall be excavated below each hydrant and filled compactly with clean coarse aggregate (AASHTO M-43) No. 57 under and around the elbow of the hydrant and to a level of six inches (6") above the drain opening. No drainage pit shall be connected to a sewer (see Standard Details).

3.02 ANCHORAGE

- A. The bowl of each hydrant shall be tied to the pipe with suitable anchor couplings, as shown on the Standard Details in the Drawings or as directed by the Owner or Engineer.

END OF SECTION

SECTION 02920 - LAWNS AND GRASSES

PART 1 - GENERAL

1.01 DESCRIPTION OF WORK

Provide all labor, materials, equipment, and services required for seeding of all disturbed areas caused by construction activities and for installation of sod where indicated on the Contract Drawings or specified herein.

1.02 RELATED DOCUMENTS

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division-1 Specification sections, apply to Work of this Section.
- B. Earthwork for Utility Work: Section 02225
- C. Erosion and Sedimentation Control: Section 02371

1.03 MAINTENANCE

- A. Maintenance shall begin immediately following the last operation of installation for each portion of lawn.
- B. Lawns shall be maintained until a suitable stand of grass is established. At the end of this period an inspection will be made and any deficiencies, which may be attributable to the Contractor, will be noted in writing. Another inspection will be made at the beginning of the next planting season, and the Contractor shall repair any of the previously noted deficiencies still existing.

1.04 INSPECTION FOR ACCEPTANCE

- A. The Inspection of the Work: The inspection of the work of lawns to determine the completion of contract work exclusive of the possible replacement of plants, will be made by the Engineer upon written notice requesting such inspection submitted by the Contractor at least ten (10) days prior to the anticipated date.
- B. Acceptance: After inspection, the Contractor will be notified in writing by the Owner of acceptance of all work of this Section, exclusive of the possible replacement of plants subject to guaranty, or if there are any deficiencies of the requirements of completion of the Work.

PART 2 - PRODUCTS

Products shall be as specified in Section 02371 – Erosion and Sedimentation Control.

PART 3 – EXECUTION

Execution shall be as specified in Section 02371 – Erosion and Sedimentation Control.

END OF SECTION

SECTION 03300 - CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.01 SCOPE OF WORK

- A. Provide all labor, materials, equipment and services required to furnish and install all cast-in-place concrete as indicated on the Drawings and specified herein.
- B. All concrete construction shall conform to all applicable requirements of ACI 301 (latest), Specifications for Structural Concrete for Buildings, except as modified by the supplemental requirements specified herein.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Earthwork for Utility Work: Section 02300

1.03 SUBMITTALS

The Contractor shall submit the following data for Engineer's review in accordance with Section 01340.

- A. Concrete mix designs, test results and curves plotted to establish water-cement ratio if ACI 301-99 Section 4.2.3.4.G is followed.
- B. Proposed mix designs and all necessary substantiating data used to establish the proposed mix designs if ACI 301-99 Section 4.2.3.1 is followed.
- C. Mix designs shall be submitted for all mixes proposed or required to be used, including all mixes containing admixtures.

1.04 QUALITY ASSURANCE

The Contractor shall obtain and have available in the field office at all times, the following references:

- A. Specifications for Structural Concrete for Buildings ACI 301 (latest Revision).
- B. Field Reference Manual: Specifications for Structural Concrete for Buildings SP-15 (89).

Available from:

The American Concrete Institute
Publications Department
P.O. Box 19150
Detroit, Michigan 48219-0150

- C. Manual of Standard Practice - CRSI. (Latest Edition).
- D. Placing Reinforcing Bars - CRSI (Latest Edition).

Available from:

Concrete Reinforcing Steel Institute
933 North Plum Grove Road
Schaumburg, Illinois 60173-4758

PART 2 - PRODUCTS

2.01 CLASSES OF CONCRETE AND USAGE

- A. Structural concrete of the various classes required shall be proportioned by either Method 1 or Method 2 of ACI 301 to produce the following 28-day compressive strengths:
 - 1. Selection of Proportions for Class A Concrete:
 - a. 4,000 psi compressive for strength at 28 days.
 - b. Type II cement plus dispersing agent and air.
 - c. Max. (water)/(cement and dispersing agent) ratio = 0.45.
 - d. Min. cement content = 564 lbs. (6.0 bags)/cu. yd. concrete.
 - e. Nominal max. size coarse aggregate = No. 67 (3/4" max.) or No. 57 (1" max.). Walls with architectural treatment shall use No. 67 (3/4" max.).
 - f. Air content = 6% plus or minus 1% by volume.
 - g. Slump = 3" - 4" in accordance with ASTM C 143.
 - 2. Selection of Proportions for Class B Concrete:
 - a. 3,000 psi compressive strength at 28 days.
 - b. Type I cement plus dispersing agent and air.
 - c. Max. (water)/(cement and dispersing agent) ratio = 0.56.
 - d. Min. cement content = 470 lbs. (5.0 bags)/cu. yd. concrete.
 - e. Nominal max. size coarse aggregate = No. 67 (3/4" max.) or No. 57 (1" max.). Walls with architectural treatment shall use No. 67 (3/4" max.).
 - f. Air content = 6% plus or minus 1% by volume.
 - g. Slump - 3" - 4" in accordance with ASTM C 143.
- B. Concrete shall be used as follows:
 - 1. Class A concrete for all concrete work except as noted below.
 - 2. Class B concrete for fill concrete, thrust blocks and topping over hollow-core slabs, and where indicated on the Drawings.
- C. Type II cement conforming to ASTM C 150 shall be used in all structural concrete. The alkali content shall not exceed 0.6% calculated as sodium oxide. Cement for exposed to view concrete shall have a uniform color classification.
- D. Coarse aggregate for concrete shall be size No. 57, as specified in ASTM C33 unless a smaller size aggregate is required to conform to provisions of Section 4.2.2.3 of ACI 301. Coarse aggregate shall conform to all requirements of ASTM C33.
- E. Manufactured sand shall not be used as fine aggregate in concrete.

2.02 ADMIXTURES

(BGWS-106)

- A. An air-entraining admixture shall be used on all concrete and shall be synthetic air entrainment such as that manufactured by Master Builders or approved equal. Certification attesting to the percent of effective solids and compliance of the material with ASTM C 260 shall be furnished, if requested.
- B. A water-reducing, set controlling admixture (nonlignin type) shall be used in all concrete. The admixture shall be a combination of polyhydroxylated polymers including catalysts and components to produce the required setting time based on job site conditions, specified early strength development, finishing characteristics required, and surface texture, as determined by the Engineer.
- C. Certification shall be furnished attesting that the admixture exceeds the physical requirements of ASTM C 494, Type A, water-reducing and normal setting admixture, and when required, for ASTM C 494, Type D, water-reducing and retarding admixture when used with local materials with which the subject concrete is composed.
- D. The admixture manufacturer, when requested, shall provide a qualified concrete technician employed by the manufacturer to assist in proportioning concrete for optimum use. He shall also be available, when requested, to advise on proper addition of the admixture to the concrete and on adjustment of the concrete mix proportions to meet changing job conditions.
- E. The use of admixtures to retard setting of the concrete during hot weather, to accelerate setting during cold weather, and to reduce water content without impairing workability will be permitted if the following conditions are met:
 - The admixture shall conform to ASTM C494, except that the durability factor for concrete containing the admixture shall be at least 100 percent of control, the water content a maximum of 90 percent of control and length change shall not be greater than control, as defined in ASTM C 494.
- F. Where the Contractor finds it impractical to employ fully the recommended procedures for hot weather concreting, the Engineer may at his discretion, require the use of a set retardant admixture for mass concrete 2.5 feet or more thick for all concrete whenever the temperature at the time concrete is cast exceeds 80°F. The admixture shall be selected by the Contractor subject to the review of the Engineer. The admixture and concrete containing the admixture shall meet all the requirements of these Specifications. Preliminary tests of this concrete shall be required at the Contractor's expense.
- G. Admixtures shall be used in concrete design mixes in the same manner and proportions as in the field so that the effects of the admixtures are included in preliminary tests submitted to the Engineer for review prior to the start of construction.
- H. When more than one (1) admixture is used, all admixtures shall be compatible. They should preferably be by the same manufacturer.
- I. Calcium chloride will not be permitted as an admixture in any concrete.

2.03 REINFORCEMENT

- A. The minimum yield strength of the reinforcement shall be 60,000 pounds per square inch. Bar reinforcement shall conform to the requirements of ASTM A 615. All bar reinforcement shall be deformed. Reinforcing steel shall be certified to meet the current AIS requirements.

(BGWS-107)

- B. Wire-mesh reinforcement shall be continuous between expansion joints. Laps shall be at least one full mesh plus 2 inches, staggered to avoid continuous lap in either direction, and securely wired or clipped with standard clips.
- C. Smooth dowels shall be plain steel bars conforming to ASTM A 615, Grade 60, or steel pipe conforming to ASTM A 120, Schedule 80. Pipe, if used, shall be closed flush at each end with mortar or metal or plastic cap. Dowels shall be installed at right angles to construction joints and expansion joints. Dowels shall be accurately aligned parallel to the finished surface, and shall be rigidly held in place and supported during placing of the concrete. One end of dowels shall be oiled or greased or dowels shall be coated with high-density polyethylene with a minimum thickness of 14 mils.
- D. Reinforcement supports and other accessories in contact with the forms for members which will be exposed to view in the finished work shall be of stainless steel or shall have approved high-density polyethylene tips so that the metal portion shall be at least one-quarter of an inch from the form or surface. Supports for reinforcement, when in contact with the ground or stone fill, shall be precast stone concrete blocks.
- E. Particular care shall be taken to bend tie wire ends away from exposed faces of beams, slabs and columns. In no case shall ends of tie wires project toward or touch formwork.

PART 3 - EXECUTION

3.01 FINISHES

- A. Exposed to Public View Concrete Surfaces:
 - 1. All concrete exposed to view in the completed structure shall be produced using materials and workmanship to such quality that only nominal finishing will be required. The provisions of paragraphs 6.2.2.1 and 6.3.6 of ACI 301 shall apply to all exterior exposed to public view concrete surfaces, including the outside surfaces of tanks.
 - 2. Forms for exposed concrete surfaces shall be exterior grade, high-density overlay plywood, steel, or wood forms with smooth tempered hard-board form-liners.
 - 3. Forms shall be coated with an approved release agent before initial pour and between subsequent pours, in accordance with the manufacturer's printed instructions. Form boards shall not be wet water prior to placing concrete.
 - 4. Recessed joints in concrete shall be formed using lacquer-coated wood battens or forms, milled to indicated profiles. Battens and corner strips shall be carefully inspected before concrete is placed and damaged pieces replaced.
 - 5. Chamfer strips shall be 1 inch radius with leg, polyvinyl chloride strips by Gateway Building Products, Saf-T-Grip Specialties Corp., Vinylex Corp., or equal.
 - 6. Particular attention is directed to the requirements of paragraphs 5.3.3.3G and 6.3.3 of ACI 301. Form panels shall be provided in the maximum sized practicable in order to minimize form joints. Wherever practicable, form joints shall occur at recessed joints. All form joints in exterior exposed to view surfaces shall be carefully caulked with an approved nonstaining caulking compound. Joints shall not be taped. Form oil or other material, which will impart a stain to the concrete, shall not be allowed to contact concrete surfaces.

(BGWS-108)

7. Care shall be taken to prevent chipping of corners or other damage to concrete when forms are removed. Exposed corners and other surfaces, which may be damaged by ensuing operations, shall be protected from damage by boxing, corner boards or other approved means until construction is completed.
 8. Form ties shall remain in the walls and shall be equipped with a water seal to prevent passage of water through the walls. Minimum set back of form ties shall be 1-1/2 inches from faces of wall. The hole left by removal of tie ends shall be sealed and grouted in accordance with the procedure described hereinafter in Par. 3.01.F.
 9. All formed exposed to view concrete surfaces shall have a "smooth rubbed finish". Exterior vertical surfaces shall be rubbed to one foot below grade. Interior exposed to public view vertical surfaces of liquid containers shall be rubbed to one (1) foot below the minimum liquid level that will occur during normal operations.
- B. All vertical surfaces in liquid containing structures shall have a "smooth form" finish.
- All "smooth form" concrete vertical surfaces shall be a true plane within 1/4 inch in 10 feet as determined by a 10 foot straightedge place anywhere on the surface in any direction. Abrupt irregularities shall not exceed 1/8 inch.
- C. Basin, flume, conduit and tank floors shall have a "troweled" finish unless shown otherwise on Drawings.
- D. Weirs and overflow surfaces shall be given a "troweled" finish.
- E. Exterior platforms, steps and landings, shall be given a "broom" finish. "Broom" finish shall be applied to surfaces, which have been steel-troweled to an even, smooth finish. The troweled surface shall then be broomed with a fiber-bristle brush in the direction transverse to that of the main traffic.
- F. Patching of holes due to removal of tie ends and other repairable defective areas, shall be as follows: Entire contact area of hole shall be coated with two-part moisture insensitive epoxy bonding compound as specified in Par. 2.04.B. in accordance with manufacturer's specifications, and prior to placing of freshly mixed patching mortar. Patching mortar shall be mixed and placed in general accordance with ACI Par. 5.3.7.5.
- G. For floors and slabs in which drains occur, special care shall be exercised to slope the floors uniformly to the drains. All floors with drains shall be sloped not less than 1/8 inch per foot unless otherwise shown. In all areas where quarry tile or other materials requiring more than 1/4 inch drop are to be overlaid, the concrete base slab shall be depressed as shown to provide a finished floor at the same elevation as surrounding areas.

3.02 TESTING (Note: Lab testing not required for water line project)

- A. All testing shall be in accordance with provisions of ACI 301. Testing services listed in ACI Sections 1.6.4 shall be performed by a testing agency acceptable to the Engineer and Owner.
- B. The testing services of ACI sections 1.6.4.2 and 1.6.4.3 shall be performed at the Contractor's expense. The Contractor shall be responsible for making concrete test cylinders, storing and protecting concrete cylinders and delivering cylinders to the Owner's testing laboratory.

(BGWS-109)

- C. Testing services of ACI Section 1.6.4.4 shall be paid for by the Contractor. Test shall be made for each 50 cubic yards of concrete and/or each day concrete is placed.

3.03 ADDITIONAL REQUIREMENTS

- A. Unless otherwise directed by the Engineer, the vertical surfaces of footings shall be formed. Excavations and reinforcement for all footings shall have been inspected by the Engineer before any concrete is placed.
- B. The installation of underground and embedded items shall be inspected before slabs are placed. Pipes and conduits shall be installed below the concrete unless otherwise indicated. Fill required to raise the subgrade shall be placed as specified in Section 02300 "Earthwork". Porous fill not less than 6 inches in compacted thickness shall be installed under all slabs, tank bottoms, and foundations. The fill shall be leveled and uniformly compacted to a reasonably true and even surface. The surfaces shall be clean, free from frost, ice, mud and water. Waterproof paper, polyethylene sheeting of nominal 4-mil minimum thickness, or polyethylene-coated burlap shall be laid over all surfaces receiving concrete.
- C. Concrete shall be placed in layers not over 18 inches deep and each layer shall be compacted by mechanical internal-vibrating equipment supplemented by hand spading, rodding and tamping as directed. Vibrators shall not be inserted into lower courses that have begun to set.
- D. Concrete that is truck mixed or transported in truck mixers or truck agitators shall be delivered to the site of the work and discharge completed in the forms within the time specified in Paragraph 10.7 of ASTM C 94 except that when the concrete temperature exceeds 85°F., the time shall be reduced to 45 minutes. Transit-mixed concrete that is completely mixed at the site of concrete placement or batched cement and aggregates transported to mixers shall be placed in the forms within 1-1/2 hours after cement has been added. Concrete shall be placed in the forms within 15 minutes after discharge from the mixer at the job site.
- E. If concrete is placed by pumping, no aluminum shall be used in any parts of the pumping system which contact or might contaminate the concrete. Aluminum chutes and conveyors shall not be used.
- F. All concrete surfaces not in contact with forms shall be moist cured by the application of absorptive mats or double thickness of fabric kept continuously wet. Forms shall be kept continuously wet. Use of other curing methods will not be permitted unless written authorization is received from the Engineer.
- G. The unit of operation shall not exceed 30 feet for tank walls and walls exposed to weather, and 45 feet for other work in any horizontal direction and not less than 48 hours shall elapse between casting of adjoining units unless these requirements are waived by the Engineer. Provision shall be made for jointing successive units as indicated or required to be made at spacing of approximately 25 feet. Additional construction joints required to satisfy the 25 foot spacing shall be located by the Contractor subject to the review of the Engineer. The Contractor shall submit for review drawings separate from the steel reinforcing drawings, showing the location of all proposed construction joints. All construction joints shall be prepared for bonding by roughening the surface of the concrete in an acceptable manner which will expose the aggregate uniformly and will not leave laitance, loosened particles of aggregate or damaged concrete at the surface. Joints in walls and columns shall be maintained level. Concrete shall be placed in layers not over 18 inches deep and each layer shall be compacted by mechanical internal-vibrating equipment supplemented by hand

(BGWS-110)

spading, rodding and tamping as directed. Vibrators shall not be inserted into lower courses that have begun to set.

- H. Formwork for beam soffits and slabs and other parts that support the weight of concrete, shall remain in place until the concrete has reached its specified 28-day strength, unless otherwise specified or permitted.
- I. Concrete Walks and Curbs:
 - 1. Subgrade shall be true and well compacted at the required grades. Spongy and otherwise unsuitable material shall have been removed and replaced with approved material. Concrete walks shall be placed upon porous fill covered with waterproof paper, polyethylene sheeting of nominal 4-mil minimum thickness or polyethylene-coated burlap.
 - 2. Concrete walks shall be not less than 4 inches in thickness. Walks shall have contraction joints every 5 linear feet in each groove in the top surface of the slab to a depth of at least one-fourth the slab thickness with a jointing tool. Transverse expansion joints shall be installed at all returns, driveways, and opposite expansion joints in adjacent curbs. Where curbs are not adjacent, transverse expansion joints shall be installed at intervals of approximately forty (40) feet. Sidewalks shall receive a "broomed" finish. Scoring shall be in a transverse direction. Edges of the sidewalks and joints shall be edged with a tool having a radius not greater than 1/6 inch. Sidewalks adjacent to curbs shall have a slope of 1/4 inch per foot toward the curb. Sidewalks not adjacent to curbs shall have a slope of 1/4 inch per foot. The surface of the concrete shall show no variation in cross section in excess of 1/4 inch in 5 feet. Concrete walks shall be reinforced with 6/6-10/10 welded wire fabric meeting the current AIS requirements.
 - 3. Concrete curbs shall be constructed to the section indicated on the Standard Detail, and all horizontal and vertical curves shall be incorporated as indicated or required. Forms shall be steel as approved by the Engineer. At the option of the Contractor, the curbs may be precast or cast-in-place. Cast-in-place curbs shall be divided into sections 8 to 10 feet in length using steel divider plates. The divider plates shall extend completely through the concrete and shall be removed. Precast curbs shall be cast in lengths of 4 to 5 feet. All exposed surfaces of concrete shall be finished smooth. All sharp edges and the edges of joints and divisions shall be tooled to 1/4 inch radius. Steel reinforcement shall be installed where the curb crosses pipe trenches or other insecure foundations. Such reinforcement shall consist of two (2) No. 4 deformed bars near the bottom of the curb and shall extend at least 24 inches beyond the insecure area. Transverse expansion joints shall be installed at all curb returns and at intervals of approximately 40 feet.

END OF SECTION

N O T I C E

**DEPARTMENT OF THE ARMY
CORPS OF ENGINEERS 404
NATIONWIDE 14 PERMIT AUTHORIZATION
KENTUCKY DIVISION OF WATER 401 WQC**

4-25-2023

PROJECT: McLean County, Item No. 2-8852
KY 56 & KY 1233 Intersection Improvements

The Section 404 & 401 activities for this project have been previously permitted under the authority of the Department of the Army Nationwide Permit No. 14 "Linear Transportation Projects" & Division of Water General Water Quality Certification. In order for these authorizations to be valid, the attached conditions must be followed. The contractor shall post a copy of this Nationwide Permit & General WQC in a conspicuous location at the project site for the duration of construction and comply with the general conditions as required.

Station 519+75

Extend a 4'x4' reinforced concrete box culvert on an U.T. of Mason Creek. The **intermittent** stream will have impacts below the normal high-water mark. The estimated area of impact is **150 linear feet** and **0.01** acres.

This project involves work near and/or within Jurisdictional Waters of the United States as defined by the United States Army Corps of Engineers and therefore requires a Nationwide 14 General 404 Permit. The Division of Water certified this General Permit with several conditions (See attached). One that should be brought to your attention is regarding the use of heavy equipment in the stream channel. If there is need to cross the stream channel with heavy equipment or conduct work from within the stream channel a working platform or temporary crossing is authorized. This should be constructed with clean rock and sufficient pipe to allow stream flow to continue unimpeded (see attached typical drawing).

In order for this authorization to be valid, the attached conditions must be followed. The contractor shall post a copy of this Nationwide Approval in a conspicuous location at the project site for the duration of construction and comply with the general conditions as required.

To more readily expedite construction, the contractor may elect to alter the design or perform the work in a manner different from what was originally proposed and specified. Prior to

commencing such alternative work, the contractor shall obtain **written** permission from the Division of Construction and the Division of Environmental Analysis. If such changes necessitate further permitting then the contractor will be responsible for applying to the Army Corps of Engineers and the Kentucky Division of Water (KDOW). A copy of any request to the Corps of Engineers or the KDOW to alter this proposal and subsequent responses shall be forwarded to the Division of Environmental Analysis, DA Permit Coordinator, for office records and for informational purposes.

KyTC BMP Plan for Project CID ## - #####



Kentucky Transportation Cabinet

Highway District 2 (1)

And

_____ (2), Construction

Kentucky Pollutant Discharge Elimination System

Permit KYR10

Best Management Practices (BMP) plan

Groundwater protection plan

For Highway Construction Activities

For

— (1)

Project: CID ## - #####

KyTC BMP Plan for Project CID ## -

Project information

Note – (1) = Design (2) = Construction (3) = Contractor

1. Owner – Kentucky Transportation Cabinet, District 2 (1)
2. Resident Engineer: (2)
3. Contractor name: (2)
Address: (2)

Phone number: (2)
Contact: (2)
Contractors: agent responsible for compliance with the KPDES permit requirements (3):
4. Project Control Number (2)
5. Route (Address) KY 56 At Intersection of KY 1233 (1)
6. Latitude/Longitude (project mid-point) 37D 37' 27", -87D 23' 34"_ (1)
7. County (project mid-point) McLean (1)
8. Project start date (date work will begin): (2)
9. Projected completion date: (2)

KyTC BMP Plan for Project CID ## -

A. Site description:

1. Nature of Construction Activity (from letting project description) Correct
Line of Sign with Intersection of KY 56 & KY 1233. (1)
2. Order of major soil disturbing activities (2) and (3)
3. Projected volume of material to be moved 29692 CY (1)
4. Estimate of total project area (acres) 3 (1)
5. Estimate of area to be disturbed (acres) 3 (1)
6. Post construction runoff coefficient will be included in the project drainage folder. Persons needing information pertaining to the runoff coefficient will contact the resident engineer to request this information. (1)
7. Data describing existing soil condition (1) & (2) See Geotech report if available. See Roadway Plans.
8. Data describing existing discharge water quality (if any) No existing water quality information available (1) & (2)
9. Receiving water name Mason Creek (1)
10. TMDLs and Pollutants of Concern in Receiving Waters: (1 DEA)
11. Site map – Project layout sheet plus the erosion control sheets in the project plans that depict Disturbed Drainage Areas (DDAs) and related information. These sheets depict the existing project conditions with areas delineated by DDA (drainage area bounded by watershed breaks and right of way limits), the storm water discharge locations (either as a point discharge or as overland flow) and the areas that drain to each discharge point. These plans define the limits of areas to be disturbed and the location of control measures. Controls will be either site specific as designated by the designer or will be annotated by the contractor and resident engineer before disturbance commences. The project layout sheet shows the surface waters and wetlands.
12. Potential sources of pollutants:

The primary source of pollutants is solids that are mobilized during storm events. Other sources of pollutants include oil/fuel/grease from servicing

KyTC BMP Plan for Project CID ## -

and operating construction equipment, concrete washout water, sanitary wastes and trash/debris. (3)

B. Sediment and Erosion Control Measures:

1. Plans for highway construction projects will include erosion control sheets that depict Disturbed Drainage Areas (DDAs) and related information. These plan sheets will show the existing project conditions with areas delineated by DDA within the right of way limits, the discharge points and the areas that drain to each discharge point. Project managers and designers will analyze the DDAs and identify Best Management Practices (BMPs) that are site specific. The balance of the BMPs for the project will be listed in the bid documents for selection and use by the contractor on the project with approval by the resident engineer.

Projects that do not have DDAs annotated on the erosion control sheets will employ the same concepts for development and managing BMP plans.

2. Following award of the contract, the contractor and resident engineer will annotate the erosion control sheets showing location and type of BMPs for each of the DDAs that will be disturbed at the outset of the project. This annotation will be accompanied by an order of work that reflects the order or sequence of major soil moving activities. The remaining DDAs are to be designated as "Do Not Disturb" until the contractor and resident engineer prepare the plan for BMPs to be employed. The initial BMP's shall be for the first phase (generally clearing and grubbing) and shall be modified as needed as the project changes phases. The BMP Plan will be modified to reflect disturbance in additional DDA's as the work progresses. All DDA's will have adequate BMP's in place before being disturbed.
3. As DDAs are prepared for construction, the following will be addressed for the project as a whole or for each DDA as appropriate:
 - Construction Access – This is the first land-disturbing activity. As soon as construction begins, bare areas will be stabilized with gravel and temporary mulch and/or vegetation.
 - At the beginning of the project, all DDAs for the project will be inspected for areas that are a source of storm water pollutants. Areas that are a source of pollutants will receive appropriate cover or BMPs to arrest the introduction of pollutants into storm water.

KyTC BMP Plan for Project CID ## -

Areas that have not been opened by the contractor will be inspected periodically (once per month) to determine if there is a need to employ BMPs to keep pollutants from entering storm water.

- Clearing and Grubbing – The following BMP's will be considered and used where appropriate.
 - Leaving areas undisturbed when possible.
 - Silt basins to provide silt volume for large areas.
 - Silt Traps Type A for small areas.
 - Silt Traps Type C in front of existing and drop inlets which are to be saved
 - Diversion ditches to catch sheet runoff and carry it to basins or traps or to divert it around areas to be disturbed.
 - Brush and/or other barriers to slow and/or divert runoff.
 - Silt fences to catch sheet runoff on short slopes. For longer slopes, multiple rows of silt fence may be considered.
 - Temporary Mulch for areas which are not feasible for the fore mentioned types of protections.
 - Non-standard or innovative methods.
- Cut & Fill and placement of drainage structures - The BMP Plan will be modified to show additional BMP's such as:
 - Silt Traps Type B in ditches and/or drainways as they are completed
 - Silt Traps Type C in front of pipes after they are placed
 - Channel Lining
 - Erosion Control Blanket
 - Temporary mulch and/or seeding for areas where construction activities will be ceased for 21 days or more.
 - Non-standard or innovative methods
- Profile and X-Section in place – The BMP Plan will be modified to show elimination of BMP's which had to be removed and the addition of new BMP's as the roadway was shaped. Probably changes include:
 - Silt Trap Type A, Brush and/or other barriers, Temporary Mulch, and any other BMP which had to be removed for final grading to take place.
 - Additional Silt Traps Type B and Type C to be placed as final drainage patterns are put in place.
 - Additional Channel Lining and/or Erosion Control Blanket.
 - Temporary Mulch for areas where Permanent Seeding and Protection cannot be done within 21 days.
 - Special BMP's such as Karst Policy
- Finish Work (Paving, Seeding, Protect, etc.) – A final BMP Plan will result from modifications during this phase of construction. Probably changes include:

KyTC BMP Plan for Project CID ## -

- Removal of Silt Traps Type B from ditches and drainways if they are protected with other BMP's which are sufficient to control erosion, i.e. Erosion Control Blanket or Permanent Seeding and Protection on moderate grades.
 - Permanent Seeding and Protection
 - Placing Sod
 - Planting trees and/or shrubs where they are included in the project
- BMP's including Storm Water Management Devices such as velocity dissipation devices and Karst policy BMP's to be installed during construction to control the pollutants in storm water discharges that will occur after construction has been completed are : Seeding and Protection, Erosion Control Blanket. (1)

C. Other Control Measures

1. No solid materials, including building materials, shall be discharged to waters of the commonwealth, except as authorized by a Section 404 permit.

2. Waste Materials

All waste materials that may leach pollutants (paint and paint containers, caulk tubes, oil/grease containers, liquids of any kind, soluble materials, etc.) will be collected and stored in appropriate covered waste containers. Waste containers shall be removed from the project site on a sufficiently frequent basis as to not allow wastes to become a source of pollution. All personnel will be instructed regarding the correct procedure for waste disposal. Wastes will be disposed in accordance with appropriate regulations. Notices stating these practices will be posted in the office.

3. Hazardous Waste

All hazardous waste materials will be managed and disposed of in the manner specified by local or state regulation. The contractor shall notify the Section Engineer if there any hazardous wastes being generated at the project site and how these wastes are being managed. Site personnel will be instructed with regard to proper storage and handling of hazardous wastes when required. The Transportation Cabinet will file for generator, registration when appropriate, with the Division of Waste Management and advise the contractor regarding waste management requirements.

4. Spill Prevention

KyTC BMP Plan for Project CID ## -

The following material management practices will be used to reduce the risk of spills or other exposure of materials and substances to the weather and/or runoff.

➤ **Good Housekeeping:**

The following good housekeeping practices will be followed onsite during the construction project.

- An effort will be made to store only enough product required to do the job
- All materials stored onsite will be stored in a neat, orderly manner in their appropriate containers and, if possible, under a roof or other enclosure
- Products will be kept in their original containers with the original manufacturer's label
- Substances will not be mixed with one another unless recommended by the manufacturer
- Whenever possible, all of the product will be used up before disposing of the container
- Manufacturers' recommendations for proper use and disposal will be followed
- The site contractor will inspect daily to ensure proper use and disposal of materials onsite

➤ **Hazardous Products:**

These practices will be used to reduce the risks associated with any and all hazardous materials.

- Products will be kept in original containers unless they are not resealable.
- Original labels and material safety data sheets (MSDS) will be reviewed and retained
- Contractor will follow procedures recommended by the manufacturer when handling hazardous materials
- If surplus product must be disposed of, manufacturers' or state/local recommended methods for proper disposal will be followed

The following product-specific practices will be followed onsite:

➤ **Petroleum Products:**

Vehicles and equipment that are fueled and maintained on site will be monitored for leaks, and receive regular preventative maintenance to reduce the chance of

KyTC BMP Plan for Project CID ## -

leakage. Petroleum products onsite will be stored in tightly sealed containers, which are clearly labeled and will be protected from exposure to weather.

The contractor shall prepare an Oil Pollution Spill Prevention Control and Countermeasure plan when the project that involves the storage of petroleum products in 55 gallon or larger containers with a total combined storage capacity of 1,320 gallons. This is a requirement of 40 CFR 112.

This project (will / will not) (3) have over 1,320 gallons of petroleum products with a total capacity, sum of all containers 55 gallon capacity and larger.

➤ **Fertilizers:**

Fertilizers will be applied at rates prescribed by the contract, standard specifications or as directed by the resident engineer. Once applied, fertilizer will be covered with mulch or blankets or worked into the soil to limit exposure to storm water. Storage will be in a covered shed. The contents of any partially used bags of fertilizer will be transferred to a sealable plastic bin to avoid spills.

➤ **Paints:**

All containers will be tightly sealed and stored indoors or under roof when not being used. Excess paint or paint wash water will not be discharged to the drainage or storm sewer system but will be properly disposed of according to manufacturers' instructions or state and local regulations.

➤ **Concrete Truck Washout:**

Concrete truck mixers and chutes will not be washed on pavement, near storm drain inlets, or within 75 feet of any ditch, stream, wetland, lake, or sinkhole. Where possible, excess concrete and wash water will be discharged to areas prepared for pouring new concrete, flat areas to be paved that are away from ditches or drainage system features, or other locations that will not drain off site. Where this approach is not possible, a shallow earthen wash basin will be excavated away from ditches to receive the wash water

➤ **Spill Control Practices**

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices will be followed for spill prevention and cleanup:

- Manufacturers' recommended methods for spill cleanup will be clearly posted. All personnel will be made aware of procedures and the location of the information and cleanup supplies.

KyTC BMP Plan for Project CID ## -

- Materials and equipment necessary for spill cleanup will be kept in the material storage area. Equipment and materials will include as appropriate, brooms, dust pans, mops, rags, gloves, oil absorbents, sand, sawdust, and plastic and metal trash containers.
- All spills will be cleaned up immediately after discovery.
- The spill area will be kept well ventilated and personnel will wear appropriate protective clothing to prevent injury from contact with a hazardous substance.
- Spills of toxic or hazardous material will be reported to the appropriate state/local agency as required by KRS 224 and applicable federal law.
- The spill prevention plan will be adjusted as needed to prevent spills from reoccurring and improve spill response and cleanup.
- Spills of products will be cleaned up promptly. Wastes from spill clean up will be disposed in accordance with appropriate regulations.

D. Other State and Local Plans

This BMP plan shall include any requirements specified in sediment and erosion control plans, storm water management plans or permits that have been approved by other state or local officials. Upon submittal of the NOI, other requirements for surface water protection are incorporated by reference into and are enforceable under this permit (even if they are not specifically included in this BMP plan). This provision does not apply to master or comprehensive plans, non-enforceable guidelines or technical guidance documents that are not identified in a specific plan or permit issued for the construction site by state or local officials. No other local requirements are being added to this project. (1)

E. Maintenance

1. The BMP plan shall include a clear description of the maintenance procedures necessary to keep the control measures in good and effective operating condition.
- Maintenance of BMPs during construction shall be a result of weekly and post rain event inspections with action being taken by the contractor to correct deficiencies.
 - Post Construction maintenance will be a function of normal highway maintenance operations. Following final project acceptance by the cabinet, district highway crews will be responsible for identification and correction of deficiencies regarding ground cover and cleaning of storm water BMPs. The project manager shall identify any BMPs that will be for the purpose of post construction storm water management with specific guidance for any non-routine maintenance. No features of this project will

KyTC BMP Plan for Project CID ## -

require post construction maintenance over and above normal maintenance procedures. (1)

F. Inspections

Inspection and maintenance practices that will be used to maintain erosion and sediment controls:

- All erosion prevention and sediment control measures will be inspected at least once each week and following any rain of one-half inch or more.
- Inspections will be conducted by individuals that have successfully completed the KEPSC-RI course as required by Section 213.02.02 of the Standard Specifications for Road and Bridge Construction, current edition.
- Inspection reports will be written, signed, dated, and kept on file.
- Areas at final grade will be seeded and mulched within 14 days.
- Areas that are not at final grade where construction has ceased for a period of 21 days or longer and soil stock piles shall receive temporary mulch no later than 14 days from the last construction activity in that area.
- All measures will be maintained in good working order; if a repair is necessary, it will be initiated within 24 hours of being reported.
- Built-up sediment will be removed from behind the silt fence before it has reached halfway up the height of the fence.
- Silt fences will be inspected for bypassing, overtopping, undercutting, depth of sediment, tears, and to ensure attachment to secure posts.
- Sediment basins will be inspected for depth of sediment, and built-up sediment will be removed when it reaches 50 percent of the design capacity and at the end of the job.
- Diversion dikes and berms will be inspected and any breaches promptly repaired. Areas that are eroding or scouring will be repaired and re-seeded / mulched as needed.
- Temporary and permanent seeding and mulching will be inspected for bare spots, washouts, and healthy growth. Bare or eroded areas will be repaired as needed.
- All material storage and equipment servicing areas that involve the management of bulk liquids, fuels, and bulk solids will be inspected weekly for conditions that represent a release or possible release of pollutants to the environment.

G. Non – Storm Water discharges

It is expected that non-storm water discharges may occur from the site during the construction period. Examples of non-storm water discharges include:

- Water from water line flushings.
- Water form cleaning concrete trucks and equipment.
- Pavement wash waters (where no spills or leaks of toxic or hazardous materials have occurred).
- Uncontaminated groundwater and rain water (from dewatering during excavation).

All non-storm water discharges will be directed to the sediment basin or to a filter fence enclosure in a flat vegetated infiltration area or be filtered via another approved commercial product.

H. Groundwater Protection Plan (3)

This plan serves as the groundwater protection plan as required by 401 KAR 5:037.

- Contractors statement: (3)

The following activities, as enumerated by 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan, will or may be may be conducted as part of this construction project:

- _____ 2. (e) land treatment or land disposal of a pollutant;
- _____ 2. (f) Storing, ..., or related handling of hazardous waste, solid waste or special waste, ..., in tanks, drums, or other containers, or in piles, (This does not include wastes managed in a container placed for collection and removal of municipal solid waste for disposal off site);
- _____ 2. (g) Handling of materials in bulk quantities (equal or greater than 55 gallons or 100 pounds net dry weight transported held in an individual container) that, if released to the environment, would be a pollutant;

KyTC BMP Plan for Project CID ## - #####

_____ 2. (j) Storing or related handling of road oils, dust suppressants,, at a central location;

_____ 2. (k) Application or related handling of road oils, dust suppressants or deicing materials, (does not include use of chloride-based deicing materials applied to roads or parking lots);

_____ 2. (m) Installation, construction, operation, or abandonment of wells, bore holes, or core holes, (this does not include bore holes for the purpose of explosive demolition);

Or, check the following only if there are no qualifying activities

_____ There are no activities for this project as listed in 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan.

The contractor is responsible for the preparation of a plan that addresses the

401 KAR 5:037 Section 3. (3) Elements of site specific groundwater protection plan:

- (a) General information about this project is covered in the Project information;
- (b) Activities that require a groundwater protection plan have been identified above;
- (c) Practices that will protect groundwater from pollution are addressed in section C. Other control measures.
- (d) Implementation schedule – all practices required to prevent pollution of groundwater are to be in place prior to conducting the activity;
- (e) Training is required as a part of the ground water protection plan. All employees of the contractor, sub-contractor and resident engineer personnel will be trained to understand the nature and requirements of this plan as they pertain to their job function(s). Training will be accomplished within one week of employment and annually thereafter. A record of training will be maintained by the contractor with a copy provide to the resident engineer.
- (f) Areas of the project and groundwater plan activities will be inspected as part of the weekly sediment and erosion control inspections
- (g) Certification (see signature page.)

KyTC BMP Plan for Project CID ## - ####

Contractor and Resident Engineer Plan certification

The contractor that is responsible for implementing this BMP plan is identified in the Project Information section of this plan.

The following certification applies to all parties that are signatory to this BMP plan:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. Further, this plan complies with the requirements of 401 KAR 5:037. By this certification, the undersigned state that the individuals signing the plan have reviewed the terms of the plan and will implement its provisions as they pertain to ground water protection.

Resident Engineer and Contractor Certification:

(2) Resident Engineer signature

Signed _____ title _____, _____
Typed or printed name² signature

(3) Signed _____ title _____, _____
Typed or printed name¹ signature

1. Contractors Note: to be signed by a person who is the owner, a responsible corporate officer, a general partner or the proprietor or a person designated to have the authority to sign reports by such a person in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601. Reference the Project Control Number (PCN) and KPDES number when one has been issued.
2. KyTC note: to be signed by the Chief District Engineer or a person designated to have the authority to sign reports by such a person (usually the resident engineer) in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601 Reference the Project Control Number (PCN) and KPDES number when one has been issued.

KyTC BMP Plan for Project CID ## - #####

Sub-Contractor Certification

The following sub-contractor shall be made aware of the BMP plan and responsible for implementation of BMPs identified in this plan as follows:

Subcontractor

Name:
Address:
Address:

Phone:

The part of BMP plan this subcontractor is responsible to implement is:

I certify under penalty of law that I understand the terms and conditions of the general Kentucky Pollutant Discharge Elimination System permit that authorizes the storm water discharges, the BMP plan that has been developed to manage the quality of water to be discharged as a result of storm events associated with the construction site activity and management of non-storm water pollutant sources identified as part of this certification.

Signed _____title_____, _____
Typed or printed name¹signature

1. Sub Contractor Note: to be signed by a person who is the owner, a responsible corporate officer, a general partner or the proprietor or a person designated to have the authority to sign reports by such a person in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601. Reference the Project Control Number (PCN) and KPDES number when one has been issued.

N O T I C E

**DEPARTMENT OF THE ARMY
CORPS OF ENGINEERS 404
NATIONWIDE 14 PERMIT AUTHORIZATION
KENTUCKY DIVISION OF WATER 401 WQC**

4-25-2023

PROJECT: McLean County, Item No. 2-8852
KY 56 & KY 1233 Intersection Improvements

The Section 404 & 401 activities for this project have been previously permitted under the authority of the Department of the Army Nationwide Permit No. 14 “Linear Transportation Projects” & Division of Water General Water Quality Certification. In order for these authorizations to be valid, the attached conditions must be followed. The contractor shall post a copy of this Nationwide Permit & General WQC in a conspicuous location at the project site for the duration of construction and comply with the general conditions as required.

Station 519+75

Extend a 4’x4’ reinforced concrete box culvert on an U.T. of Mason Creek. The **intermittent** stream will have impacts below the normal high-water mark. The estimated area of impact is **150 linear feet** and **0.01** acres.

This project involves work near and/or within Jurisdictional Waters of the United States as defined by the United States Army Corps of Engineers and therefore requires a Nationwide 14 General 404 Permit. The Division of Water certified this General Permit with several conditions (See attached). One that should be brought to your attention is regarding the use of heavy equipment in the stream channel. If there is need to cross the stream channel with heavy equipment or conduct work from within the stream channel a working platform or temporary crossing is authorized. This should be constructed with clean rock and sufficient pipe to allow stream flow to continue unimpeded (see attached typical drawing).

In order for this authorization to be valid, the attached conditions must be followed. The contractor shall post a copy of this Nationwide Approval in a conspicuous location at the project site for the duration of construction and comply with the general conditions as required.

To more readily expedite construction, the contractor may elect to alter the design or perform the work in a manner different from what was originally proposed and specified. Prior to

commencing such alternative work, the contractor shall obtain **written** permission from the Division of Construction and the Division of Environmental Analysis. If such changes necessitate further permitting then the contractor will be responsible for applying to the Army Corps of Engineers and the Kentucky Division of Water (KDOW). A copy of any request to the Corps of Engineers or the KDOW to alter this proposal and subsequent responses shall be forwarded to the Division of Environmental Analysis, DA Permit Coordinator, for office records and for informational purposes.

DATE: 04/12/2024 COPI: 0000000000




COMMONWEALTH OF KENTUCKY
DEPARTMENT OF HIGHWAYS



eNOI Map



ITEM NO. COUNTY OF
2-8552.00 MCLENN
DATE: 04/12/2024

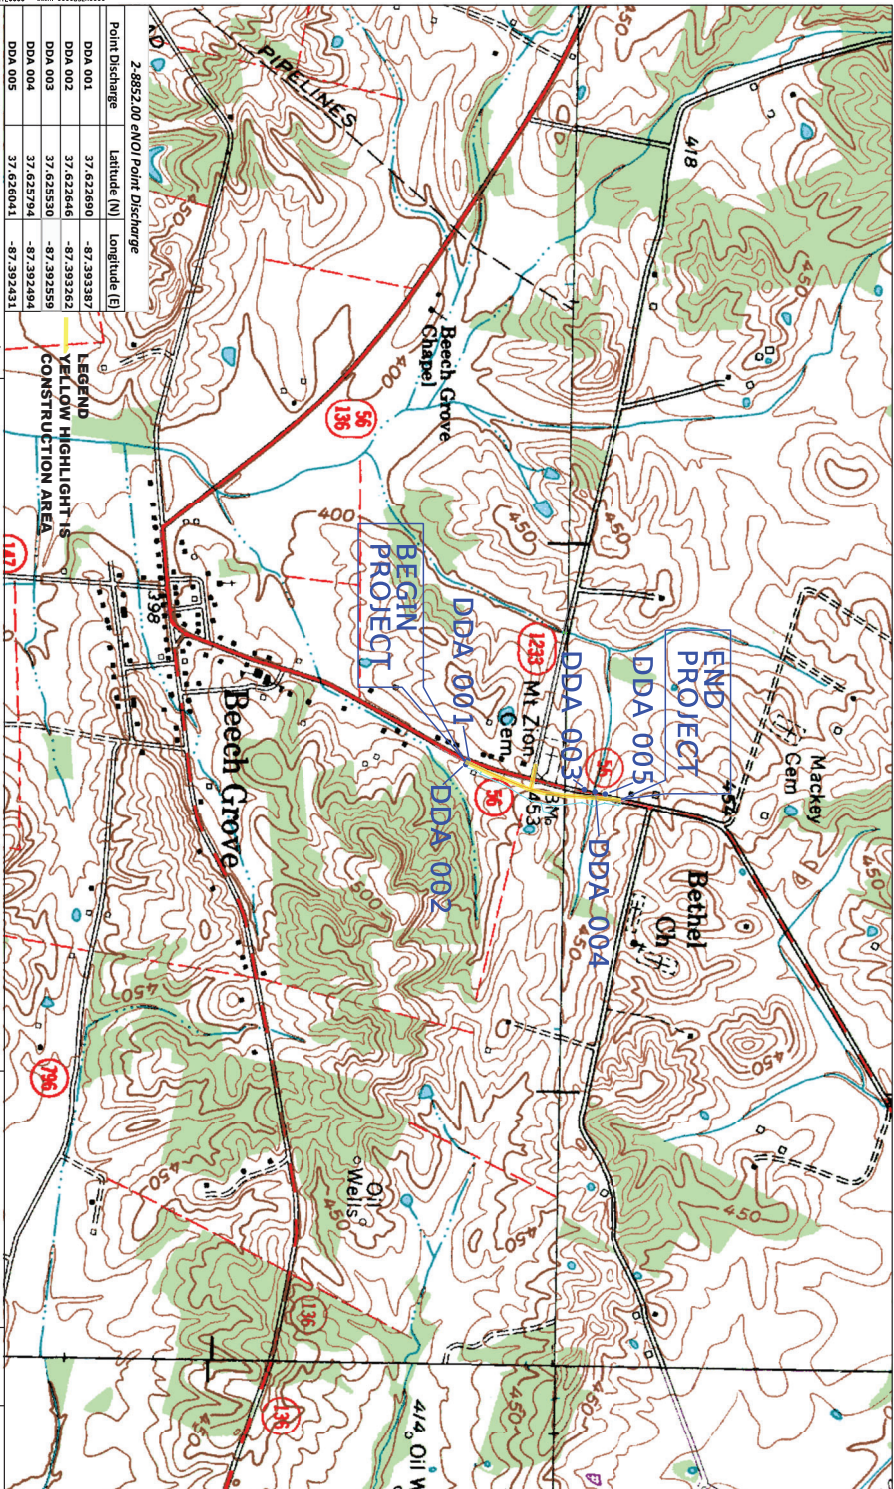

PART II

SPECIFICATIONS AND STANDARD DRAWINGS

STANDARD SPECIFICATIONS

Any reference in the plans or proposal to previous editions of the *Standard Specifications for Road and Bridge Construction* and *Standard Drawings* are superseded by *Standard Specifications for Road and Bridge Construction, Edition of 2019* and *Standard Drawings, Edition of 2020*.

SUPPLEMENTAL SPECIFICATIONS

The contractor shall use the Supplemental Specifications that are effective at the time of letting. The Supplemental Specifications can be found at the following link:
<http://transportation.ky.gov/Construction/Pages/Kentucky-Standard-Specifications.aspx>

SPECIAL NOTE FOR PORTABLE CHANGEABLE MESSAGE SIGNS

This Special Note will apply when indicated on the plans or in the proposal.

1.0 DESCRIPTION. Furnish, install, operate, and maintain variable message signs at the locations shown on the plans or designated by the Engineer. Remove and retain possession of variable message signs when they are no longer needed on the project.

2.0 MATERIALS.

2.1 General. Use LED Variable Message Signs Class I, II, or III, as appropriate, from the Department's List of Approved Materials.

Unclassified signs may be submitted for approval by the Engineer. The Engineer may require a daytime and nighttime demonstration. The Engineer will make a final decision within 30 days after all required information is received.

2.2 Sign and Controls. All signs must:

- 1) Provide 3-line messages with each line being 8 characters long and at least 18 inches tall. Each character comprises 35 pixels.
- 2) Provide at least 40 preprogrammed messages available for use at any time. Provide for quick and easy change of the displayed message; editing of the message; and additions of new messages.
- 3) Provide a controller consisting of:
 - a) Keyboard or keypad.
 - b) Readout that mimics the actual sign display. (When LCD or LCD type readout is used, include backlighting and heating or otherwise arrange for viewing in cold temperatures.)
 - c) Non-volatile memory or suitable memory with battery backup for storing pre-programmed messages.
 - d) Logic circuitry to control the sequence of messages and flash rate.
- 4) Provide a serial interface that is capable of supporting complete remote control ability through land line and cellular telephone operation. Include communication software capable of immediately updating the message, providing complete sign status, and allowing message library queries and updates.
- 5) Allow a single person easily to raise the sign to a satisfactory height above the pavement during use, and lower the sign during travel.
- 6) Be Highway Orange on all exterior surfaces of the trailer, supports, and controller cabinet.
- 7) Provide operation in ambient temperatures from -30 to + 120 degrees Fahrenheit during snow, rain and other inclement weather.
- 8) Provide the driver board as part of a module. All modules are interchangeable, and have plug and socket arrangements for disconnection and reconnection. Printed circuit boards associated with driver boards have a conformable coating to protect against moisture.
- 9) Provide a sign case sealed against rain, snow, dust, insects, etc. The lens is UV stabilized clear plastic (polycarbonate, acrylic, or other approved material) angled to prevent glare.
- 10) Provide a flat black UV protected coating on the sign hardware, character PCB, and appropriate lens areas.
- 11) Provide a photocell control to provide automatic dimming.

- 12) Allow an on-off flashing sequence at an adjustable rate.
- 13) Provide a sight to aim the message.
- 14) Provide a LED display color of approximately 590 nm amber.
- 15) Provide a controller that is password protected.
- 16) Provide a security device that prevents unauthorized individuals from accessing the controller.
- 17) Provide the following 3-line messages preprogrammed and available for use when the sign unit begins operation:

/KEEP/RIGHT/⇒⇒⇒/	/MIN/SPEED/**MPH/
/KEEP/LEFT/⇐⇐⇐/	/ICY/BRIDGE/AHEAD/ /ONE
/LOOSE/GRAVEL/AHEAD/	LANE/BRIDGE/AHEAD/
/RD WORK/NEXT/**MILES/	/ROUGH/ROAD/AHEAD/
/TWO WAY/TRAFFIC/AHEAD/	/MERGING/TRAFFIC/AHEAD/
/PAINT/CREW/AHEAD/	/NEXT/***/MILES/
/REDUCE/SPEED/**MPH/	/HEAVY/TRAFFIC/AHEAD/
/BRIDGE/WORK/***() FT/	/SPEED/LIMIT/**MPH/
/MAX/SPEED/**MPH/	/BUMP/AHEAD/
/SURVEY/PARTY/AHEAD/	/TWO/WAY/TRAFFIC/

*Insert numerals as directed by the Engineer.
Add other messages during the project when required by the Engineer.

2.3 Power.

- 1) Design solar panels to yield 10 percent or greater additional charge than sign consumption. Provide direct wiring for operation of the sign or arrow board from an external power source to provide energy backup for 21 days without sunlight and an on-board system charger with the ability to recharge completely discharged batteries in 24 hours.

3.0 CONSTRUCTION. Furnish and operate the variable message signs as designated on the plans or by the Engineer. Ensure the bottom of the message panel is a minimum of 7 feet above the roadway in urban areas and 5 feet above in rural areas when operating. Use Class I, II, or III signs on roads with a speed limit less than 55 mph. Use Class I or II signs on roads with speed limits 55 mph or greater.

Maintain the sign in proper working order, including repair of any damage done by others, until completion of the project. When the sign becomes inoperative, immediately repair or replace the sign. Repetitive problems with the same unit will be cause for rejection and replacement.

Use only project related messages and messages directed by the Engineer, unnecessary messages lessen the impact of the sign. Ensure the message is displayed in either one or 2 phases with each phase having no more than 3 lines of text. When no message is needed, but it is necessary to know if the sign is operable, flash only a pixel.

When the sign is not needed, move it outside the clear zone or where the Engineer directs. Variable Message Signs are the property of the Contractor and shall be removed from the project when no longer needed. The Department will not assume ownership of these signs.

4.0 MEASUREMENT. The final quantity of Variable Message Sign will be

11
the actual number of individual signs acceptably furnished and operated during the project. The Department will not measure signs replaced due to damage or rejection.

5.0 PAYMENT. The Department will pay for the Variable Message Signs at the unit price each. The Department will not pay for signs replaced due to damage or rejection. Payment is full compensation for furnishing all materials, labor, equipment, and service necessary to, operate, move, repair, and maintain or replace the variable message signs. The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
02671	Portable Changeable Message Sign	Each

Effective June 15, 2012

11N

SPECIAL NOTE FOR LONGITUDINAL PAVEMENT JOINT ADHESIVE

1. **DESCRIPTION.** This specification covers the requirements and practices for applying an asphalt adhesive material to the longitudinal joint of the surface course of an asphalt pavement. Apply the adhesive to the face of longitudinal joint between driving lanes for the first lane paved. Then, place and compact the adjacent lane against the treated face to produce a strong, durable, waterproof longitudinal joint.
2. **MATERIALS, EQUIPMENT, AND PERSONNEL.**

2.1 Joint Adhesive. Provide material conforming to Subsection 2.1.1.

2.1.1 Provide an adhesive conforming to the following requirements:

Property	Specification	Test Procedure
Viscosity, 400 ° F (Pa·s)	4.0 – 10.0	ASTM D 4402
Cone Penetration, 77 ° F	60 – 100	ASTM D 5329
Flow, 140 ° F (mm)	5.0 max.	ASTM D 5329
Resilience, 77 ° F (%)	30 min.	ASTM D 5329
Ductility, 77 ° F (cm)	30.0 min.	ASTM D 113
Ductility, 39 ° F (cm)	30.0 min.	ASTM D 113
Tensile Adhesion, 77 ° F (%)	500 min.	ASTM D 5329, Type II
Softening Point, ° F	171 min.	AASHTO T 53
Asphalt Compatibility	Pass	ASTM D 5329

Ensure the temperature of the pavement joint adhesive is between 380 and 410 °F when the material is extruded in a 0.125-inch-thick band over the entire face of the longitudinal joint.

2.2. Equipment.

2.2.1 Melter Kettle. Provide an oil-jacketed, double-boiler, melter kettle equipped with any needed agitation and recirculating systems.

2.2.2 Applicator System. Provide a pressure-feed-wand applicator system with an applicator shoe attached.

2.3 Personnel. Ensure a technical representative from the manufacturer of the pavement joint adhesive is present during the initial construction activities and available upon the request of the Engineer.

3. **CONSTRUCTION.**

3.1 Surface Preparation. Prior to the application of the pavement joint adhesive, ensure the face of the longitudinal joint is thoroughly dry and free from dust or any other debris that would inhibit adhesion. Clean the joint face by the use of compressed air.

11N

Ensure this preparation process occurs shortly before application to prevent the return of debris on the joint face.

3.2 Pavement Joint Adhesive Application. Ensure the ambient temperature is a minimum of 40 ° F during the application of the pavement joint adhesive. Prior to applying the adhesive, demonstrate competence in applying the adhesive according to this note to the satisfaction of the Engineer. Heat the adhesive in the melter kettle to the specified temperature range. Pump the adhesive from the melter kettle through the wand onto the vertical face of the cold joint. Apply the adhesive in a continuous band over the entire face of the longitudinal joint. Do not use excessive material in either thickness or location. Ensure the edge of the extruded adhesive material is flush with the surface of the pavement. Then, place and compact the adjacent lane against the joint face. Remove any excessive material extruded from the joint after compaction (a small line of material may remain).

3.3 Pavement Joint Adhesive Certification. Furnish the joint adhesive's certification to the Engineer stating the material conforms to all requirements herein prior to use.

3.4 Sampling and Testing. The Department will require a random sample of pavement joint adhesive from each manufacturer's lot of material. Extrude two 5 lb. samples of the heated material and forward the sample to the Division of Materials for testing. Reynolds oven bags, turkey size, placed inside small cardboard boxes or cement cylinder molds have been found suitable. Ensure the product temperature is 400°F or below at the time of sampling.

4. MEASUREMENT. The Department will measure the quantity of Pavement Joint Adhesive in linear feet. The Department will not measure for payment any extra materials, labor, methods, equipment, or construction techniques used to satisfy the requirements of this note. The Department will not measure for payment any trial applications of Pavement Joint Adhesive, the cleaning of the joint face, or furnishing and placing the adhesive. The Department will consider all such items incidental to the Pavement Joint Adhesive.
5. PAYMENT. The Department will pay for the Pavement Joint Adhesive at the Contract unit bid price and apply an adjustment for each manufacturer's lot of material based on the degree of compliance as defined in the following schedule. When a sample fails on two or more tests, the Department may add the deductions, but the total deduction will not exceed 100 percent.

11N

Pavement Joint Adhesive Price Adjustment Schedule						
Test	Specification	100% Pay	90% Pay	80% Pay	50% Pay	0% Pay
Joint Adhesive Referenced in Subsection 2.1.1						
Viscosity, 400 ° F (Pa•s)			3.0-3.4	2.5-2.9	2.0-2.4	≤1.9
ASTM D 3236	4.0-10.0	3.5-10.5	10.6-11.0	11.1-11.5	11.6-12.0	≥ 12.1
Cone Penetration, 77 ° F			54-56	51-53	48-50	≤ 47
ASTM D 5329	60-100	57-103	104-106	107-109	110-112	≥ 113
Flow, 140 ° F (mm) ASTM D 5329	≤ 5.0	≤ 5.5	5.6-6.0	6.1-6.5	6.6-7.0	≥ 7.1
Resilience, 77 ° F (%) ASTM D 5329	≥ 30	≥ 28	26-27	24-25	22-23	≤ 21
Tensile Adhesion, 77 ° F (%) ASTM D 5329	≥ 500	≥ 490	480-489	470-479	460-469	≤ 459
Softening Point, ° F AASHTO T 53	≥ 171	≥ 169	166-168	163-165	160-162	≤ 159
Ductility, 77 ° F (cm) ASTM D 113	≥ 30.0	≥ 29.0	28.0-28.9	27.0-27.9	26.0-26.9	≤ 25.9
Ductility, 39 ° F (cm) ASTM D 113	≥ 30.0	≥ 29.0	28.0-28.9	27.0-27.9	26.0-26.9	≤ 25.9

Code
20071EC

Pay Item
Joint Adhesive

Pay Unit
Linear Foot

May 7, 2014

PART III

EMPLOYMENT, WAGE AND RECORD REQUIREMENTS

**TRANSPORTATION CABINET
DEPARTMENT OF HIGHWAYS**

**LABOR AND WAGE REQUIREMENTS
APPLICABLE TO OTHER THAN FEDERAL-AID SYSTEM PROJECTS**

- I. Application
- II. Nondiscrimination of Employees (KRS 344)

I. APPLICATION

1. These contract provisions shall apply to all work performed on the contract by the contractor with his own organization and with the assistance of workmen under his immediate superintendence and to all work performed on the contract by piecework, station work or by subcontract. The contractor's organization shall be construed to include only workmen employed and paid directly by the contractor and equipment owned or rented by him, with or without operators.

2. The contractor shall insert in each of his subcontracts all of the stipulations contained in these Required Provisions and such other stipulations as may be required.

3. A breach of any of the stipulations contained in these Required Provisions may be grounds for termination of the contract.

3. If the contractor is in control of apprenticeship or other training or retraining, including on-the-job training programs, he shall not discriminate against an individual because of his race, color, religion, national origin, sex, disability or age forty (40) and over, in admission to, or employment in any program established to provide apprenticeship or other training.

4. The contractor will send to each labor union or representative of workers with which he has a collective bargaining agreement or other contract or understanding, a notice to be provided advising the said labor union or workers' representative of the contractor's commitments under this section, and shall post copies of the notice in conspicuous places available to employees and applicants for employment. The contractor will take such action with respect to any subcontract or purchase order as the administering agency may direct as a means of enforcing such provisions, including sanctions for non-compliance.

Revised: January 25, 2017

II. NONDISCRIMINATION OF EMPLOYEES

**AN ACT OF THE KENTUCKY
GENERAL ASSEMBLY TO PREVENT
DISCRIMINATION IN EMPLOYMENT
KRS CHAPTER 344
EFFECTIVE JUNE 16, 1972**

The contract on this project, in accordance with KRS Chapter 344, provides that during the performance of this contract, the contractor agrees as follows:

1. The contractor shall not fail or refuse to hire, or shall not discharge any individual, or otherwise discriminate against an individual with respect to his compensation, terms, conditions, or privileges of employment, because of such individual's race, color, religion, national origin, sex, disability or age (forty and above); or limit, segregate, or classify his employees in any way which would deprive or tend to deprive an individual of employment opportunities or otherwise adversely affect his status as an employee, because of such individual's race, color, religion, national origin, sex, disability or age forty (40) and over. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided setting forth the provisions of this nondiscrimination clause.

2. The contractor shall not print or publish or cause to be printed or published a notice or advertisement relating to employment by such an employer or membership in or any classification or referral for employment by the employment agency, indicating any preference, limitation, specification, or discrimination, based on race, color, religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, except that such a notice or advertisement may indicate a preference, limitation, or specification based on religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, when religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, is a bona fide occupational qualification for employment.

EXECUTIVE BRANCH CODE OF ETHICS

In the 1992 regular legislative session, the General Assembly passed and Governor Brereton Jones signed Senate Bill 63 (codified as KRS 11A), the Executive Branch Code of Ethics, which states, in part:

KRS 11A.040 (7) provides:

No present or former public servant shall, within six (6) months following termination of his office or employment, accept employment, compensation, or other economic benefit from any person or business that contracts or does business with, or is regulated by, the state in matters in which he was directly involved during the last thirty-six (36) months of his tenure. This provision shall not prohibit an individual from returning to the same business, firm, occupation, or profession in which he was involved prior to taking office or beginning his term of employment, or for which he received, prior to his state employment, a professional degree or license, provided that, for a period of six (6) months, he personally refrains from working on any matter in which he was directly involved during the last thirty-six (36) months of his tenure in state government. This subsection shall not prohibit the performance of ministerial functions, including but not limited to filing tax returns, filing applications for permits or licenses, or filing incorporation papers, nor shall it prohibit the former officer or public servant from receiving public funds disbursed through entitlement programs.

KRS 11A.040 (9) states:

A former public servant shall not represent a person or business before a state agency in a matter in which the former public servant was directly involved during the last thirty-six (36) months of his tenure, for a period of one (1) year after the latter of:

- a) The date of leaving office or termination of employment; or
- b) The date the term of office expires to which the public servant was elected.

This law is intended to promote public confidence in the integrity of state government and to declare as public policy the idea that state employees should view their work as a public trust and not as a way to obtain private benefits.

If you have worked for the executive branch of state government within the past six months, you may be subject to the law's prohibitions. The law's applicability may be different if you hold elected office or are contemplating representation of another before a state agency.

Also, if you are affiliated with a firm which does business with the state and which employs former state executive-branch employees, you should be aware that the law may apply to them.

In case of doubt, the law permits you to request an advisory opinion from the Executive Branch Ethics Commission, 1025 Capital Center Drive, Suite 104, Frankfort, Kentucky 40601; telephone (502) 564-7954.

Revised: May 23, 2022

Kentucky Equal Employment Opportunity Act of 1978

The requirements of the Kentucky Equal Employment Opportunity Act of 1978 (KRS 45.560-45.640) shall apply to this Contract. The apparent low Bidder will be required to submit EEO forms to the Division of Construction Procurement, which will then forward to the Finance and Administration Cabinet for review and approval. No award will become effective until all forms are submitted and EEO/CC has certified compliance. The required EEO forms are as follows:

- EEO-1: Employer Information Report
- Affidavit of Intent to Comply
- Employee Data Sheet
- Subcontractor Report

These forms are available on the Finance and Administration's web page under ***Vendor Information, Standard Attachments and General Terms*** at the following address:
<https://www.eProcurement.ky.gov>.

Bidders currently certified as being in compliance by the Finance and Administration Cabinet may submit a copy of their approval letter in lieu of the referenced EEO forms.

For questions or assistance please contact the Finance and Administration Cabinet by email at **finance.contractcompliance@ky.gov** or by phone at 502-564-2874.

EMPLOYEE RIGHTS UNDER THE FAIR LABOR STANDARDS ACT

THE UNITED STATES DEPARTMENT OF LABOR WAGE AND HOUR DIVISION

FEDERAL MINIMUM WAGE

\$7.25

 PER HOUR

BEGINNING JULY 24, 2009

OVERTIME PAY

At least $1\frac{1}{2}$ times your regular rate of pay for all hours worked over 40 in a workweek.

CHILD LABOR

An employee must be at least **16** years old to work in most non-farm jobs and at least **18** to work in non-farm jobs declared hazardous by the Secretary of Labor.

Youths **14** and **15** years old may work outside school hours in various non-manufacturing, non-mining, non-hazardous jobs under the following conditions:

No more than

- **3** hours on a school day or **18** hours in a school week;
- **8** hours on a non-school day or **40** hours in a non-school week.

Also, work may not begin before **7 a.m.** or end after **7 p.m.**, except from June 1 through Labor Day, when evening hours are extended to **9 p.m.** Different rules apply in agricultural employment.

TIP CREDIT

Employers of "tipped employees" must pay a cash wage of at least \$2.13 per hour if they claim a tip credit against their minimum wage obligation. If an employee's tips combined with the employer's cash wage of at least \$2.13 per hour do not equal the minimum hourly wage, the employer must make up the difference. Certain other conditions must also be met.

ENFORCEMENT

The Department of Labor may recover back wages either administratively or through court action, for the employees that have been underpaid in violation of the law. Violations may result in civil or criminal action.

Employers may be assessed civil money penalties of up to \$1,100 for each willful or repeated violation of the minimum wage or overtime pay provisions of the law and up to \$11,000 for each employee who is the subject of a violation of the Act's child labor provisions. In addition, a civil money penalty of up to \$50,000 may be assessed for each child labor violation that causes the death or serious injury of any minor employee, and such assessments may be doubled, up to \$100,000, when the violations are determined to be willful or repeated. The law also prohibits discriminating against or discharging workers who file a complaint or participate in any proceeding under the Act.

ADDITIONAL INFORMATION

- Certain occupations and establishments are exempt from the minimum wage and/or overtime pay provisions.
- Special provisions apply to workers in American Samoa and the Commonwealth of the Northern Mariana Islands.
- Some state laws provide greater employee protections; employers must comply with both.
- The law requires employers to display this poster where employees can readily see it.
- Employees under 20 years of age may be paid \$4.25 per hour during their first 90 consecutive calendar days of employment with an employer.
- Certain full-time students, student learners, apprentices, and workers with disabilities may be paid less than the minimum wage under special certificates issued by the Department of Labor.

For additional information:



1-866-4-USWAGE

(1-866-487-9243)

TTY: 1-877-889-5627



WWW.WAGEHOUR.DOL.GOV

PART IV

INSURANCE

Refer to
Kentucky Standard Specifications for Road and Bridge Construction,
current edition

PART V

BID ITEMS

PART IV

BID ITEMS

Section: 0001 - PAVING

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0010	00003		CRUSHED STONE BASE	1,705.00	TON		\$	
0020	00078		CRUSHED AGGREGATE SIZE NO 2	2,957.00	TON		\$	
0030	00100		ASPHALT SEAL AGGREGATE	28.00	TON		\$	
0040	00103		ASPHALT SEAL COAT	5.00	TON		\$	
0050	00190		LEVELING & WEDGING PG64-22	19.00	TON		\$	
0060	00221		CL2 ASPH BASE 0.75D PG64-22	1,119.00	TON		\$	
0070	00309		CL2 ASPH SURF 0.50D PG64-22	482.00	TON		\$	
0080	00356		ASPHALT MATERIAL FOR TACK	7.00	TON		\$	
0090	20071EC		JOINT ADHESIVE	3,200.00	LF		\$	

Section: 0002 - ROADWAY

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0100	01000		PERFORATED PIPE-4 IN	54.00	LF		\$	
0110	01010		NON-PERFORATED PIPE-4 IN	20.00	LF		\$	
0120	01028		PERF PIPE HEADWALL TY 3-4 IN	2.00	EACH		\$	
0130	02091		REMOVE PAVEMENT	45.00	SQYD		\$	
0140	02159		TEMP DITCH	750.00	LF		\$	
0150	02160		CLEAN TEMP DITCH	375.00	LF		\$	
0160	02200		ROADWAY EXCAVATION	30,520.00	CUYD		\$	
0170	02242		WATER	60.00	MGAL		\$	
0180	02429		RIGHT-OF-WAY MONUMENT TYPE 1	12.00	EACH		\$	
0190	02432		WITNESS POST	3.00	EACH		\$	
0200	02475		PLUG WATER WELL	1.00	EACH		\$	
0210	02483		CHANNEL LINING CLASS II	255.00	TON		\$	
0220	02545		CLEARING AND GRUBBING 3 ACRES	1.00	LS		\$	
0230	02562		TEMPORARY SIGNS	150.00	SQFT		\$	
0240	02585		EDGE KEY	62.00	LF		\$	
0250	02602		FABRIC-GEOTEXTILE CLASS 1	4,032.00	SQYD		\$	
0260	02604		FABRIC-GEOTEXTILE CLASS 1A	4,032.00	SQYD		\$	
0270	02607		FABRIC-GEOTEXTILE CLASS 2 FOR PIPE	363.00	SQYD	\$2.00	\$	\$726.00
0280	02650		MAINTAIN & CONTROL TRAFFIC	1.00	LS		\$	
0290	02671		PORTABLE CHANGEABLE MESSAGE SIGN	2.00	EACH		\$	
0300	02690		SAFELOADING	8.25	CUYD		\$	
0310	02697		EDGE LINE RUMBLE STRIPS	2,867.00	LF		\$	
0320	02701		TEMP SILT FENCE	750.00	LF		\$	
0330	02703		SILT TRAP TYPE A	3.00	EACH		\$	
0340	02704		SILT TRAP TYPE B	3.00	EACH		\$	
0350	02705		SILT TRAP TYPE C	3.00	EACH		\$	
0360	02706		CLEAN SILT TRAP TYPE A	3.00	EACH		\$	
0370	02707		CLEAN SILT TRAP TYPE B	3.00	EACH		\$	
0380	02708		CLEAN SILT TRAP TYPE C	3.00	EACH		\$	
0390	02726		STAKING 1% TOTAL PROJECT COST	1.00	LS		\$	
0400	05950		EROSION CONTROL BLANKET	1,242.00	SQYD		\$	

Report Date 12/26/24

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0410	05952		TEMP MULCH	9,200.00	SQYD		\$	
0420	05953		TEMP SEEDING AND PROTECTION	6,900.00	SQYD		\$	
0430	05963		INITIAL FERTILIZER	.60	TON		\$	
0440	05964		MAINTENANCE FERTILIZER	1.10	TON		\$	
0450	05985		SEEDING AND PROTECTION	20,300.00	SQYD		\$	
0460	05992		AGRICULTURAL LIMESTONE	9.00	TON		\$	
0470	06510		PAVE STRIPING-TEMP PAINT-4 IN	1,535.00	LF		\$	
0480	06515		PAVE STRIPING-PERM PAINT-6 IN	5,129.00	LF		\$	
0490	06568		PAVE MARKING-THERMO STOP BAR-24IN	9.00	LF		\$	
0500	10020NS		FUEL ADJUSTMENT	4,945.00	DOLL	\$1.00	\$	\$4,945.00
0510	20071EC		JOINT ADHESIVE	3,200.00	LF		\$	
0520	20166ES810		TEMPORARY PIPE	100.00	LF		\$	
0530	20458ES403		CENTERLINE RUMBLE STRIPS	1,500.00	LF		\$	
0540	21134ND		REMOVE-STORE AND REINSTALL SIGN	17.00	EACH		\$	
0550	21289ED		LONGITUDINAL EDGE KEY	330.00	LF		\$	

Section: 0003 - DRAINAGE

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0560	00441		ENTRANCE PIPE-18 IN	236.00	LF		\$	
0570	26131ED		SLOPED AND MITERED HEADWALL-18 IN	10.00	EACH		\$	

Section: 0004 - BRIDGE-CULVERT

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0580	02403		REMOVE CONCRETE MASONRY	1.00	CUYD		\$	
0590	08002		STRUCTURE EXCAV-SOLID ROCK	13.00	CUYD		\$	
0600	08003		FOUNDATION PREPARATION	1.00	LS		\$	
0610	08100		CONCRETE-CLASS A	37.10	CUYD		\$	
0620	08150		STEEL REINFORCEMENT	3,695.00	LB		\$	

Section: 0005 - WATERLINE

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0630	14000		W AIR RELEASE VALVE 1 INCH	1.00	EACH		\$	
0640	14003		W CAP EXISTING MAIN	3.00	EACH		\$	
0650	14004		W DIRECTIONAL BORE	100.00	LF		\$	
0660	14022		W FLUSH HYDRANT ASSEMBLY	2.00	EACH		\$	
0670	14057		W PIPE PVC 03 INCH	15.00	LF		\$	
0680	14059		W PIPE PVC 06 INCH	1,155.00	LF		\$	
0690	14066		W PIPE PVC SPECIAL	100.00	LF		\$	
0700	14092		W TIE-IN 03 INCH	1.00	EACH		\$	
0710	14094		W TIE-IN 06 INCH	3.00	EACH		\$	
0720	14103		W VALVE 03 INCH	1.00	EACH		\$	
0730	14105		W VALVE 06 INCH	8.00	EACH		\$	
0740	14177		W VALVE BOX REMOVE	5.00	EACH		\$	

Report Date 12/26/24

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0750	14506		W ENCASEMENT STEEL OPEN CUT RANGE 3 INST	78.00	LF		\$	

Section: 0006 - DEMOBILIZATION AND/OR MOBILIZATION

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0760	02569		DEMOBILIZATION	1.00	LS		\$	