


GRADING AT BULLNOSE

~ NOTES ~

- 400 MINIMUM WORKING WIDTH 4'-2".
 GRADING FROM POST 1 TO POST 13 AND THE 60' LEADING OR TRAILING THE THRIE BEAM TERMINAL SHALL BE 10:1 OR FLATTER.
 GRADING BEYOND POST 13 MAY BE ADJUSTED FOR DRAINAGE, PROVIDED THERE IS A MINIMUM OF 2 FEET OF FILL BEHIND THE POSTS TO ENSURE ADEQUATE SUPPORT FOR THE SYSTEM.
- 401 FIXED OBJECT OR OTHER OBSTACLE.
- 402 EVALUATE MEDIAN DRAINAGE AND ENSURE POSITIVE FLOW. INCLUDE A DROP BOX INLET AND PIPING AS NEEDED, AND ENSURE THAT ALL NECESSARY BID ITEMS ARE INCLUDED.
- 403 WHILE MEDIAN GRADING DETAIL DEPICTS SYMMETRICAL THRIE BEAM BULLNOSE TERMINAL, ALL GRADING REQUIREMENTS APPLY TO ASYMMETRICAL SITUATIONS ALSO.
- 404 GRADING QUANTITIES MUST BE CALCULATED AND SHOWN AS BID ITEMS.

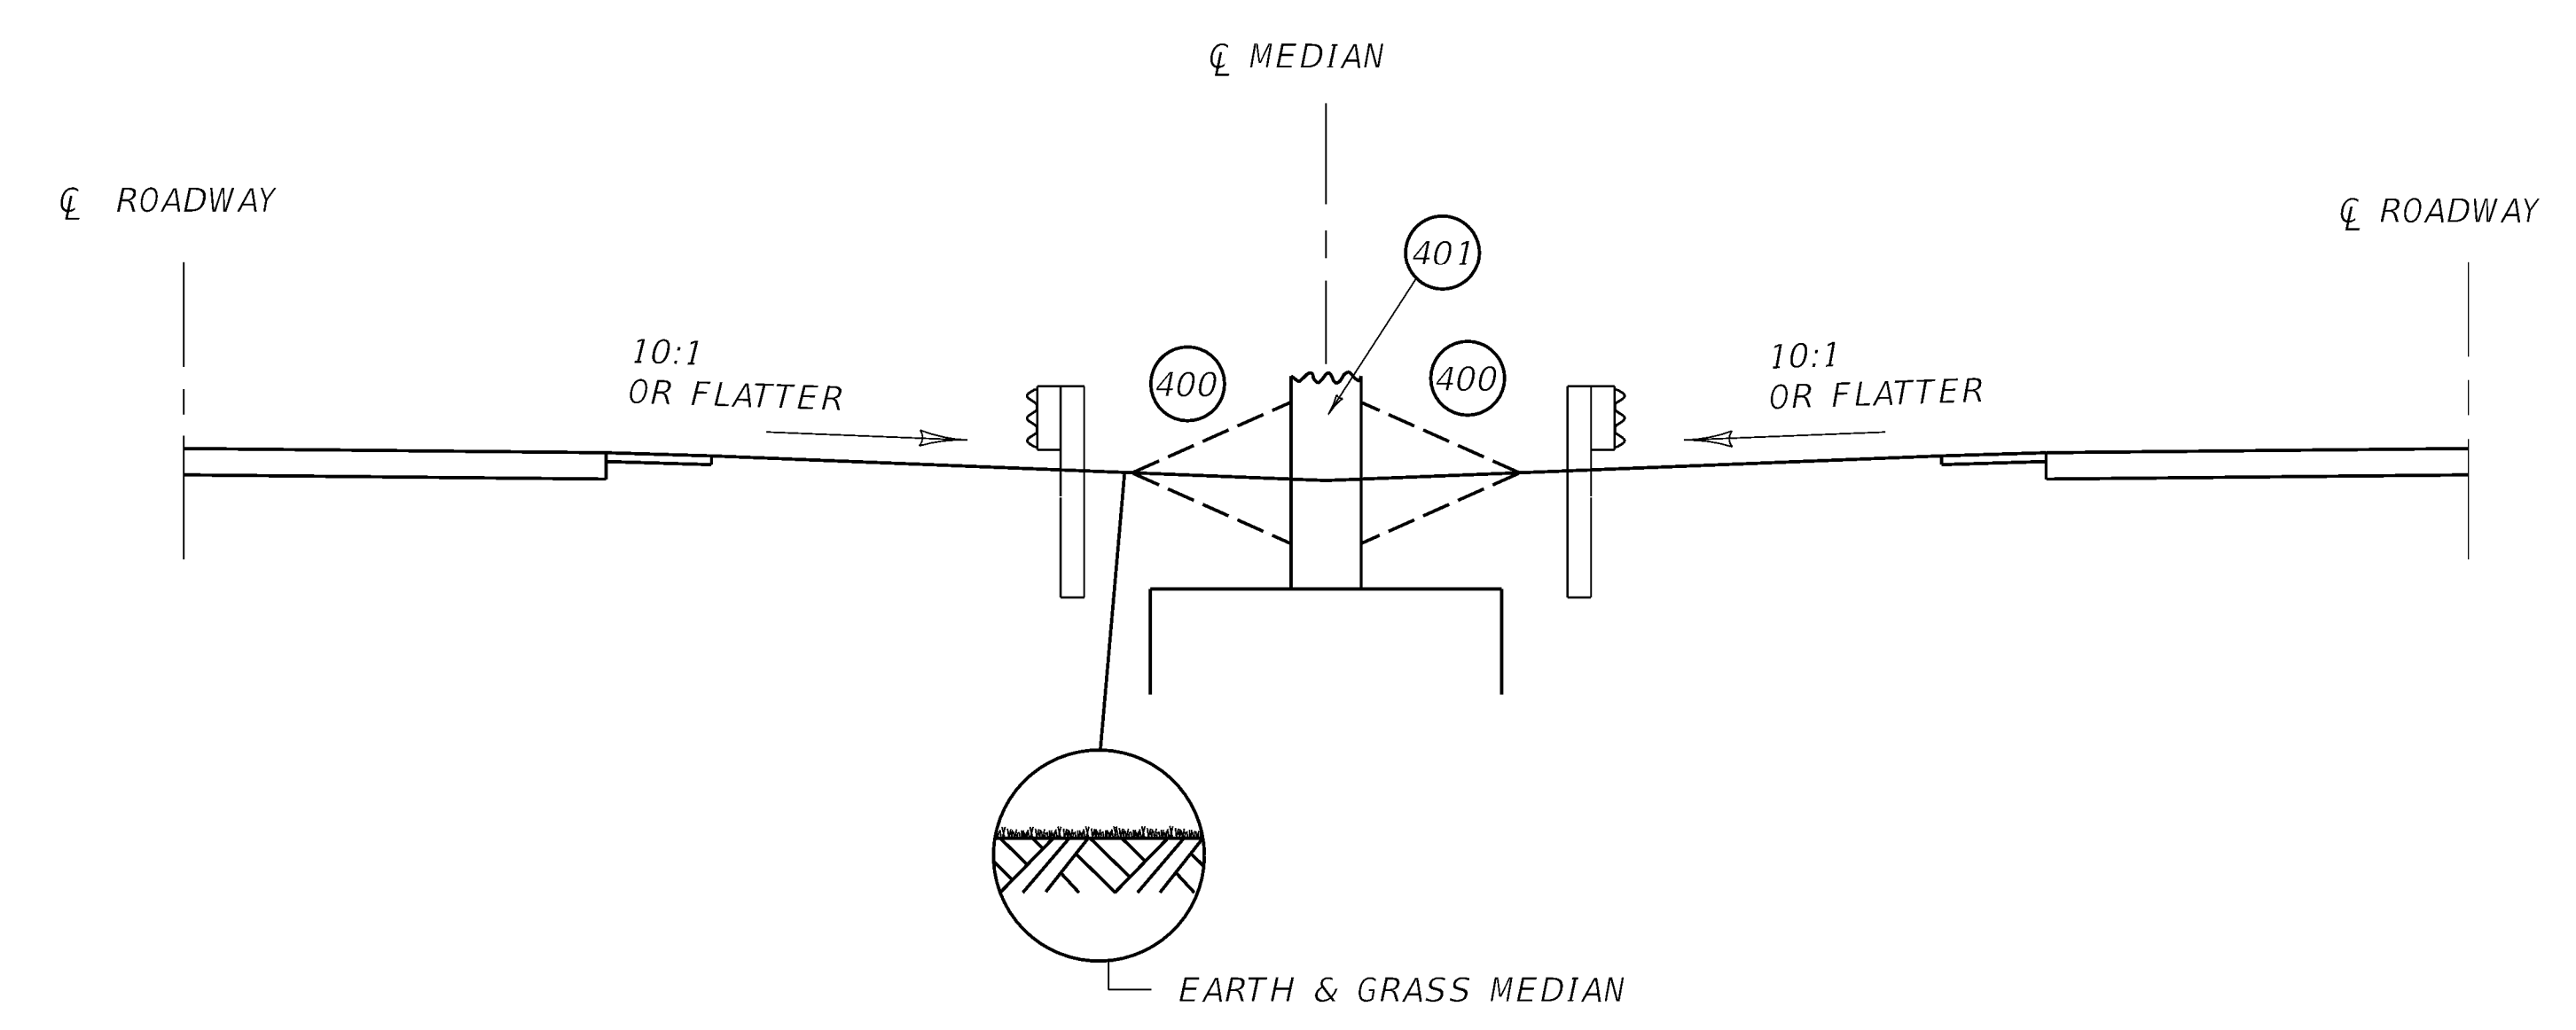

CROSS SECTION AT BULLNOSE

BARRIERS