

OVERHEAD UTILITY ENCROACHMENT DIAGRAM FOR FULLY CONTROLLED HIGHWAYS

County: _____

Minimum Clearance to Roadway: _____


Highway Route: _____

Type of Utility Crossing: _____

Mile Point: _____

Voltage of Line: _____

KYTC KEPT #:

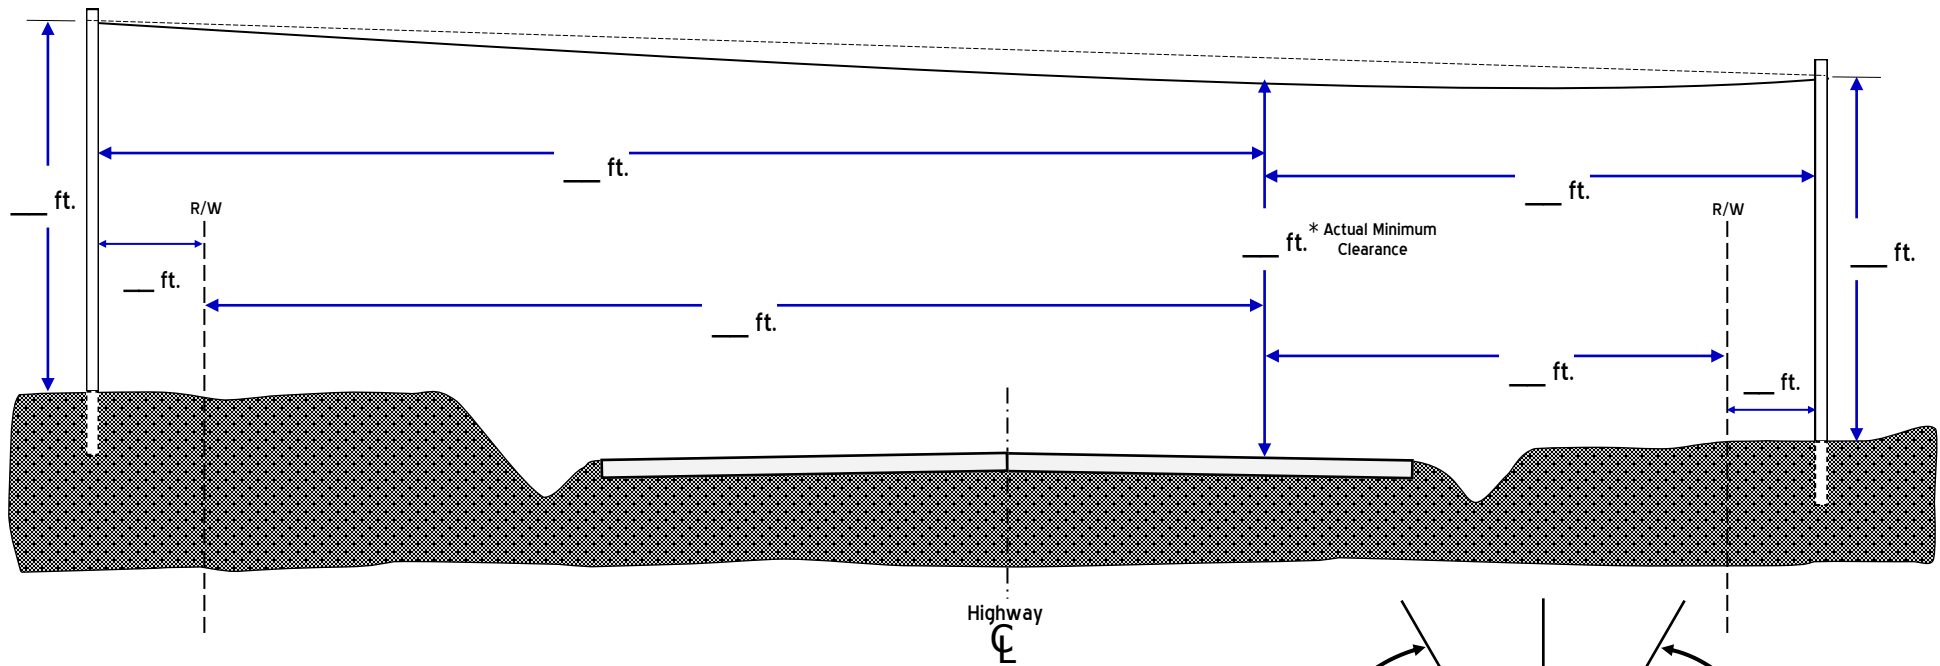

GENERAL NOTES - For Fully Controlled Access Highways:

- The vertical clearance of overhead utility lines crossing shall be a minimum of **24 feet** or greater per NESC guidelines or other applicable codes.
- The plans shall include a statement that the facility, as proposed, meets National Electrical Safety Code (NESC) Grade "B" - Heavy Loading standards and all Department permit requirements identified in the Kentucky Transportation Cabinet's Permits Manual policy PE-302, Utilities - "Installations on Fully Controlled Access Highways."

