



## OVERHEAD UTILITY ENCROACHMENT DIAGRAM FOR FULLY CONTROLLED HIGHWAYS

County: \_\_\_\_\_

Minimum Clearance to Roadway: \_\_\_\_\_


Highway Route: \_\_\_\_\_

Type of Utility Crossing: \_\_\_\_\_

Mile Point: \_\_\_\_\_

Voltage of Line: \_\_\_\_\_

<b>KYTC KEPT #:</b>

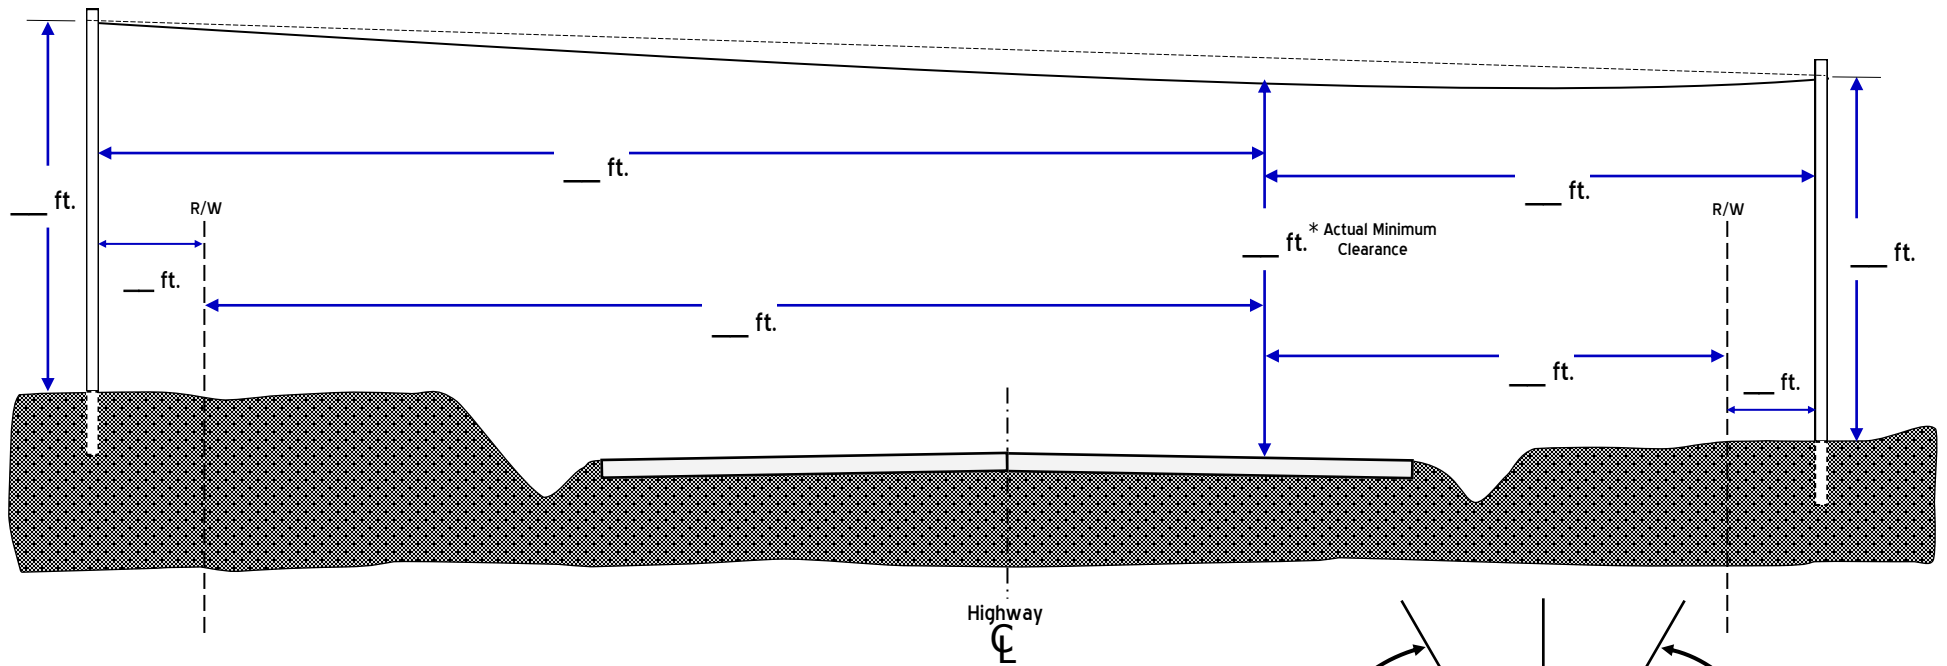

### GENERAL NOTES - For Fully Controlled Access Highways:

- The vertical clearance of overhead utility lines crossing shall be a minimum of **24 feet** or greater per NESC guidelines or other applicable codes.
- Must include Licensed Professional Engineer certification that crossing meets NESC Grade B Heavy Loading construction standards.

