



OVERHEAD UTILITY ENCROACHMENT DIAGRAM FOR NON-FULLY CONTROLLED HIGHWAYS

County: _____

Minimum Clearance to Roadway: _____


Highway Route: _____

Type of Utility Crossing: _____

Mile Point: _____

Voltage of Line: _____

| |
|---------------------|
| KYTC KEPT #: |
| |

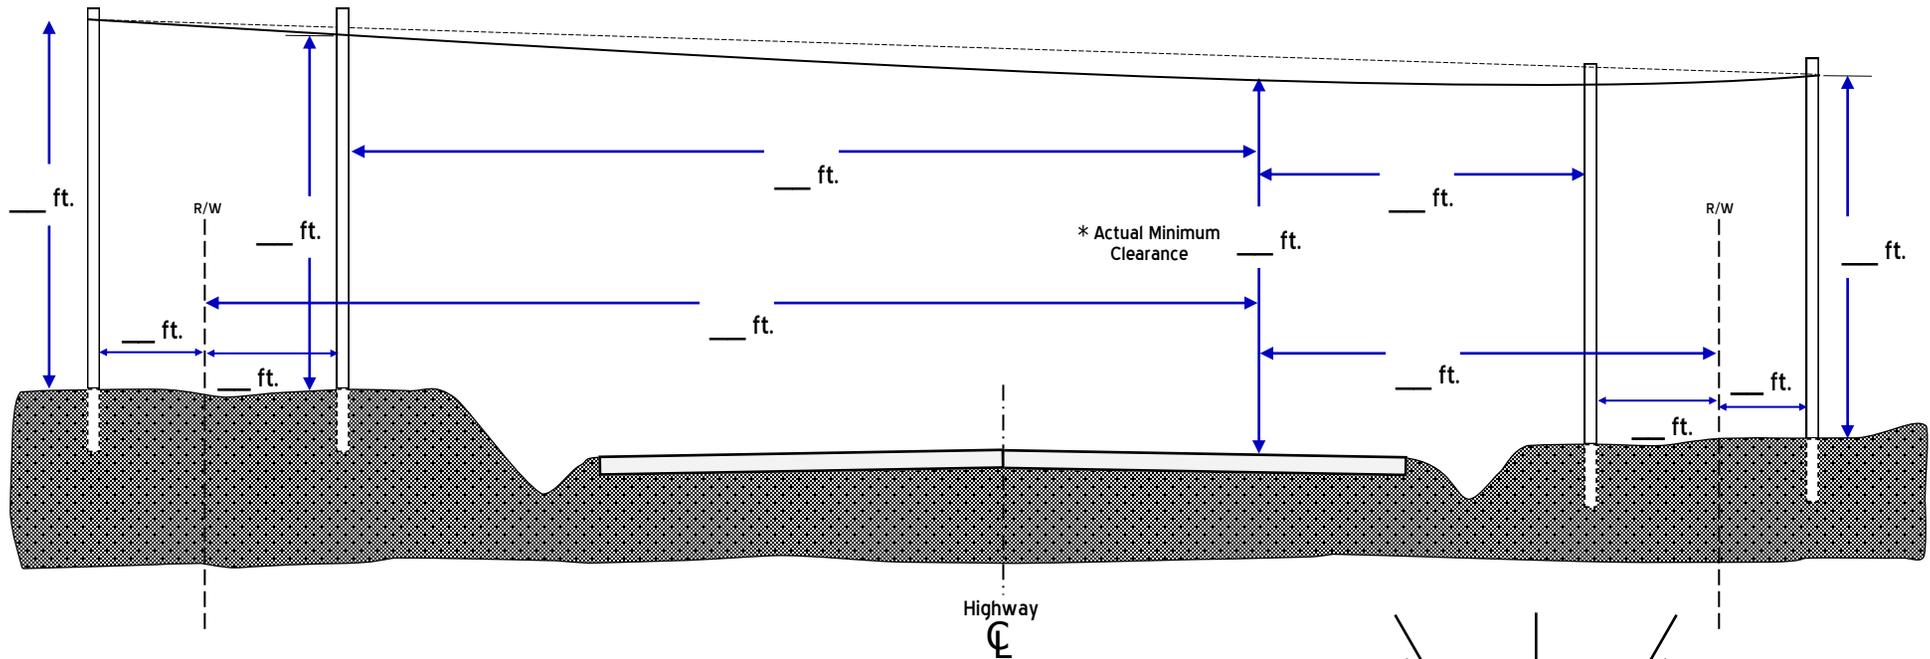

GENERAL NOTES - For Non-Fully Controlled Access Highways:

- The vertical clearance of overhead utility lines crossing shall be a minimum of **18 feet** or greater per NESC guidelines or other applicable codes.

