


CULVERT PIPE REPLACEMENT DETAIL



CULVERT PIPE REPLACEMENTS - INITIAL BACKFILL

Culvert Pipe Replacements shall be constructed according to the Initial Backfill Detail shown above, or as directed by the Engineer. Allow the asphalt base to be exposed to traffic a minimum of 14 days to allow for settlement. After the 14 day waiting period, mill and inlay 1.25 inches of asphalt surface according to the detail below.

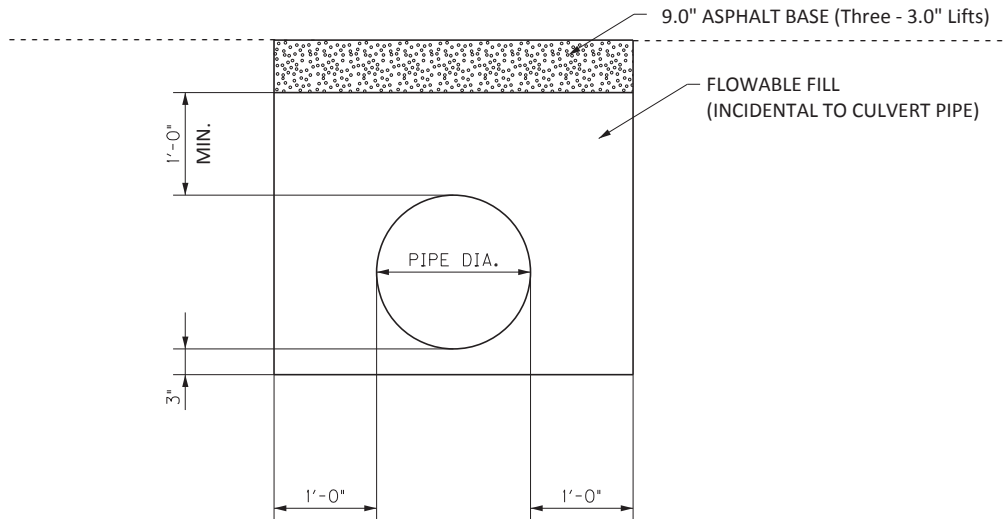