



CALL NO. 302

CONTRACT ID. 191014

KENTON COUNTY

FED/STATE PROJECT NUMBER FD04 059 0025 009-010

DESCRIPTION DIXIE HIGHWAY(US-25)

WORK TYPE GRADE & DRAIN WITH ASPHALT SURFACE

PRIMARY COMPLETION DATE 8/1/2019

LETTING DATE: March 22,2019

Sealed Bids will be received electronically through the Bid Express bidding service until 10:00 AM EASTERN DAYLIGHT TIME March 22,2019. Bids will be publicly announced at 10:00 AM EASTERN DAYLIGHT TIME.

PLANS AVAILABLE FOR THIS PROJECT.

REQUIRED BID PROPOSAL GUARANTY: Not less than 5% of the total bid.

TABLE OF CONTENTS

PART I	SCOPE OF WORK
	<ul style="list-style-type: none">• PROJECT(S), COMPLETION DATE(S), & LIQUIDATED DAMAGES• CONTRACT NOTES• STATE CONTRACT NOTES• ASPHALT MIXTURE• INCIDENTAL SURFACING• COMPACTION OPTION A• SPECIAL NOTE(S) APPLICABLE TO PROJECT• RIGHT OF WAY NOTES• UTILITY IMPACT & RAIL CERTIFICATION NOTES• SEWER STANDARD UTILITY BID ITEMS• SEWERLINE SPECS• KPDES STORM WATER PERMIT, BMP AND ENOI
PART II	SPECIFICATIONS AND STANDARD DRAWINGS
	<ul style="list-style-type: none">• SPECIFICATIONS REFERENCE• SUPPLEMENTAL SPECIFICATION• [SN-1I] PORTABLE CHANGEABLE SIGNS
PART III	EMPLOYMENT, WAGE AND RECORD REQUIREMENTS
	<ul style="list-style-type: none">• LABOR AND WAGE REQUIREMENTS• EXECUTIVE BRANCH CODE OF ETHICS• KENTUCKY EQUAL EMPLOYMENT OPPORTUNITY ACT OF 1978 LOCALITY / STATE• PROJECT WAGE RATES / STATE
PART IV	INSURANCE
PART V	BID ITEMS

PART I
SCOPE OF WORK

ADMINISTRATIVE DISTRICT - 06

CONTRACT ID - 191014

FD04 059 0025 009-010

COUNTY - KENTON

PCN - DE05900251914

FD04 059 0025 009-010

DIXIE HIGHWAY(US-25) CONSTRUCT LEFT TURN LANE ON NORTHBOUND APPROACH AT THE INTERSECTION OF US-25 AND BEECHWOOD ROAD JUST SOUTH OF I-75, A DISTANCE OF 0.18 MILES.GRADE & DRAIN WITH ASPHALT SURFACE SYP NO. 06-00432.00.

GEOGRAPHIC COORDINATES LATITUDE 39:02:00.00 LONGITUDE 84:33:11.00

COMPLETION DATE(S):

COMPLETED BY 08/01/2019

APPLIES TO ENTIRE CONTRACT

CONTRACT NOTES

PROPOSAL ADDENDA

All addenda to this proposal must be applied when calculating bid and certified in the bid packet submitted to the Kentucky Department of Highways. Failure to use the correct and most recent addenda may result in the bid being rejected.

BID SUBMITTAL

Bidder must use the Department's electronic bidding software. The Bidder must download the bid file located on the Bid Express website (www.bidx.com) to prepare a bid packet for submission to the Department. The bidder must submit electronically using Bid Express.

JOINT VENTURE BIDDING

Joint venture bidding is permissible. All companies in the joint venture must be prequalified in one of the work types in the Qualifications for Bidders for the project. The bidders must get a vendor ID for the joint venture from the Division of Construction Procurement and register the joint venture as a bidder on the project. Also, the joint venture must obtain a digital ID from Bid Express to submit a bid. A joint bid bond of 5% may be submitted for both companies or each company may submit a separate bond of 5%.

UNDERGROUND FACILITY DAMAGE PROTECTION

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. When prescribed in said directives, the contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom shall be contacted through their individual Protection Notification Center. Non-compliance with these directives can result in the enforcement of penalties.

REGISTRATION WITH THE SECRETARY OF STATE BY A FOREIGN ENTITY

Pursuant to KRS 176.085(1)(b), an agency, department, office, or political subdivision of the Commonwealth of Kentucky shall not award a state contract to a person that is a foreign entity required by [KRS 14A.9-010](#) to obtain a certificate of authority to transact business in the Commonwealth ("certificate") from the Secretary of State under [KRS 14A.9-030](#) unless the person produces the certificate within fourteen (14) days of the bid or proposal opening. If the foreign entity is not required to obtain a certificate as provided in [KRS 14A.9-010](#), the foreign entity should identify the applicable exception. Foreign entity is defined within [KRS 14A.1-070](#).

For all foreign entities required to obtain a certificate of authority to transact business in the Commonwealth, if a copy of the certificate is not received by the contracting agency within the time frame identified above, the foreign entity's solicitation response shall be deemed non-responsive or the awarded contract shall be cancelled.

Businesses can register with the Secretary of State at <https://secure.kentucky.gov/sos/ftbr/welcome.aspx>.

SPECIAL NOTE FOR PROJECT QUESTIONS DURING ADVERTISEMENT

Questions about projects during the advertisement should be submitted in writing to the Division of Construction Procurement. This may be done by fax (502) 564-7299 or email to kytc.projectquestions@ky.gov. The Department will attempt to answer all submitted questions. The Department reserves the right not to answer if the question is not pertinent or does not aid in clarifying the project intent.

The deadline for posting answers will be 3:00 pm Eastern Daylight Time, the day preceding the Letting. Questions may be submitted until this deadline with the understanding that the later a question is submitted, the less likely an answer will be able to be provided.

The questions and answers will be posted for each Letting under the heading "Questions & Answers" on the Construction Procurement website (www.transportation.ky.gov/contract). The answers provided shall be considered part of this Special Note and, in case of a discrepancy, will govern over all other bidding documents.

HARDWOOD REMOVAL RESTRICTIONS

The US Department of Agriculture has imposed a quarantine in Kentucky and several surrounding states, to prevent the spread of an invasive insect, the emerald ash borer. Hardwood cut in conjunction with the project may not be removed from the state. Chipping or burning on site is the preferred method of disposal.

INSTRUCTIONS FOR EXCESS MATERIAL SITES AND BORROW SITES

Identification of excess material sites and borrow sites shall be the responsibility of the Contractor. The Contractor shall be responsible for compliance with all applicable state and federal laws and may wish to consult with the US Fish and Wildlife Service to seek protection under Section 10 of the Endangered Species Act for these activities.

ACCESS TO RECORDS

The contractor, as defined in KRS 45A.030 (9) agrees that the contracting agency, the Finance and Administration Cabinet, the Auditor of Public Accounts, and the Legislative Research Commission, or their duly authorized representatives, shall have access to any books, documents, papers, records, or other evidence, which are directly pertinent to this contract for the purpose of financial audit or program review. Records and other prequalification information confidentially

disclosed as part of the bid process shall not be deemed as directly pertinent to the contract and shall be exempt from disclosure as provided in KRS 61.878(1)(c). The contractor also recognizes that any books, documents, papers, records, or other evidence, received during a financial audit or program review shall be subject to the Kentucky Open Records Act, KRS 61.870 to 61.884.

In the event of a dispute between the contractor and the contracting agency, Attorney General, or the Auditor of Public Accounts over documents that are eligible for production and review, the Finance and Administration Cabinet shall review the dispute and issue a determination, in accordance with Secretary's Order 11-004.

April 30, 2018

SPECIAL NOTE FOR RECIPROCAL PREFERENCE

RECIPROCAL PREFERENCE TO BE GIVEN BY PUBLIC AGENCIES TO RESIDENT BIDDERS

By reference, KRS 45A.490 to 45A.494 are incorporated herein and in compliance regarding the bidders residency. Bidders who want to claim resident bidder status should complete the Affidavit for Claiming Resident Bidder Status along with their bid in the electronic bidding software. Submittal of the Affidavit should be done along the bid in Bid Express.

April 30, 2018

ASPHALT MIXTURE

Unless otherwise noted, the Department estimates the rate of application for all asphalt mixtures to be 110 lbs/sy per inch of depth.

INCIDENTAL SURFACING

The Department has included in the quantities of asphalt mixtures established in the proposal estimated quantities required for resurfacing or surfacing mailbox turnouts, farm field entrances, residential and commercial entrances, curve widening, ramp gores and tapers, and road and street approaches, as applicable. Pave these areas to the limits as shown on Standard Drawing RPM-110-06 or as directed by the Engineer. In the event signal detectors are present in the intersecting streets or roads, pave the crossroads to the right of way limit or back of the signal detector, whichever is the farthest back of the mainline. Surface or resurface these areas as directed by the Engineer. The Department will not measure placing and compacting for separate payment but shall be incidental to the Contract unit price for the asphalt mixtures.

OPTION A

Be advised that the Department will accept compaction of asphalt mixtures furnished for driving lanes and ramps, at 1 inch (25mm) or greater, on this project according to OPTION A in accordance with Section 402 and Section 403 of the current Standard Specifications. The Department will require joint cores as described in Section 402.03.02 for surface mixtures only. The Department will accept compaction of all other asphalt mixtures according to OPTION B.

SPECIAL NOTE FOR EROSION CONTROL

I. DESCRIPTION

Perform all erosion and water pollution control work in accordance with the Department's Standard and Interim Supplemental Specifications, Special Provisions and Special Notes, and Standard and Sepia Drawings, current editions, and as directed by the Engineer. Section references are to the Standard Specifications. This work shall consist of:

(1) Developing and preparing a Best Management Practices Plan (BMP) tailored to suit the specific construction phasing for each site within the project; (2) Preparing the project site for construction, including locating, furnishing, installing, and maintaining temporary and/or permanent erosion and water pollution control measures as required by the BMP prior to beginning any earth disturbing activity on the project site; (3) Clearing and grubbing and removal of all obstructions as required for construction; (4) Removing all erosion control devices when no longer needed; (5) Restoring all disturbed areas as nearly as possible to their original condition; (6) Preparing seedbeds and permanently seeding all disturbed areas; (7) Providing a Kentucky Erosion Prevention and Sediment Control Program (KEPSC) qualified inspector; and (8) Performing any other work to prevent erosion and/or water pollution as specified by this contract, required by the BMP, or as directed by the Engineer.

II. MATERIALS

Furnish materials in accordance with these notes, the Standard Specifications and Interim Supplemental Specifications, and applicable Special Provisions and Special Notes, and Standard and Sepia Drawings, current editions. Provide for all materials to be sampled and tested in accordance with the Department's Sampling Manual. Unless directed otherwise by the Engineer, make the materials available for sampling a sufficient time in advance of the use of the materials to allow for the necessary time for testing.

III. CONSTRUCTION

Be advised, these Erosion Control Plan Notes do not constitute a BMP plan for the project. Jointly with the Engineer, prepare a site specific BMP plan for each drainage area within the project in accordance with Section 213. Provide a unique BMP at each project site using good engineering practices taking into account existing site conditions, the type of work to be performed, and the construction phasing, methods and techniques to be utilized to complete the work. Be responsible for all erosion prevention, sediment control, and water pollution prevention measures required by the BMP for each site. Represent and warrant compliance with the Clean Water Act (33 USC Section 1251 et seq.), the 404 Permit, the 401 Water Quality Certification, and applicable state and

Erosion Control
Page 2 of 4

local government agency laws, regulations, rules, specifications, and permits. Contrary to Section 105.05, in case of discrepancy between these notes, the Standard Specifications, Interim Supplemental Specifications, Special and Special Notes, Standard and Sepia Drawings, and such state and local government agency requirements, adhere to the most restrictive requirement.

Conduct operations in such a manner as to minimize the amount of disturbed ground during each phase of the construction and limit the haul roads to the minimum required to perform the work. Preserve existing vegetation not required to be removed by the work or the contract. Seed and/or mulch disturbed areas at the earliest opportunity. Use silt fence, silt traps, temporary ditches, brush barriers, erosion control blankets, sodding, channel lining, and other erosion control measures in a timely manner as required by the BMP and as directed or approved by the Engineer. Prevent sediment laden water from leaving the project, entering an existing drainage structure, or entering a stream.

Provide for erosion control measures to be in place and functioning prior to any earth disturbance within a drainage area. Compute the volume and size of silt control devices necessary to control sediment during each phase of construction. Remove sediment from silt traps before they become a maximum of ½ full. Maintain silt fence by removing accumulated trappings and/or replacing the geotextile fabric when it becomes clogged, damaged, or deteriorated, or when directed by the Engineer. Properly dispose of all materials trapped by erosion control devices at approved sites off the right of way obtained by the Contractor at no additional cost to the Department (See Special Note for Waste and Borrow).

As work progresses, add or remove erosion control measures as required by the BMP applicable to the Contractor's project phasing and construction methods and techniques. Update the volume calculations and modify the BMP as necessary throughout the duration of the project. Ensure that an updated BMP is kept on site and available for public inspection throughout the life of the project.

After all construction is complete, restore all disturbed areas in accordance with Section 212. Completely remove all temporary erosion control devices not required as part of the permanent erosion control from the construction site. Prior to removal, obtain the Engineer's concurrence of items to be removed. Grade the remaining exposed earth (both on and off the Right-of-Way) as nearly as possible to its original condition, or as directed by the Engineer. Prepare the seed bed areas and sow all exposed earthen areas with the applicable seed mixture(s) according to Section 212.03.03.

IV. MEASUREMENT

Erosion Control Blanket. If required by the BMP, the Department will measure Erosion Control Blanket according to Section 212.04.07.

Sodding. If required by the BMP, the Department will measure Sodding according to Section 212.04.08.

Channel Lining. If required by the BMP, the Department will measure Channel Lining according to Sections 703.04.04-703.04.07.

Erosion Control. Contrary to Sections 212.04, 213.04, and 703.04 other than Erosion Control Blankets, Sodding, and Channel Lining, the Department will measure Erosion Control as one lump sum. The Department will not measure developing, updating, and maintaining a BMP plan for each site; providing a KEPSC qualified inspector; locating, furnishing, installing, inspecting, maintaining, and removing erosion and water pollution control items; Roadway Excavation, Borrow Excavation, Embankment In Place, Topsoil Furnished and Placed, and Spreading Stockpiled Topsoil; Topdressing Fertilizer, Temporary and Permanent Seeding and Protection, Special Seeding Crown Vetch, and Temporary Mulch; Sedimentation Basin and Clean Sedimentation Basin, Silt Trap Type "A" and Clean Silt Trap Type "A"; Silt Trap Type "B" and Clean Silt Trap Type "B"; Silt Trap Type "C" and Clean Silt Trap Type "C"; Temporary Silt Fence and Clean Temporary Silt Fence; Plants, Vines, Shrubs, and Trees; Gabion and Dumped Stone Deflectors and Riffle Structures; Boulders; Temporary Ditches and clean Temporary Ditches; Geotextile Fabric, and all other erosion and water pollution control items required by the BMP or the Engineer, but shall be incidental to Erosion Control.

V. Basis of Payment

Erosion Control Blanket. If not listed as a bid item, but required by the BMP, the Department will pay for Erosion Control Blankets as Extra Work according to Sections 104.03 and 109.04.

Sodding. If not listed as a bid item, but required by the BMP, the Department will pay for Sodding as Extra Work according to Sections 104.03 and 109.04.

Channel Lining. If not listed as a bid item, but required by the BMP, the Department will pay for Channel Lining as Extra Work according to Sections 104.03 and 109.04.

Erosion Control
Page 4 of 4

Erosion Control. Contrary to Sections 212.05 and 213.05, other than Erosion Control Blanket, Sodding, and Channel Lining, payment at the Contract lump sum price for Erosion Control, shall be full compensation for all materials, equipment, labor and incidentals necessary to complete the erosion and water pollution control work as specified in these notes, Sections 212 and 213, the Supplemental Specifications, applicable Special Provisions and Special Notes, and Standard and Sepia Drawings, including but not limited to developing, updating, and maintaining a BMP plan for each site; providing a KEPSC qualified inspector; locating, furnishing, installing, inspecting, maintaining, and removing erosion and water pollution control items; Roadway Excavation, Borrow Excavation, Embankment In Place, Topsoil Furnished and Placed, and Spreading Stockpiled Topsoil; Topdressing Fertilizer, Temporary and Permanent Seeding and Protection, Special Seeding Crown Vetch, and Temporary Mulch; Sedimentation Basin and Clean Sedimentation Basin, Silt Trap Type "A" and Clean Silt Trap Type "A"; Silt Trap Type "B" and Clean Silt Trap Type "B"; Silt Trap Type "C" and Clean Silt Trap Type "C"; Temporary Silt Fence and Clean Temporary Silt Fence; Plants, Vines, Shrubs, and Trees; Gabion and Dumped Stone Deflectors and Riffle Structures; Boulders; Temporary Ditches and clean Temporary Ditches; Geotextile Fabric and all other erosion and water pollution control items required by the BMP or the Engineer.

1-561 erosion Control Note for Maintenance Projects
06/08/2012

**RECOMMENDATION FOR PICKUP OF ITEMS TO BE INSTALLED
 ON TRAFFIC SIGNALS/LIGHTING**

Item Number: **6-432.00**

County: **KENTON**

Description: **US 25 @ BEECHWOOD DRIVE**

Cabinets	Master code	Description of item
1	T-01-0020	Base Mounted 332 Cabinet
1	T-01-0100	170 Controller
1	T-01-0510	Isolator, Model 242 (for ped detector and railroad)
2	T-01-0600	Loop Detector, Model 222
6	T-01-0700	Load Switches

Signals	Master code	Description of item
8	T-02-0009	Siemens 3 Section Signal
1	T-02-0033	Siemen 4 section 12" signal (poly)
4	T-02-0090	Pedestrian signal housing
1	T-02-0300	LED Module 12" red arrow
2	T-02-0310	LED Module 12" yellow arrow
1	T-02-0320	LED Module 12" green arrow
8	T-02-0330	LED Module 12" red ball
8	T-02-0340	LED Module 12" yellow ball
8	T-02-0350	LED Module 12" green ball
4	T-02-0365	LED Countdown Pedestrian Module



Special items	Master code	Description of item
1	T-09-0504	Router (this includes power supply/antenna/cabling)
1	T-02-0650	Pedstl.top mntg.bkt One-way
1	T-02-0661	Post Top for Pedestal (each)
1	T-02-0670	Pedestal
4	T-06-0710	Ped Detector Pole Mount FSA Box
4	T-06-0730	Ped Button w/o Plunger

Poles	Master code	Description of item
4	T-04-0030	Steel Strain Pole 32 foot


Electrical Contractor Name _____
 Electrical Contractor Supervisor _____ Contact number for Supervisor _____
 Project Engineer Nikki Hill _____ Contact number for Project Engineer _____
 Project Engineer attests that the mentioned contractor is the actual electrical contractor on this project
 Signature of Project Engineer or Designee _____

Standard Water Bid Item Descriptions

W METER ADJUST This item includes all labor, equipment, excavation, materials, backfill, restoration, and etc., to adjust the meter casting to finished grade (whatever size exists) at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

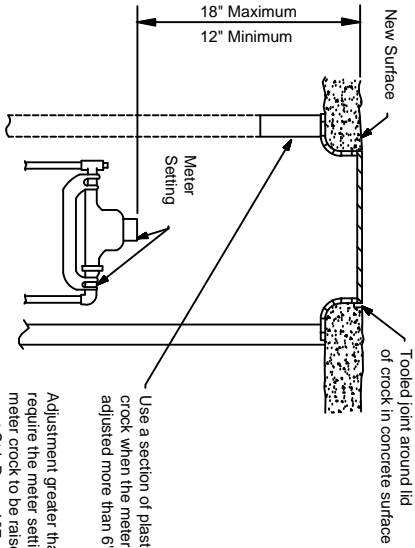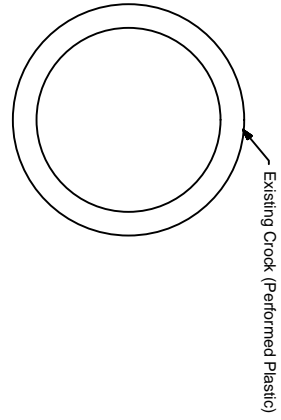

Use a section of plastic meter crock when the meter lid is to be adjusted more than 6"-up to 12". Adjustment greater than 12" will require the meter setting and meter crock to be raised to meet Std. Dwg. 107.

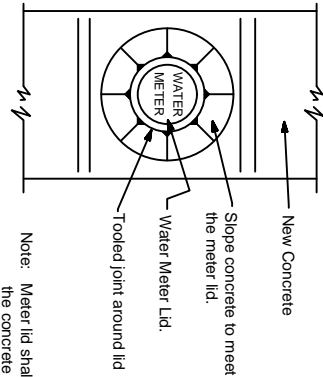

Note: Meter lid shall be flush with the top of the concrete surface. The concrete surface shall be tapered to provide a smooth transition to the meter lid. A tooled joint shall be formed around the meter lid.

NOTE: SERVICES INSTALLED IN CONCRETE AREAS, NOT SUBJECT TO VEHICLE TRAFFIC, A FORD TYPE A32, OR APPROVED EQUAL, LID AND RING SHALL BE USED. AREAS SUBJECT TO VEHICLE TRAFFIC, A FORD TYPE A32HH, OR APPROVED EQUAL, LID AND RING SHALL BE USED.

PLASTIC (PVC) METER CROCKS shall be raised by use of an adapter with a section of plastic crock cut to achieve final grade.

At no time shall wood be used to adjust the ring and lid to grade.

Meter ring and lids shall be reset solidly and shall have no broken edge to allow dirt to enter the crock.

If the meter box is damaged beyond repair, it shall be replaced. See Standard Drawing 107.

RAISING CURB STOPS OR VALVE BOXES:

Curb stop boxes and valve boxes shall be raised by turning the upper section to meet grade. If the upper section cannot be raised in this manner it shall be carefully broken off and replaced.

New upper sections shall be supplied by NKWD

REVISION	BY	DATE

N. KY. WATER DISTRICT	
ADJUSTING RING & LID TO GRADE	
DRAWN BY: SAR	
APPROVED: <i>SA</i>	
DATE: 8/5/2014	
STANDARD DRAWING NO. 112	



KENTUCKY TRANSPORTATION CABINET
Department of Highways
DIVISION OF RIGHT OF WAY & UTILITIES

TC 62-226
Rev. 01/2016
Page 1 of 1

RIGHT OF WAY CERTIFICATION

<input checked="" type="checkbox"/> Original	<input type="checkbox"/> Re-Certification	RIGHT OF WAY CERTIFICATION	
ITEM #	COUNTY	PROJECT # (STATE)	PROJECT # (FEDERAL)
06-432	Kenton	FD04 008 0025 009-010	N/A
PROJECT DESCRIPTION			
Construct left turn lane on NB approach at the intersection of US25 & Beechwood road just S of I-75			
<input type="checkbox"/> No Additional Right of Way Required			
Construction will be within the limits of the existing right of way. The right of way was acquired in accordance to FHWA regulations under the Uniform Relocation Assistance and Real Property Acquisitions Policy Act of 1970, as amended. No additional right of way or relocation assistance were required for this project.			
<input checked="" type="checkbox"/> Condition # 1 (Additional Right of Way Required and Cleared)			
All necessary right of way, including control of access rights when applicable, have been acquired including legal and physical possession. Trial or appeal of cases may be pending in court but legal possession has been obtained. There may be some improvements remaining on the right-of-way, but all occupants have vacated the lands and improvements, and KYTC has physical possession and the rights to remove, salvage, or demolish all improvements and enter on all land. Just Compensation has been paid or deposited with the court. All relocations have been relocated to decent, safe, and sanitary housing or that KYTC has made available to displaced persons adequate replacement housing in accordance with the provisions of the current FHWA directive.			
<input type="checkbox"/> Condition # 2 (Additional Right of Way Required with Exception)			
The right of way has not been fully acquired, the right to occupy and to use all rights-of-way required for the proper execution of the project has been acquired. Some parcels may be pending in court and on other parcels full legal possession has not been obtained, but right of entry has been obtained, the occupants of all lands and improvements have vacated, and KYTC has physical possession and right to remove, salvage, or demolish all improvements. Just Compensation has been paid or deposited with the court for most parcels. Just Compensation for all pending parcels will be paid or deposited with the court prior to AWARD of construction contract			
<input type="checkbox"/> Condition # 3 (Additional Right of Way Required with Exception)			
The acquisition or right of occupancy and use of a few remaining parcels are not complete and/or some parcels still have occupants. All remaining occupants have had replacement housing made available to them in accordance with 49 CFR 24.204. KYTC is hereby requesting authorization to advertise this project for bids and to proceed with bid letting even though the necessary right of way will not be fully acquired, and/or some occupants will not be relocated, and/or the just compensation will not be paid or deposited with the court for some parcels until after bid letting. KYTC will fully meet all the requirements outlined in 23 CFR 635.309(c)(3) and 49 CFR 24.102(j) and will expedite completion of all acquisitions, relocations, and full payments after bid letting and prior to AWARD of the construction contract or force account construction.			
Total Number of Parcels on Project	1	EXCEPTION (S) Parcel #	ANTICIPATED DATE OF POSSESSION WITH EXPLANATION
Number of Parcels That Have Been Acquired			
Signed Deed	0		
Condemnation	1		See Note
Signed ROE	1		
Notes/ Comments (Use Additional Sheet if necessary) IOJ entered on Jan 22, 2019			
LPA RW Project Manager		Right of Way Supervisor	
Printed Name		Printed Name	Brian R. Cox
Signature		Signature	Brian Cox 2019.02.07 15:59:27 -05'00'
Date		Date	02-07-19
Right of Way Director		FHWA	
Printed Name		Printed Name	
Signature	Digitally signed by DM Loy Date: 2019.02.08 07:20:39 05'00'	Signature	
Date		Date	

UTILITIES AND RAIL CERTIFICATION NOTE

Kenton County
FD04 008 91544 01U
Mile point: 9.340 TO 9.580
CONSTRUCT LEFT TURN LANE ON NB APPROACH AT THE INTERSECTION OF US 25
AND BEECHWOOD RD JUST S OF I-75
ITEM NUMBER: 06-432.00

PROJECT NOTES ON UTILITIES

Please Note: The information presented in this Utility Note is informational in nature and the information contained herein is not guaranteed.

Any work pertaining to these utility facilities is defined in the bid package and is to be carried out as instructed by the Kentucky Transportation Cabinet. The contractor will be responsible for any coordination or adjustments that are discussed or quantified in the proposal.

Damage to Utilities

Any intentional or accidental disruption of service due to damage to sewer, gas or water mains caused by any of the contractor's operations without three days advance notice to the utility owner shall be cause for the Cabinet to charge liquidated damages in the amount of five thousand dollars per day (\$5,000/day) per occurrence against the contractor until such time as the utility main is restored.

Any intentional or accidental disruption of any individual water, gas or sewer service caused by any of the contractor's operations without three days advance notice to the utility owner shall be cause for the Cabinet to charge liquidated damages in the amount of five hundred dollars per day (\$500/day) per occurrence against the contractor until such time as service is restored.

In the case of a main disruption, liquidated damages shall be charged at the main disruption rate only. Liquidated damages shall not be charged in addition for service disruptions when a main disruption is involved.

NOTE: DO NOT DISTURB THE FOLLOWING FACILITIES LOCATED WITHIN THE PROJECT DISTURB LIMITS

Cincinnati Bell Telephone, Duke Energy Electric, Duke Energy Gas, Northern Kentucky Water District, Sanitation District No. 1, CenturyLink, Spectrum Communications, MCI/Verizon, and Zayo all have facilities within the project area. Overhead utility lines are located on each side of the project and cross over US 25 at two locations near Station 12+12 and Station 15+69. Exercise caution with equipment around the overhead lines. Traffic signals are attached to two of Duke Energy's poles at 16+06 (28' RT) and Station 16+15 (80' LT) that are to be removed as part of the roadway project with new steel strain poles and signals to be installed. Contact the KYTC District 6 Traffic Section to coordinate. Northern Kentucky Water District and Sanitation District No. 1 have water and sewer facilities that will be adjusted with this project. All other facilities should not be disturbed by the road construction work. Please see notes in each section pertaining to each facilities relocation work and involvement.

The Contractor is fully responsible for protection of all utilities listed above

UTILITIES AND RAIL CERTIFICATION NOTE

Kenton County
FD04 008 91544 01U
Mile point: 9.340 TO 9.580
CONSTRUCT LEFT TURN LANE ON NB APPROACH AT THE INTERSECTION OF US 25
AND BEECHWOOD RD JUST S OF I-75
ITEM NUMBER: 06-432.00

THE FOLLOWING FACILITY OWNERS ARE RELOCATING/ADJUSTING THEIR FACILITIES WITHIN THE PROJECT LIMITS AND WILL BE COMPLETE PRIOR TO CONSTRUCTION

Duke Energy Electric has four existing distribution poles that are to be relocated to the following approximate locations: Sta. 12+14, Sta. 14+04, Sta. 15+41, and Sta. 15+79 as well as respective anchors. The relocation is to be complete prior to construction.

Duke Energy Gas has a gas main to relocate along US 25 between stations 17+00 and 19+00. Relocation is expected to be complete prior to construction. Gas facilities run throughout the project and should not be disturbed. Specific locations to note are across Beechwood Road and near Sta. 18+80 where gas facilities shift to locate under US 25.

THE FOLLOWING FACILITY OWNERS HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE OWNER OR THEIR SUBCONTRACTOR AND IS TO BE COORDINATED WITH THE ROAD CONTRACT

Duke Energy Electric has a utility pole (K74-77E) approximately at Sta. 16+15, 80' L that will need to be held while the proposed storm sewer is constructed. The contractor will need to contact Duke Energy at 800-544-6900 to have the pole held and the anchor temporarily removed to accommodate installation of the storm sewer box. The contractor shall give at least 3 days of notice.

Cincinnati Bell Telephone, Spectrum, MCI/Verizon, Zayo, and CenturyLink all have overhead facilities attached to these poles that are to be relocated. All attachment relocations may not be complete prior to construction but are expected to be complete no later than **May 1, 2019**. CenturyLink is only attached to one utility pole involved at Sta. 15+79 (K74-77E) at the intersection and continues north along US 25. Cincinnati Bell will have to provide a temporary head guy across US 25 from the pole near Sta. 16+15 (K74-81E) to the pole on the right near Sta. 15+44 (K74-79E) and anchor while the proposed storm sewer is constructed. The contractor shall give Cincinnati Bell at least one week advance notice.

Cincinnati Bell Telephone has underground facilities to be relocated/adjusted in several locations. The telephone duct extending northwest along Beechwood Road from the manhole at the intersection is to be lowered to avoid conflict with the proposed pavement and storm sewer work. The telephone duct starting at the same manhole and crossing to run along the west side of US 25 is to be shifted towards the roadway starting near Sta. 16+60 through the end of the project to avoid conflict with the proposed curb box inlet and 18" storm pipe. The buried copper that crosses through the entrance and proposed storm sewer work near Sta. 12+93 is to be abandoned. This relocation work is expected to be complete by **May 1, 2019**. Cincinnati Bell has three manholes that will require frame and cover adjustments to grade at approximate stations 11+90, 12+94, and 15+72. The contractor is not to pave over the telephone manholes and shall provide at least one week advance notice to Cincinnati Bell to coordinate

UTILITIES AND RAIL CERTIFICATION NOTE

Kenton County
FD04 008 91544 01U
Mile point: 9.340 TO 9.580
CONSTRUCT LEFT TURN LANE ON NB APPROACH AT THE INTERSECTION OF US 25
AND BEECHWOOD RD JUST S OF I-75
ITEM NUMBER: 06-432.00

the adjustment work. All other underground telephone is to remain in place and all facilities are not to be disturbed.

THE FOLLOWING FACILITY OWNERS HAVE FACILITIES TO BE RELOCATED/ADJUSTED BY THE ROAD CONTRACTOR AS INCLUDED IN THIS CONTRACT

Northern Kentucky Water District and Sanitation District No. 1 have facilities to be adjusted by the Cabinet’s roadway contractor using specifications inserted into the project proposal. Appropriate utility bid items have been included in the contract bid documents.

Northern Kentucky Water District has a water meter at Sta. 11+22, 34’ LT to be adjusted to grade. The Water District also has an existing 6” cast iron water main at the intersection with Beechwood Road that the proposed storm sewer crosses under near Sta. 16+29, 42’ LT and Sta. 16+46, 70’ LT that is not to be disturbed. At least 3 feet of cover is to remain over all water main in areas where ditching is to occur.

Sanitation District No. 1 has an existing manhole approximately located 25’ right of Station 16+18 that is to be adjusted to grade. The sanitary sewer lines located north of this manhole along US 25 and crossing the roadway are not to be disturbed.

RAIL COMPANIES HAVE FACILITIES IN CONJUNCTION WITH THIS PROJECT AS NOTED

No Rail Involvement **Rail Involved** **Rail Adjacent**

SPECIAL CAUTION NOTE – PROTECTION OF UTILITES

The contractor will be responsible for contacting all utility facility owners on the subject project to coordinate his activities. The contractor will coordinate his activities to minimize and, where possible, avoid conflicts with utility facilities. Due to the nature of the work proposed, it is unlikely to conflict with the existing utilities beyond minor facility adjustments. Where conflicts with utility facilities are unavoidable, the contractor will coordinate any necessary relocation work with the facility owner and Resident Engineer. The Kentucky Transportation Cabinet maintains the right to remove or alter portions of this contract if a utility conflict occurs. The utility facilities as noted in the previous section(s) have been determined using data garnered by varied means and with varying degrees of accuracy: from the facility owners, a result of S.U.E., field inspections, and/or reviews of record drawings. The facilities defined may not be inclusive of all utilities in the project scope and are not Level A quality, unless specified as such. It is the contractor’s responsibility to verify all utilities and their respective locations before excavating.

UTILITIES AND RAIL CERTIFICATION NOTE

Kenton County
FD04 008 91544 01U
Mile point: 9.340 TO 9.580
CONSTRUCT LEFT TURN LANE ON NB APPROACH AT THE INTERSECTION OF US 25
AND BEECHWOOD RD JUST S OF I-75
ITEM NUMBER: 06-432.00

UNDERGROUND FACILITY DAMAGE PROTECTION – BEFORE YOU DIG

The contractor shall make every effort to protect underground facilities from damage as prescribed in the Underground Facility Damage Protection Act of 1994, Kentucky Revised Statute KRS 367.4901 to 367.4917. It is the contractor's responsibility to determine and take steps necessary to be in compliance with federal and state damage prevention directives. The contractor is instructed to contact KY 811 for the location of existing underground utilities. Contact shall be made a minimum of two (2) and no more than ten (10) business days prior to excavation. The contractor shall submit Excavation Locate Requests to the Kentucky Contact Center (KY 811) via web ticket entry. The submission of this request does not relieve the contractor from the responsibility of contacting non-member facility owners, whom are to be contacted through their individual Protection Notification Center. It may be necessary for the contractor to contact the County Court Clerk to determine what utility companies have facilities in the area. Non-compliance with these directives can result in the enforcement of penalties.

AREA FACILITY OWNER CONTACT LIST

UTILITY CONTACT INFORMATION WILL BE PROVIDED AT THE PRECONSTRUCTION MEETING.

Standard Sanitary Sewer Bid Item Descriptions

S BYPASS PUMPING This item shall include all labor, equipment, and materials needed to complete a bypass pumping and/or hauling operation for diversion of sewage during sanitary sewer construction. Examples of such operations when bypass pumping and/or hauling may be necessary is during force main tie-ins, manhole invert reconstruction, insertion of new manholes into existing mains, or other similar construction. There may be more than one bypass pumping/hauling operation on a project. This item shall be paid for each separate bypass pumping/hauling operation occurrence as called out on the plans or directed by the engineer and actually performed. There will be no separate bid items defined for length, duration, or volume of sewage pumped or hauled in each occurrence. If a bypass pumping/hauling operation is called out on the plans; but, conditions are such that the bypass pumping/hauling operation is not needed or utilized, no payment will be made under this item. The contractor shall draw his own conclusions as to what labor, equipment, and materials may be needed for each bypass pumping/hauling occurrence. The contractor should be prepared to handle the maximum volume of the sewer being bypassed, even during a storm event. This item shall not be paid separately, but shall be considered incidental, when bypass pumping and/or hauling is needed during cast-in-place-pipe (CIPP) and/or point repair operations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA).

S CIPP LATERAL SERVICE INVESTIGATION This item shall include all equipment, materials, labor and incidentals necessary to enter the sewer in compliance with all safety/confined space requirements and perform the identification, assessment and pre-measurement of all existing and abandoned laterals for the placement of Cured-In-Place-Pipe lining. This item shall be in payment for all lateral service investigation for all sewer segments to be lined as a part of this contract. This bid item shall include bypass pumping when required. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be LUMP SUM (LS).

S CIPP LATERAL REINSTATEMENT This item is to pay for installing a Cured-In-Place-Pipe liner in service laterals and service/mainline connections to stabilize structural defects and construction inadequacies. This bid item shall include all labor, equipment, materials and incidentals necessary to perform the service lateral reinstatement in accordance with the plans and specifications. Work under this item shall include bypass pumping, sewer flow control, pre-installation cleaning, sealing connections to existing sewer main, pre- and post- construction CCTV inspection and final testing of the CIPP system. This item shall also include the "top hat" required by the specifications. All CIPP lateral reinstatements shall be paid under this item regardless of the size or length of reinstatement. No separate bid items of varying sizes or length of CIPP lateral reinstatement will be provided in the contract. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be EACH (EA) for each CIPP lateral reinstatement complete and ready for use.

S CIPP LINER This bid Item is to pay for rehabilitation of existing sanitary sewers using the Cured-In-Place-Pipe method. This bid item description applies to all CIPP sizes included in the contract.

All CIPP Liner items of all varying sizes shall include all labor, materials, customer notification, testing, necessary permits, ingress and egress procedures, bypass pumping, pre-construction video, sediment and root removal, dewatering, traffic control, erosion and sediment control, excavation pits, removal and replacement of manhole frames and covers as necessary to facilitate the lining work, sealing at manholes and service connections, clearing and grubbing, pipeline cleaning, re-cleaning and video inspection as many times as necessary, debris collection and disposal, root removal, pre- and post-construction video inspection, all digital inspection footage, final report preparation and approval, the cost of potable water from the Owner, required compliance tests, site restoration, site cleanup, sealing of liner at manholes, acceptance testing and all other rehabilitation work and incidentals not included under other pay items necessary to complete the rehabilitation per the plans and specifications. There will be no separate payment for acceptance testing of the lined pipe; but shall be considered incidental to this item. Pay under this item shall be by each size bid in the contract. Pay measurement shall be from center of manhole to center of manhole. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S CIPP PROTRUDING LATERAL REMOVAL This item includes all equipment, materials, labor and incidentals necessary to enter the sewer in compliance with all safety/confined space requirements, remove a sufficient amount of the protruding tap to insure a proper and safe Cured-In-Place-Pipe lining insertion and perform pre-installation CCTV. This bid item shall include bypass pumping when required. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. Payment for this item shall be EACH (EA) for each protruding lateral removed.

S CONCRETE PIPE ANCHOR This item shall be constructed on the sewer pipe at the locations shown on the plans in accordance with sanitary sewer specifications and standard drawings. Payment for concrete anchors will be made at the contract unit price each in place complete and ready for use. Each concrete anchor of sewer pipe or force main shall be paid under one bid item per contract regardless of the sizes of carrier pipe being anchored in the contract. No separate bid items will be established for size variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S DIRECTIONAL BORE Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of force main or gravity sewer under streets, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S ENCASEMENT CONCRETE Includes all labor, equipment, excavation, concrete, reinforcing

steel, backfill, restoration, and etc., to construct the concrete encasement of the sewer or force main as shown on the plans, and in accordance with the specifications and standard drawings. Payment under this item shall be in addition to the carrier pipe as paid under separate bid items. Carrier pipe is not included in this bid item. Any and all concrete encasement shall be paid under one bid item included in the contract regardless of the size of the carrier pipe or the volume of concrete or steel reinforcement as specified in the plans and specifications. No separate bid items will be established for size variations. Measurement of pay quantity shall be from end of concrete to end of concrete. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF) when complete.

S ENCASEMENT STEEL BORED This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to bore and install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The sizes of encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S ENCASEMENT STEEL OPEN CUT This item shall include the steel encasement pipe size as specified on the plans and in the specifications, casing spacers, end seals, labor, and equipment to open cut install the encasement in accordance with the plans and specifications, complete and ready for use. The size shall be the measured internal diameter of the encasement pipe. The size encasement to be paid under the size ranges specified in the bid items shall be as follows:

- Range 1 = All encasement sizes greater than 2 inches to and including 6 inches
- Range 2 = All encasement sizes greater than 6 inches to and including 10 inches
- Range 3 = All encasement sizes greater than 10 inches to and including 14 inches
- Range 4 = All encasement sizes greater than 14 inches to and including 18 inches
- Range 5 = All encasement sizes greater than 18 inches to and including 24 inches
- Range 6 = All encasement sizes greater than 24 inches

(Encasement sizes of 2 inches internal diameter or less shall not be paid separately; but, shall be considered incidental to the carrier pipe.) Payment under this bid item shall not include the carrier pipe. Carrier pipe shall be paid under a separate bid item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S FORCE MAIN This description shall apply to all PVC and ductile iron and polyethylene/plastic pipe bid items of every size and type, except those bid items defined as “Special”. This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, bends, tees, reducers, plugs, and caps), tracing wire with test boxes (if required by specification), polyethylene wrap (when specified), labor, equipment, excavation, bedding, restoration, testing, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. No additional payment will be made for rock excavation. This bid item includes material and placement of flowable fill under existing and proposed pavement, and wherever else specified on the plans or in the specifications. This item shall also include pipe anchors on polyethylene pipe runs as shown on the plans or required by the specifications to prevent the creep or contraction of the pipe. Measurement of quantities under this item shall be through fittings, encasements, and directional bores (only when a separate carrier pipe is specified within the directional bore pipe). No separate payment will be made under pipe items when the directional bore pipe is the carrier pipe. Measurements shall be further defined to be to the center of tie-in where new pipe contacts existing pipe at the center of connecting fittings, to the outside face of vault or structure walls, or to the point of main termination at dead ends. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S FORCE MAIN AIR RLS/VAC VLV This bid item description shall apply to all force main air release/vacuum valve installations of every size except those defined as “Special”. This item shall include the air release/vacuum valve, main to valve connecting line or piping, manhole/vault/structure, access casting or doors, tapping the main, labor, equipment, excavation, proper backfill and restoration required to install the air release/vacuum valve at the location shown on the plans or as directed in accordance with the specifications and standard drawings complete and ready for use. All air release/vacuum valves on a project shall be paid under one bid item regardless of size. No separate pay items will be established for size variations. Only in the case of the uniqueness of a particular air release/vacuum valve would a separate bid item be established. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN DIRECTIONAL BORE Payment under this item is made whenever the plans or specifications specifically show directional boring is to be utilized in order to minimize the impact of open cut for the installation of sewer or force main under streets, buildings, creeks, and etc. Payment under this item shall include the specified bore pipe, labor, and equipment. No separate payment shall be made for bore pipe installed in the bore whether used as a carrier pipe or an encasement of a separate carrier pipe. This item shall also include pipe anchors at each end of the bore when specified to prevent the creep or contraction of the bore pipe. Carrier pipe installed within a bore pipe shall be paid separately under pipe items. Payment under this item shall not be size specific and no separate bid items will be established for size variations. The bore pipe sizes to be included under this item shall be as shown on the plans and/or in the specifications. Any and all directional bores in each contract shall be paid under one directional bore bid item included in the contract regardless of size. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S FORCE MAIN POINT RELOCATE This item is intended for payment for horizontal and/or vertical relocation of a short length of an existing main at the locations shown on the plans. This bid item is to be used to relocate an existing force main at point locations such as to clear a conflict at a

proposed drainage structure, pipe or any other similar short relocation situation, and where the existing pipe material is to be reused. The contractor shall provide any additional pipe or fitting material needed to complete the work as shown on the plans and specifications. The materials provided shall be of the same type and specification as those that exist. Substitution of alternative materials shall be approved by the engineer in advance on a case by case basis. New polyethylene wrap is to be provided (if wrap exists or is specified in the specifications to be used). If it is necessary that the pipe be disassembled for relay, payment under this item shall also include replacement of joint gaskets as needed. Bedding and backfill shall be provided and performed the same as with any other pipe installation as detailed in the plans and specifications. Payment under this item shall be for each location requiring an existing main to be relocated horizontally or vertically regardless of pipe size or relocation length. No separate pay items will be established for pipe size variations or relocation segment length variations. Force Main Relocate shall not be paid on a linear feet basis; but shall be shall be paid EACH (EA) at each location when complete and placed in service. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced.

S FORCE MAIN TAP SLEVE/VALVE RANGE 1 OR 2 This item shall include the specified tapping sleeve, valve, valve box, concrete pad around valve box (when required in specifications or plans), labor, and equipment to install the specified tapping sleeve and valve, complete and ready for use in accordance with the plans and specifications. The size shall be the measured internal diameter of the live pipe to be tapped. The size tapping sleeve and valve to be paid under sizes 1 or 2 shall be as follows:

- Range 1 = All live tapped main sizes up to and including 8 inches
- Range 2 = All live tapped main sizes greater than 8 inches

Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN TIE-IN This bid description shall be used for all force main tie-in bid items of every size except those defined as "Special". This item includes all labor, equipment, excavation, fittings, sleeves, reducers, couplings, blocking, anchoring, restoration, testing and backfill required to make the force main tie-in as shown on the plans and in accordance with the specifications complete and ready for use. This bid item shall include purge and sanitary disposal of any sewage from any abandoned segments of force main. Pipe for tie-ins shall be paid under separate bid items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN VALVE This description shall apply to all force main valves of every size required in the plans and specifications, except those bid items defined as "Special". Payment under this description is to be for gate or butterfly force main valves being installed with new force main. This item includes the valve as specified in the plans and specifications, polyethylene wrap (if required by specification), labor, equipment, excavation, anchoring (if any), valve box and valve stem extensions, backfill, concrete pad around valve box (if required by specification), restoration, testing, and etc., required to install the specified valve at the location shown on the plans in accordance with the specifications and standard drawings complete and ready for use. If required on plans and/or proposed adjoining DIP is restrained, force main valves shall be restrained. Force main valve restraint shall be considered incidental to the force main valve and adjoining pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be

referenced. This item shall be paid EACH (EA) when complete.

S FORCE MAIN VALVE BOX ADJUST Includes all labor, equipment, valve box and valve stem extensions (if required), excavation, backfill, concrete pad around valve box (when specified in specifications or plans), restoration, and etc., to adjust the top of the force main valve box to finished grade complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LATERAL CLEANOUT This item shall be for payment for installation of a cleanout in a service lateral line. This item shall include furnishing and installation of a tee, vertical pipe of whatever length required, and threaded cap. The cleanout shall extend from the lateral to final grade elevation. The size of the cleanout shall be equivalent to the size of the lateral. The cleanout materials shall meet the same specification as those for the lateral. The cleanout shall be installed at the locations shown on the plans or as directed by the engineer. Only one pay item shall be established for cleanout installation. No separate pay items shall be established for size or height variances. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LATERAL LOCATE This bid item is to pay for all labor, equipment, and materials needed in locating an existing sanitary sewer service lateral for tie-in of the lateral to new mainline sewers and/or for the relocation of a lateral. This bid item shall be inclusive of any and all methods and efforts required to locate the lateral for tie-in or relocation of the lateral. Locating methods to be included under this items shall include, but are not limited to, those efforts employing the use of video cameras from within an existing sanitary sewer main or lateral, electronic locating beacons and/or tracers inserted into the sanitary sewer main or lateral, careful excavation as a separate operation from mainline sewer or lateral excavation, the use of dyes to trace the flow of a lateral, or any combination of methods required to accurately locate the lateral. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA).

S LATERAL LONG SIDE This bid item description shall apply to all service lateral installations of every size up to and including 6 inch internal diameter, except those lateral bid items defined as "Special". This item includes the specified piping material, main tap, bends, clean outs, labor, equipment, excavation, backfill, testing, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for service lateral installations where the ends of the lateral connection are on opposite sides of the public roadway. The new lateral must cross the centerline of the public roadway to qualify for payment as a long side lateral. The length of the service lateral is not to be specified. Payment under this item shall not be restricted by a minimum or maximum length. The contractor shall draw his own conclusions as to the length of piping that may be needed. Payment under this item shall include boring, jacking, or excavating across the public roadway for placement. Placement of a service lateral across a private residential or commercial entrance alone shall not be reason to make payment under this item. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LATERAL SHORT SIDE This bid item description shall apply to all service lateral installations of every size up to and including 6 inch, except those lateral bid items defined as “Special”. This item includes the specified piping material, main tap tee, bends, clean outs, labor, equipment, excavation, backfill, testing, and restoration, at the locations shown on the plans or as directed, in accordance with the specifications and standard drawings, complete and ready for use. This bid item is to pay for lateral installations where both ends of the lateral connection are on the same side of the public roadway, or when an existing lateral crossing a public roadway will remain and is being extended, reconnected, or relocated with all work on one side of the public roadway centerline as shown on the plans. The length of the service lateral is not to be specified and shall not be restricted to any minimum or maximum length. Payment shall be made under this item even if the lateral crosses a private residential or commercial entrance; but, not a public roadway. Private or commercial entrances shall not be considered a public roadway in defining payment under this item. The contractor shall draw his own conclusions as to the length of piping that may be needed. No additional payment will be made for rock excavation or for bedding required in rock excavation. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S LINE MARKER This item is for payment for furnishing and installing a sewer utility line marker as specified by the utility owner specifications and plans. A line marker may consist of a post or monument of whatever materials specified and shall include markings and/or signage on same as specified by plans or specifications. This item shall include all labor, equipment, and materials needed for complete installation of the marker. This item shall be paid EACH (EA) when complete.

S MANHOLE Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole. Payment for manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Manholes shall include concrete base, barrel sections, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup in accordance with the specifications and standard drawings. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company’s Specifications. If the Company does not have specifications, KYTC’s Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE ABANDON/REMOVE Payment under this item is for the partial removal and/or filling of any sanitary sewer manhole regardless of size or depth that no longer serves any purpose. Payment shall be made regardless of whether the manhole is or is not in conflict with other work. Any manhole requiring partial removal, but not total removal, in order to clear a conflict with other work shall be paid under this item. All manholes partially removed shall be removed to a point at least one foot below final grade, one foot below roadway subgrade, or one foot clear of any other underground infrastructure, whichever is lowest. If partial removal of an abandoned manhole is elected by the contractor, the remaining manhole structure shall be refilled with flowable fill. Payment for disposal of a sanitary sewer manhole will be made under this item only. Please refer to the Utility Company’s

Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE ADJUST TO GRADE Payment under this item is for the adjustment of sanitary sewer casting elevation on all sizes of existing sanitary manholes. This work shall be performed in accordance with the sanitary sewer specifications. Payment shall be made under this bid item regardless of the amount of adjustment necessary to a sanitary sewer manhole casting or diameter of the manhole. Work under this pay item may be as simple as placing a bed of mortar under a casting; but, shall also be inclusive of installation of adjusting rings, and /or addition, removal, or replacement of barrel sections. The existing casting is to be reused unless a new casting is specified on the plans. New casting, when specified, shall be paid as a separate bid item. Anchoring of the casting shall be incidental to this item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE CASTING STANDARD Payment under this bid items is for furnishing of a new standard traffic baring casting for sanitary manholes meeting the requirements of the sanitary sewer specifications and standard drawings. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when installed.

S MANHOLE CASTING WATERTIGHT Payment under this bid item is for furnishing of a new watertight traffic baring casting for sanitary manholes meeting the requirements of the sanitary sewer specifications and standard drawings. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when installed.

S MANHOLE RECONSTRUCT INVERT This bid item is to pay for all labor, equipment, and material for rework of the manhole bench to redirect or eliminate flow, such as when the flow of a pipe or pipes are being removed or redirected. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in elimination or redirect of flow. This item shall also include providing and placement of a rubber seal or boot as required by utility specification, standard drawing or plan. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the specifications, standard drawings, and plans. No payment shall be made under this bid when MANHOLE TAP EXISTING, or MANHOLE TAP EXISTING ADD DROP are being paid at the same location, as this type of work is included in those items. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE TAP EXISTING This bid item is to pay for all labor, equipment, and material for coring one opening in an existing manhole base, addition of a rubber seal as specified, and rework of the manhole bench to direct the additional pipe flow. The bid item shall be paid for each core opening added to a single manhole. This bid item shall also include any rework of the existing manhole bench due to the elimination of other existing pipes and flow. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in the addition, elimination, or redirect of flow. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the

specifications, standard drawings, and plans. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE TAP EXISTING ADD DROP This bid item is to pay for all labor, equipment, and material for coring one opening in an existing manhole base, addition of a rubber seal as specified, addition of a vertical drop pipe to the outside of the manhole, placement of reinforcing steel and concrete to encase vertical pipe, and rework of the manhole bench to direct the additional pipe flow. The bid item shall be paid for each drop added to a single manhole. This bid item shall also include any rework of the existing manhole bench due to the elimination of other existing pipes and flow. This work will be as specified in the plans, specifications, or directed by the engineer. This work may consist of, but is not limited to, removal of concrete and/or placement of concrete in the addition, elimination, or redirect of flow. The contractor shall draw his own conclusions as to the effort and scope of work needed to comply with the specifications, standard drawings, and plans. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE WITH DROP Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole with drop. Payment for drop manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Drop manholes shall include concrete base, barrel sections, drop materials, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE WITH LINING Payment under this item is for the installation of new 4 foot interior diameter sanitary sewer manhole with corrosion resistant lining. Payment for manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Manholes shall include concrete base, barrel sections, cone section or slab top, steps, lining, excavation, backfilling, air testing, restoration, and cleanup in accordance with the standard drawings. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). All materials, except casting, shall be new and unused. An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S MANHOLE WITH TRAP Payment under this item is for the installation of a new manhole with

trap. Payment for trap manholes will be made at the contract unit price each in place complete and ready for use at the locations shown on plans in accordance with specifications and standard drawings. Trap manholes shall include concrete base, manhole structure and trap materials, cone section or slab top, steps, excavation, backfilling, air testing, restoration, and cleanup. All materials, except casting, shall be new and unused. Payment shall be made under this item regardless of whether the base is to be precast or cast-in-place (doghouse). An existing casting from an existing abandoned or removed manhole is to be reused and shall be considered incidental to this item. When a new casting is specified, or an existing casting is unavailable, it shall be paid as a separate bid item. Anchoring of casting, new or used, shall be considered incidental to this bid item. No additional compensation will be paid for manhole height variations. No additional payment will be made for rock excavation. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S PIPE This description shall apply to all PVC and ductile iron gravity sewer pipe bid items of every size and type 8 inches internal diameter and larger, except those bid items defined as "Special". This item includes the pipe specified by the plans and specifications, all fittings (including, but not limited to, tap tees and couplings for joining to existing similar or dissimilar pipes), polyethylene wrap (if required by specification), labor, equipment, excavation, bedding, restoration, pressure or vacuum testing, temporary testing materials, video inspection, backfill, and etc., required to install the specified new pipe and new fittings at the locations shown on the plans, or as directed, in accordance with the specifications and standard drawings complete and ready for use. This bid item shall include material and placement of flowable fill under existing and proposed pavement, and wherever specified on the plans or in the specifications. No additional payment will be made for rock excavation. Measurement of quantities under this item shall be through fittings and encasements to a point at the outside face of manhole barrels, or to the point of main termination at dead ends or lamp holes. Carrier pipe placed within an encasement shall be paid under this item and shall include casing spacers and end seals. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S PIPE POINT REPAIR This item is to be used to pay for repair of short lengths of existing sanitary sewer pipe that, through prior video inspection or other means, are known to have pre-existing failure. Pipe Point Repair may be needed in preparation for installation of cured-in-place-pipe (CIPP) lining or other instances where failure is known and repair is prudent. The size of pipe shall not be defined in separate bid items. All diameter sizes of point repair shall be paid under this one item. The materials to be used to make the repair shall be as defined on the plans or in the specifications. This bid item shall include all excavation, pipe materials, joining materials to connect old and new pipe, bedding, and backfill to complete the repair at the locations shown on the plans or as directed by the engineer, complete and ready for use. This bid item shall include bypass pumping when required. Measurement shall be from contact point to contact point of old and new pipe. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid LINEAR FEET (LF).

S PUMP STATION This item is for payment for installation of sanitary pump stations including above or below ground structure for housing of the pumps. This item shall include all pumps, piping, fittings, valves, electrical components, building materials, concrete, any other appurtenances, labor, equipment, excavation, and backfill, to complete the pump station installation as required by the plans, standard drawings, and specifications, complete and ready for use. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall

be referenced. This item shall be paid LUMP SUM (LS) for each when complete.

S STRUCTURE ABANDON This item is to be used to pay for abandonment of larger above or below ground sewer structures such as air release/vacuum valve vaults, pump stations, tanks, etc. Payment under this time shall not be limited to size or scope; however structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to sewer construction, (i.e., abandonment of standard air release/vacuum valves up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted fill or flowable fill for abandonment of the structure in place and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

S STRUCTURE REMOVAL This item is to be used to pay for removal of larger above or below ground sewer structures such as air release/vacuum valve vaults, pump stations, tanks, and etc. Payment under this time shall not be limited to size or scope; however, structures with connecting pipes of 2 inches or less shall not be paid under this item; but, shall be considered incidental to sewer construction, (i.e., removal of standard air release/vacuum valves and their structure up to and including 2 inches would not be paid under this item). Payment under this item shall include all labor, equipment, and compacted backfill for removal of the structure and restoration complete. No separate bid items will be established for size or structure variations. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

SANITARY SEWER MANHOLE ADJUSTMENT BID ITEM DESCRIPTION AND SPECIFICATIONS

BID ITEM DESCRIPTION

S MANHOLE ADJUST TO GRADE Payment under this item is for the adjustment of sanitary sewer casting elevation on all sizes of existing sanitary manholes. This work shall be performed in accordance with the sanitary sewer specifications. Payment shall be made under this bid item regardless of the amount of adjustment necessary to a sanitary sewer manhole casting or diameter of the manhole. Work under this pay item may be as simple as placing a bed of mortar under a casting; but, shall also be inclusive of installation of adjusting rings, and /or addition, removal, or replacement of barrel sections. The existing casting is to be reused unless a new casting is specified on the plans. New casting, when specified, shall be paid as a separate bid item. Anchoring of the casting shall be incidental to this item. Please refer to the Utility Company's Specifications. If the Company does not have specifications, KYTC's Specifications shall be referenced. This item shall be paid EACH (EA) when complete.

SECTION 02606

MANHOLES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Scope: CONTRACTOR shall provide all labor, materials, equipment and incidentals as shown on the Design Drawings, specified herein and required to furnish and install all precast and cast-in-place manholes, air release manholes and bypass pumping vaults.
- B. General:
 - 1. Manholes shall conform in shape, size, dimensions, material, and other respects to the details shown or as ordered by ENGINEER.
 - 2. Cast-iron frames, grates and covers shall be as specified in Section 05540.
 - 3. Concrete for cast-in-place manholes and for inverts in precast manholes shall conform to the requirements specified under Section 03300.

4. Floor access hatch covers for air release manholes shall be as specified in Section 05536.

C. Related Sections:

1. Division 2 Sections on Earthwork.
2. Section 03300, Cast-In-Place Concrete.
3. Section 05501, Miscellaneous Metal Fabrications.
4. Section 05536, Floor Access Hatch Covers
5. Section 05540, Castings.
6. Division 15 Sections on Piping.

1.2 QUALITY ASSURANCE

A. Reference Standards:

1. ASTM C 33, Standard Specification for Concrete Aggregate.
2. ASTM C 76, Class III Reinforced Concrete Pipes.
3. ASTM C 443, Specifications for Joints for Circular Concrete Sewer and Culvert Pipe, using Rubber Gaskets.
4. ASTM C 478, Specification for Precast Reinforced Concrete Manhole Sections.
5. ASTM C 579, Standard test method for compressive strength of chemical resistant mortars, grouts, monolithic surfacing and polymer concretes.
6. ASTM C 857, Standard Practice for Minimum Structural Design Loading for underground Precast Concrete Utility Structures.
7. ASTM C 923, Specification for Resilient Connectors Between Reinforced Concrete Manhole Structures, Pipes, and Laterals.
8. ASTM D 695, Standard Test Method for Compressive Properties of Rigid Plastics.
9. ASTM D 790, Standard Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials.
10. ASTM C 990, Standard Specification for Joints for Concrete Pipe, Manholes, Precast Box Sections Using Preformed Flexible Joint Sealants.
11. ASTM C 1244, Standard Test Method for Concrete Sewer Manholes by the Negative Air Pressure (Vacuum) Test Prior to Backfill.
12. ASTM D 1737, Test Method for Elongation of Attached Organic Coatings with Cylindrical Mandrel Apparatus
13. ASTM D 2240, Standard Test Method for Rubber Property
14. ASTM D 412, Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers Tension
15. ASTM D 4161, Standard Specification for Fiberglass (Glass-Fiber-Reinforced Thermosetting-Resin) Pipe Joints Using Flexible Elastomeric Seals.

16. ASTM D 6783, Standard Specification for Polymer Concrete Pipe.
17. ASTM F 477, Specification for Elastomeric Seals (gaskets) for Joining Plastic Pipe.
18. ASTM 4060, Test Method for Abrasion Resistance of Organic Coatings by the Taber Abraser
19. ASTM 4541, Standard Test Method for Pull Off Strength of Coatings using Portable Adhesion Testers
20. AWWA C 110, Ductile-Iron and Gray-Iron Fittings, 3 in. through 48 in., for Water and Other Liquids.
21. AWWA C 111, Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings. AWWA C 115, Flanged Ductile-Iron Pipe with Threaded Flanges.
22. AWWA C 151, Ductile-Iron Pipe, Centrifugally Cast, for Water or Other Liquids.
23. AWWA C 302, Reinforced Concrete Pressure Pipe, Noncylinder Type, for Water and Other Liquids.

1.3 SUBMITTALS

- A. Shop Drawings: Submit for approval the following:
 1. Design Drawings showing design and construction details of all precast concrete and cast-in-place manholes including details of joints between the manhole bases and riser sections and stubs or openings for the connection of sewers. Design Drawings shall show invert elevations of all pipe connections entering and leaving the manhole along with flowline slope across the base. Design Drawings shall also show the delta angles for all points of intersection, except where more than one line intersects at the same manhole. Where more than one line intersects, the angles relating all lines shall be shown. All angles shall be shown to the nearest second.
 2. Manufacturer's name for all precast structures.
- B. Submit a laying schedule of each manhole showing elevations and manhole components to be used from base to casting.
- C. For manhole interior linings, submit a description of the method and materials required to line the manhole. Submit a Material Data Safety Sheet (MSDS) for each product used in the lining. A CIGMAT evaluation shall be submitted, if required. Submittals shall also include, as required, work procedures for flow diversion plans and methods/materials used for repair of leaks and cracks in manholes. If required, submit calculations for the round manhole lining that demonstrate hoop strength under maximum hydrostatic conditions. The calculation shall assume zero liner adhesion to the existing structure, but assume lateral support from the existing wall. The calculated hoop stress shall be less than 11% of the compressive strength as determined

by appropriate ASTM test method. Submit a final installation report on manholes that have been lined.

- D. Comply with all the requirements of Section 01340.

PART 2 - PRODUCTS

2.1 PRECAST CONCRETE MANHOLES, AIR RELEASE MANHOLES, AND BYPASS PUMPING VAULTS

- A. General:
1. Precast manholes shall conform to the details shown on the Standard Details.
 2. Concrete shall be minimum 4000 psi compressive strength.
 3. Except where otherwise specified precast manhole components shall consist of reinforced concrete pipe sections especially designed for manhole construction and manufactured in accordance with ASTM C 478 except as modified herein.
 - a. Standard Manholes shall be six (6) feet or more in depth, measured from the base of the cover frame to the invert of the outlet and shall be concentric cone-type, top construction as shown on the Design Drawings.
 - b. Shallow Manholes shall be less than six (6) feet in depth, measured from the base of the cover frame to the invert of the outlet and shall be of flat-top construction as shown on the Design Drawings.
 4. Precast, reinforced concrete manhole bases, riser sections, flat slabs and other components shall be manufactured by wet cast methods only, using forms which will provide smooth surfaces free from irregularities, honeycombing or other imperfections.
 5. All precast manhole components shall be of approved design and of sufficient strength to withstand the loads imposed upon them. They shall be designed for a minimum earth cover loading of 130 pounds per cubic foot, an H-20 wheel loading, and an allowance of 30 percent in roadways and 15 percent in rights-of-way for impact.
 6. Precast concrete manhole sections (including eccentric and concentric cones, risers and grade rings) shall conform to ASTM C 478 except sections deeper than 12 feet shall have reinforcing equal to that of ASTM C76 Class III reinforced concrete pipes, unless otherwise noted on the Design Drawings.
 7. Lifting holes, if used in manhole components, shall be tapered, and no more than two shall be cast in each section. Tapered, solid rubber plugs shall be furnished to seal the lifting holes. The lifting holes shall be made to be sealed by plugs driven from the outside face of the section only.

8. Mark date of manufacture, manhole number as shown on the Design Drawings, and name or trademark of manufacturer on inside of barrel.

B. Manhole Bases Sections:

1. Precast concrete manhole base sections shall be "monolithic", consisting of base slab and base riser (barrel) section.
 - a. NOTE TO SPECIFIER: DESIGN ENGINEER SHALL REVIEW GROUNDWATER & FLOOD ELEVATIONS IN THE PROJECT AREA & THE POTENTIAL FOR FLOATATION OF THE MANHOLES. DESIGN ENGINEER SHALL SUBMIT CALCULATIONS AND GROUNDWATER DATA VERIFYING POTENTIAL FOR MANHOLE FLOATATION. If floatation is found to occur based on the Design Engineer's review, precast base sections shall be furnished with an integral anti-flotation footing, thickness as specified hereinafter, extending trench bank-to-bank as shown in the Standard Details (minimum 8" projection).
 - b. Precast concrete manhole base slab thickness shall comply with the following schedule:

0.0' – 15.0'	Vertical Height	- 8" Slab
15.1' – 20.0'	Vertical Height	- 10" Slab
20.1' – 25.0'	Vertical Height	- 12" Slab
25.1' – 30.0'	Vertical Height	- 14" Slab
 - c. Manholes over 30 feet shall be designed by a Professional Engineer registered in the State of Kentucky. Submittals shall be provided to SD1 for review & approval.
 - d. Manhole bases shall have two cages of reinforcing steel in their walls, each of the area equal to that required in the riser sections. Wall thickness shall not be less than 5 inches.
 - e. There should be a minimum of twelve (12") inches between the outside diameters of all pipe penetrations in the base section.
 - f. Base riser shall extend a minimum twelve (12) inches above the top of the highest pipe in the base.
2. Flow channel (invert) and apron (bench) shall be poured separately at the point of manufacture to the dimensions shown on the Design Drawings.
 - a. The flow channel through manholes should be made to conform in shape and slope to that of the sewers.
 - b. Invert shall be smooth and semi-circular in cross-section of the same diameter of the pipe leaving the manhole.
 - c. Changes of direction of flow or sewer centerline within the manhole shall be made by forming the flow channel along a smooth curve with as long radius as the inside of the manhole

will allow.

- d. Bench shall slope toward invert at not less than one (1) inch per foot.
3. All precast base sections with pipe openings shall be furnished with ASTM C 923 pipe-to-manhole connector gaskets as specified hereinafter.

C. Manhole Barrel Sections:

1. Manhole barrel sections shall have reinforcing steel in their walls, Wall thickness shall not be less than 5 inches.
2. The barrel of the manhole shall be constructed of various lengths of riser pipe manufactured in increments of one foot to provide the correct height with the fewest joints. Openings in the barrel of the manholes for sewers or drop connections will not be permitted closer than one foot from the nearest joint. Special manhole base or riser sections shall be furnished as necessary to meet this requirement.
3. The barrel sections shall be of the height required, but not less than one (1) foot in height. No opening shall be cut into a barrel section, the maximum dimension of which exceeds one-half (1/2) the section height.
4. Joints between manhole components shall be the tongue and groove. The circumferential and longitudinal steel reinforcement shall extend into the tongue and groove ends of the joint without breaking the continuity of the steel. Joints between the base sections, riser sections and top slabs of manholes 72 inches in diameter and less shall be rubber and concrete joints. Joints for manhole components greater than 72 inches in diameter shall be provided with steel bell and spigot rings.
5. Precast manhole section joints shall be joined with one of the following products:
 - a. ASTM C 443, a single, continuous rubber O-ring gasket and shall conform to AWWA C302.
 - b. ASTM C-990, flexible butyl resin sealant such as Conseal CS-102, CS-202 as manufactured by Concrete Sealants, Inc.
 - c. Hamilton-Kent "Kent-Seal No. 2"
 - d. K.T. Snyder Co. "Rub'r-Nek"
 - e. Press Seal Gasket "E-Z Stik"
6. All precast barrel sections with pipe openings shall be furnished with ASTM C 923 pipe-to-manhole connector gaskets as specified hereinafter.

D. Cone Sections and Top Slab:

1. A precast concentric cone or precast top slab shall be provided at the top of the manhole barrel to receive the cast iron frame and cover or

floor access hatch cover as shown on the Design Drawings. Eccentric cones will be evaluated on a case by case basis.

2. Cone sections and top slabs shall be designed for an H-20 wheel loading, and an allowance of 30 percent in roadways and 15 percent in rights-of-way for impact.
3. Cone sections for standard manholes shall have a minimum 8" thick upper walls and shall not exceed 3'-0" in height.
4. Concrete top slabs shall not be less than 8 inches thick.

E. Drop Manhole:

1. Drop Manholes shall conform to all provisions specified herein, with the additional requirements for the drop pipe as shown on the Design Drawings.
2. The drop pipe shall be of the same material and diameter as the inlet sewer pipe used.
3. Drop pipe shall be totally enclosed in concrete, formed, with a minimum covering dimension of six (6) inches.
4. No drop pipes shall be allowed inside of the manholes, unless otherwise approved by SD1.
5. Base shall be cast to support drop connection.

F. Acceptable Manufacturers

1. Aerocrete
2. Sherman Dixie
3. KOI
4. Hanson
5. or equal

2.2 PRECAST EPOXY RESIN MANHOLES

A. General:

Polymer concrete manholes may be installed in lieu of lined concrete manholes. Polymer concrete manholes shall be manufactured in accordance with ASTM D 6783.

1. Design

- a. Manholes shall be designed to withstand all live loads and dead loads as described in project plans and specifications.
- b. Dead loads shall include overburden load, soil side pressure and hydrostatic loading conditions.
- c. Manholes shall also be designed to resist buoyancy for the project conditions.
- d. Compressive strength: Pipe shall have a minimum unconfined compressive strength of 13,000 psi when measured in accordance with ASTM C 579.

B. Materials:

Resin: The manufacturer shall use only polyester resin systems designed for

use with this particular application.

1. Filler: All aggregate, sand and quartz powder shall meet the requirements of ASTM C 33, where applicable.
2. Additives: Resin additives, such as curing agents, pigments, dyes, fillers and thixotropic agents, when used, shall not be detrimental to the manhole.
3. Elastomeric Gaskets: Gaskets shall be suitable for the service intended. All gaskets shall meet the requirement of ASTM F 477.

C. Manufacturing and Product Construction

1. Manholes: Manhole components shall be manufactured by the vibratory vertical casting process resulting in a dense, non-porous, corrosion-resistant, homogeneous, composite structure. Manhole bases shall be designed to withstand flotation from groundwater or floodwater and movement from high velocities and/or directional changes in flow. The flow channel, benches and invert must also be of the same material as the manhole, integral within the manhole and installed by the manhole manufacturer and as shown on the standard manhole details drawing.
2. Joints:
 - a. The manhole components shall be connected with a compatible epoxy bonding agent or an elastomeric sealing gasket as the sole means to maintain joint water-tightness.
3. Joints at pipe tie-ins shall be ASTM C923 flexible pipe-to-manhole connector gaskets, as specified in Section 2.4. Joints shall be watertight. The connector gaskets shall be integral with the manhole wall. Walls shall have sufficient thickness to install the connector within the hole cored in the manhole wall. Pipe stubs cast into the manhole through the wall to provide the additional wall thickness are not acceptable and will not be allowed.
4. Fittings:
 - a. Cones, reducer slabs, base slabs and adjusting rings shall be of the same material as adjoining riser sections.
 - b. Fittings shall be manufactured elastomeric gaskets, epoxy bonding or fiberglass overlay.
5. Manhole Steps:
 - a. Furnish steel-reinforced polypropylene steps as specified in Section 2.6.
 - b. No steps shall be aligned over the flow channel.
 - c. Step spacing is 16" as indicated on the Standard Drawings.
6. Acceptable manufacturer: Manufacturer of pipe and fittings shall employ manufacturing methods and material formulations in use for a minimum of ten years.
 - a. Meyer Rohr +Schacht GmbH
 - b. or equal

2.3 MISCELLANEOUS METALS

- A. Metal frames, covers, floor access hatch covers, steps, toe pockets and similar required items shall be provided as shown on the Design Drawings and in accordance with Division 5 Sections on Metal Fabrications.

2.4 FLEXIBLE PIPE JOINT SEAL

- A. A flexible pipe joint seal shall be provided in the connection of pipe to manholes and other miscellaneous structures. The rubber seal shall meet the requirements given in ASTM C 923. The seal shall be of a size specifically designed for the pipe size and material.
- B. All connecting elements of the seal shall be Type 304 stainless steel.
- C. Flexible pipe joint seal shall allow for pipe alignment of up to fifteen (15) degrees deflection.
- D. Pipes entering manholes that do not have existing flows and have slopes greater than twenty-six (26) percent shall have fittings (22.5 or 11.25 degree bends) installed immediately outside the manhole.
- E. If a flexible pipe joint seal is provided at each manhole wall penetration and the pipe is not rigidly locked into the manhole wall through grouting or other methods, then the 12" maximum pipe stub shown in the SD1 Standard Drawing No. 113 is not required.
- F. Acceptable Products:
 - 1. Kor-N-Seal by NPC, Inc.
 - 2. A-Lok by A-LOK Products, Inc.
 - 3. Dura-Seal III by Dura-Tech
 - 4. Or equal.

2.5 MANHOLE COATINGS AND LININGS

- A. Interior Lining
 - 1. **NOTE TO SPECIFIER: All new manholes located within one (1) mile downstream of a force main discharge shall be lined with a corrosion resistant monolithic lining conforming to SD1's Technical Specifications.**

Where a force main connects to an existing manhole, that manhole and at least the next three (3) manholes downstream shall be lined with a corrosion resistant monolithic lining conforming to SD1's Technical Specifications. SD1 may also require existing manholes up to one (1) mile downstream of the new force main discharge be similarly lined on a case-by-case basis. The cover on the force main discharge manhole shall be a solid lid (not vented). SD1 may require that additional downstream vented manhole lids be replaced on a case-by-case basis.

Any existing manholes to be lined shall be inspected by the DESIGN ENGINEER and SD1 to determine the conditions of the manholes and confirm if the manholes are suitable for lining. If in the opinion of SD1, the existing manholes cannot be lined, then the manholes shall be replaced.

- B. Any concrete manhole designated to be lined on the Design Drawings must have a liner selected from one of the three types listed below or the Epoxy Resin type (Deduct Alternate) specified in section 2.2 above.

1. **Type 1 - Cured-in-place PVC composite liner**

- a. As a minimum the manhole liner systems shall be composed of a multiple layered composite. The primary layer shall be manufactured from 20 mils PVC with 10 ounce per square yard polyester fleece. The surface hairs of the fleece must be embedded in the molten PVC during the manufacturing process of the PVCP laminate. Glued laminates are not allowed.
- b. The fibrous body will be impregnated with a modified epoxy resin. Add fiberglass and resin, for additional liner thickness.

PVCP20-10=86 mills. (20 mill PVC & 10 oz Fleece). (i.e. no fiberglass).

PVCP20-28=88 mills. (20 mill PVC, 10 oz Fleece & 18 oz Fiberglass).

PVCP20-34=110 mills. (20 mill PVC, 10 oz Fleece & 24 oz Fiberglass).

PVCP20-custom mills (20 mill PVC, 10 oz Fleece & Fiberglass as required).

- c. Liner Thickness: The anticipated hydrostatic head "h" in feet above the bottom of the invert and the Radius "R" in feet of the structure shall determine the necessary liner thickness "t" in mils according to the calculation: $t = 3.32 \times R \times h$. Contractor shall calculate "t" for all manholes and provide these calculations to the Owner as part of the liner submittal.

- d. Liner shall be PVCP, Multiplexx™ Liner System or approved equal. Manholes receiving an interior lining shall have a polypropylene ladder in lieu of steps.
 - i. Ladder shall be Lane Vault Ladder or equal.

2. **Type 2 – SPECTRASHIELD**

SPECTRASHIELD shall only be used on existing manholes in rehabilitation applications.

Lining for existing manholes shall be SPECTRASHIELD Liner System as manufactured by CCI Spectrum, Inc., Jacksonville, Florida; 904-268-4951. Materials shall be designed and manufactured to withstand the severe effects of hydrogen sulfide in a wastewater environment.

CCI Spectrum, Inc. (manufacturer) and Applicator warrant the SPECTRASHIELD manhole liner against failure for a period of 10 years. Failure will be deemed to have occurred if the protective lining fails to (a) prevent the internal deterioration or corrosion of the structure (b) protect the substrate and environment from contamination by effluent. If any such failure occurs within 10 years of initial completion of work on a structure, the damage will be repaired to restore the lining at no cost to the Owner within 60 days after written notification of the failure. Failure does not include damage resulting from mechanical or chemical abuse or act of God. Mechanical or chemical abuse means exposing the lined surfaces of the structure to any mechanical force or chemical substance not customarily present or used in connection with structures of the type involved. There are no warranties express or implied other than those specifically stated in this section 1.03. Any liability for consequential and incidental damages is expressly disclaimed. Liability is limited to and shall not exceed the purchase price paid.

- a. The lining system shall be composed of a multi-layered stress skin palled liner system and installed in accordance with the manufacture's specifications. The components are described below:
 - i. The moisture barrier shall be a modified polymer and shall have a minimum thickness of 50 mils. The modified polymer shall be sprayable, solvent free, two-component polymeric, moisture/chemical barrier specifically developed for the corrosive wastewater environment.
 - ii. The surfacer shall be a polyurethane/polymeric blend foam and shall have a minimum thickness of 400 mils. The foam

shall be consist of two components with low viscosity and contain flame retardants.

- iii. The final corrosion barrier shall be a modified polymer and shall have a minimum thickness of 50 mils. The modified polymer shall be sprayable, solvent free, two-component polymeric, moisture/chemical barrier specifically developed for the corrosive wastewater environment.

The total thickness of the multi-component stress panel liner shall be a minimum of 500 mils.

- b. The components shall meet the following chemical analysis:

(i) Modified Polymer:

“A Component”

Viscosity, 77° F, cps., ASTM D-1638	450
Physical State	Liquid
Color	Clear to Amber
Hygroscopicity	Reacts with water

“B Component”

Viscosity, 77° F, cps., ASTM D-1638	500
Physical State	Liquid
Color	Flamingo Pink
Hygroscopicity	100 %

Reaction Profile (100 grams, 175° F Sample)

Gel Time, seconds	10
Tack Free Time, seconds	20
Cure Time, seconds	90

A System / B System Volume Ratio	1:1
----------------------------------	-----

Typical Physical Properties

Tensile Strength, PSI	>3600
Elongation, %	>300
Tear Strength, PLI	>5000
Shore a Hardness	96
100% Modulus, PSI	>2500

(ii) Polyurethane Rigid Structure Foam

“A Component”

Viscosity, 77° F, cps., ASTM D-1638	200
Physical State	Liquid

Color	Dark Brown
Hygroscopicity	Reacts with water and evolves CO ₂ gas

“B Component”

Viscosity, 77° F, cps., ASTM D-1638	660
Physical State	Liquid
Color	Transparent Dark
Hygroscopicity	Absorbs water rapidly thus changing ratio

Reaction Profile (100 grams, 77° F Sample)

Cream Time, seconds	1-4
Tack Free Time, seconds	5-8
Rise Time, seconds	6-10

A System / B System Volume Ratio	1:1
----------------------------------	-----

Typical Physical Properties

Density, nominal, core, lbs/ft ³ ASTM D-1622, 74° F	4-10
Compression Strength, PSI ASTM D-1621, 74° F Parallel Rise	90-150
Closed Cell Content, % ASTM 1940, 74° F	Over 95
Shear Strength, PSI ASTM C-273, 74° F	225-250

3. Type 3 – Duraplate 100 Liner System

Lining for manholes shall be PVC Duraplate 100 Liner System as manufactured by ALOK Products, Tullytown, Pennsylvania; 1-800-822-2565. Liner shall be cast integral into the concrete at the point of precast manufacture.

- a. PVC Liner, Channel Joints, H-joints and Corner Joints; Manufactured from polyvinyl chloride resin. White in color to assist in providing a light reflective environment. All sheet compounds shall result in a semi-rigid material for thermoforming to the contour of the structure and shall have a minimum wall thickness of 1.7mm (0.065 inch).
- b. Lined manholes shall have a flat top that is lined with the same type of protective liner as the manhole.

- c. Rubber gasket between structures shall be provided for a watertight seal. Gasket shall be DURA-Plate-Lok-Sealant MT-320 measuring 0.5 inches by 1.5 inches to be placed on the return. When the two sections are coupled, the butyl-lok will displace over the return on the bell and tongue ends of the liner.
- d. Linings shall be installed by a certified lining manhole precaster, while constructing the manhole, in strict conformance with the manufacturer's requirements. The Precaster shall submit certification documentation from ALOK products with the manhole submittals.
 - i. Inspect the form core for sharp or jagged edges that could damage the liner during the precasting and shipping process.
 - ii. Place Dura Plate 100 Liner panels level around the core of the form. Form release agent is not necessary.
 - iii. Install the vertical joints by placing the black rubber strip between the panel returns, making sure that the flap of the strip is fitted over one of the returns.
 - iv. Place backing plate on the inside return of panel that the flap fits over. Hold together with spring loaded clamps evenly spaced about 12" apart.
 - v. Secure the panels together with fasteners placed every 3 inches, making sure that each fastener is tightened to 5 in-lbs.
Note: The fasteners must be installed from the side opposite the flap, straight thru the backing plate, parallel to the liner.
 - vi. Repeat for all seams.
Note: Caulk can be placed between the form core and liner returns to minimize concrete seepage during production.
 - vii. Install reinforcement into form with any other necessary parts needed for the structure.
 - viii. Pour concrete around the liner evenly to prevent shifting of the liner.
 - ix. Vibrate and compact the concrete in a manner that will protect the liner and produce a dense, homogenous structure.
 - x. Take precaution to protect the liner from sharp or jagged objects while stripping from the form.
 - xi. Visually inspect the liner after production for any cuts or tears. If repairs are needed, refer to Dura

Plate 100 Liner repair bulletin for proper repair procedures.

- E. Steps shall be installed in each manhole at the point of manufacture. Drill all holes in liner larger than the diameter of the step. Install steps or ladder then caulk area around step and liner with FR500 caulking material (lap Sealant) and seal with a minimum 0.5” thickness of ThoRoc SewerGuard epoxy.
- F. All hole opening surfaces shall be coated with a minimum 0.5” thickness coverage of ThoRoc SewerGuard epoxy that overlaps the liner at least 1 ½ inches.
- G. Manhole Bench and Inverts – The benches and inverts shall be of the same material as the manhole, integral within the manhole and installed by the manhole manufacturer and as shown on the standard manhole detail drawings. The benches and inverts shall be coated with a minimum of 0.5” thickness of ThoRoc SewerGuard epoxy or approved equal. Thickness shall be tested in the field by SD1. CONTRACTOR shall patch all test holes.
- H. The procedure below shall be followed at the factory to determine the thickness of epoxy applied to the benching in manholes and structures manufactured.

Procedure:

1. Utilizing a 40 “L x 1.5“W x 0.5“H Nylon rod:
 - a. Designate each rod with a corresponding number.
 - b. Verify each rod dimension using a caliper.
 - c. Initial and date the measurements.
2. Mark the rod with a line at 1” increments.
3. Cut the rod at each line to form segments of 1“L x 1.5“W x 0.5“H.
4. Once the concrete is formed in the base of the manhole or structure space the segments approximately 18” apart and adhere the segments to the concrete such that the 0.5“H is the distance from top of concrete to the tip of the nylon segment.
 - a. Document the spacing of each segment on the back of the Manhole or Structure Assembly/Inspection Form.
 - b. Initial and date the measurements.
5. As the benching is being applied, it should be above the segments, which are 0.5“H.

6. During the final inspection of the manhole/structure, there should be no visible segments.
 - a. Document the observations on the back of the Manhole or Structure Assembly/Inspection Form.
 - b. Initial and date the observations.
- c. If the difference or thickness of the ThoRoc is 0.5" – 1.0" inches at all reference points, the manhole is acceptable.
- d. If the difference or thickness of the ThoRoc is less than 0.5", the thickness is not correct. Inform proper production personnel of the problem and that it needs to be corrected before the manhole/structure is approved.

2.6 MANHOLE STEPS

- A. Plastic manhole steps shall be PS1-PF (Press Fit polypropylene plastic) as manufactured by MA Industries, or equal. Steps shall be driven into specially sized holes cast into the manhole section. Holes shall be formed in the manhole section using an insert plug that is removed upon curing.
- B. No steps shall be aligned over the flow channel. Step spacing shall be 16" as shown the Standard Detail Drawing.

2.7 MANHOLE RISERS

- A. Manhole risers (adjusting rings) 6" to 10" height shall be concrete.
- B. Manhole risers 2" to 4" height shall be high density polyethylene as manufactured by Ladtech, Inc.

2.8 VORTEX ASSEMBLIES

- A. General

NOTE TO SPECIFIER: Design Engineer shall specify the manhole diameter which will receive the Vortex assembly. The minimum manhole diameter shall be six (6) feet; all other diameters will be evaluated on a case by case basis and approved by SD1.

1. Vortex Assemblies shall be as designed by Vortex Flow, Inc, or approved equal. Vortex Assemblies shall be designed to operate effectively with flows between 15% and 115% of their rated capacity. NOTE TO SPECIFIER: Design Engineer shall specify the design flows.
2. All units supplied to any project must be engraved "U.S. Patent No. 6,419,843". This should appear 4" down from the top of the inner wall of the Vortex Form and 4" down from the top of the Vortex shaft. The engraving must be readable at any time.
3. All Vortex assemblies shall be manufactured by IPEX USA L.L.C.

(1-800-463-9572) or an IPEX authorized sub-contractor, without exception.

4. All units shall be manufactured to standard specifications produced by Vortex Flow Inc. and supplied under license to IPEX Inc.

B. References

1. American Society of Testing Materials (ASTM)
 - a. D618 Conditioning Plastics and Electrical insulating materials for Testing
 - b. D1784 Rigid Poly Vinyl Chloride (PVC) Compounds and Chlorinated Poly Vinyl Chloride (CPVC) compounds
 - c. D2122 Determining Dimensions of Thermoplastic Pipe and Fittings
 - d. D2152 Degree of Fusion of Extruded Poly Vinyl Chloride (PVC) Pipe and Molded Fittings by Acetone Immersion
 - e. D2241 Poly Vinyl Chloride (PVC) Plastic Pipe (SDR-PR)
2. American Water Works Association (AWWA)
 - a. C900 PVC Pressure Pipe and Fabricated Fittings, 4 through 12"
 - b. C905 PVC Pressure Pipe and Fabricated Fittings, 14 through 48"

C. Materials

1. All pipe sections used in the fabrication of the Vortex assembly must be manufactured to AWWA C900 (4"-12" nominal diameter) or AWWA C905 (14" – 48" nominal diameter).
2. All PVC sheet used in the fabrication of the Vortex Assembly to be ½" PVC sheet as per ASTM D1248.
3. The vortex Manufacturer or design engineer shall provide calculations specifying the steel strap anchoring devices to be used. The strapping detail shall be shown on the vortex design drawings.
4. Type 316 SS strapping and anchors shall be provided to anchor the vortex unit to the manhole.

D. Installation

1. Verify that field measurements are as indicated on Shop Drawings.
2. Install components in accordance with shop drawings, manufacturer's instructions, and Standard Drawings.
3. Align Work plumb and level.
4. Rigidly anchor to substrate with Type 316 SS straps to prevent misalignment.
5. Do not allow the PVC Vortex device to be stored uncovered and open to sunlight. Do not store the finished Work uncovered and open to sunlight.

- E. Tolerances
 - 1. Maximum variation from true dimension: 1/4 inch.
 - 2. Maximum offset from true position: 3/8 inch.

2.9 EXTERNAL SLEEVE FOR STRUCTURE

- A. Provide external sleeve around all manhole joints and the chimney as designated on the plans. Any manholes located within fifty (50) feet or less of a creek/ stream or within a floodplain shall have an external sleeve. External sleeve shall be a wraparound heat shrinkable sleeve that creates a barrier to water infiltration and protects support of the structure and frame from ground moisture prevents corrosion and freeze-thaw damage. The system shall be compatible with and bond to concrete, metal, and fiberglass using an adhesive type primer. The sleeve shall have the following physical properties:

Softening Point	212 degrees Fahrenheit	ASTM E-28
Lap Shear Strength	12 PSI	DIN 30 672
Tensile Strength	2900 PSI	ASTM D-638
Elongation	600%	ASTM D-638
Hardness	46 Shore D	ASTM D-2240
Abrasion Resistance	45 mg	ASTM D-1044
Peel Strength	9PLI	ASTM D-1000
Water Absorption	0.05%	ASTM D-570
Low Temperature	-40 degrees Fahrenheit	ASTM D-2671D
Minimum Width	12 inches	

- B. System shall accommodate ground movement and resists soil stress.
- C. Acceptable Products:
 - 1. WrapidSeal – Manhole Encapsulation System by Canusa –CPS.
 - 2. Link- Seal Riser- Wrap Heat Shrink System.
 - 3. Or Equal.

PART 3 - EXECUTION

3.1 MANHOLE BASES

- A. General
 - 1. Manholes shall be constructed at the locations shown on the Design Drawings.

2. The dimensions shall be as shown on the detail sheets and the depths shall be as indicated by either finished top elevation given or depth dimension given on the plans.
3. Perform Sitework as per the requirements of Specifications Sections 02050, 02110, 02220, and 02222.
4. Excavation for manholes and other underground structures shall be of sufficient size to adequately accommodate installation and proper centering.
5. The bases shall be placed directly on an 8-inch to 12-inch deep pad (compacted thickness) of pipe bedding material as specified in section 02220, placed to proper elevation and leveled, unless a deeper excavation is required to remove any loose sandy soils or soft to medium stiff, clayey soils down to a soil stratum suitable for support of the manhole and base.
 - a. The excavated soils shall be replaced with an appropriate Structural Backfill material or with controlled, low-strength material (CLSM), lean concrete, or an extra thickness of manhole base concrete.
6. The excavation shall be kept free of water while the manhole is being constructed and manhole shall not be backfilled until inspected by the OWNER.
7. CONTRACTOR will be required to compact bedding material around the entire circumference of the manhole and manhole excavation area to at least 12-inches above the highest incoming or outgoing pipe.
8. Compacted backfill as specified on the Design Drawings or section 02220 shall then be placed above the compacted bedding material up to finished grade.

B. Pre-Cast Bases

1. The OWNER reserves the right to inspect precast manhole base sections at the construction site and to reject the use of such sections if the OWNER determines the products unsuitable for the OWNER'S installation.
2. Pre-Cast bases shall be used in lieu of doghouse manholes where flow permits, as determined by the ENGINEER.

C. Cast-in-Place Bases

1. Cast-in-Place Bases shall be used when installing a doghouse manhole over an existing sewer or as approved by the ENGINEER.
 - a. Cast-in-place bases shall be placed on suitable foundations after the pipes are laid as specified in 3.1.A.5.
2. The base shall be cast monolithically to an elevation at least 12 inches above the top of the highest pipe entering the manhole, except where a drop connection is to be installed.
 - a. Base thickness shall be as per 2.1.B.1.


- b. Base, walls and bottom shall be at least of the thickness shown and reinforced to withstand the loads to be expected.
- c. Connections for sewer pipes shall conform to SD1's standard detail.
- d. The base of the bell or groove end at joints between components shall be buttered with 1:2 cement-sand mortar to provide a uniform bearing between components.
- e. All joints shall be sealed with cement mortar inside and out and troweled smooth to the contour of the wall surface.
- f. Raised or rough joint finishes will not be accepted.

3.2 PRECAST MANHOLE SECTIONS

- A. Set sections vertical with steps and sections in true alignment.
- B. Install sections, joints and gaskets in accordance with manufacturer's recommendations.

3.3 MANHOLE CHANNELS

- A. All invert channels through manholes shall be constructed of 4000 psi concrete.
- B. The flow line (channel) and benches shall be cast separately from the floor and side wall at the place of manufacture, unless otherwise approved by SD1.
- C. Channels shall be properly formed to the sizes, cross sections, grades and shapes shown or as ordered.
- D. Benches shall be built up to the heights shown or as ordered and given a uniform wood float finish.
- E. Care shall be taken to slope all benches for proper drainage to the invert channel.
- F. All flow channel angles between any new incoming pipe and new outgoing pipe shall be at least 95 degrees in the direction of flow as seen in the figure below. For any pipe with velocities exceeding 5 ft/s consult SD1 for the required angle or for the need of an oversized manhole.

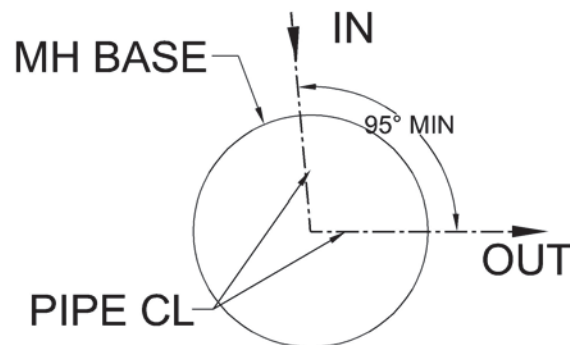

3.4 GRADE RINGS

- A. Grade rings shall be used for all precast and masonry manholes to adjust height of manhole frame casting where required.
 - 1. Grade rings shall be a maximum of 10 inches in height, constructed on the roof slab or cone section on which the manhole frame and cover shall be placed.
 - 2. The height of the grade ring shall be such as is necessary to bring the manhole frame to the proper grade.
 - 3. One piece precast concrete rings shall be used for grade adjustment greater than six (6) inches and up to ten (10) inches in height. Rings shall be set concentrically on top of the cone section or top slab if used.
 - 4. High density polyethylene risers shall be used for grade adjustment from two (2) inches to a maximum of six (6) inches in height. Rings shall be set concentrically on top of the cone section or top slab if used.
 - 5. All grade rings shall be sealed using two rows of butyl rubber sealant.

- B. The casting frame shall be installed on the riser as previously described with four (4) five-eighths (5/8) inch diameter stainless steel bolts extending through the riser, grade rings, and into the cone section or top slab.
 - 1. The riser and cone may also be drilled with four (4) equally spaced five-eighths (5/8) inch diameter holes and four (4) No. 5 steel reinforcement bars installed and left flush with the riser top to prevent lateral movement and the casting frame bolted to the riser as previously described.

- C. High Density Polyethylene Manhole Adjusting Rings shall be used to adjust up to a maximum of six (6) inches.

3.5 PIPE CONNECTIONS TO MANHOLES

- A. A flexible pipe-to-manhole joint connector shall be used for joining piping to manholes and other miscellaneous structures. The rubber seal shall meet the requirements given in ASTM C 923. The seal shall be of a size specifically designed for the pipe size and material and be as specified herein.
 - 1. If a Kor-N-Seal joint seal or equal with a stainless steel tightening band is used, CONTRACTOR shall tighten the band to the proper torque as specified by the manufacturer.
 - 2. If the slope of the incoming sewer exceeds 26% from the horizontal, a fitting shall be used outside the manhole wall to facilitate a more perpendicular connection to the manhole wall. The use of this fitting is to be evaluated on a case by case basis by sd1 engineers.
- B. All pipe connections to manholes shall match crowns. If matching crowns is not possible, a drop manhole may be approved by SD1.
- C. All drop manholes shall be approved by SD1. Drop manholes may be acceptable under the following conditions:
 - 1. If the slope of the influent sewer is greater than or equal to five (5) percent, SD1's drop connection detail 114 shall be followed. All other influent sewer slopes and drop connections will be evaluated on a case by case basis.
 - 2. All other drop manhole requests shall be approved on a case by case basis including but not limited to pipe realignments, connections to existing manholes, etc.

NOTE TO DESIGN ENGINEER: SD1 prefers matching crowns for sewer connections; however, depending upon depth of the sewer, drop manholes will be evaluated. Contact SD1 to discuss the details of the design for the project.
 - 3. If the total height of the drop is greater than sixteen (16) feet, a Vortex assembly shall be used. See Section 2.8.
- D. Slide manholes shall not be used.

3.6 CONNECTIONS TO EXISTING MANHOLES

- A. Perform by core drilling in accordance with section 01045.
- B. A flexible pipe-to-manhole joint connector shall be used for joining new piping to existing manholes and other miscellaneous structures. The rubber seal shall meet the requirements given in ASTM C 923. The seal shall be of

a size specifically designed for the pipe size and material and be as specified herein.

1. If a Kor-N-Seal joint seal or equal with a stainless steel tightening band is used, CONTRACTOR shall tighten the band to the proper torque as specified by the manufacturer.
- C. The flow channel and bench for the new connection shall be constructed onsite or the existing flow channel and bench modified to accept the new piping.
- D. New connections to existing manholes need to be greater than ninety (90) degrees to the existing flow channel in the direction of the flow.
- E. Where new flows joining an existing eight (8) inch sewer that is flowing half pipe or greater, or the exiting pipe is twelve (12) inches or greater, an oversized manhole shall be installed to allow a smooth, sweeping flow transition. Consult SD1 for required manhole diameter.
- F. Perform all connections in accordance with Parts 3.9 and 3.11 of this section.

3.7 DOGHOUSE MANHOLES

For joining new pipe to existing pipe, refer to Item 3.1.B.2 of this section for requirements. Doghouse manholes shall only be used for connections to sewer mains with high flows, as determined by the ENGINEER. Doghouse manholes must be approved by SD1. For applications using doghouse manholes, refer to Item 3.1.C of this section and SD1 Standard Detail No.106 for requirements.

3.8 INTERIOR LINING

Any concrete manhole designated to be lined on the Design Drawings must have **Type 1 - Cured-in-place PVC composite liner, Type 2 – SPECTRASHIELD Liner System, or Type 3 – Duraplate 100 Liner System.** Epoxy Resin manholes can also be used in lieu of lined manholes as a Deduct Alternate (see Section 2.2).

- A. Cured-in-place PVC Composite Liner:
1. Description of Work
 - a. This work shall include the furnishing of all labor, materials, and equipment for the installation of a cured-in-place PVC composite liner within a new sanitary sewer manhole.
 - b. The manhole liner shall be manufactured to the shape of the manhole. The fibrous portion of the liner shall be saturated with a modified epoxy resin, then pressurized and cured in-place.
 - c. A removable inflation bladder shall be pressurized between ½ - 5 pounds per square inch. The bladder will be removed

- upon completion of the curing.
 - d. The exposed surface of the liner shall be white PVC.
- 2. Liner Performance Requirements
 - a. Liner shall be of the type that allows lining of a concentric, eccentric or flat top manhole without removing the manhole ring and top section or corbel.
 - b. The liner shall be installed and cured in place via controlled curing by heat and pressurization in the manhole to complete the curing process.
 - c. The lining of the manhole shall result in a monolithic structure to the shape and contour of the existing manhole. The liner shall be installed and bond to the interior manhole substrate and be completely watertight, and free of any joints or openings other than pipe inlets, outlets and the cover frame opening.
 - d. Where indicated on the manhole schedule, the lining shall be designed with independent structural hoop strength for full height hydrostatic pressure as if the liner were a secondary vessel inside the existing manhole. The manufacturer shall design adequate liner thickness into the system with or without additional fiberglass layers.
 - e. All lined manholes shall have lined inverts. Plug the pipes entering the manhole and line the flow channel to the edge of the pipe. Trim all pipe openings and seal trimmed edges with a coating of epoxy mastic.
- 3. Preparation

All surfaces of the manhole shall be cleaned with a high-pressure water-jet sprayer with an operating pressure of at least 3,500 psi. Pressure wash the manhole to remove all dirt, grease, sand, and surface contaminants on the wall and floor leaving a clean damp surface.
- 4. Liner Installation
 - a. Installation shall be by an installer that is qualified by the liner manufacturer. The Contractor shall include the furnishing of all materials, equipment, tools, and labor as required for the rehabilitation of the manholes selected, including the installation of the interior liner.
 - b. The installation of the approved liner system shall be in strict accordance with the manufacturer's instructions. This shall include the preparation, installation, inflation, curing, and finishing operations, required for the completion of the manhole lining process.
 - c. All safety rules and regulations, applicable laws, and insurance requirements shall be observed in storing, handling, use, and application of the liner materials, resins, and any solvents.

- d. Ventilation shall be provided to the workers at all times.
- 5. Warranty
The CONTRACTOR shall warrant to the OWNER in writing the installation, fabrics, and resins to be free of defects in workmanship and materials for a period of ten years.

B. SPECTRASHIELD Liner System

The applicator of the SpectraShield liner system shall be trained and certified by the manufacturer for the handling, mixing, application and inspection of the liner system as described. To ensure total unit responsibility, all materials and installation thereof shall be furnished and coordinated with/by one supplier/applicator who turnkeys the work and assumes full responsibility for the entire operations.

- 1. Inspection
 - a. Applicator shall take appropriate action to comply with all local, state and federal regulations including those set forth by OSHA, EPA, the Owner and any other applicable authorities.
 - b. Prior to conducting any work, perform inspection of structure to determine need for protection against hazardous gases or oxygen depleted atmosphere and the need for flow control or flow diversion.
 - c. Submit plan for flow control or bypass to owner/engineer for approval prior to conducting the work.
 - d. New Portland cement structures shall have endured a minimum of 28 days since manufacture prior to commencing installation of the liner system.
- 2. Description of Work
 - a. This work shall include the furnishing of all labor, material, and equipment for the installation of SpectraShield liner system within a new sanitary sewer manhole.
- 3. Surface Preparation
 - a. Conduct surface preparation program to include monitoring of atmosphere for hydrogen sulfide, methane, low oxygen or other gases, approved flow control equipment, and surface preparation equipment.
 - b. Surface preparation methods may include high pressure water cleaning, hydro blasting, abrasive blasting, grinding, detergent water cleaning and shall be suited to provide a surface compatible for installation of the liner system.
 - c. Surface preparation method shall produce a cleaned, abraded and sound surface with no evidence of laitance, loose concrete, brick or mortar, contaminants or debris, and shall

display a surface profile suitable for application of liner system.

- d. After completion of surface preparation, perform the seven point check list, which is the inspection for:
 1. Leaks
 2. Cracks
 3. Holes
 4. Exposed Rebar
 5. Ring and Cover condition
 6. Invert Condition
 7. Inlet and Outlet Pipe Condition
 - e. After the defects in the structure are identified, repair all leaks with a chemical or hydraulic sealant designed for use in field sealing of ground water. Severe cracks shall be repaired with a urethane based chemical sealant. Product to be utilized shall be as approved by owner/engineer prior to installation. Repairs to exposed rebar, defective pipe penetrations or inverts, etc. shall be repaired utilizing non-shrink grout or approved alternative method.
4. Material Installation
- a. Application procedures shall conform to recommendations of the manufacturer, including materials handling, mixing, environmental controls during application, safety and spray equipment.
 - b. Spray equipment shall be specifically designed to accurately ratio and apply the liner system.
 - c. Application of multi-component liner system shall be in strict accordance with manufacturer's recommendation. Final installation shall be a minimum of 500 mils. A permanent identification and date of work performed shall be affixed to the structure in a readily visible location.
 - d. Provide final written report to owner/engineer detailing the location, date of report, and description of repair.
5. Post-Construction Inspection
- a. Final liner system shall be completely free of pinholes or voids. Liner thickness shall be the minimum value as described herein.
 - b. Visual inspection shall be made by the Owner/Engineer. Any deficiencies in the finished liner system shall be marked and repaired according to the procedures set forth by Manufacturer.
 - c. The sewer system may be returned to full operational service as soon as the final inspection has taken place.

3.9 STUBS FOR FUTURE CONNECTIONS

- A. Installation of stubs for future connections shall be evaluated on a case by case basis and approved by SD1. If stubs are approved, PVC, ductile iron, or fiberglass pipe stubs with approved watertight plugs shall be installed in manholes. SD1 requires that future connections to existing manholes be cored and the benching modified to accept the new connection. Where pipe stubs, sleeves or couplings for future connections are shown or ordered, CONTRACTOR shall provide all materials and work for their construction.
- B. If stubs are approved by SD1, stubs out of manholes shall be a two (2) to five (5) foot stick of pipe with sealed caps. When future connections are made to these manholes, the stubs shall be removed and a full stick of pipe shall be installed at the proper slope.
- C. Where connections are made to existing manholes installed after May 15, 2000, the existing manhole shall be vacuum tested prior to the connection being made. If the manhole is vacuum tested prior to alterations and fails, it is the responsibility of SD1 to repair or replace the manhole. If the manhole passes the vacuum test prior to connection, but fails the vacuum test after the connection is made, then the CONTRACTOR shall repair or replace the manhole per SD1's direction and approval.

If the CONTRACTOR fails to vacuum test the manhole prior to any connections being made, and the manhole fails the vacuum test after the connection, the CONTRACTOR shall repair or replace the manhole per SD1's direction and approval.
- D. If the connection to an existing manhole is cored, the connection shall be booted and the existing manhole shall pass a vacuum test after all work is complete, if the existing manhole was installed after May 15, 2000.
- E. If the elevation or grade of an existing manhole is altered, the existing manhole shall pass a vacuum test after all work is complete, if the existing manhole was installed after May 15, 2000.

3.10 GRADING AT MANHOLES

- A. Manholes shall be installed to conform to the following convention unless otherwise called for on the plans. The ground surface shall be graded to drain away from the manhole. Final dimensions shall be determined after grading has taken place.
 - 1. Manholes in roads, parking lots, paved areas and lawns shall be installed flush with the surrounding area.
 - 2. Manholes in wooded or other inaccessible areas shall be installed twelve (12) inches above the final grade.
 - 3. Manholes in cultivated fields, hay fields and pastures shall be

installed with the cone section flush with the final grade. After installation of the casting, a slope fill 1:5 (1 vertical to 5 horizontal) shall be installed to provide surface drainage away from the manhole.

- B. Manholes in paved areas shall be constructed to meet the final surface grade. In paved areas on State Highways, all manholes shall be 1/2 inch below final wearing surfaces. Manholes shall not project above finished roadway pavements to prevent damage from snowplows.
- C. CONTRACTOR shall be solely responsible for the proper height of all manholes necessary to reach the final grade at all locations. CONTRACTOR is cautioned that ENGINEER'S review of Shop drawings for manhole components will be general in nature and CONTRACTOR shall provide an adequate supply of random length precast manhole riser sections to adjust any manhole to meet field conditions for final grading.

3.11 MANHOLE WATERTIGHTNESS

- A. All manholes shall be free of visible leakage. Each manhole shall be tested for leaks and inspected. If the manhole fails a visual leakage inspection and/or vacuum testing, SD1 will consider the manhole defective and the Contractor shall replace the manhole and make any necessary reconnections to the new or existing pipelines at no additional cost to the Owner. No leak repairs shall be performed without the ENGINEER'S approval.
- B. Vacuum test manholes to ASTM C 1244. Testing to be witnessed by OWNER. Manholes not subject to vacuum testing must be in writing from OWNER. This specification shall govern the negative air pressure (vacuum) testing of sanitary sewer manholes and structures and shall be used as a method of determining acceptability by the OWNER, in accepting maintenance of a sanitary sewer manhole or structure on behalf of the public. Other forms of testing of some manholes may be required, as deemed necessary by the Owner.
- C. Manholes shall be tested after installation with all connections in place along with the following completed prior to testing:
 - 1. Lift holes, if any, shall be plugged with an approved, non-shrinkable grout prior to testing.
 - 2. Drop connections shall be installed prior to testing.
 - 3. The vacuum test shall include testing of the seal between the cast iron frame and the concrete cone, slab or grade rings.
 - 4. The manholes shall be backfilled and finished to design grade prior to test.
 - 5. Test pressure requirements of ASTM C-923 shall be met.

D. Test Procedure:

1. Temporarily plug, with the plugs being braced to prevent the plugs or pipes from being drawn into the manhole, all pipes entering the manhole at least eight inches into the sewer pipe(s). The plug must be inflated at a location past the manhole/pipe gasket.
2. The test head shall be placed inside the frame at the top of the manhole and inflated, in accordance with the manufacturer's recommendations.
3. A vacuum of 10" of mercury shall be drawn on the manhole. Shut the valve on the vacuum line to the manhole and disconnect the vacuum line.
4. The pressure gauge shall be liquid filled, having a 3.5 inch diameter face with a reading from zero to thirty inches of mercury.
5. The manhole shall be considered to pass the vacuum test if it holds at least 9 inches of mercury for the following time durations:

<u>Manhole Depth</u>	<u>Time (Minutes)</u>		
	<u>4' Diameter</u>	<u>5' Diameter</u>	<u>6' Diameter</u>
20 Feet or Less	1	2	3
20.1 to 30 Feet	2	3	4

Note: Consult SD1 on manhole diameters larger than six (6) feet.

6. If a manhole fails the vacuum test, SD1 will consider the manhole defective and the CONTRACTOR shall replace the manhole and/ or defective components and make any necessary reconnections to the new or existing pipelines at no additional cost to the Owner. No repairs shall be made to the manhole unless approved by the ENGINEER.
7. All temporary plugs and braces shall be removed after each test.
8. Manholes will be accepted as having passed the vacuum test requirements if they meet the criteria stated above.

+ + END OF SECTION + +

KyTC BMP Plan for Project PCN ## - #####



Kentucky Transportation Cabinet

Highway District 6

And

_____ (2), Construction

**Kentucky Pollutant Discharge Elimination System
Permit KYR10
Best Management Practices (BMP) plan**

Groundwater protection plan

For Highway Construction Activities

For

**US 25 (Dixie Highway) at Beechwood Road
Kenton County**

**Project: PCN ## - #####
Item 06-0432.00**

KyTC BMP Plan for Project PCN ## - #####

Project information

Note – (1) = Design (2) = Construction (3) = Contractor

1. Owner – Kentucky Transportation Cabinet, District 6
2. Resident Engineer: (2)
3. Contractor name: (2)
Address: (2)

Phone number: (2)
Contact: (2)
Contractors agent responsible for compliance with the KPDES permit requirements (3):
4. Project Control Number (2)
5. Route (Address) US 25 (Dixie Highway) at Beechwood Road in Kenton County
6. Latitude/Longitude (project mid-point) dd/mm/ss, dd/mm/ss 39^02'90" north, 84^33'11" west
7. County (project mid-point) Kenton County
8. Project start date (date work will begin): (2)
9. Projected completion date: (2)

KyTC BMP Plan for Project PCN ## -

A. Site description:

1. Nature of Construction Activity (from letting project description) **Adding a left turn lane**
2. Order of major soil disturbing activities **(2) and (3)**
3. Projected volume of material to be moved **495 Cubic Yards**
4. Estimate of total project area (acres) **6.50 Acres**
5. Estimate of area to be disturbed (acres) **0.75 Acres**
6. Post construction runoff coefficient will be included in the project drainage folder. Persons needing information pertaining to the runoff coefficient will contact the resident engineer to request this information. **0.5**
7. Data describing existing soil condition **(2)**
8. Data describing existing discharge water quality (if any) **(2)**
9. Receiving water name, **Pleasant Run Creek**
10. TMDLs and Pollutants of Concern in Receiving Waters: **None**
11. Site map – Project layout sheet plus the erosion control sheets in the project plans that depict Disturbed Drainage Areas (DDAs) and related information. These sheets depict the existing project conditions with areas delineated by DDA (drainage area bounded by watershed breaks and right of way limits), the storm water discharge locations (either as a point discharge or as overland flow) and the areas that drain to each discharge point. These plans define the limits of areas to be disturbed and the location of control measures. Controls will be either site specific as designated by the designer or will be annotated by the contractor and resident engineer before disturbance commences. The project layout sheet shows the surface waters and wetlands.
12. Potential sources of pollutants:

The primary source of pollutants is solids that are mobilized during storm events. Other sources of pollutants include oil/fuel/grease from servicing and operating construction equipment, concrete washout water, sanitary wastes and trash/debris. (3)

KyTC BMP Plan for Project PCN ## -

B. Sediment and Erosion Control Measures:

1. Plans for highway construction projects will include erosion control sheets that depict Disturbed Drainage Areas (DDAs) and related information. These plan sheets will show the existing project conditions with areas delineated by DDA within the right of way limits, the discharge points and the areas that drain to each discharge point. Project managers and designers will analyze the DDAs and identify Best Management Practices (BMPs) that are site specific. The balance of the BMPs for the project will be listed in the bid documents for selection and use by the contractor on the project with approval by the resident engineer.

Projects that do not have DDAs annotated on the erosion control sheets will employ the same concepts for development and managing BMP plans.

2. Following award of the contract, the contractor and resident engineer will annotate the erosion control sheets showing location and type of BMPs for each of the DDAs that will be disturbed at the outset of the project. This annotation will be accompanied by an order of work that reflects the order or sequence of major soil moving activities. The remaining DDAs are to be designated as "Do Not Disturb" until the contractor and resident engineer prepare the plan for BMPs to be employed. The initial BMP's shall be for the first phase (generally Clearing and Grubbing) and shall be modified as needed as the project changes phases. The BMP Plan will be modified to reflect disturbance in additional DDA's as the work progresses. All DDA's will have adequate BMP's in place before being disturbed.
3. As DDAs are prepared for construction, the following will be addressed for the project as a whole or for each DDA as appropriate:
 - Construction Access – This is the first land-disturbing activity. As soon as construction begins, bare areas will be stabilized with gravel and temporary mulch and/or vegetation.
 - At the beginning of the project, all DDAs for the project will be inspected for areas that are a source of storm water pollutants. Areas that are a source of pollutants will receive appropriate cover or BMPs to arrest the introduction of pollutants into storm water. Areas that have not been opened by the contractor will be inspected periodically (once per month) to determine if there is a need to employ BMPs to keep pollutants from entering storm water.

KyTC BMP Plan for Project PCN ## -

- Clearing and Grubbing – The following BMP's will be considered and used where appropriate.
 - Leaving areas undisturbed when possible.
 - Silt basins to provide silt volume for large areas.
 - Silt Traps Type A for small areas.
 - Silt Traps Type C in front of existing and drop inlets which are to be saved
 - Diversion ditches to catch sheet runoff and carry it to basins or traps or to divert it around areas to be disturbed.
 - Brush and/or other barriers to slow and/or divert runoff.
 - Silt fences to catch sheet runoff on short slopes. For longer slopes, multiple rows of silt fence may be considered.
 - Temporary Mulch for areas which are not feasible for the fore mentioned types of protections.
 - Non-standard or innovative methods.
- Cut & Fill and placement of drainage structures - The BMP Plan will be modified to show additional BMP's such as:
 - Silt Traps Type B in ditches and/or drainways as they are completed
 - Silt Traps Type C in front of pipes after they are placed
 - Channel Lining
 - Erosion Control Blanket
 - Temporary mulch and/or seeding for areas where construction activities will be ceased for 21 days or more.
 - Non-standard or innovative methods
- Profile and X-Section in place – The BMP Plan will be modified to show elimination of BMP's which had to be removed and the addition of new BMP's as the roadway was shaped. Probably changes include:
 - Silt Trap Type A, Brush and/or other barriers, Temporary Mulch, and any other BMP which had to be removed for final grading to take place.
 - Additional Silt Traps Type B and Type C to be placed as final drainage patterns are put in place.
 - Additional Channel Lining and/or Erosion Control Blanket.
 - Temporary Mulch for areas where Permanent Seeding and Protection cannot be done within 21 days.
 - Special BMP's such as Karst Policy
- Finish Work (Paving, Seeding, Protect, etc.) – A final BMP Plan will result from modifications during this phase of construction. Probably changes include:
 - Removal of Silt Traps Type B from ditches and drainways if they are protected with other BMP's which are sufficient to control erosion, i.e. Erosion Control Blanket or Permanent Seeding and Protection on moderate grades.

KyTC BMP Plan for Project PCN ## -

- Permanent Seeding and Protection
 - Placing Sod
 - Planting trees and/or shrubs where they are included in the project
- BMP's including Storm Water Management Devices such as velocity dissipation devices and Karst policy BMP's to be installed during construction to control the pollutants in storm water discharges that will occur after construction has been completed are : N/A

C. Other Control Measures

1. No solid materials, including building materials, shall be discharged to waters of the commonwealth, except as authorized by a Section 404 permit.
2. Waste Materials

All waste materials that may leach pollutants (paint and paint containers, caulk tubes, oil/grease containers, liquids of any kind, soluble materials, etc.) will be collected and stored in appropriate covered waste containers. Waste containers shall be removed from the project site on a sufficiently frequent basis as to not allow wastes to become a source of pollution. All personnel will be instructed regarding the correct procedure for waste disposal. Wastes will be disposed in accordance with appropriate regulations. Notices stating these practices will be posted in the office.

3. Hazardous Waste

All hazardous waste materials will be managed and disposed of in the manner specified by local or state regulation. The contractor shall notify the Resident Engineer if there any hazardous wastes being generated at the project site and how these wastes are being managed. Site personnel will be instructed with regard to proper storage and handling of hazardous wastes when required. The Transportation Cabinet will file for generator, registration when appropriate, with the Division of Waste Management and advise the contractor regarding waste management requirements.

4. Spill Prevention

The following material management practices will be used to reduce the risk of spills or other exposure of materials and substances to the weather and/or runoff.

KyTC BMP Plan for Project PCN ## -

➤ **Good Housekeeping:**

The following good housekeeping practices will be followed onsite during the construction project.

- An effort will be made to store only enough product required to do the job
- All materials stored onsite will be stored in a neat, orderly manner in their appropriate containers and, if possible, under a roof or other enclosure
- Products will be kept in their original containers with the original manufacturer's label
- Substances will not be mixed with one another unless recommended by the manufacturer
- Whenever possible, all of the product will be used up before disposing of the container
- Manufacturers' recommendations for proper use and disposal will be followed
- The site contractor will inspect daily to ensure proper use and disposal of materials onsite

➤ **Hazardous Products:**

These practices will be used to reduce the risks associated with any and all hazardous materials.

- Products will be kept in original containers unless they are not resealable
- Original labels and material safety data sheets (MSDS) will be reviewed and retained
- Contractor will follow procedures recommended by the manufacturer when handling hazardous materials
- If surplus product must be disposed of, manufacturers' or state/local recommended methods for proper disposal will be followed

The following product-specific practices will be followed onsite:

➤ **Petroleum Products:**

Vehicles and equipment that are fueled and maintained on site will be monitored for leaks, and receive regular preventative maintenance to reduce the chance of leakage. Petroleum products onsite will be stored in tightly sealed containers, which are clearly labeled and will be protected from exposure to weather.

The contractor shall prepare an Oil Pollution Spill Prevention Control and Countermeasure plan when the project that involves the storage of petroleum

KyTC BMP Plan for Project PCN ## -

products in 55 gallon or larger containers with a total combined storage capacity of 1,320 gallons. This is a requirement of 40 CFR 112.

This project (will / will not) (3) have over 1,320 gallons of petroleum products with a total capacity, sum of all containers 55 gallon capacity and larger.

➤ **Fertilizers:**

Fertilizers will be applied at rates prescribed by the contract, standard specifications or as directed by the resident engineer. Once applied, fertilizer will be covered with mulch or blankets or worked into the soil to limit exposure to storm water. Storage will be in a covered shed. The contents of any partially used bags of fertilizer will be transferred to a sealable plastic bin to avoid spills.

➤ **Paints:**

All containers will be tightly sealed and stored indoors or under roof when not being used. Excess paint or paint wash water will not be discharged to the drainage or storm sewer system but will be properly disposed of according to manufacturers' instructions or state and local regulations.

➤ **Concrete Truck Washout:**

Concrete truck mixers and chutes will not be washed on pavement, near storm drain inlets, or within 75 feet of any ditch, stream, wetland, lake, or sinkhole. Where possible, excess concrete and wash water will be discharged to areas prepared for pouring new concrete, flat areas to be paved that are away from ditches or drainage system features, or other locations that will not drain off site. Where this approach is not possible, a shallow earthen wash basin will be excavated away from ditches to receive the wash water

➤ **Spill Control Practices**

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices will be followed for spill prevention and cleanup:

- Manufacturers' recommended methods for spill cleanup will be clearly posted. All personnel will be made aware of procedures and the location of the information and cleanup supplies.
- Materials and equipment necessary for spill cleanup will be kept in the material storage area. Equipment and materials will include as appropriate, brooms, dust pans, mops, rags, gloves, oil absorbents, sand, sawdust, and plastic and metal trash containers.
- All spills will be cleaned up immediately after discovery.

KyTC BMP Plan for Project PCN ## -

- The spill area will be kept well ventilated and personnel will wear appropriate protective clothing to prevent injury from contact with a hazardous substance.
- Spills of toxic or hazardous material will be reported to the appropriate state/local agency as required by KRS 224 and applicable federal law.
- The spill prevention plan will be adjusted as needed to prevent spills from reoccurring and improve spill response and cleanup.
- Spills of products will be cleaned up promptly. Wastes from spill clean up will be disposed in accordance with appropriate regulations.

D. Other State and Local Plans

This BMP plan shall include any requirements specified in sediment and erosion control plans, storm water management plans or permits that have been approved by other state or local officials. Upon submittal of the NOI, other requirements for surface water protection are incorporated by reference into and are enforceable under this permit (even if they are not specifically included in this BMP plan). This provision does not apply to master or comprehensive plans, non-enforceable guidelines or technical guidance documents that are not identified in a specific plan or permit issued for the construction site by state or local officials.

E. Maintenance

1. The BMP plan shall include a clear description of the maintenance procedures necessary to keep the control measures in good and effective operating condition.
- Maintenance of BMPs during construction shall be a result of weekly and post rain event inspections with action being taken by the contractor to correct deficiencies.
 - Post Construction maintenance will be a function of normal highway maintenance operations. Following final project acceptance by the cabinet, district highway crews will be responsible for identification and correction of deficiencies regarding ground cover and cleaning of storm water BMPs. The project manager shall identify any BMPs that will be for the purpose of post construction storm water management with specific guidance for any non-routine maintenance.

KyTC BMP Plan for Project PCN ## -

F. Inspections

Inspection and maintenance practices that will be used to maintain erosion and sediment controls:

- All erosion prevention and sediment control measures will be inspected at least once each week and following any rain of one-half inch or more.
- Inspections will be conducted by individuals that have received KyTC Grade Level II training or other qualification as prescribed by the cabinet that includes instruction concerning sediment and erosion control.
- Inspection reports will be written, signed, dated, and kept on file.
- Areas at final grade will be seeded and mulched within 14 days.
- Areas that are not at final grade where construction has ceased for a period of 21 days or longer and soil stock piles shall receive temporary mulch no later than 14 days from the last construction activity in that area.
- All measures will be maintained in good working order; if a repair is necessary, it will be initiated within 24 hours of being reported.
- Built-up sediment will be removed from behind the silt fence before it has reached halfway up the height of the fence.
- Silt fences will be inspected for bypassing, overtopping, undercutting, depth of sediment, tears, and to ensure attachment to secure posts.
- Sediment basins will be inspected for depth of sediment, and built-up sediment will be removed when it reaches 70 percent of the design capacity and at the end of the job.
- Diversion dikes and berms will be inspected and any breaches promptly repaired. Areas that are eroding or scouring will be repaired and re-seeded / mulched as needed.
- Temporary and permanent seeding and mulching will be inspected for bare spots, washouts, and healthy growth. Bare or eroded areas will be repaired as needed.
- All material storage and equipment servicing areas that involve the management of bulk liquids, fuels, and bulk solids will be inspected weekly for conditions that represent a release or possible release of pollutants to the environment.

KyTC BMP Plan for Project PCN ## -

G. Non – Storm Water discharges

It is expected that non-storm water discharges may occur from the site during the construction period. Examples of non-storm water discharges include:

- Water from water line flushings.
- Water from cleaning concrete trucks and equipment.
- Pavement wash waters (where no spills or leaks of toxic or hazardous materials have occurred).
- Uncontaminated groundwater and rain water (from dewatering during excavation).

All non-storm water discharges will be directed to the sediment basin or to a filter fence enclosure in a flat vegetated infiltration area or be filtered via another approved commercial product.

H. Groundwater Protection Plan (3)

This plan serves as the groundwater protection plan as required by 401 KAR 5:037.

- Contractors statement: (3)

The following activities, as enumerated by 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan, will or may be may be conducted as part of this construction project:

_____ 2. (e) land treatment or land disposal of a pollutant;

_____ 2. (f) Storing, ..., or related handling of hazardous waste, solid waste or special waste, ..., in tanks, drums, or other containers, or in piles, (This does not include wastes managed in a container placed for collection and removal of municipal solid waste for disposal off site);

_____ 2. (g) Handling of materials in bulk quantities (equal or greater than 55 gallons or 100 pounds net dry weight transported held in an individual container) that, if released to the environment, would be a pollutant;

_____ 2. (j) Storing or related handling of road oils, dust suppressants,, at a central location;

_____ 2. (k) Application or related handling of road oils, dust suppressants or deicing materials, (does not include use of chloride-based deicing materials applied to roads or parking lots);

KyTC BMP Plan for Project PCN ## -

_____ 2. (m) Installation, construction, operation, or abandonment of wells, bore holes, or core holes, (this does not include bore holes for the purpose of explosive demolition);

Or, check the following only if there are no qualifying activities

_____ There are no activities for this project as listed in 401 KAR 5:037 Section 2 that require the preparation and implementation of a groundwater protection plan.

The contractor is responsible for the preparation of a plan that addresses the

401 KAR 5:037 Section 3. (3) Elements of site specific groundwater protection plan:

- (a) General information about this project is covered in the Project information;
- (b) Activities that require a groundwater protection plan have been identified above;
- (c) Practices that will protect groundwater from pollution are addressed in section C. Other control measures.
- (d) Implementation schedule – all practices required to prevent pollution of groundwater are to be in place prior to conducting the activity;
- (e) Training is required as a part of the ground water protection plan. All employees of the contractor, sub-contractor and resident engineer personnel will be trained to understand the nature and requirements of this plan as they pertain to their job function(s). Training will be accomplished within one week of employment and annually thereafter. A record of training will be maintained by the contractor with a copy provide to the resident engineer.
- (f) Areas of the project and groundwater plan activities will be inspected as part of the weekly sediment and erosion control inspections
- (g) Certification (see signature page.)

KyTC BMP Plan for Project PCN ## -

Contractor and Resident Engineer Plan certification

The contractor that is responsible for implementing this BMP plan is identified in the Project Information section of this plan.

The following certification applies to all parties that are signatory to this BMP plan:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. Further, this plan complies with the requirements of 401 KAR 5:037. By this certification, the undersigned state that the individuals signing the plan have reviewed the terms of the plan and will implement its provisions as they pertain to ground water protection.

Resident Engineer and Contractor Certification:

(2) Resident Engineer signature

Signed _____ title _____, _____ signature
 Typed or printed name²

(3) Signed _____ title _____, _____ signature
 Typed or printed name¹

1. Contractors Note: to be signed by a person who is the owner, a responsible corporate officer, a general partner or the proprietor or a person designated to have the authority to sign reports by such a person in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601. Reference the Project Control Number (PCN) and KPDES number when one has been issued.

2. KyTC note: to be signed by the Chief District Engineer or a person designated to have the authority to sign reports by such a person (usually the resident engineer) in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601 Reference the Project Control Number (PCN) and KPDES number when one has been issued.

KyTC BMP Plan for Project PCN ## - #####

Sub-Contractor Certification

The following sub-contractor shall be made aware of the BMP plan and responsible for implementation of BMPs identified in this plan as follows:

Subcontractor

Name:
Address:
Address:

Phone:

The part of BMP plan this subcontractor is responsible to implement is:

I certify under penalty of law that I understand the terms and conditions of the general Kentucky Pollutant Discharge Elimination System permit that authorizes the storm water discharges, the BMP plan that has been developed to manage the quality of water to be discharged as a result of storm events associated with the construction site activity and management of non-storm water pollutant sources identified as part of this certification.

Signed _____ title _____, _____
Typed or printed name¹ signature

1. Sub Contractor Note: to be signed by a person who is the owner, a responsible corporate officer, a general partner or the proprietor or a person designated to have the authority to sign reports by such a person in accordance with 401 KAR 5:060 Section 9. This delegation shall be in writing to: Manager, KPDES Branch, Division of Water, 14 Reilly Road, Frankfort Kentucky 40601. Reference the Project Control Number (PCN) and KPDES number when one has been issued.

PART II
SPECIFICATIONS AND STANDARD DRAWINGS

SPECIFICATIONS REFERENCE

Any reference in the plans or proposal to previous editions of the *Standard Specifications for Road and Bridge Construction* and *Standard Drawings* are superseded by *Standard Specifications for Road and Bridge Construction, Edition of 2012* and *Standard Drawings, Edition of 2016*.

SUPPLEMENTAL SPECIFICATIONS

The contractor shall use the Supplemental Specifications that are effective at the time of letting.
The Supplemental Specifications can be found at the following link:

<http://transportation.ky.gov/Construction/Pages/Kentucky-Standard-Specifications.aspx>

SPECIAL NOTE FOR PORTABLE CHANGEABLE MESSAGE SIGNS

This Special Note will apply when indicated on the plans or in the proposal.

1.0 DESCRIPTION. Furnish, install, operate, and maintain variable message signs at the locations shown on the plans or designated by the Engineer. Remove and retain possession of variable message signs when they are no longer needed on the project.

2.0 MATERIALS.

2.1 General. Use LED Variable Message Signs Class I, II, or III, as appropriate, from the Department's List of Approved Materials.

Unclassified signs may be submitted for approval by the Engineer. The Engineer may require a daytime and nighttime demonstration. The Engineer will make a final decision within 30 days after all required information is received.

2.2 Sign and Controls. All signs must:

- 1) Provide 3-line messages with each line being 8 characters long and at least 18 inches tall. Each character comprises 35 pixels.
- 2) Provide at least 40 preprogrammed messages available for use at any time. Provide for quick and easy change of the displayed message; editing of the message; and additions of new messages.
- 3) Provide a controller consisting of:
 - a) Keyboard or keypad.
 - b) Readout that mimics the actual sign display. (When LCD or LCD type readout is used, include backlighting and heating or otherwise arrange for viewing in cold temperatures.)
 - c) Non-volatile memory or suitable memory with battery backup for storing pre-programmed messages.
 - d) Logic circuitry to control the sequence of messages and flash rate.
- 4) Provide a serial interface that is capable of supporting complete remote control ability through land line and cellular telephone operation. Include communication software capable of immediately updating the message, providing complete sign status, and allowing message library queries and updates.
- 5) Allow a single person easily to raise the sign to a satisfactory height above the pavement during use, and lower the sign during travel.
- 6) Be Highway Orange on all exterior surfaces of the trailer, supports, and controller cabinet.
- 7) Provide operation in ambient temperatures from -30 to + 120 degrees Fahrenheit during snow, rain and other inclement weather.
- 8) Provide the driver board as part of a module. All modules are interchangeable, and have plug and socket arrangements for disconnection and reconnection. Printed circuit boards associated with driver boards have a conformable coating to protect against moisture.
- 9) Provide a sign case sealed against rain, snow, dust, insects, etc. The lens is UV stabilized clear plastic (polycarbonate, acrylic, or other approved material) angled to prevent glare.
- 10) Provide a flat black UV protected coating on the sign hardware, character PCB, and appropriate lens areas.
- 11) Provide a photocell control to provide automatic dimming.

- 12) Allow an on-off flashing sequence at an adjustable rate.
- 13) Provide a sight to aim the message.
- 14) Provide a LED display color of approximately 590 nm amber.
- 15) Provide a controller that is password protected.
- 16) Provide a security device that prevents unauthorized individuals from accessing the controller.
- 17) Provide the following 3-line messages preprogrammed and available for use when the sign unit begins operation:

/KEEP/RIGHT/=>=>=>/	/MIN/SPEED/**MPH/
/KEEP/LEFT/<=<=</	/ICY/BRIDGE/AHEAD/ /ONE
/LOOSE/GRAVEL/AHEAD/	LANE/BRIDGE/AHEAD/
/RD WORK/NEXT/**MILES/	/ROUGH/ROAD/AHEAD/
/TWO WAY/TRAFFIC/AHEAD/	/MERGING/TRAFFIC/AHEAD/
/PAINT/CREW/AHEAD/	/NEXT/***/MILES/
/REDUCE/SPEED/**MPH/	/HEAVY/TRAFFIC/AHEAD/
/BRIDGE/WORK/***0 FT/	/SPEED/LIMIT/**MPH/
/MAX/SPEED/**MPH/	/BUMP/AHEAD/
/SURVEY/PARTY/AHEAD/	/TWO/WAY/TRAFFIC/

*Insert numerals as directed by the Engineer.
Add other messages during the project when required by the Engineer.

2.3 Power.

- 1) Design solar panels to yield 10 percent or greater additional charge than sign consumption. Provide direct wiring for operation of the sign or arrow board from an external power source to provide energy backup for 21 days without sunlight and an on-board system charger with the ability to recharge completely discharged batteries in 24 hours.

3.0 CONSTRUCTION. Furnish and operate the variable message signs as designated on the plans or by the Engineer. Ensure the bottom of the message panel is a minimum of 7 feet above the roadway in urban areas and 5 feet above in rural areas when operating. Use Class I, II, or III signs on roads with a speed limit less than 55 mph. Use Class I or II signs on roads with speed limits 55 mph or greater.

Maintain the sign in proper working order, including repair of any damage done by others, until completion of the project. When the sign becomes inoperative, immediately repair or replace the sign. Repetitive problems with the same unit will be cause for rejection and replacement.

Use only project related messages and messages directed by the Engineer, unnecessary messages lessen the impact of the sign. Ensure the message is displayed in either one or 2 phases with each phase having no more than 3 lines of text. When no message is needed, but it is necessary to know if the sign is operable, flash only a pixel.

When the sign is not needed, move it outside the clear zone or where the Engineer directs. Variable Message Signs are the property of the Contractor and shall be removed from the project when no longer needed. The Department will not assume ownership of these signs.

4.0 MEASUREMENT. The final quantity of Variable Message Sign will be

11

the actual number of individual signs acceptably furnished and operated during the project. The Department will not measure signs replaced due to damage or rejection.

5.0 PAYMENT. The Department will pay for the Variable Message Signs at the unit price each. The Department will not pay for signs replaced due to damage or rejection. Payment is full compensation for furnishing all materials, labor, equipment, and service necessary to, operate, move, repair, and maintain or replace the variable message signs. The Department will make payment for the completed and accepted quantities under the following:

<u>Code</u>	<u>Pay Item</u>	<u>Pay Unit</u>
02671	Portable Changeable Message Sign	Each

Effective June 15, 2012

PART III

EMPLOYMENT, WAGE AND RECORD REQUIREMENTS

**TRANSPORTATION CABINET
DEPARTMENT OF HIGHWAYS**

**LABOR AND WAGE REQUIREMENTS
APPLICABLE TO OTHER THAN FEDERAL-AID SYSTEM PROJECTS**

- I. Application
- II. Nondiscrimination of Employees (KRS 344)

I. APPLICATION

1. These contract provisions shall apply to all work performed on the contract by the contractor with his own organization and with the assistance of workmen under his immediate superintendence and to all work performed on the contract by piecework, station work or by subcontract. The contractor's organization shall be construed to include only workmen employed and paid directly by the contractor and equipment owned or rented by him, with or without operators.

2. The contractor shall insert in each of his subcontracts all of the stipulations contained in these Required Provisions and such other stipulations as may be required.

3. A breach of any of the stipulations contained in these Required Provisions may be grounds for termination of the contract.

3. If the contractor is in control of apprenticeship or other training or retraining, including on-the-job training programs, he shall not discriminate against an individual because of his race, color, religion, national origin, sex, disability or age forty (40) and over, in admission to, or employment in any program established to provide apprenticeship or other training.

4. The contractor will send to each labor union or representative of workers with which he has a collective bargaining agreement or other contract or understanding, a notice to be provided advising the said labor union or workers' representative of the contractor's commitments under this section, and shall post copies of the notice in conspicuous places available to employees and applicants for employment. The contractor will take such action with respect to any subcontract or purchase order as the administrating agency may direct as a means of enforcing such provisions, including sanctions for non-compliance.

Revised: January 25, 2017

II. NONDISCRIMINATION OF EMPLOYEES

**AN ACT OF THE KENTUCKY
GENERAL ASSEMBLY TO PREVENT
DISCRIMINATION IN EMPLOYMENT
KRS CHAPTER 344
EFFECTIVE JUNE 16, 1972**

The contract on this project, in accordance with KRS Chapter 344, provides that during the performance of this contract, the contractor agrees as follows:

1. The contractor shall not fail or refuse to hire, or shall not discharge any individual, or otherwise discriminate against an individual with respect to his compensation, terms, conditions, or privileges of employment, because of such individual's race, color, religion, national origin, sex, disability or age (forty and above); or limit, segregate, or classify his employees in any way which would deprive or tend to deprive an individual of employment opportunities or otherwise adversely affect his status as an employee, because of such individual's race, color, religion, national origin, sex, disability or age forty (40) and over. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided setting forth the provisions of this nondiscrimination clause.

2. The contractor shall not print or publish or cause to be printed or published a notice or advertisement relating to employment by such an employer or membership in or any classification or referral for employment by the employment agency, indicating any preference, limitation, specification, or discrimination, based on race, color, religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, except that such a notice or advertisement may indicate a preference, limitation, or specification based on religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, when religion, national origin, sex, or age forty (40) and over, or because the person is a qualified individual with a disability, is a bona fide occupational qualification for employment.

EXECUTIVE BRANCH CODE OF ETHICS

In the 1992 regular legislative session, the General Assembly passed and Governor Brereton Jones signed Senate Bill 63 (codified as KRS 11A), the Executive Branch Code of Ethics, which states, in part:

KRS 11A.040 (7) provides:

No present or former public servant shall, within six (6) months following termination of his office or employment, accept employment, compensation, or other economic benefit from any person or business that contracts or does business with, or is regulated by, the state in matters in which he was directly involved during the last thirty-six (36) months of his tenure. This provision shall not prohibit an individual from returning to the same business, firm, occupation, or profession in which he was involved prior to taking office or beginning his term of employment, or for which he received, prior to his state employment, a professional degree or license, provided that, for a period of six (6) months, he personally refrains from working on any matter in which he was directly involved during the last thirty-six (36) months of his tenure in state government. This subsection shall not prohibit the performance of ministerial functions, including but not limited to filing tax returns, filing applications for permits or licenses, or filing incorporation papers, nor shall it prohibit the former officer or public servant from receiving public funds disbursed through entitlement programs.

KRS 11A.040 (9) states:

A former public servant shall not represent a person or business before a state agency in a matter in which the former public servant was directly involved during the last thirty-six (36) months of his tenure, for a period of one (1) year after the latter of:

- a) The date of leaving office or termination of employment; or
- b) The date the term of office expires to which the public servant was elected.

This law is intended to promote public confidence in the integrity of state government and to declare as public policy the idea that state employees should view their work as a public trust and not as a way to obtain private benefits.

If you have worked for the executive branch of state government within the past six months, you may be subject to the law's prohibitions. The law's applicability may be different if you hold elected office or are contemplating representation of another before a state agency.

Also, if you are affiliated with a firm which does business with the state and which employs former state executive-branch employees, you should be aware that the law may apply to them.

In case of doubt, the law permits you to request an advisory opinion from the Executive Branch Ethics Commission, 3 Fountain Place, Frankfort, Kentucky 40601; telephone (502) 564-7954.

Revised: January 27, 2017

Kentucky Equal Employment Opportunity Act of 1978

The requirements of the Kentucky Equal Employment Opportunity Act of 1978 (KRS 45.560-45.640) shall apply to this Contract. The apparent low Bidder will be required to submit EEO forms to the Division of Construction Procurement, which will then forward to the Finance and Administration Cabinet for review and approval. No award will become effective until all forms are submitted and EEO/CC has certified compliance. The required EEO forms are as follows:

- EEO-1: Employer Information Report
- Affidavit of Intent to Comply
- Employee Data Sheet
- Subcontractor Report

These forms are available on the Finance and Administration's web page under ***Vendor Information, Standard Attachments and General Terms*** at the following address:
<https://www.eProcurement.ky.gov>.

Bidders currently certified as being in compliance by the Finance and Administration Cabinet may submit a copy of their approval letter in lieu of the referenced EEO forms.

For questions or assistance please contact the Finance and Administration Cabinet by email at **finance.contractcompliance@ky.gov** or by phone at 502-564-2874.

EMPLOYEE RIGHTS UNDER THE FAIR LABOR STANDARDS ACT

THE UNITED STATES DEPARTMENT OF LABOR WAGE AND HOUR DIVISION

FEDERAL MINIMUM WAGE

\$7.25

 PER HOUR

BEGINNING JULY 24, 2009

OVERTIME PAY At least 1½ times your regular rate of pay for all hours worked over 40 in a workweek.

CHILD LABOR An employee must be at least **16** years old to work in most non-farm jobs and at least **18** to work in non-farm jobs declared hazardous by the Secretary of Labor.

Youths **14** and **15** years old may work outside school hours in various non-manufacturing, non-mining, non-hazardous jobs under the following conditions:

No more than

- **3** hours on a school day or **18** hours in a school week;
- **8** hours on a non-school day or **40** hours in a non-school week.

Also, work may not begin before **7 a.m.** or end after **7 p.m.**, except from June 1 through Labor Day, when evening hours are extended to **9 p.m.** Different rules apply in agricultural employment.

TIP CREDIT Employers of “tipped employees” must pay a cash wage of at least \$2.13 per hour if they claim a tip credit against their minimum wage obligation. If an employee’s tips combined with the employer’s cash wage of at least \$2.13 per hour do not equal the minimum hourly wage, the employer must make up the difference. Certain other conditions must also be met.

ENFORCEMENT The Department of Labor may recover back wages either administratively or through court action, for the employees that have been underpaid in violation of the law. Violations may result in civil or criminal action.

Employers may be assessed civil money penalties of up to \$1,100 for each willful or repeated violation of the minimum wage or overtime pay provisions of the law and up to \$11,000 for each employee who is the subject of a violation of the Act’s child labor provisions. In addition, a civil money penalty of up to \$50,000 may be assessed for each child labor violation that causes the death or serious injury of any minor employee, and such assessments may be doubled, up to \$100,000, when the violations are determined to be willful or repeated. The law also prohibits discriminating against or discharging workers who file a complaint or participate in any proceeding under the Act.

ADDITIONAL INFORMATION

- Certain occupations and establishments are exempt from the minimum wage and/or overtime pay provisions.
- Special provisions apply to workers in American Samoa and the Commonwealth of the Northern Mariana Islands.
- Some state laws provide greater employee protections; employers must comply with both.
- The law requires employers to display this poster where employees can readily see it.
- Employees under 20 years of age may be paid \$4.25 per hour during their first 90 consecutive calendar days of employment with an employer.
- Certain full-time students, student learners, apprentices, and workers with disabilities may be paid less than the minimum wage under special certificates issued by the Department of Labor.

For additional information:



1-866-4-USWAGE

(1-866-487-9243)

TTY: 1-877-889-5627



WWW.WAGEHOUR.DOL.GOV

PART IV
INSURANCE

INSURANCE

The Contractor shall procure and maintain the following insurance in addition to the insurance required by law:

- 1) Commercial General Liability-Occurrence form – not less than \$2,000,000 General aggregate, \$2,000,000 Products & Completed Aggregate, \$1,000,000 Personal & Advertising, \$1,000,000 each occurrence.
- 2) Automobile Liability- \$1,000,000 per accident
- 3) Employers Liability:
 - a) \$100,000 Each Accident Bodily Injury
 - b) \$500,000 Policy limit Bodily Injury by Disease
 - c) \$100,000 Each Employee Bodily Injury by Disease
- 4) The insurance required above must be evidenced by a Certificate of Insurance and this Certificate of Insurance must contain one of the following statements:
 - a) "policy contains no deductible clauses."
 - b) "policy contains _____ (amount) deductible property damage clause but company will pay claim and collect the deductible from the insured."
- 5) **KENTUCKY WORKMEN'S COMPENSATION INSURANCE.** The contractor shall furnish evidence of coverage of all his employees or give evidence of self-insurance by submitting a copy of a certificate issued by the Workmen's Compensation Board.

The cost of insurance is incidental to all contract items. All subcontractors must meet the same minimum insurance requirements.

PART V
BID ITEMS

PROPOSAL BID ITEMS

191014

Page 1 of 3

Report Date 2/21/19

Section: 0001 - PAVING

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0010	00003		CRUSHED STONE BASE	289.00	TON		\$	
0020	00005		GEOGRID REINFORCEMENT FOR SUBGRADE	1,380.00	SQYD		\$	
0030	00078		CRUSHED AGGREGATE SIZE NO 2	953.00	TON		\$	
0040	00190		LEVELING & WEDGING PG64-22	50.00	TON		\$	
0050	00212		CL2 ASPH BASE 1.00D PG64-22	1,381.00	TON		\$	
0060	00356		ASPHALT MATERIAL FOR TACK	1.00	TON		\$	
0070	02599		FABRIC-GEOTEXTILE TYPE IV	4,700.00	SQYD		\$	
0080	02677		ASPHALT PAVE MILLING & TEXTURING	413.00	TON		\$	
0090	24685EC		CL2 ASPH SURF 0.38A PG64-22	462.00	TON		\$	

Section: 0002 - ROADWAY

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0100	01002		PERFORATED PIPE-8 IN	687.00	LF		\$	
0110	01742		CORED HOLE DRAINAGE BOX CON-8 IN	5.00	EACH		\$	
0120	01810		STANDARD CURB AND GUTTER	853.00	LF		\$	
0130	02014		BARRICADE-TYPE III	5.00	EACH		\$	
0140	02091		REMOVE PAVEMENT	140.00	SQYD		\$	
0150	02200		ROADWAY EXCAVATION	495.00	CUYD		\$	
0160	02545		CLEARING AND GRUBBING 0.4 ACRES	1.00	LS		\$	
0170	02562		TEMPORARY SIGNS	147.00	SQFT		\$	
0180	02585		EDGE KEY	132.00	LF		\$	
0190	02600		FABRIC GEOTEXTILE TY IV FOR PIPE	479.00	SQYD	\$2.00	\$	\$958.00
0200	02650		MAINTAIN & CONTROL TRAFFIC	1.00	LS		\$	
0210	02671		PORTABLE CHANGEABLE MESSAGE SIGN	2.00	EACH		\$	
0220	02676		MOBILIZATION FOR MILL & TEXT	1.00	LS		\$	
0230	02720		SIDEWALK-4 IN CONCRETE	40.00	SQYD		\$	
0240	02726		STAKING	1.00	LS		\$	
0250	02775		ARROW PANEL	2.00	EACH		\$	
0260	05990		SODDING	1,710.00	SQYD		\$	
0270	06510		PAVE STRIPING-TEMP PAINT-4 IN	4,000.00	LF		\$	
0280	06514		PAVE STRIPING-PERM PAINT-4 IN	3,832.00	LF		\$	
0290	06540		PAVE STRIPING-THERMO-4 IN W	114.00	LF		\$	
0300	06565		PAVE MARKING-THERMO X-WALK-6 IN	105.00	LF		\$	
0310	06568		PAVE MARKING-THERMO STOP BAR-24IN	80.00	LF		\$	
0320	06569		PAVE MARKING-THERMO CROSS-HATCH	3,160.00	SQFT		\$	
0330	06574		PAVE MARKING-THERMO CURV ARROW	6.00	EACH		\$	
0340	20430ED		SAW CUT	1,031.00	LF		\$	
0350	21415ND		EROSION CONTROL	1.00	LS		\$	
0360	21476ED		SNOW FENCE	145.00	LF		\$	
0370	22664EN		WATER BLASTING EXISTING STRIPE	100.00	LF		\$	
0380	23158ES505		DETECTABLE WARNINGS	78.00	SQFT		\$	

PROPOSAL BID ITEMS

191014

Page 2 of 3

Report Date 2/21/19

Section: 0003 - DRAINAGE

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0390	00521		STORM SEWER PIPE-15 IN	423.00	LF		\$	
0400	00522		STORM SEWER PIPE-18 IN	430.00	LF		\$	
0410	01456		CURB BOX INLET TYPE A	4.00	EACH		\$	
0420	01480		CURB BOX INLET TYPE B	1.00	EACH		\$	
0430	01487		CURB BOX INLET TYPE F	1.00	EACH		\$	
0440	01496		DROP BOX INLET TYPE 3	3.00	EACH		\$	
0450	01756		MANHOLE TYPE A	1.00	EACH		\$	
0460	02600		FABRIC GEOTEXTILE TY IV FOR PIPE	1,121.00	SQYD		\$	
0470	20904ED		RECONSTRUCT CURB BOX INLET	1.00	EACH		\$	

Section: 0004 - SEWER

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0480	15094		S MANHOLE ADJUST TO GRADE	1.00	EACH		\$	

Section: 0005 - SIGNALIZATION

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0490	04792		CONDUIT-1 IN	20.00	LF		\$	
0500	04811		ELECTRICAL JUNCTION BOX TYPE B	2.00	EACH		\$	
0510	04820		TRENCHING AND BACKFILLING	170.00	LF		\$	
0520	04830		LOOP WIRE	900.00	LF		\$	
0530	04844		CABLE-NO. 14/5C	1,600.00	LF		\$	
0540	04850		CABLE-NO. 14/1 PAIR	750.00	LF		\$	
0550	04885		MESSENGER-10800 LB	450.00	LF		\$	
0560	04895		LOOP SAW SLOT AND FILL	400.00	LF		\$	
0570	04931		INSTALL CONTROLLER TYPE 170	1.00	EACH		\$	
0580	04932		INSTALL STEEL STRAIN POLE	4.00	EACH		\$	
0590	20093NS835		INSTALL PEDESTRIAN HEAD-LED	4.00	EACH		\$	
0600	20188NS835		INSTALL LED SIGNAL-3 SECTION	8.00	EACH		\$	
0610	20266ES835		INSTALL LED SIGNAL- 4 SECTION	1.00	EACH		\$	
0620	20390NS835		INSTALL COORDINATING UNIT	1.00	EACH		\$	
0630	21743NN		INSTALL PEDESTRIAN DETECTOR	4.00	EACH		\$	
0640	23157EN		TRAFFIC SIGNAL POLE BASE	20.00	CUYD		\$	
0650	23222EC		INSTALL SIGNAL PEDESTAL	1.00	EACH		\$	
0660	24900EC		PVC CONDUIT-1 1/4 IN-SCHEDULE 80	110.00	LF		\$	
0670	24901EC		PVC CONDUIT-2 IN-SCHEDULE 80	60.00	LF		\$	
0680	24955ED		REMOVE SIGNAL EQUIPMENT	1.00	EACH		\$	

Section: 0006 - WATERLINE

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0690	14029		W METER ADJUST	1.00	EACH		\$	

191014

PROPOSAL BID ITEMS

Page 3 of 3

Report Date 2/21/19

Section: 0007 - DEMOBILIZATION &/OR MOBILIZATION

LINE	BID CODE	ALT	DESCRIPTION	QUANTITY	UNIT	UNIT PRIC	FP	AMOUNT
0700	02569		DEMOBILIZATION	1.00	LS		\$	